

# SIEMENS

[www.nicsanat.com](http://www.nicsanat.com)

021-87700210

NIC SANAT

نیک صنعت



## MICROMASTER 440

Parameter List

Issue 07/05



User Documentation  
6SE6400-5BB00-0BP0

## Available Documentation for the MICROMASTER 440


### Getting Started Guide

Is for quick commissioning with SDP and BOP.




### Operating Instructions

Gives information about features of the MICROMASTER 440, Installation, Commissioning, Control modes, System Parameter structure, Troubleshooting, Specifications and available options of the MICROMASTER 440.

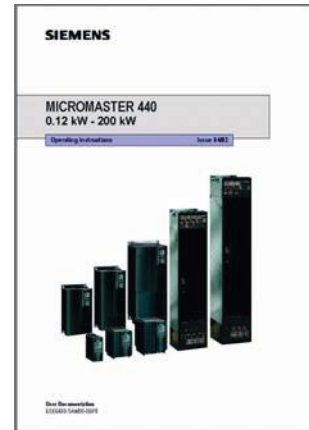

### Parameter List

The Parameter List contains the description of all Parameters structured in functional order and a detailed description. The Parameter list also includes a series of function plans.

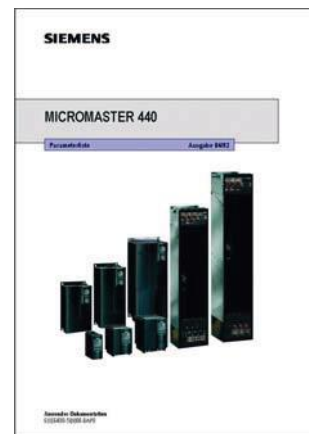

### Catalogues

In the catalogue you will find all needs to select a certain inverter, as well as filters chokes, operator panels or communications options.



# SIEMENS

## MICROMASTER 440

Parameter List  
User Documentation

[www.nicsanat.com](http://www.nicsanat.com)

021-87700210



Valid for

Issue 07/05

Converter Type  
MICROMASTER 440

Software Version  
V2.0

Issue 07/05

Block Diagram  
and Terminals

Parameter List

Function Diagrams

Faults and Alarms

Abbreviations



### Warning

Please refer to all Definitions and Warnings contained in the Operating Instructions. You will find the Operating Instructions on the Docu CD delivered with your inverter. If the CD is lost, it can be ordered via your local Siemens department under the Order No. 6SE6400-5AD00-1AP0.

Information about MICROMASTER 440 is also available from:

### Regional Contacts

Please get in touch with your contact for Technical Support in your Region for questions about services, prices and conditions of Technical Support.

### Central Technical Support

The competent consulting service for technical issues with a broad range of requirements-based services around our products and systems.

#### Europe / Africa

Tel: +49 (0) 180 5050 222

Fax: +49 (0) 180 5050 223

Email: [adsupport@siemens.com](mailto:adsupport@siemens.com)

#### America

Tel: +1 423 262 2522

Fax: +1 423 262 2589

Email: [simatic.hotline@sea.siemens.com](mailto:simatic.hotline@sea.siemens.com)

#### Asia / Pacific

Tel: +86 1064 757 575

Fax: +86 1064 747 474

Email: [adsupport.asia@siemens.com](mailto:adsupport.asia@siemens.com)

### Online Service & Support

The comprehensive, generally available information system over the Internet, from product support to service & support to the support tools in the shop.

<http://www.siemens.com/automation/service&support>

### Internet Address

Customers can access technical and general information under the following address:

<http://www.siemens.com/micromaster>

---

Printed in the Federal Republic of Germany

Approved Siemens Quality for Software and Training is to DIN ISO 9001, Reg. No. 2160-01

The reproduction, transmission or use of this document, or its contents is not permitted unless authorized in writing. Offenders will be liable for damages. All rights including rights created by patent grant or registration of a utility model or design are reserved.

© Siemens AG 2001 - 2005 All Rights Reserved.

MICROMASTER® is a registered trademark of Siemens

Siemens-Aktiengesellschaft.

Other functions not described in this document may be available. However, this fact shall not constitute an obligation to supply such functions with a new control, or when servicing.

We have checked that the contents of this document correspond to the hardware and software described. There may be discrepancies nevertheless, and no guarantee can be given that they are completely identical. The information contained in this document is reviewed regularly and any necessary changes will be included in the next edition. We welcome suggestions for improvement.

Siemens handbooks are printed on chlorine-free paper that has been produced from managed sustainable forests. No solvents have been used in the printing or binding process. Document subject to change without prior notice.

---

Printed in the Federal Republic of Germany

Siemens-Aktiengesellschaft.

# Parameters MICROMASTER 440

This Parameter List must only be used together with the Operating Instructions of the MICROMASTER 440. Please pay special attention to the Warnings, Cautions, Notices and Notes contained in these manuals.


## Table of Contents

1	Block Diagram and Terminals .....	7
1.1	Block Diagram .....	7
1.2	Power Terminals.....	8
1.3	Control Terminals .....	11
2	Parameters .....	12
2.1	Introduction to MICROMASTER System Parameters .....	12
2.2	Quick commissioning (P0010 = 1).....	15
2.3	Command and Drive Datasets - Overview .....	17
2.4	Binector Input Parameters.....	21
2.5	Connector Input Parameters .....	22
2.6	Binector Output Parameters .....	22
2.7	Connector Output Parameters.....	23
2.8	Connector/Binector Output Parameters .....	24
3	Parameter Description .....	25
3.1	Common parameters .....	25
3.2	Diagnosis parameters.....	29
3.3	Inverter parameters (HW).....	42
3.4	Motor parameters .....	49
3.5	Speed encoder .....	66
3.6	Application macros .....	68
3.7	Motor temperature .....	68
3.8	Command source .....	74
3.9	Digital inputs .....	76
3.10	Digital outputs .....	83
3.11	Analog inputs .....	85
3.12	Analog outputs.....	92
3.13	Parameter / command / drive data set .....	95
3.14	BICO command parameters.....	100
3.15	Communication parameters .....	103
3.16	Setpoint source.....	108
3.17	Fixed frequencies .....	111
3.18	Motorized potentiometer (MOP) .....	117
3.19	JOG.....	119
3.20	Setpoint channel.....	122

3.21	Ramp-function generator .....	128
3.22	Flying restart .....	133
3.23	Automatic restart.....	136
3.24	Motor holding brake .....	138
3.25	DC braking .....	140
3.26	Compound braking .....	143
3.27	Dynamic braking .....	144
3.28	Vdc controller .....	145
3.29	Control mode .....	150
3.29.1	V/f control technique .....	153
3.29.1.1	Slip compensation .....	159
3.29.1.2	Resonance damping .....	160
3.29.1.3	I <sub>max</sub> controller .....	161
3.29.1.4	Soft starting.....	162
3.29.2	Field-orientated vector control .....	163
3.29.2.1	Speed controller with/without encoder.....	164
3.29.2.2	Droop .....	166
3.29.2.3	Speed controller pre-control .....	168
3.29.2.4	Torque control.....	169
3.29.2.5	Supplementary torque setpoint.....	172
3.29.2.6	Torque / power limiting .....	173
3.29.2.7	Flux control .....	175
3.29.2.8	Current controller .....	178
3.29.2.9	Motor model .....	179
3.30	Inverter parameters (Modulator).....	184
3.31	Motor data identification.....	185
3.32	Speed optimization .....	188
3.33	Reference parameters .....	188
3.34	Communication parameters (USS, CB).....	191
3.35	Faults, Alarms, Monitoring .....	203
3.36	Load torque monitoring.....	214
3.37	Technology controller (PID controller).....	218
3.38	Positioning down ramp .....	234
3.39	Free function blocks (FFB) .....	236
3.40	Inverter parameters .....	252
4	Function Diagrams.....	255
5	Faults and Alarms.....	303
5.1	Fault messages .....	303
5.2	Alarm Messages .....	310
6	Abbreviations .....	315

# 1 Block Diagram and Terminals

## 1.1 Block Diagram

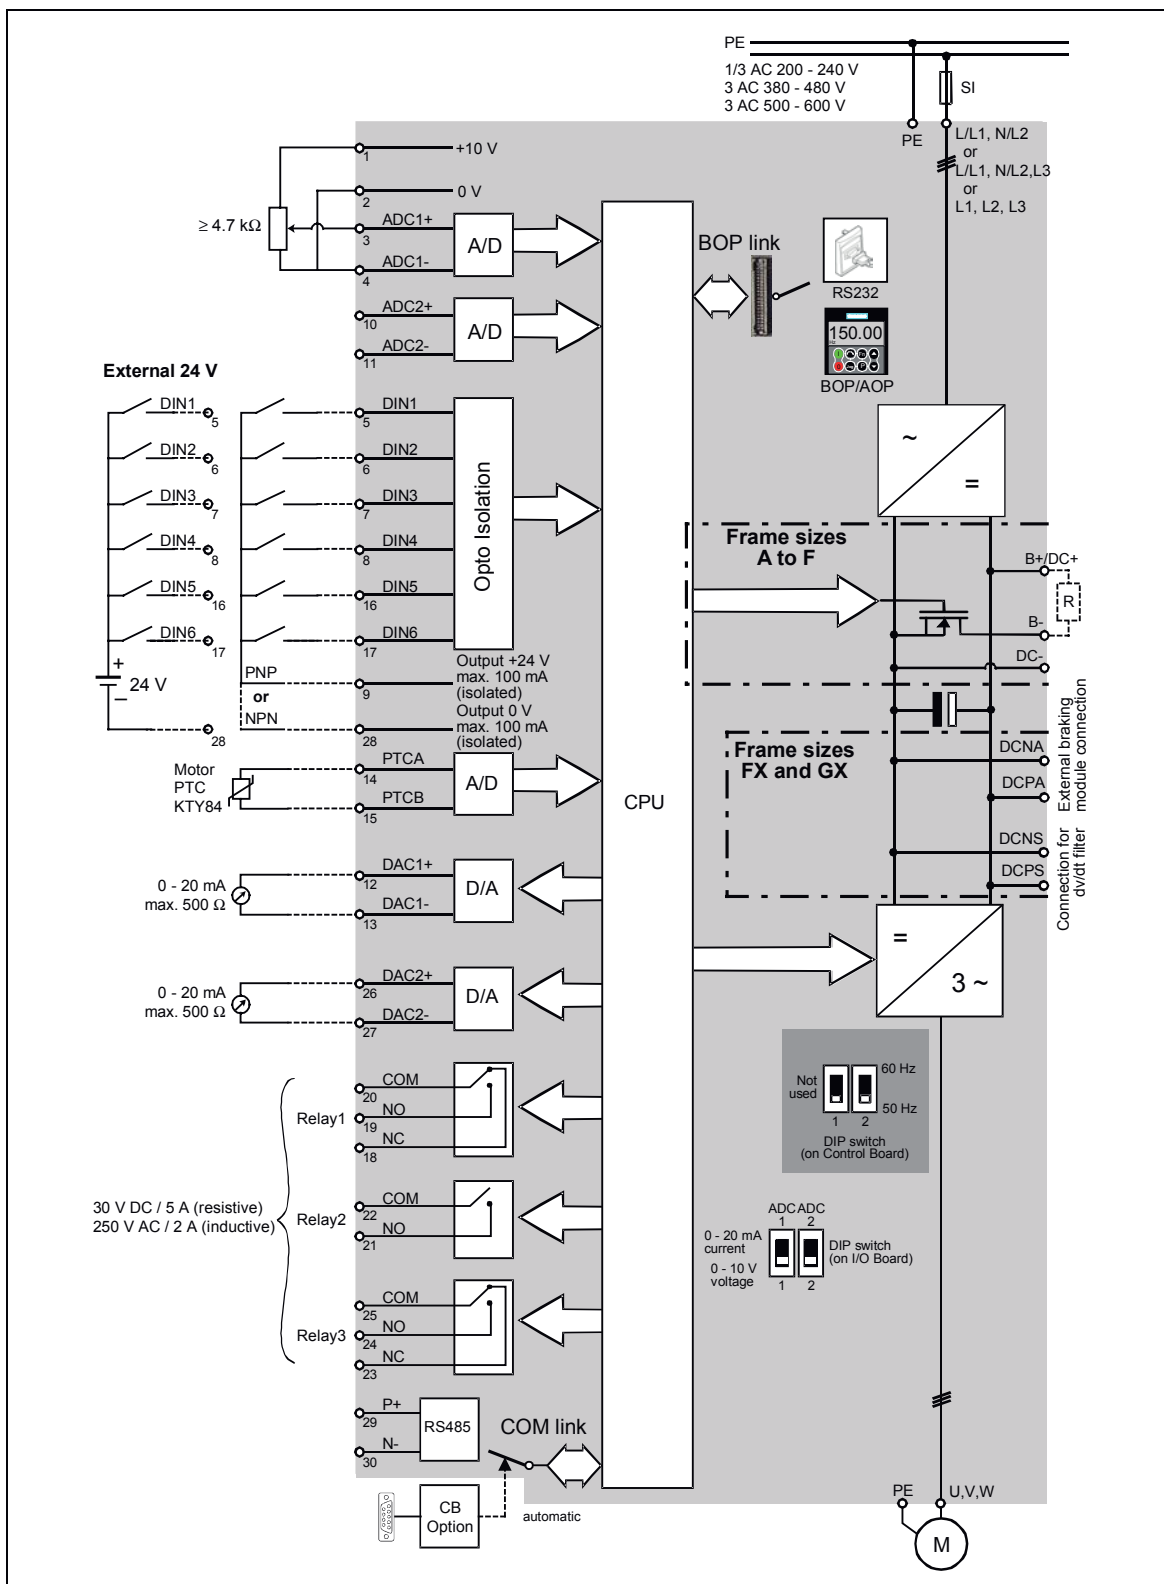

## 1.2 Power Terminals

You can gain access to the mains and motor terminals by removing the front covers.

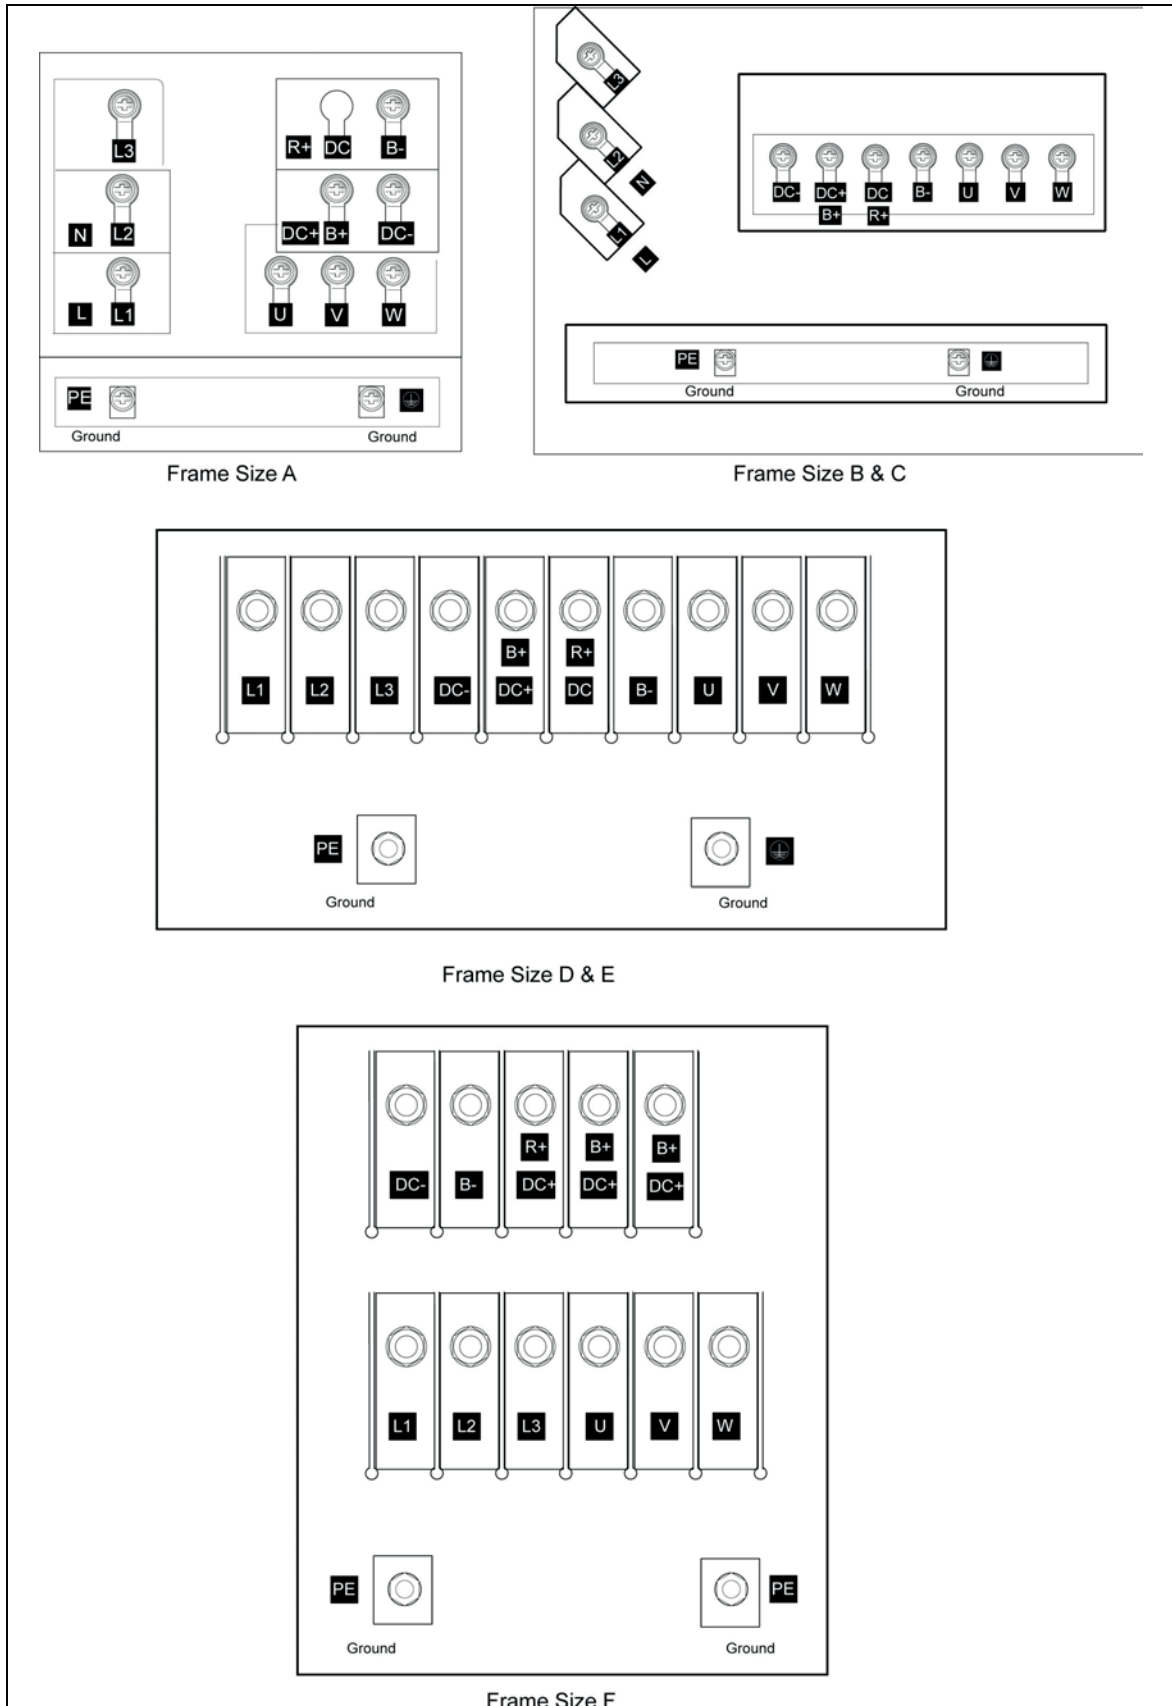


Fig. 1-1 Frame Size A - F



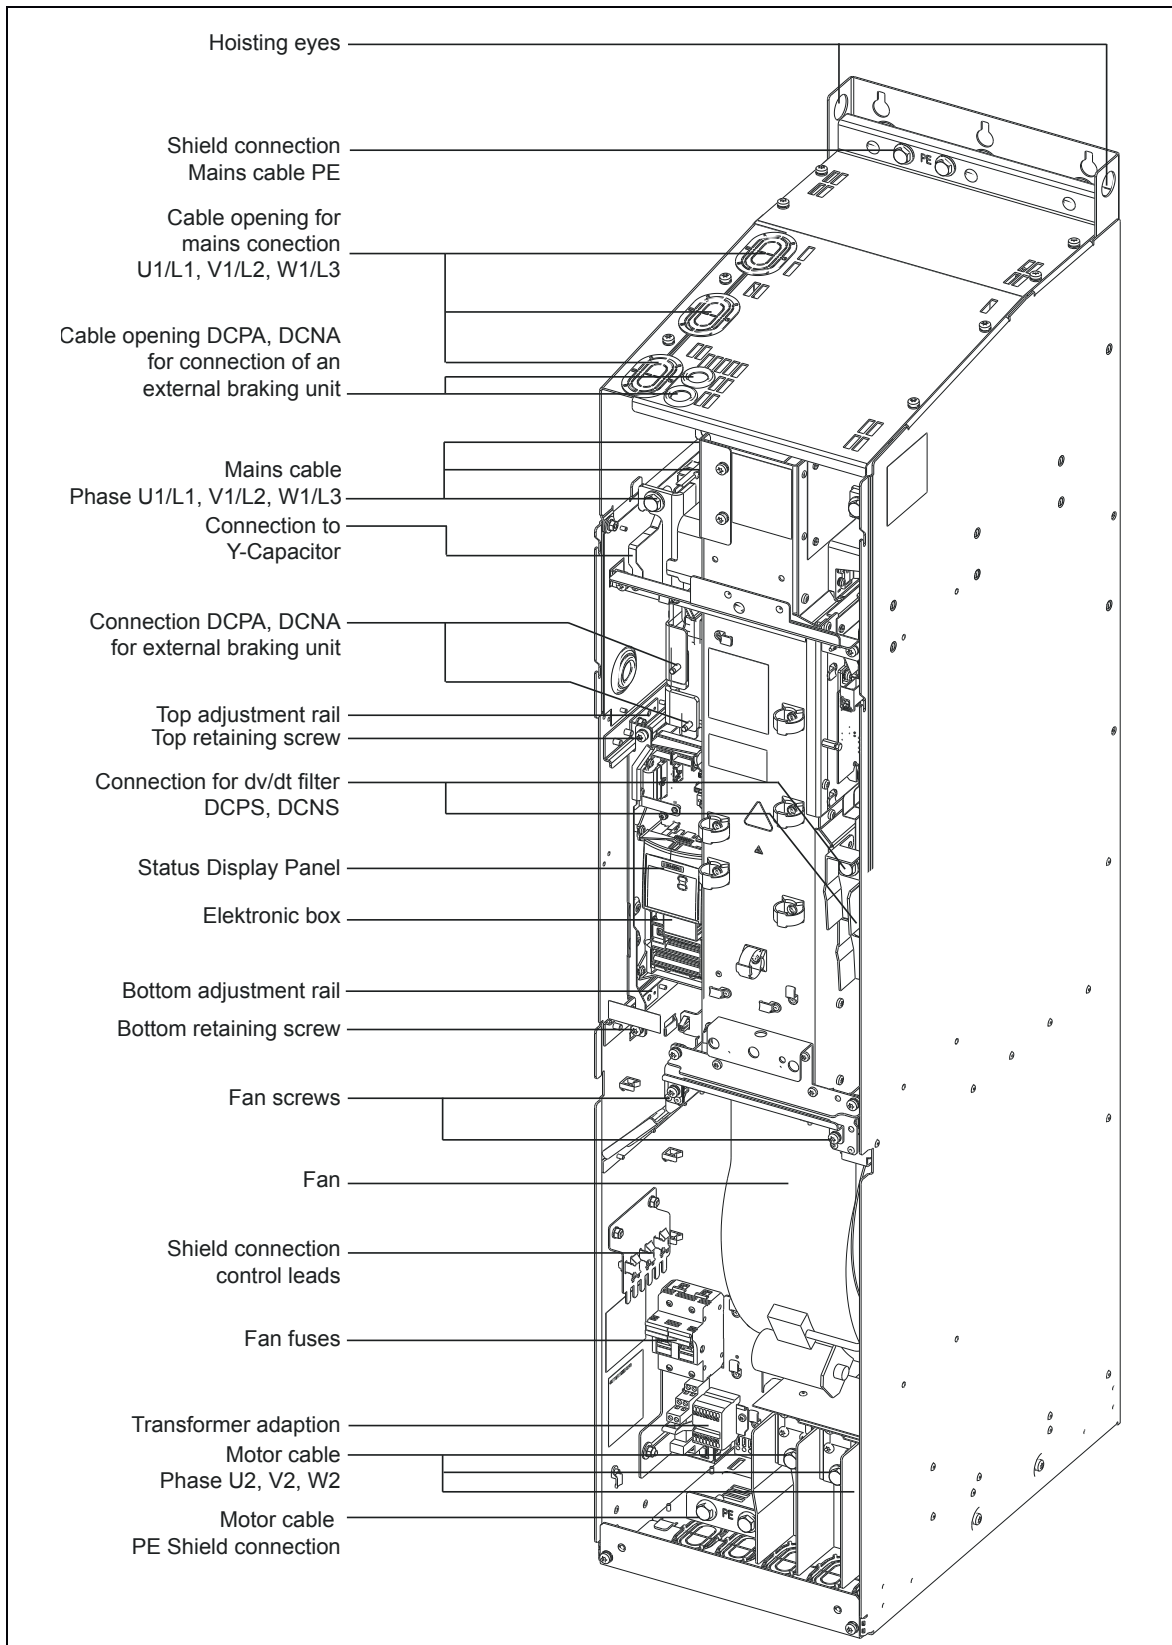


Fig. 1-3 Frame Size GX

## 1.3 Control Terminals

Terminal	Designation	Function
1	-	Output +10 V
2	-	Output 0 V
3	ADC1+	Analog input 1 (+)
4	ADC1-	Analog input 1 (-)
5	DIN1	Digital input 1
6	DIN2	Digital input 2
7	DIN3	Digital input 3
8	DIN4	Digital input 4
9	-	Isolated output +24 V / max. 100 mA
10	ADC2+	Analog input 2 (+)
11	ADC2-	Analog input 2 (-)
12	DAC1+	Analog output 1 (+)
13	DAC1-	Analog output 1 (-)
14	PTCA	Connection for PTC / KTY84
15	PTCB	Connection for PTC / KTY84
16	DIN5	Digital input 5
17	DIN6	Digital input 6
18	DOUT1/NC	Digital output 1 / NC contact
19	DOUT1/NO	Digital output 1 / NO contact
20	DOUT1/COM	Digital output 1 / Changeover contact
21	DOUT2/NO	Digital output 2 / NO contact
22	DOUT2/COM	Digital output 2 / Changeover contact
23	DOUT3/NC	Digital output 3 / NC contact
24	DOUT3/NO	Digital output 3 / NO contact
25	DOUT3/COM	Digital output 3 / Changeover contact
26	DAC2+	Analog output 2 (+)
27	DAC2-	Analog output 2 (-)
28	-	Isolated output 0 V / max. 100 mA
29	P+	RS485 port
30	P-	RS485 port

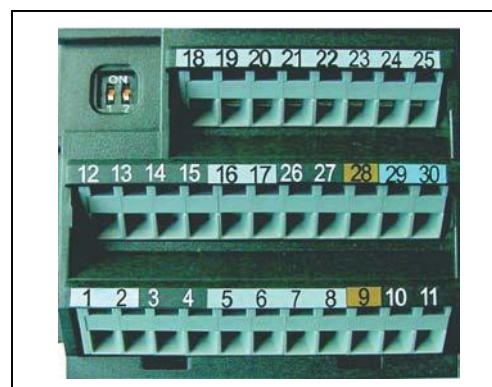


Fig. 1-4 Control terminals of MICROMASTER 440

## 2 Parameters

### 2.1 Introduction to MICROMASTER System Parameters

The layout of the parameter description is as follows.

1 Par number [index]	2 Parameter name	5 Datatype	7 Unit:	9 Min:	12 Level:
	3 CStat:	6 active:	8 Quick Comm:	10 Def:	2
	4 P-Group:			11 Max:	
13	Description:				

#### 1. Parameter number

Indicates the relevant parameter number. The numbers used are 4-digit numbers in the range 0000 to 9999. Numbers prefixed with an “r” indicate that the parameter is a “read-only” parameter, which displays a particular value but cannot be changed directly by specifying a different value via this parameter number (in such cases, dashes “-“ are entered at the points “Unit”, “Min”, “Def” and “Max” in the header of the parameter description.

All other parameters are prefixed with a “P”. The values of these parameters can be changed directly in the range indicated by the “Min” and “Max” settings in the header.


**[index]** indicates that the parameter is an indexed parameter and specifies the number of indices available.


#### 2. Parameter name


Indicates the name of the relevant parameter.


Certain parameter names include the following abbreviated prefixes: BI, BO, CI, and CO followed by a colon.


These abbreviations have the following meanings:

BI =  Binector input, i.e. parameter selects the source of a binary signal

BO =  Binector output, i.e. parameter connects as a binary signal

CI =  Connector input, i.e. parameter selects the source of an analog signal

CO =  Connector output, i.e. parameter connects as an analog signal

CO/BO =  Connector/Binector output, i.e. parameter connects as an analog signal and/or as a binary signal

To make use of BiCo you will need access to the full parameter list. At this level many new parameter settings are possible, including BiCo functionality. BiCo functionality is a different, more flexible way of setting and combining input and output functions. It can be used in most cases in conjunction with the simple, level 2 settings.

The BiCo system allows complex functions to be programmed. Boolean and mathematical relationships can be set up between inputs (digital, analog, serial etc.) and outputs (inverter current, frequency, analog output, relays, etc.).

### 3. CStat

Commissioning status of the parameter. Three states are possible:

Commissioning      C  
Run                      U  
Ready to run        T

This indicates when the parameter can be changed. One, two or all three states may be specified. If all three states are specified, this means that it is possible to change this parameter setting in all three inverter states

### 4. P-Group

Indicates the functional group of the particular.

#### Note

Parameter P0004 (parameter filter) acts as a filter and focuses access to parameters according to the functional group selected.

### 5. Datatype

The data types available are shown in the table below.

Notation	Meaning
U16	16-bit unsigned
U32	32-bit unsigned
I16	16-bit integer
I32	32-bit integer
Float	Floating point

### 6. Active

Indicates whether

- ◆ Immediately changes to the parameter values take effective immediately after they have been entered, or
- ◆ Confirm      the “P” button on the operator panel (BOP or AOP) must be pressed before the changes take effect.

### 7. Unit

Indicates the unit of measure applicable to the parameter values

### 8. QuickComm

Indicates whether or not (Yes or No) a parameter can only be changed during quick commissioning, i.e. when P0010 (parameter groups for commissioning) is set to 1 (quick commissioning).

### 9. Min

Indicates the minimum value to which the parameter can be set.

### 10. Def

Indicates the default value, i.e. the value which applies if the user does not specify a particular value for the parameter.

### 11. Max

Indicates the maximum value to which the parameter can be set.

### 12. Level

Indicates the level of user access. There are four access levels: Standard, Extended, Expert and Service. The number of parameters that appear in each functional group depends on the access level set in P0003 (user access level).

### 13. Description

The parameter description consists of the sections and contents listed below. Some of these sections and contents are optional and will be omitted on a case-to-case basis if not applicable.

<b>Description:</b>	Brief explanation of the parameter function.
<b>Diagram:</b>	Where applicable, diagram to illustrate the effects of parameters on a characteristic curve, for example
<b>Settings:</b>	List of applicable settings. These include Possible settings, Most common settings, Index and Bitfields
<b>Example:</b>	Optional example of the effects of a particular parameter setting.
<b>Dependency:</b>	Any conditions that must be satisfied in connection with this parameter. Also any particular effects, which this parameter has on other parameter(s) or which other parameters have on this one.
<b>Warning / Caution / Notice / Note:</b>	Important information which must be heeded to prevent personal injury or damage to equipment / specific information which should be heeded in order to avoid problems / information which may be helpful to the user
<b>More details:</b>	Any sources of more detailed information concerning the particular parameter.

## Operators

The following operators are used in the parameter list to represent mathematical interrelationships:

### Arithmetic operators

+	Addition
-	Subtraction
*	Multiplication
/	Division

### Comparison operators

>	Greater than
>=	Greater than / equal to
<	Less than
<=	Less than / equal to

### Equivalence operators

==	Equal to
!=	Not equal to

### Logical operators

&&	AND logic operation
	OR logic operation

## 2.2 Quick commissioning (P0010 = 1)

The following parameters are necessary for quick commissioning (P0010 = 1).

### Quick commissioning (P0010 = 1)

Par.-No.	Name	Access level	Cstat
P0100	Europe / North America	1	C
P0205	Inverter application	3	C
P0300	Select motor type	2	C
P0304	Motor voltage rating	1	C
P0305	Motor current rating	1	C
P0307	Motor power rating	1	C
P0308	Motor cosPhi rating	2	C
P0309	Motor efficiency rating	2	C
P0310	Motor frequency rating	1	C
P0311	Motor speed rating	1	C
P0320	Motor magnetizing current	3	CT
P0335	Motor cooling	2	CT
P0640	Motor overload factor [%]	2	CUT
P0700	Selection of command source	1	CT
P1000	Selection of frequency setpoint	1	CT
P1080	Min. speed	1	CUT
P1082	Max. speed	1	CT
P1120	Ramp-up time	1	CUT
P1121	Ramp-down time	1	CUT
P1135	OFF3 ramp-down time	2	CUT
P1300	Control mode	2	CT
P1500	Selection of torque setpoint	2	CT
P1910	Select motor data identification	2	CT
P1960	Speed control optimisation	3	CT
P3900	End of quick commissioning	1	C

When P0010 = 1 is chosen, P0003 (user access level) can be used to select the parameters to be accessed. This parameter also allows selection of a user-defined parameter list for quick commissioning.

At the end of the quick commissioning sequence, set P3900 = 1 to carry out the necessary motor calculations and clear all other parameters (not included in P0010 = 1) to their default settings.

#### Note

This applies only in Quick Commissioning mode.

### Reset to Factory default

To reset all parameters to the factory default settings; the following parameters should be set as follows:

Set P0010 = 30


Set P0970 = 1

#### Note

The reset process takes approximately 10 seconds to complete. Reset to Factory default

## Seven-segment display

The seven-segment display is structured as follows:

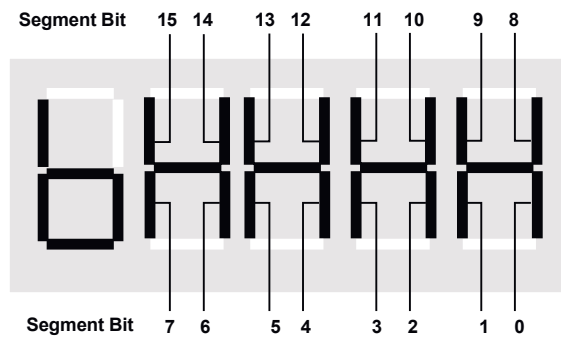

The significance of the relevant bits in the display is described in the status and control word parameters.

## 2.3 Command and Drive Datasets - Overview

### Command Datasets (CDS)

ParNo	Parameter text
P0700[3]	Selection of command source
P0701[3]	Function of digital input 1
P0702[3]	Function of digital input 2
P0703[3]	Function of digital input 3
P0704[3]	Function of digital input 4
P0705[3]	Function of digital input 5
P0706[3]	Function of digital input 6
P0707[3]	Function of digital input 7
P0708[3]	Function of digital input 8
P0719[3]	Selection of cmd. & freq. setp.
P0731[3]	BI: Function of digital output 1
P0732[3]	BI: Function of digital output 2
P0733[3]	BI: Function of digital output 3
P0800[3]	BI: Download parameter set 0
P0801[3]	BI: Download parameter set 1
P0840[3]	BI: ON/OFF1
P0842[3]	BI: ON reverse/OFF1
P0844[3]	BI: 1. OFF2
P0845[3]	BI: 2. OFF2
P0848[3]	BI: 1. OFF3
P0849[3]	BI: 2. OFF3
P0852[3]	BI: Pulse enable
P1000[3]	Selection of frequency setpoint
P1020[3]	BI: Fixed freq. selection Bit 0
P1021[3]	BI: Fixed freq. selection Bit 1
P1022[3]	BI: Fixed freq. selection Bit 2
P1023[3]	BI: Fixed freq. selection Bit 3
P1026[3]	BI: Fixed freq. selection Bit 4
P1028[3]	BI: Fixed freq. selection Bit 5
P1035[3]	BI: Enable MOP (UP-command)
P1036[3]	BI: Enable MOP (DOWN-command)
P1055[3]	BI: Enable JOG right
P1056[3]	BI: Enable JOG left
P1070[3]	CI: Main setpoint
P1071[3]	CI: Main setpoint scaling

ParNo	Parameter text
P1074[3]	BI: Disable additional setpoint
P1075[3]	CI: Additional setpoint
P1076[3]	CI: Additional setpoint scaling
P1110[3]	BI: Inhibit neg. freq. setpoint
P1113[3]	BI: Reverse
P1124[3]	BI: Enable JOG ramp times
P1140[3]	BI: RFG enable
P1141[3]	BI: RFG start
P1142[3]	BI: RFG enable setpoint
P1230[3]	BI: Enable DC braking
P1330[3]	CI: Voltage setpoint
P1477[3]	BI: Set integrator of n-ctrl.
P1478[3]	CI: Set integrator value n-ctrl.
P1500[3]	Selection of torque setpoint
P1501[3]	BI: Change to torque control
P1503[3]	CI: Torque setpoint
P1511[3]	CI: Additional torque setpoint
P1522[3]	CI: Upper torque limit
P1523[3]	CI: Lower torque limit
P2103[3]	BI: 1. Faults acknowledgement
P2104[3]	BI: 2. Faults acknowledgement
P2106[3]	BI: External fault
P2151[3]	CI: Monitoring freq. setpoint
P2152[3]	CI: Act. monitoring frequency
P2200[3]	BI: Enable PID controller
P2220[3]	BI: Fixed PID setp. select Bit 0
P2221[3]	BI: Fixed PID setp. select Bit 1
P2222[3]	BI: Fixed PID setp. select Bit 2
P2223[3]	BI: Fixed PID setp. select Bit 3
P2226[3]	BI: Fixed PID setp. select Bit 4
P2228[3]	BI: Fixed PID setp. select Bit 5
P2235[3]	BI: Enable PID-MOP (UP-cmd)
P2236[3]	BI: Enable PID-MOP (DOWN-cmd)
P2253[3]	CI: PID setpoint
P2254[3]	CI: PID trim source
P2264[3]	CI: PID feedback



### Drive Datasets (DDS)

ParNo	Parameter text
P0005[3]	Display selection
r0035[3]	CO: Act. motor temperature
P0291[3]	Inverter protection
P0300[3]	Select motor type
P0304[3]	Rated motor voltage
P0305[3]	Rated motor current
P0307[3]	Rated motor power
P0308[3]	Rated motor cosPhi
P0309[3]	Rated motor efficiency
P0310[3]	Rated motor frequency
P0311[3]	Rated motor speed
r0313[3]	Motor pole pairs
P0314[3]	Motor pole pair number
P0320[3]	Motor magnetizing current
r0330[3]	Rated motor slip
r0331[3]	Rated magnetization current
r0332[3]	Rated power factor
r0333[3]	Rated motor torque
P0335[3]	Motor cooling
P0340[3]	Calculation of motor parameters
P0341[3]	Motor inertia [kg*m^2]
P0342[3]	Total/motor inertia ratio
P0344[3]	Motor weight
r0345[3]	Motor start-up time
P0346[3]	Magnetization time
P0347[3]	Demagnetization time
P0350[3]	Stator resistance (line-to-line)
P0352[3]	Cable resistance
P0354[3]	Rotor resistance
P0356[3]	Stator leakage inductance
P0358[3]	Rotor leakage inductance
P0360[3]	Main inductance
P0362[3]	Magnetizing curve flux 1
P0363[3]	Magnetizing curve flux 2
P0364[3]	Magnetizing curve flux 3
P0365[3]	Magnetizing curve flux 4
P0366[3]	Magnetizing curve imag 1
P0367[3]	Magnetizing curve imag 2
P0368[3]	Magnetizing curve imag 3
P0369[3]	Magnetizing curve imag 4

ParNo	Parameter text
r0370[3]	Stator resistance [%]
r0372[3]	Cable resistance [%]
r0373[3]	Rated stator resistance [%]
r0374[3]	Rotor resistance [%]
r0376[3]	Rated rotor resistance [%]
r0377[3]	Total leakage reactance [%]
r0382[3]	Main reactance [%]
r0384[3]	Rotor time constant
r0386[3]	Total leakage time constant
P0400[3]	Select encoder type
P0408[3]	Encoder pulses per revolution
P0491[3]	Reaction on freq. signal loss
P0492[3]	Allowed frequency difference
P0494[3]	Delay frequency loss reaction
P0500[3]	Technological application
P0530[3]	Unit for positioning signal
P0531[3]	Unit conversion
P0601[3]	Motor temperature sensor
P0604[3]	Threshold motor temperature
P0625[3]	Ambient motor temperature
P0626[3]	Overtemperature stator iron
P0627[3]	Overtemperature stator winding
P0628[3]	Overtemperature rotor winding
r0630[3]	CO: Ambient temperature
r0631[3]	CO: Stator iron temperature
r0632[3]	CO: Stator winding temperature
r0633[3]	CO: Rotor winding temperature
P0640[3]	Motor overload factor [%]
P1001[3]	Fixed frequency 1
P1002[3]	Fixed frequency 2
P1003[3]	Fixed frequency 3
P1004[3]	Fixed frequency 4
P1005[3]	Fixed frequency 5
P1006[3]	Fixed frequency 6
P1007[3]	Fixed frequency 7
P1008[3]	Fixed frequency 8
P1009[3]	Fixed frequency 9
P1010[3]	Fixed frequency 10
P1011[3]	Fixed frequency 11
P1012[3]	Fixed frequency 12

ParNo	Parameter text
P1013[3]	Fixed frequency 13
P1014[3]	Fixed frequency 14
P1015[3]	Fixed frequency 15
P1031[3]	Setpoint memory of the MOP
P1040[3]	Setpoint of the MOP
P1058[3]	JOG frequency right
P1059[3]	JOG frequency left
P1060[3]	JOG ramp-up time
P1061[3]	JOG ramp-down time
P1080[3]	Min. frequency
P1082[3]	Max. frequency
P1091[3]	Skip frequency 1
P1092[3]	Skip frequency 2
P1093[3]	Skip frequency 3
P1094[3]	Skip frequency 4
P1101[3]	Skip frequency bandwidth
P1120[3]	Ramp-up time
P1121[3]	Ramp-down time
P1130[3]	Ramp-up initial rounding time
P1131[3]	Ramp-up final rounding time
P1132[3]	Ramp-down initial rounding time
P1133[3]	Ramp-down final rounding time
P1134[3]	Rounding type
P1135[3]	OFF3 ramp-down time
P1202[3]	Motor-current: Flying start
P1203[3]	Search rate: Flying start
P1232[3]	DC braking current
P1233[3]	Duration of DC braking
P1234[3]	DC braking start frequency
P1236[3]	Compound braking current
P1240[3]	Configuration of Vdc controller
P1243[3]	Dynamic factor of Vdc-max
P1245[3]	Switch on level kin. buffering
r1246[3]	CO:Switch-on level kin buffering
P1247[3]	Dyn. factor of kinetic buffering
P1250[3]	Gain of Vdc-controller
P1251[3]	Integration time Vdc-controller
P1252[3]	Differential time Vdc-controller
P1253[3]	Vdc-controller output limitation
P1256[3]	Reaction of kinetic buffering

ParNo	Parameter text
P1257[3]	Freq limit for kinetic buffering
P1300[3]	Control mode
P1310[3]	Continuous boost
P1311[3]	Acceleration boost
P1312[3]	Starting boost
P1316[3]	Boost end frequency
P1320[3]	Programmable V/f freq. coord. 1
P1321[3]	Programmable V/f volt. coord. 1
P1322[3]	Programmable V/f freq. coord. 2
P1323[3]	Programmable V/f volt. coord. 2
P1324[3]	Programmable V/f freq. coord. 3
P1325[3]	Programmable V/f volt. coord. 3
P1333[3]	Start frequency for FCC
P1335[3]	Slip compensation
P1336[3]	Slip limit
P1338[3]	Resonance damping gain V/f
P1340[3]	Imax freq. controller prop. gain
P1341[3]	Imax freq. ctrl. integral time
P1345[3]	Imax voltage ctrl. prop. gain
P1346[3]	Imax voltage ctrl. integral time
P1350[3]	Voltage soft start
P1400[3]	Configuration of speed control
P1442[3]	Filter time for act. speed
P1452[3]	Filter time for act. freq (SLVC)
P1460[3]	Gain speed controller
P1462[3]	Integral time speed controller
P1470[3]	Gain speed controller (SLVC)
P1472[3]	Integral time n-ctrl. (SLVC)
P1488[3]	Droop input source
P1489[3]	Droop scaling
P1492[3]	Enable droop
P1496[3]	Scaling accel. precontrol
P1499[3]	Scaling accel. torque control
P1520[3]	CO: Upper torque limit
P1521[3]	CO: Lower torque limit
P1525[3]	Scaling lower torque limit
P1530[3]	Motoring power limitation
P1531[3]	Regenerative power limitation
P1570[3]	CO: Fixed value flux setpoint
P1574[3]	Dynamic voltage headroom

ParNo	Parameter text
P1580[3]	Efficiency optimization
P1582[3]	Smooth time for flux setpoint
P1596[3]	Int. time field weak. controller
P1610[3]	Continuous torque boost (SLVC)
P1611[3]	Acc. torque boost (SLVC)
P1654[3]	Smooth time for Isq setpoint
P1715[3]	Gain current controller
P1717[3]	Integral time current controller
P1750[3]	Control word of motor model
P1755[3]	Start-freq. motor model (SLVC)
P1756[3]	Hyst.-freq. motor model (SLVC)
P1758[3]	Chng-ov. del. t SLVC op.-lp ctrl
P1759[3]	Chng-ov. del. t SLVC cl.-lp ctrl
P1764[3]	Kp of n-adaption (SLVC)
P1767[3]	Tn of n-adaption (SLVC)
P1780[3]	Control word of Rs/Rr-adaption
P1781[3]	Tn of Rs-adaption
P1786[3]	Tn of Xm-adaption
P1803[3]	Max. modulation
P1820[3]	Reverse output phase sequence
P1909[3]	Ctrl. word of motor data ident.
P2000[3]	Reference frequency
P2001[3]	Reference voltage
P2002[3]	Reference current
P2003[3]	Reference torque
r2004[3]	Reference power
P2150[3]	Hysteresis frequency f_hys
P2153[3]	Time-constant frequency filter
P2155[3]	Threshold frequency f_1
P2156[3]	Delay time of threshold freq f_1
P2157[3]	Threshold frequency f_2
P2158[3]	Delay time of threshold freq f_2
P2159[3]	Threshold frequency f_3
P2160[3]	Delay time of threshold freq f_3
P2161[3]	Min. threshold for freq. setp.
P2162[3]	Hysteresis freq. for overfreq.
P2163[3]	Entry freq. for perm. deviation
P2164[3]	Hysteresis frequency deviation
P2165[3]	Delay time permitted deviation
P2166[3]	Delay time ramp up completed

ParNo	Parameter text
P2167[3]	Switch-off frequency f_off
P2168[3]	Delay time T_off
P2170[3]	Threshold current I_thresh
P2171[3]	Delay time current
P2172[3]	Threshold DC-link voltage
P2173[3]	Delay time DC-link voltage
P2174[3]	Torque threshold M_thresh
P2176[3]	Delay time for torque threshold
P2177[3]	Delay time for motor is blocked
P2178[3]	Delay time for motor pulled out
P2181[3]	Belt failure detection mode
P2182[3]	Belt threshold frequency 1
P2183[3]	Belt threshold frequency 2
P2184[3]	Belt threshold frequency 3
P2185[3]	Upper torque threshold 1
P2186[3]	Lower torque threshold 1
P2187[3]	Upper torque threshold 2
P2188[3]	Lower torque threshold 2
P2189[3]	Upper torque threshold 3
P2190[3]	Lower torque threshold 3
P2192[3]	Time delay for belt failure
P2201[3]	Fixed PID setpoint 1
P2202[3]	Fixed PID setpoint 2
P2203[3]	Fixed PID setpoint 3
P2204[3]	Fixed PID setpoint 4
P2205[3]	Fixed PID setpoint 5
P2206[3]	Fixed PID setpoint 6
P2207[3]	Fixed PID setpoint 7
P2208[3]	Fixed PID setpoint 8
P2209[3]	Fixed PID setpoint 9
P2210[3]	Fixed PID setpoint 10
P2211[3]	Fixed PID setpoint 11
P2212[3]	Fixed PID setpoint 12
P2213[3]	Fixed PID setpoint 13
P2214[3]	Fixed PID setpoint 14
P2215[3]	Fixed PID setpoint 15
P2231[3]	Setpoint memory of PID-MOP
P2240[3]	Setpoint of PID-MOP
P2480[3]	Position mode
P2481[3]	Gearbox ratio input
P2482[3]	Gearbox ratio output
P2484[3]	No. of shaft turns = 1 Unit
P2487[3]	Positional error trim value
P2488[3]	Distance / No. of revolutions

## 2.4 Binector Input Parameters

ParNo	Parameter text
P0731[3]	BI: Function of digital output 1
P0732[3]	BI: Function of digital output 2
P0733[3]	BI: Function of digital output 3
P0800[3]	BI: Download parameter set 0
P0801[3]	BI: Download parameter set 1
P0810	BI: CDS bit 0 (Local / Remote)
P0811	BI: CDS bit 1
P0820	BI: DDS bit 0
P0821	BI: DDS bit 1
P0840[3]	BI: ON/OFF1
P0842[3]	BI: ON reverse/OFF1
P0844[3]	BI: 1. OFF2
P0845[3]	BI: 2. OFF2
P0848[3]	BI: 1. OFF3
P0849[3]	BI: 2. OFF3
P0852[3]	BI: Pulse enable
P1020[3]	BI: Fixed freq. selection Bit 0
P1021[3]	BI: Fixed freq. selection Bit 1
P1022[3]	BI: Fixed freq. selection Bit 2
P1023[3]	BI: Fixed freq. selection Bit 3
P1026[3]	BI: Fixed freq. selection Bit 4
P1028[3]	BI: Fixed freq. selection Bit 5
P1035[3]	BI: Enable MOP (UP-command)
P1036[3]	BI: Enable MOP (DOWN-command)
P1055[3]	BI: Enable JOG right
P1056[3]	BI: Enable JOG left
P1074[3]	BI: Disable additional setpoint
P1110[3]	BI: Inhibit neg. freq. setpoint
P1113[3]	BI: Reverse
P1124[3]	BI: Enable JOG ramp times
P1140[3]	BI: RFG enable
P1141[3]	BI: RFG start
P1142[3]	BI: RFG enable setpoint
P1230[3]	BI: Enable DC braking
P1477[3]	BI: Set integrator of n-ctrl.

ParNo	Parameter text
P1501[3]	BI: Change to torque control
P2103[3]	BI: 1. Faults acknowledgement
P2104[3]	BI: 2. Faults acknowledgement
P2106[3]	BI: External fault
P2200[3]	BI: Enable PID controller
P2220[3]	BI: Fixed PID setp. select Bit 0
P2221[3]	BI: Fixed PID setp. select Bit 1
P2222[3]	BI: Fixed PID setp. select Bit 2
P2223[3]	BI: Fixed PID setp. select Bit 3
P2226[3]	BI: Fixed PID setp. select Bit 4
P2228[3]	BI: Fixed PID setp. select Bit 5
P2235[3]	BI: Enable PID-MOP (UP-cmd)
P2236[3]	BI: Enable PID-MOP (DOWN-cmd)
P2810[2]	BI: AND 1
P2812[2]	BI: AND 2
P2814[2]	BI: AND 3
P2816[2]	BI: OR 1
P2818[2]	BI: OR 2
P2820[2]	BI: OR 3
P2822[2]	BI: XOR 1
P2824[2]	BI: XOR 2
P2826[2]	BI: XOR 3
P2828	BI: NOT 1
P2830	BI: NOT 2
P2832	BI: NOT 3
P2834[4]	BI: D-FF 1
P2837[4]	BI: D-FF 2
P2840[2]	BI: RS-FF 1
P2843[2]	BI: RS-FF 2
P2846[2]	BI: RS-FF 3
P2849	BI: Timer 1
P2854	BI: Timer 2
P2859	BI: Timer 3
P2864	BI: Timer 4

## 2.5 Connector Input Parameters

ParNo	Parameter text
P0095[10]	CI: Display PZD signals
P0771[2]	CI: DAC
P1070[3]	CI: Main setpoint
P1071[3]	CI: Main setpoint scaling
P1075[3]	CI: Additional setpoint
P1076[3]	CI: Additional setpoint scaling
P1330[3]	CI: Voltage setpoint
P1478[3]	CI: Set integrator value n-ctrl.
P1503[3]	CI: Torque setpoint
P1511[3]	CI: Additional torque setpoint
P1522[3]	CI: Upper torque limit
P1523[3]	CI: Lower torque limit
P2016[8]	CI: PZD to BOP link (USS)
P2019[8]	CI: PZD to COM link (USS)
P2051[8]	CI: PZD to CB

ParNo	Parameter text
P2253[3]	CI: PID setpoint
P2254[3]	CI: PID trim source
P2264[3]	CI: PID feedback
P2869[2]	CI: ADD 1
P2871[2]	CI: ADD 2
P2873[2]	CI: SUB 1
P2875[2]	CI: SUB 2
P2877[2]	CI: MUL 1
P2879[2]	CI: MUL 2
P2881[2]	CI: DIV 1
P2883[2]	CI: DIV 2
P2885[2]	CI: CMP 1
P2887[2]	CI: CMP 2

## 2.6 Binector Output Parameters

ParNo	Parameter text
r0751	BO: Status word of ADC
r2032	BO: CtrlWrd1 from BOP link (USS)
r2033	BO: CtrlWrd2 from BOP link (USS)
r2036	BO: CtrlWrd1 from COM link (USS)
r2037	BO: CtrlWrd2 from COM link (USS)
r2090	BO: Control word 1 from CB
r2091	BO: Control word 2 from CB
r2811	BO: AND 1
r2813	BO: AND 2
r2815	BO: AND 3
r2817	BO: OR 1
r2819	BO: OR 2
r2821	BO: OR 3
r2823	BO: XOR 1
r2825	BO: XOR 2
r2827	BO: XOR 3
r2829	BO: NOT 1
r2831	BO: NOT 2
r2833	BO: NOT 3
r2835	BO: Q D-FF 1

ParNo	Parameter text
r2836	BO: NOT-Q D-FF 1
r2838	BO: Q D-FF 2
r2839	BO: NOT-Q D-FF 2
r2841	BO: Q RS-FF 1
r2842	BO: NOT-Q RS-FF 1
r2844	BO: Q RS-FF 2
r2845	BO: NOT-Q RS-FF 2
r2847	BO: Q RS-FF 3
r2848	BO: NOT-Q RS-FF 3
r2852	BO: Timer 1
r2853	BO: Nout timer 1
r2857	BO: Timer 2
r2858	BO: Nout timer 2
r2862	BO: Timer 3
r2863	BO: Nout timer 3
r2867	BO: Timer 4
r2868	BO: Nout timer 4
r2886	BO: CMP 1
r2888	BO: CMP 2

## 2.7 Connector Output Parameters

ParNo	Parameter text
r0020	CO: Freq. setpoint before RFG
r0021	CO: Act. filtered frequency
r0024	CO: Act. filtered output freq.
r0025	CO: Act. filtered output voltage
r0026	CO: Act. filtered DC-link volt.
r0027	CO: Act. filtered output current
r0029	CO: Flux gen. current
r0030	CO: Torque gen. current
r0031	CO: Act. filtered torque
r0032	CO: Act. filtered power
r0035[3]	CO: Act. motor temperature
r0036	CO: Inverter overload utilization
r0037[5]	CO: Inverter temperature [°C]
r0038	CO: Act. power factor
r0039	CO: Energy consumpt. meter [kWh]
r0050	CO: Active command data set
r0051[2]	CO: Active drive data set (DDS)
r0061	CO: Act. encoder frequency
r0062	CO: Freq. setpoint
r0063	CO: Act. frequency
r0064	CO: Dev. frequency controller
r0065	CO: Slip frequency
r0066	CO: Act. output frequency
r0067	CO: Act. output current limit
r0068	CO: Output current
r0069[6]	CO: Act. phase currents
r0070	CO: Act. DC-link voltage
r0071	CO: Max. output voltage
r0072	CO: Act. output voltage
r0074	CO: Act. modulation
r0075	CO: Current setpoint Isd
r0076	CO: Act. current Isd
r0077	CO: Current setpoint Isq
r0078	CO: Act. current Isq
r0079	CO: Torque setpoint (total)
r0080	CO: Act. torque
r0084	CO: Act. air gap flux
r0086	CO: Act. active current
r0090	CO: Act. rotor angle
r0394	CO: Stator resistance IGBT [%]

ParNo	Parameter text
r0395	CO: Total stator resistance [%]
r0396	CO: Act. rotor resistance
r0630[3]	CO: Ambient temperature
r0631[3]	CO: Stator iron temperature
r0632[3]	CO: Stator winding temperature
r0633[3]	CO: Rotor winding temperature
r0755[2]	CO: Act. ADC after scal. [4000h]
r1024	CO: Act. fixed frequency
r1050	CO: Act. Output freq. of the MOP
r1078	CO: Total frequency setpoint
r1079	CO: Selected frequency setpoint
r1114	CO: Freq. setp. after dir. ctrl.
r1119	CO: Freq. setpoint before RFG
r1170	CO: Frequency setpoint after RFG
r1242	CO: Switch-on level of Vdc-max
r1246[3]	CO: Switch-on level kin buffering
r1315	CO: Total boost voltage
r1337	CO: V/f slip frequency
r1343	CO: I <sub>max</sub> controller freq. output
r1344	CO: I <sub>max</sub> controller volt. output
r1438	CO: Freq. setpoint to controller
r1445	CO: Act. filtered frequency
r1482	CO: Integral output of n-ctrl.
r1490	CO: Droop frequency
r1508	CO: Torque setpoint
r1515	CO: Additional torque setpoint
r1518	CO: Acceleration torque
P1520[3]	CO: Upper torque limit
P1521[3]	CO: Lower torque limit
r1526	CO: Upper torque limitation
r1527	CO: Lower torque limitation
r1536	CO: Max. trq. motoring current
r1537	CO: Max trq regenerative current
r1538	CO: Upper torque limit (total)
r1539	CO: Lower torque limit (total)
P1570[3]	CO: Fixed value flux setpoint
r1583	CO: Flux setpoint (smoothed)
r1597	CO: Outp. field weak. controller
r1598	CO: Flux setpoint (total)
r1718	CO: Output of Isq controller

ParNo	Parameter text
r1719	CO: Integral output of Isq ctrl.
r1723	CO: Output of Isd controller
r1724	CO: Integral output of Isd ctrl.
r1725	CO: Integral limit of Isd ctrl.
r1728	CO: Decoupling voltage
r1770	CO: Prop. output of n-adaption
r1771	CO: Int. output of n-adaption
r1778	CO: Flux angle difference
r1801	CO: Act. pulse frequency
r2015[8]	CO: PZD from BOP link (USS)
r2018[8]	CO: PZD from COM link (USS)
r2050[8]	CO: PZD from CB
r2169	CO: Act. filtered frequency
r2224	CO: Act. fixed PID setpoint
r2250	CO: Output setpoint of PID-MOP

ParNo	Parameter text
r2260	CO: PID setpoint after PID-RFG
r2262	CO: Filtered PID setp. after RFG
r2266	CO: PID filtered feedback
r2272	CO: PID scaled feedback
r2273	CO: PID error
r2294	CO: Act. PID output
r2870	CO: ADD 1
r2872	CO: ADD 2
r2874	CO: SUB 1
r2876	CO: SUB 2
r2878	CO: MUL 1
r2880	CO: MUL 2
r2882	CO: DIV 1
r2884	CO: DIV 2
P2889	CO: Fixed setpoint 1 in [%]
P2890	CO: Fixed setpoint 2 in [%]

## 2.8 Connector/Binector Output Parameters

ParNo	Parameter text
r0019	CO/BO: BOP control word
r0052	CO/BO: Act. status word 1
r0053	CO/BO: Act. status word 2
r0054	CO/BO: Act. control word 1
r0055	CO/BO: Act. control word 2

ParNo	Parameter text
r0056	CO/BO: Status of motor control
r0403	CO/BO: Encoder status word
r0722	CO/BO: Binary input values
r0747	CO/BO: State of digital outputs
r1407	CO/BO: Status 2 of motor control
r2197	CO/BO: Monitoring word 1
r2198	CO/BO: Monitoring word 2



### 3 Parameter Description

**Note**

Level 4 Parameters are not visible with BOP or AOP.

#### 3.1 Common parameters

<b>r0000</b>	<b>Drive display</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level 1</b>
	<b>P-Group:</b> ALWAYS			<b>Def:</b> -	
				<b>Max:</b> -	

Displays the user selected output as defined in P0005.

**Note:**

Pressing the "Fn" button for 2 seconds allows the user to view the values of DC link voltage, output frequency, output voltage, output current, and chosen r0000 setting (defined in P0005).

<b>r0002</b>	<b>Drive state</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level 2</b>
	<b>P-Group:</b> COMMANDS			<b>Def:</b> -	
				<b>Max:</b> -	

Displays actual drive state.

**Possible Settings:**

- 0 Commissioning mode (P0010 != 0)
- 1 Drive ready
- 2 Drive fault active
- 3 Drive starting (DC-link precharging)
- 4 Drive running
- 5 Stopping (ramping down)

**Dependency:**

State 3 visible only while precharging DC link, and when externally powered communications board is fitted.

<b>P0003</b>	<b>User access level</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	<b>Level 1</b>
	<b>CStat:</b> CUT			<b>Def:</b> 1	
	<b>P-Group:</b> ALWAYS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4	

Defines user access level to parameter sets. The default setting (standard) is sufficient for most simple applications.

**Possible Settings:**

- 0 User defined parameter list - see P0013 for details on use
- 1 Standard: Allows access into most frequently used parameters.
- 2 Extended: Allows extended access e.g. to inverter I/O functions.
- 3 Expert: For expert use only.
- 4 Service: Only for use by authorized service personal - password protected.

<b>P0004</b>	<b>Parameter filter</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	<b>Level 1</b>
	<b>CStat:</b> CUT			<b>Def:</b> 0	
	<b>P-Group:</b> ALWAYS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 22	

Filters available parameters according to functionality to enable a more focussed approach to commissioning.

**Possible Settings:**

- 0 All parameters
- 2 Inverter
- 3 Motor
- 4 Speed sensor
- 5 Technol. application / units
- 7 Commands, binary I/O
- 8 ADC and DAC
- 10 Setpoint channel / RFG
- 12 Drive features
- 13 Motor control
- 20 Communication
- 21 Alarms / warnings / monitoring
- 22 Technology controller (e.g. PID)

**Example:**

P0004 = 22 specifies that only PID parameters will be visible.



**Dependency:**

The parameters are sub-divided into groups (P-Group) according to their functionality. This increases the transparency and allows a parameter to be quickly searched for. Furthermore, parameter P0004 can be used to control the ability to be visualized for the operator panel.

Value	P-Group	Group	Parameter area
0	ALWAYS	All parameters	
2	INVERTER	Drive inverter parameters	0200 .... 0299
3	MOTOR	Motor parameters	0300 ... 0399 + 0600 .... 0699
4	ENCODER	Speed encoder	0400 .... 0499
5	TECH_APL	Technical applications / units	0500 .... 0599
7	COMMANDS	Control commands, digital I/O	0700 .... 0749 + 0800 ... 0899
8	TERMINAL	Analog inputs/outputs	0750 .... 0799
10	SETPOINT	Setpoint channel and ramp-function gen.	1000 .... 1199
12	FUNC	Drive inverter functions	1200 .... 1299
13	CONTROL	Motor open-loop/closed-loop control	1300 .... 1799
20	COMM	Communications	2000 .... 2099
21	ALARMS	Faults, warnings, monitoring functions	2100 .... 2199
22	TECH	Technological controller (PID controller)	2200 .... 2399

Parameters marked "Quick Comm: Yes" in the parameter header can only be set when P0010 = 1 (Quick Commissioning).

<b>P0005[3]</b>	<b>Display selection</b>	<b>Min:</b> 2	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Selects display for parameter r0000 (drive display).

**Index:**

- P0005[0] : 1st. Drive data set (DDS)
- P0005[1] : 2nd. Drive data set (DDS)
- P0005[2] : 3rd. Drive data set (DDS)

**Common Settings:**

- 21 Actual frequency
- 25 Output voltage
- 26 DC link voltage
- 27 Output current

**Notice:**

These settings refer to read only parameter numbers ("rxxxx").

**Details:**

See relevant "rxxxx" parameter descriptions.

<b>P0006</b>	<b>Display mode</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Defines mode of display for r0000 (drive display).

**Possible Settings:**

- 0 In Ready state alternate between setpoint and output frequency. In run display output frequency
- 1 In Ready state display setpoint. In run display output frequency.
- 2 In Ready state alternate between P0005 value and r0020 value. In run display P0005 value
- 3 In Ready state alternate between r0002 value and r0020 value. In run display r0002 value
- 4 In all states just display P0005

**Note:**

- When inverter is not running, the display alternates between the values for "Not Running" and "Running".
- Per default, the setpoint and actual frequency values are displayed alternately.

<b>P0007</b>	<b>Backlight delay time</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Defines time period after which the backlight display turns off if no operator keys have been pressed.

**Value:**

- P0007 = 0:  
Backlight always on (default state).
- P0007 = 1 - 2000:  
Number of seconds after which the backlight will turn off.

<b>P0010</b>	<b>Commissioning parameter</b>				Min: 0	Level <b>1</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> ALWAYS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 30		

Filters parameters so that only those related to a particular functional group are selected.

**Possible Settings:**

- 0 Ready
- 1 Quick commissioning
- 2 Inverter
- 29 Download
- 30 Factory setting

**Dependency:**

- Reset to 0 for inverter to run.
- P0003 (user access level) also determines access to parameters.

**Note:**

P0010 = 1

The inverter can be commissioned very quickly and easily by setting P0010 = 1. After that only the important parameters (e.g.: P0304, P0305, etc.) are visible. The value of these parameters must be entered one after the other. The end of quick commissioning and the start of internal calculation will be done by setting P3900 = 1 - 3. Afterward parameter P0010 and P3900 will be reset to zero automatically.

P0010 = 2

For service purposes only.

P0010 = 29

To transfer a parameter file via PC tool (e.g.: DriveMonitor, STARTER) parameter P0010 will be set to 29 by the PC tool. When download has been finished PC tool resets parameter P0010 to zero.

P0010 = 30

When resetting the parameters of inverter P0010 must be set to 30. Resetting of the parameters will be started by setting parameter P0970 = 1. The inverter will automatically reset all its parameters to their default settings. This can prove beneficial if you experience problems during parameter setup and wish to start again. Duration of factory setting will take about 60 s.

<b>P0011</b>	<b>Lock for user defined parameter</b>				Min: 0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 65535		

**Details:**

See parameter P0013 (user defined parameter)

<b>P0012</b>	<b>Key for user defined parameter</b>				Min: 0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 65535		

**Details:**

See parameter P0013 (user defined parameter).

<b>P0013[20]</b>	<b>User defined parameter</b>				Min: 0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 65535		

Defines a limited set of parameters to which the end user will have access.

Instructions for use:

1. Set P0003 = 3 (expert user)
2. Go to P0013 indices 0 to 16 (user list)
3. Enter into P0013 index 0 to 16 the parameters required to be visible in the user-defined list. The following values are fixed and cannot be changed:
  - P0013 index 19 = 12 (key for user defined parameter)
  - P0013 index 18 = 10 (commissioning parameter filter)
  - P0013 index 17 = 3 (user access level)
4. Set P0003 = 0 to activate the user defined parameter.

**Index:**

- P0013[0] : 1st user parameter
- P0013[1] : 2nd user parameter
- P0013[2] : 3rd user parameter
- P0013[3] : 4th user parameter
- P0013[4] : 5th user parameter
- P0013[5] : 6th user parameter
- P0013[6] : 7th user parameter
- P0013[7] : 8th user parameter
- P0013[8] : 9th user parameter
- P0013[9] : 10th user parameter
- P0013[10] : 11th user parameter
- P0013[11] : 12th user parameter
- P0013[12] : 13th user parameter
- P0013[13] : 14th user parameter
- P0013[14] : 15th user parameter
- P0013[15] : 16th user parameter
- P0013[16] : 17th user parameter
- P0013[17] : 18th user parameter
- P0013[18] : 19th user parameter
- P0013[19] : 20th user parameter

**Dependency:**

First, set P0011 ("lock") to a different value than P0012 ("key") to prevent changes to user-defined parameter. Then, set P0003 to 0 to activate the user-defined list.

When locked and the user-defined parameter is activated, the only way to exit the user-defined parameter (and view other parameters) is to set P0012 ("key") to the value in P0011 ("lock").

**Note:**

- Alternatively, set P0010 = 30 (commissioning parameter filter = factory setting) and P0970 = 1 (factory reset) to perform a complete factory reset.
- The default values of P0011 ("lock") and P0012 ("key") are the same.

<b>P0014[3]</b>	<b>Store mode</b>			<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> UT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> -	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 1	

Sets the store mode for parameters ("volatile" (RAM) or "nonvolatile" (EEPROM)).

**Possible Settings:**

- 0 volatile (RAM)
- 1 nonvolatile (EEPROM)

**Index:**

- P0014[0] : Serial interface COM link
- P0014[1] : Serial interface BOP link
- P0014[2] : PROFIBUS / CB

**Note:**

1. With the BOP the parameter will always be stored in the EEPROM.
2. P0014 itself will always be stored in the EEPROM.
3. P0014 will not be changed by performing a factory reset (P0010 = 30 and P0971 = 1).
4. P0014 can be transferred during a DOWNLOAD (P0010 = 29).
5. If "Store request via USS/CB = volatile (RAM)" and "P0014[x] = volatile (RAM)", you can make a transfer of all parameter values into the nonvolatile memory via P0971.
6. If "Store request via USS/CB" and P0014[x] are not consistent, the setting of P14[x] = "store nonvolatile (EEPROM)" has always higher priority.

Store request via USS/CB	Value of P0014[x]	Result
EEPROM	RAM	EEPROM
EEPROM	EEPROM	EEPROM
RAM	RAM	RAM
RAM	EEPROM	EEPROM

## 3.2 Diagnosis parameters

<b>r0018</b>	<b>Firmware version</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>1</b>
	<b>P-Group:</b> INVERTER				

Displays version number of installed firmware.

<b>r0019</b>	<b>CO/BO: BOP control word</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMMANDS				

Displays status of operator panel commands.

The settings below are used as the "source" codes for keypad control when connecting to BICO input parameters.

**Bitfields:**

Bit00	ON/OFF1	0	NO	1	YES
Bit01	OFF2: Electrical stop	0	YES	1	NO
Bit08	JOG right	0	NO	1	YES
Bit11	Reverse (setpoint inversion)	0	NO	1	YES
Bit13	Motor potentiometer MOP up	0	NO	1	YES
Bit14	Motor potentiometer MOP down	0	NO	1	YES

**Note:**


When BICO technology is used to allocate functions to panel buttons, this parameter displays the actual status of the relevant command.

The following functions can be "connected" to individual buttons:

- ON/OFF1,
- OFF2,
- JOG,
- REVERSE,
- INCREASE,
- DECREASE

<b>r0020</b>	<b>CO: Freq. setpoint before RFG</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays actual frequency setpoint (input from ramp function generator).

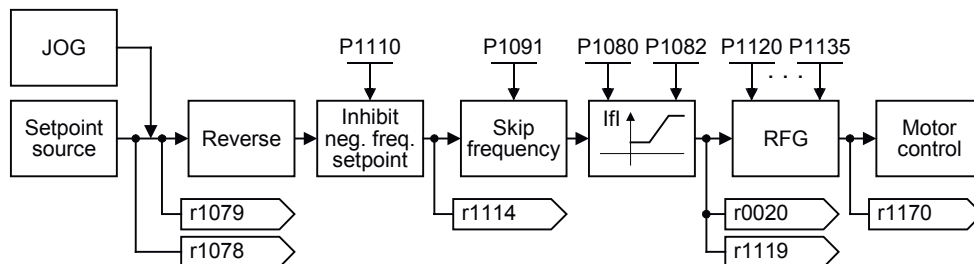

<b>r0021</b>	<b>CO: Act. filtered frequency</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>2</b>
	<b>P-Group:</b> CONTROL				

Displays actual inverter output frequency (r0021) excluding slip compensation, resonance damping and frequency limitation.

<b>r0022</b>	<b>Act. filtered rotor speed</b>	<b>Datatype:</b> Float	<b>Unit:</b> 1/min	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays calculated rotor speed based on inverter output frequency [Hz] x 120 / number of poles.

$$r0022 [1/min] = r0021 [Hz] \cdot \frac{60}{r0313}$$

**Note:**

This calculation makes no allowance for load-dependent slip.

<b>r0024</b>	<b>CO: Act. filtered output freq.</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays actual output frequency (slip compensation, resonance damping and frequency limitation are included).

<b>r0025</b>	<b>CO: Act. filtered output voltage</b>	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>2</b>
	<b>P-Group:</b> CONTROL				

Displays [rms] voltage applied to motor.

<b>r0026</b>	<b>CO: Act. filtered DC-link volt.</b>	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>2</b>
	<b>P-Group:</b> INVERTER				

Displays DC-link voltage.

		Mains		
		200 - 240 V	380 - 480 V	500 - 600 V
U <sub>DC_max_trip</sub>	F0002	420 V (FS A - C) 410 V (FS D - F)	840 V (FS A - C) 820 V (FS D - F) 820 V (FS FX, GX)	1020 V
U <sub>DC_min_trip</sub>	F0003	215 V	430 V (FS A - F) 380 V (FS FX, GX)	530 V
U <sub>DC_max_warn</sub>	A0502	r1242		
U <sub>DC_max_ctrl</sub>	(P1240)			
U <sub>DC_min_warn</sub>	A0503	$\frac{P1245 [\%]}{100} \cdot \sqrt{2} \cdot P0210$		
U <sub>DC_min_ctrl</sub>	(P1240)			
U <sub>DC_Comp</sub>	(P1236)	0.98 · r1242		
U <sub>DC_Chopper</sub>	(P1237)	0.98 · r1242		

<b>r0027</b>	<b>CO: Act. filtered output current</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>2</b>
	<b>P-Group:</b> CONTROL				

Displays [rms] value of motor current [A].

<b>r0029</b>	<b>CO: Flux gen. current</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays flux-generating current component.

The flux-generating current component is based on the nominal flux, which is calculated from the motor parameters (P0340 - Calculation of motor parameters).

**Dependency:**

Applies when vector control is selected in P1300 (control mode); otherwise, the display shows the value zero.

**Note:**

The flux-generating current component is generally constant up to the base speed of the motor; above base speed, this component is weakened (field weakening) thus enabling an increase in motor speed but at reduced torque.

<b>r0030</b>	<b>CO: Torque gen. current</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays torque-generating current component.

**Note:**

For asynchronous motors, a limit is calculated for the torque generating current component (in conjunction with the maximum possible output voltage (r0071), motor leakage and current field weakening (r0377)) and this prevents motor stalling.

<b>r0031</b>	<b>CO: Act. filtered torque</b>	<b>Datatype:</b> Float	<b>Unit:</b> Nm	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>2</b>
	<b>P-Group:</b> CONTROL				

Displays electrical torque.

$$m_M = \frac{3}{2} \cdot \frac{L_m}{L_R} \cdot Z_p \cdot \Psi_{rd} \cdot i_{sq}$$

$m_M$  : Motor torque  
 $Z_p$  : Pole pair number  
 $\Psi_{rd}$  : Rotor flux  
 $L_R$  : Rotor inductance  
 $L_m$  : Magnetizing inductance  
 $i_{sq}$  : Torque-generating current  
 $e$  : Motor counter EMF

Valid for V/f-characteristic:

$$i_{sq} \approx \frac{u \cdot |i_s| \cdot \cos \varphi - R_s^2 \cdot |i_s|}{e}$$


Output value will be zero at low speeds when the current injection is active (r1751.5 = 1).

**Note:**

The electrical torque is not the same as the mechanical torque, which can be measured on the shaft. Due to windage and friction a part of the electrical torque is lost in the motor.

<b>r0032</b>	<b>CO: Act. filtered power</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>2</b>
	<b>P-Group:</b> CONTROL				

Displays motor power (power output at the motor shaft).

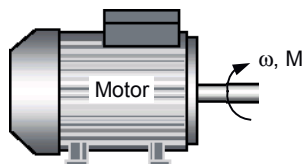

$$P_{mech} = \omega \cdot M = 2 \cdot \pi \cdot f \cdot M$$

$$r0032 \text{ [kW]} = \frac{1}{1000} \cdot 2 \cdot \pi \cdot \frac{r0022}{60} \text{ [1/min]} \cdot r0031 \text{ [Nm]}$$

$$r0032 \text{ [hp]} = 0.75 \cdot r0032 \text{ [kW]}$$

**Dependency:**

Value is displayed in [kW] or [hp] depending on setting for P0100 (operation for Europe / North America).

<b>r0035[3]</b>	<b>CO: Act. motor temperature</b>	<b>Datatype:</b> Float	<b>Unit:</b> °C	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>2</b>
	<b>P-Group:</b> MOTOR				

Displays measured motor temperature.

**Index:**

r0035[0] : 1st. Drive data set (DDS)  
 r0035[1] : 2nd. Drive data set (DDS)  
 r0035[2] : 3rd. Drive data set (DDS)

<b>r0036</b>	<b>CO: Inverter overload utilization</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>4</b>
	<b>P-Group:</b> INVERTER				


Displays inverter overload utilization calculated via I2t model.

The actual I2t value relative to the max. possible I2t value supplies utilization in [%].

If the current exceeds the threshold for P0294 (inverter I2t overload warning), alarm A0505 (inverter I2t) is generated and the output current of the inverter reduced via P0290 (inverter overload reaction).

If 100 % utilization is exceeded, alarm F0005 (inverter I2t) is tripped.

**Example:**

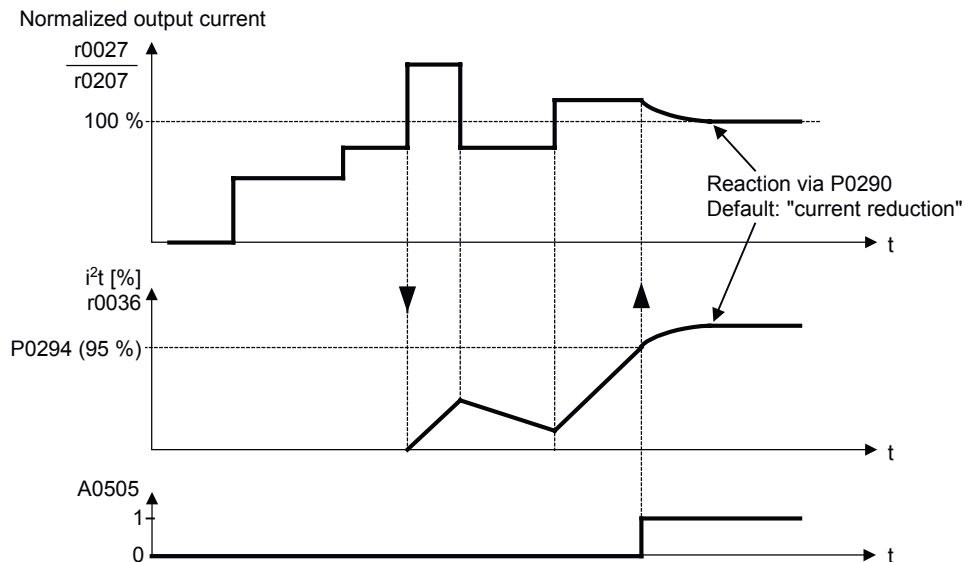

**Dependency:**

r0036 > 0:  
If the nominal current of the inverter is exceed, utilization will be displayed. Otherwise, 0 % utilization is displayed.

<b>r0037[5]</b>	<b>CO: Inverter temperature [°C]</b>	<b>Datatype:</b> Float	<b>Unit:</b> °C	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> INVERTER				

Displays measured heatsink temperature and calculated junction temperature of IGBTs based on thermal model.

**Index:**

- r0037[0] : Measured heat sink temperature
- r0037[1] : Chip temperature
- r0037[2] : Rectifier temperature
- r0037[3] : Inverter ambient temperature
- r0037[4] : Control board temperature

<b>r0038</b>	<b>CO: Act. power factor</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays actual power factor.

**Dependency:**

Applies when V/f control is selected in P1300 (control mode); otherwise, the display shows the value 1.

<b>r0039</b>	<b>CO: Energy consumpt. meter [kWh]</b>	<b>Datatype:</b> Float	<b>Unit:</b> kWh	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>2</b>
	<b>P-Group:</b> INVERTER				

Displays electrical energy used by inverter since display was last reset (see P0040 - reset energy consumption meter).

$$r0039 = \int_0^{t_{act}} P_W \cdot dt = \int_0^{t_{act}} \sqrt{3} \cdot u \cdot i \cdot \cos \phi \cdot dt$$

**Dependency:**

Value is reset when P0040 = 1 (reset energy consumption meter).

<b>P0040</b>	<b>Reset energy consumption meter</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT <b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> INVERTER <b>Active:</b> first confirm <b>QuickComm.:</b> No	<b>Max:</b> 1	

Resets value of parameter r0039 (energy consumption meter) to zero.

**Possible Settings:**

- 0 No reset
- 1 Reset r0039 to 0

**Dependency:**

No reset until "P" is pressed.

<b>r0050</b>	<b>CO: Active command data set</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> COMMANDS	<b>Max:</b> -	

Displays currently selected and active command data set (CDS).

**Possible Settings:**

- 0 1st. Command data set (CDS)
- 1 2nd. Command data set (CDS)
- 2 3rd. Command data set (CDS)

**Details:**

See parameter P0810.

<b>r0051[2]</b>	<b>CO: Active drive data set (DDS)</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> COMMANDS	<b>Max:</b> -	

Displays currently selected and active drive data set (DDS).

**Possible Settings:**

- 0 1st. Drive data set (DDS)
- 1 2nd. Drive data set (DDS)
- 2 3rd. Drive data set (DDS)

**Index:**

- r0051[0] : Selected drive data set
- r0051[1] : Active drive data set

**Details:**

See parameter P0820.



<b>r0052</b>	<b>CO/BO: Act. status word 1</b>	<b>Min:</b> -	<b>Level</b>
	<b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> -	<b>2</b>
<b>P-Group:</b> COMMANDS		<b>Max:</b> -	

Displays first active status word of inverter (bit format) and can be used to diagnose inverter status.


**Bitfields:**

Bit00	Drive ready	0	NO	1	YES
Bit01	Drive ready to run	0	NO	1	YES
Bit02	Drive running	0	NO	1	YES
Bit03	Drive fault active	0	NO	1	YES
Bit04	OFF2 active	0	YES	1	NO
Bit05	OFF3 active	0	YES	1	NO
Bit06	ON inhibit active	0	NO	1	YES
Bit07	Drive warning active	0	NO	1	YES
Bit08	Deviation setpoint / act. value	0	YES	1	NO
Bit09	PZD control	0	NO	1	YES
Bit10	Maximum frequency reached	0	NO	1	YES
Bit11	Warning: Motor current limit	0	YES	1	NO
Bit12	Motor holding brake active	0	NO	1	YES
Bit13	Motor overload	0	YES	1	NO
Bit14	Motor runs right	0	NO	1	YES
Bit15	Inverter overload	0	YES	1	NO

**Dependency:**

r0052 Bit00 - Bit02:

State-sequence diagram after Power On or ON/OFF1 respectively: ==> see below

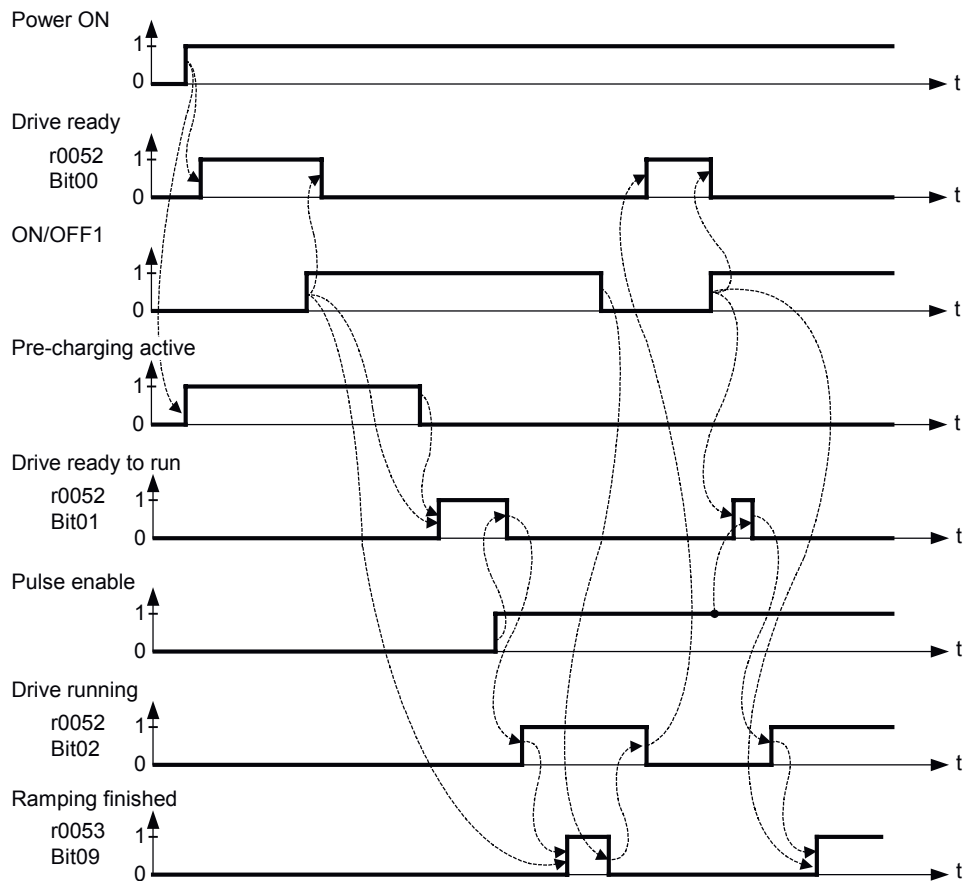

r0052 Bit03 "Drive fault active":


Output of Bit3 (Fault) will be inverted on digital output (Low = Fault, High = No Fault).

r0052 Bit08 "Deviation setpoint / act. value" ==> see parameter P2164

r0052 Bit10 "f\_act >= P1082 (f\_max)" ==> see parameter P1082

r0052 Bit12 "Motor holding brake active" ==> see parameter P1215

r0052 Bit14 "Motor runs right" ==> see below

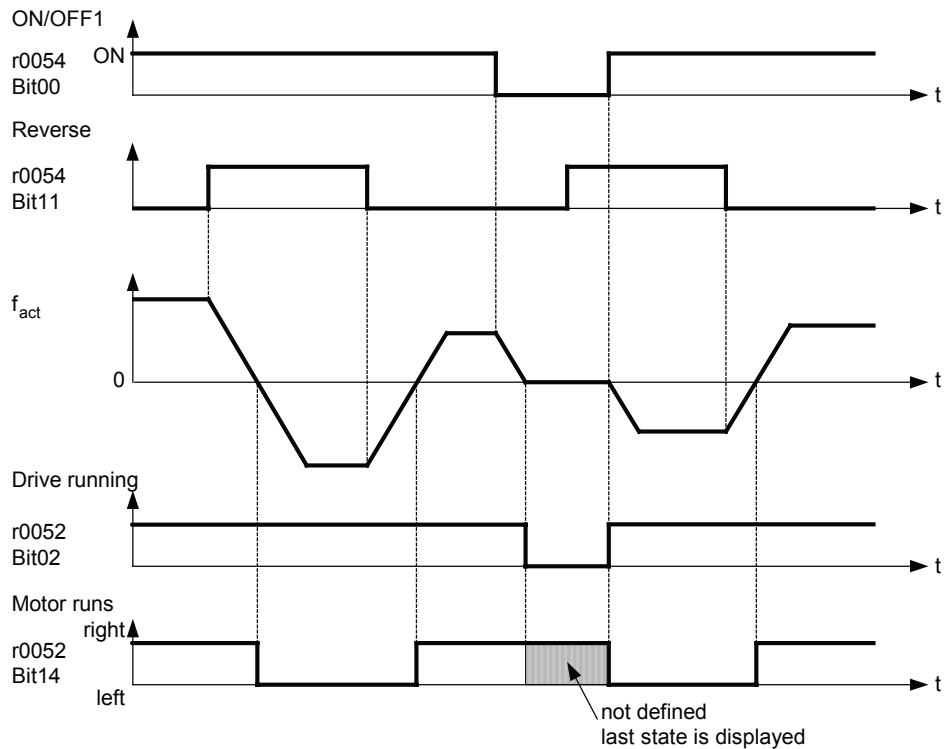

**Details:**

The 7-segment display of the bit-parameters (binary parameters) is explained in the Introduction of the Parameter List.

<b>r0053</b>	<b>CO/BO: Act. status word 2</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>P-Group:</b> COMMANDS			<b>Def:</b> -	
				<b>Max:</b> -	

Displays second status word of inverter (in bit format).


**Bitfields:**

Bit00	DC brake active	0	NO	1	YES
Bit01	f <sub>act</sub> > P2167 (f <sub>off</sub> )	0	NO	1	YES
Bit02	f <sub>act</sub> <= P1080 (f <sub>min</sub> )	0	NO	1	YES
Bit03	Act. current r0027 > P2170	0	NO	1	YES
Bit04	f <sub>act</sub> > P2155 (f <sub>1</sub> )	0	NO	1	YES
Bit05	f <sub>act</sub> <= P2155 (f <sub>1</sub> )	0	NO	1	YES
Bit06	f <sub>act</sub> >= setpoint	0	NO	1	YES
Bit07	Act. Vdc r0026 < P2172	0	NO	1	YES
Bit08	Act. Vdc r0026 > P2172	0	NO	1	YES
Bit09	Ramping finished	0	NO	1	YES
Bit10	PID output r2294 == P2292 (PID <sub>min</sub> )	0	NO	1	YES
Bit11	PID output r2294 == P2291 (PID <sub>max</sub> )	0	NO	1	YES
Bit14	Download data set 0 from AOP	0	NO	1	YES
Bit15	Download data set 1 from AOP	0	NO	1	YES

**Note:**

- r0053 Bit00 ==> see parameter P1233
- r0053 Bit01 ==> see parameter P2167
- r0053 Bit02 ==> see parameter P1080
- r0053 Bit03 ==> see parameter P2170
- r0053 Bit04 ==> see parameter P2155
- r0053 Bit05 ==> see parameter P2155
- r0053 Bit06 ==> see parameter P2150
- r0053 Bit07 ==> see parameter P2172
- r0053 Bit08 ==> see parameter P2172

r0053 Bit09 "Ramping finished" ==> see below

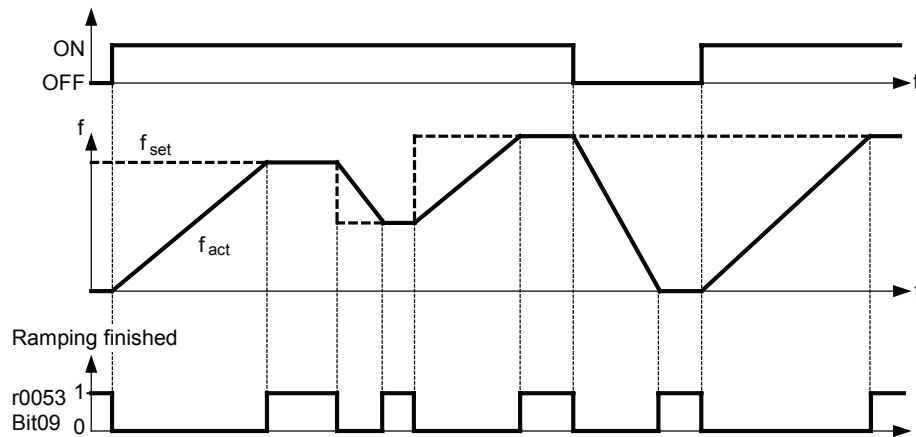

**Details:**

See description of seven-segment display given in the "Introduction to MICROMASTER System Parameters" in this manual.

<b>r0054</b>	<b>CO/BO: Act. control word 1</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMMANDS				

Displays first control word of inverter and can be used to diagnose which commands are active.

**Bitfields:**

Bit00	ON/OFF1	0	NO	1	YES
Bit01	OFF2: Electrical stop	0	YES	1	NO
Bit02	OFF3: Fast stop	0	YES	1	NO
Bit03	Pulse enable	0	NO	1	YES
Bit04	RFG enable	0	NO	1	YES
Bit05	RFG start	0	NO	1	YES
Bit06	Setpoint enable	0	NO	1	YES
Bit07	Fault acknowledge	0	NO	1	YES
Bit08	JOG right	0	NO	1	YES
Bit09	JOG left	0	NO	1	YES
Bit10	Control from PLC	0	NO	1	YES
Bit11	Reverse (setpoint inversion)	0	NO	1	YES
Bit13	Motor potentiometer MOP up	0	NO	1	YES
Bit14	Motor potentiometer MOP down	0	NO	1	YES
Bit15	CDS Bit 0 (Local/Remote)	0	NO	1	YES

**Details:**

See description of seven-segment display given in the "Introduction to MICROMASTER System Parameters" in this manual.

<b>r0055</b>	<b>CO/BO: Act. control word 2</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMMANDS				

Displays additional control word of inverter and can be used to diagnose which commands are active.

**Bitfields:**

Bit00	Fixed frequency Bit 0	0	NO	1	YES
Bit01	Fixed frequency Bit 1	0	NO	1	YES
Bit02	Fixed frequency Bit 2	0	NO	1	YES
Bit03	Fixed frequency Bit 3	0	NO	1	YES
Bit04	Drive data set (DDS) Bit 0	0	NO	1	YES
Bit05	Drive data set (DDS) Bit 1	0	NO	1	YES
Bit08	PID enabled	0	NO	1	YES
Bit09	DC brake enabled	0	NO	1	YES
Bit11	Droop enabled	0	NO	1	YES
Bit12	Torque control	0	NO	1	YES
Bit13	External fault 1	0	YES	1	NO
Bit15	Command data set (CDS) Bit 1	0	NO	1	YES

**Details:**

See description of seven-segment display given in the "Introduction to MICROMASTER System Parameters" in this handbook.

<b>r0056</b>	<b>CO/BO: Status of motor control</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	<b>Level</b>
	<b>P-Group:</b> CONTROL						<b>3</b>

Displays status of motor control (MM420: V/f status), which can be used to diagnose inverter status.

**Bitfields:**

Bit00	Init. control finished	0	NO	1	YES
Bit01	Motor demagnetizing finished	0	NO	1	YES
Bit02	Pulses enabled	0	NO	1	YES
Bit03	Voltage soft start select	0	NO	1	YES
Bit04	Motor excitation finished	0	NO	1	YES
Bit05	Starting boost active	0	NO	1	YES
Bit06	Acceleration boost active	0	NO	1	YES
Bit07	Frequency is negative	0	NO	1	YES
Bit08	Field weakening active	0	NO	1	YES
Bit09	Volts setpoint limited	0	NO	1	YES
Bit10	Slip frequency limited	0	NO	1	YES
Bit11	F <sub>out</sub> > F <sub>max</sub> Freq. limited	0	NO	1	YES
Bit12	Phase reversal selected	0	NO	1	YES
Bit13	I-max controller active	0	NO	1	YES
Bit14	Vdc-max controller active	0	NO	1	YES
Bit15	KIB (Vdc-min control) active	0	NO	1	YES

**Details:**

See description of seven-segment display given in the introduction.

<b>r0061</b>	<b>CO: Act. encoder frequency</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	<b>Level</b>
	<b>P-Group:</b> CONTROL						<b>2</b>


Displays actual frequency detected by encoder.

<b>r0062</b>	<b>CO: Freq. setpoint</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	<b>Level</b>
	<b>P-Group:</b> CONTROL						<b>3</b>

Displays frequency setpoint of vector controller.

<b>r0063</b>	<b>CO: Act. frequency</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	<b>Level</b>
	<b>P-Group:</b> CONTROL						<b>3</b>

Displays actual unfiltered frequency.

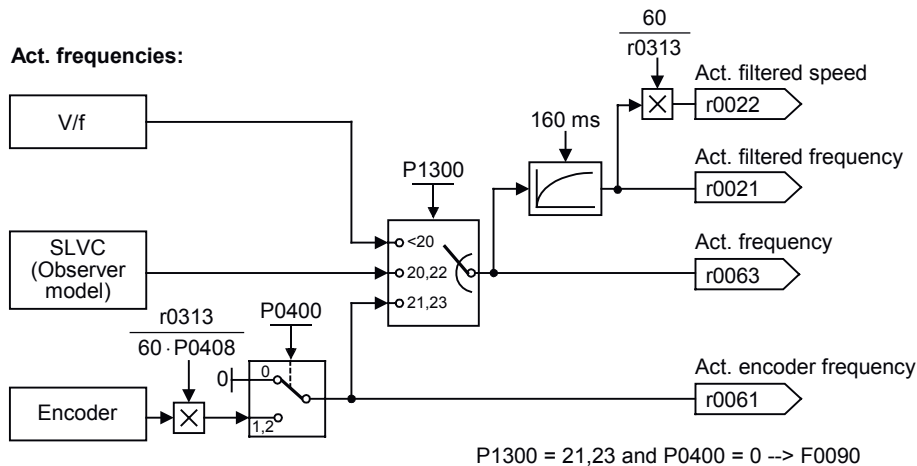

<b>r0064</b>	<b>CO: Dev. frequency controller</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	<b>Level</b>
	<b>P-Group:</b> CONTROL						<b>3</b>

Displays actual deviation of speed controller.

This value is calculated from the frequency setpoint (r0062) and the actual frequency (r0063).

**Dependency:**

Applies when vector control is selected in P1300 (control mode); otherwise, the display shows the value zero.

<b>r0065</b>	<b>CO: Slip frequency</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays slip frequency of motor in [%] relative to the rated motor frequency (P0310).

**Details:**

For V/f control, see also P1335 (slip compensation).

<b>r0066</b>	<b>CO: Act. output frequency</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays actual output frequency.

**Note:**


The output frequency is limited by the values entered in P1080 (min. frequency) and P1082 (max. frequency).

<b>r0067</b>	<b>CO: Act. output current limit</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays valid maximum output current of inverter.

Parameter r0067 is influenced/determined by the following factors:

- Rated motor current P0305
- Motor overload factor P0640
- Motor protection in dependency of P0610
- r0067 is less than or equal to maximum inverter current r0209
- Inverter protection in dependency of P0290

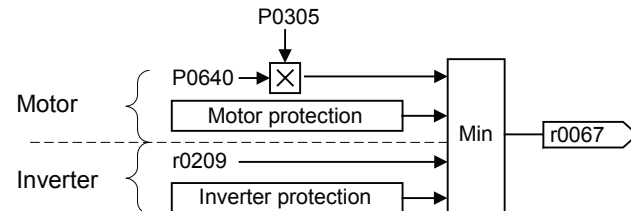

**Note:**

A reduction of r0067 may indicate an inverter overload or a motor overload.

<b>r0068</b>	<b>CO: Output current</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays unfiltered [rms] value of motor current [A].

**Note:**

Used for process control purposes (in contrast to r0027 (output current), which is filtered and is used to display the value on the BOP/AOP).

<b>r0069[6]</b>	<b>CO: Act. phase currents</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>4</b>
	<b>P-Group:</b> CONTROL				

Displays phase currents.

**Index:**

- r0069[0] : U\_phase
- r0069[1] : V\_phase
- r0069[2] : W\_phase
- r0069[3] : Offset U\_phase
- r0069[4] : Offset V\_phase
- r0069[5] : Offset W\_phase

<b>r0070</b>	<b>CO: Act. DC-link voltage</b>	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> INVERTER				


Displays (unfiltered) DC-link voltage.

**Note:**

Used for process control purposes (in contrast to r0026 (actual DC-link voltage), which is filtered and is used to display the value on the BOP/AOP).

<b>r0071</b>	<b>CO: Max. output voltage</b>	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays maximum output voltage.

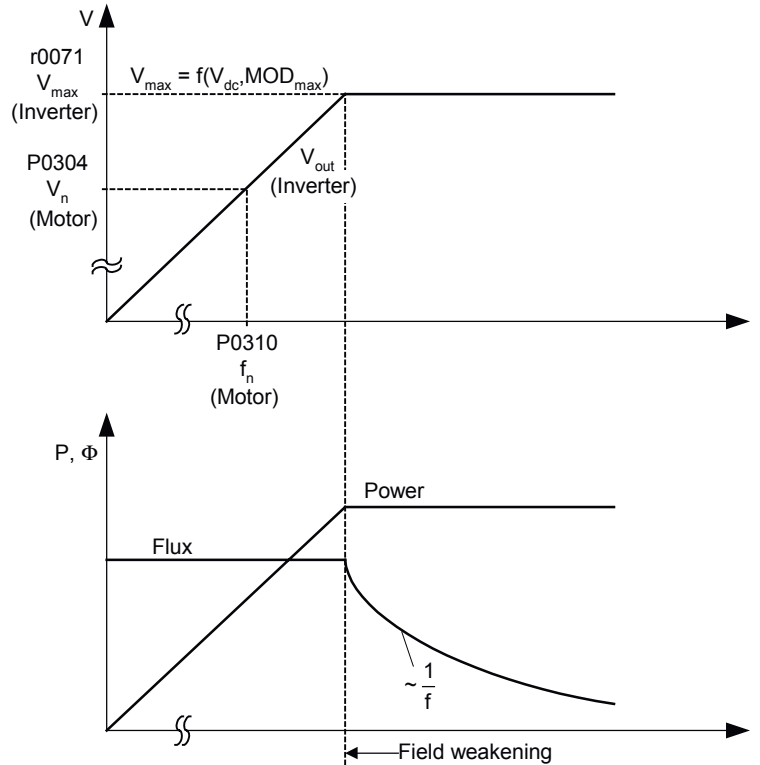

**Dependency:**

- The actual maximum output voltage depends on the actual incoming line supply voltage.
- The maximum possible output voltage r0071 of the drive inverter is determined by the DC link voltage r0026 and the maximum modulation depth P1803 in the gating unit.
- The maximum output voltage r0071 is tracked with the DC link voltage so that the highest possible value is always and automatically achieved.
- The output voltage only reaches the calculated maximum value under steady-state conditions at the rated load.
- In the no-load and partial load ranges, lower output voltages r0025 are obtained.

<b>r0072</b>	<b>CO: Act. output voltage</b>	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays output voltage.

<b>r0074</b>	<b>CO: Act. modulation</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>4</b>
	<b>P-Group:</b> CONTROL				

Displays actual modulation index.

The modulation index is defined as ratio between the magnitude of the fundamental component in the inverter phase output voltage and half of the dc-link voltage.

<b>r0075</b>	<b>CO: Current setpoint Isd</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays setpoint of flux generating current component.

**Dependency:**

Applies when vector control is selected in P1300 (control mode); otherwise, the display shows the value zero.

<b>r0076</b>	<b>CO: Act. current Isd</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL				

Displays flux generating current component.

**Dependency:**

Applies when vector control is selected in P1300 (control mode); otherwise, the display shows the value zero.

<b>r0077</b>	<b>CO: Current setpoint Isq</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	Level
	<b>P-Group:</b> CONTROL						<b>3</b>

Displays setpoint for component of torque generating current.

**Dependency:**

Applies when vector control is selected in P1300 (control mode); otherwise, the display shows the value zero.

<b>r0078</b>	<b>CO: Act. current Isq</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	Level
	<b>P-Group:</b> CONTROL						<b>3</b>

Displays component of torque generating current.

<b>r0079</b>	<b>CO: Torque setpoint (total)</b>	<b>Datatype:</b> Float	<b>Unit:</b> Nm	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	Level
	<b>P-Group:</b> CONTROL						<b>3</b>

Displays total torque setpoint after torque limiting.

**Dependency:**

Applies when vector control is selected in P1300 (control mode); otherwise, the display shows the value zero.

<b>r0080</b>	<b>CO: Act. torque</b>	<b>Datatype:</b> Float	<b>Unit:</b> Nm	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	Level
	<b>P-Group:</b> CONTROL						<b>4</b>

Displays actual torque. Output value will be zero at low frequencies when current injection is active (r1751.5 = 1).

<b>r0084</b>	<b>CO: Act. air gap flux</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	Level
	<b>P-Group:</b> CONTROL						<b>4</b>

Displays air gap flux in [%] relative to the rated motor flux.

<b>r0086</b>	<b>CO: Act. active current</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	Level
	<b>P-Group:</b> CONTROL						<b>3</b>

Displays active (real part) of motor current.

**Dependency:**

Applies when V/f control is selected in P1300 (control mode); otherwise, the display shows the value zero.

<b>r0090</b>	<b>CO: Act. rotor angle</b>	<b>Datatype:</b> Float	<b>Unit:</b> °	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	Level
	<b>P-Group:</b> CONTROL						<b>2</b>

Indicates the current angle of the rotor. This function is not available on single input channel encoders.

<b>P0095[10]</b>	<b>CI: Display PZD signals</b>			<b>Min:</b> 0:0	<b>Def:</b> 0:0	<b>Max:</b> 4000:0	Level
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -				<b>3</b>
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No				

Selects source of display for PZD signals.

**Index:**

- P0095[0] : 1st PZD signal
- P0095[1] : 2nd PZD signal
- P0095[2] : 3rd PZD signal
- P0095[3] : 4th PZD signal
- P0095[4] : 5th PZD signal
- P0095[5] : 6th PZD signal
- P0095[6] : 7th PZD signal
- P0095[7] : 8th PZD signal
- P0095[8] : 9th PZD signal
- P0095[9] : 10th PZD signal

<b>r0096[10]</b>	<b>PZD signals</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
------------------	--------------------	------------------------	----------------	---	--------------------------

**P-Group:** CONTROL

Displays PZD signals in [%].

**Index:**

- r0096[0] : 1st PZD signal
- r0096[1] : 2nd PZD signal
- r0096[2] : 3rd PZD signal
- r0096[3] : 4th PZD signal
- r0096[4] : 5th PZD signal
- r0096[5] : 6th PZD signal
- r0096[6] : 7th PZD signal
- r0096[7] : 8th PZD signal
- r0096[8] : 9th PZD signal
- r0096[9] : 10th PZD signal

**Note:**

r0096 = 100 % corresponds to 4000 hex.



### 3.3 Inverter parameters (HW)

<b>P0100</b>	<b>Europe / North America</b>				<b>Min:</b> 0	<b>Level</b> <b>1</b>
	<b>CStat:</b> C	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> QUICK	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes	<b>Max:</b> 2		

Determines whether power settings (e.g. nominal rating plate power - P0307) are expressed in [kW] or [hp]. The default settings for the nominal rating plate frequency (P0310) and maximum motor frequency (P1082) are also set automatically here, in addition to reference frequency (P2000).

**Possible Settings:**

- 0 Europe [kW], frequency default 50 Hz
- 1 North America [hp], frequency default 60 Hz
- 2 North America [kW], frequency default 60 Hz


**Dependency:**

Where:

- Stop drive first (i.e. disable all pulses) before you change this parameter.
- Changing P0100 resets all rated motor parameters as well as other parameters that depend on the rated motor parameters (see P0340 - calculation of motor parameters).

Changing P0100 overwrites the settings of the DIP50/60 switch (location shown in the diagram below):

1. Parameter P0100 has a higher priority than the DIP50/60 switch.
2. However, after the inverter is powered-on again and P0100 < 2, the DIP50/60 setting will take priority and overwrite P0100.
3. The DIP50/60 switch does not have any effect, if P0100 = 2.

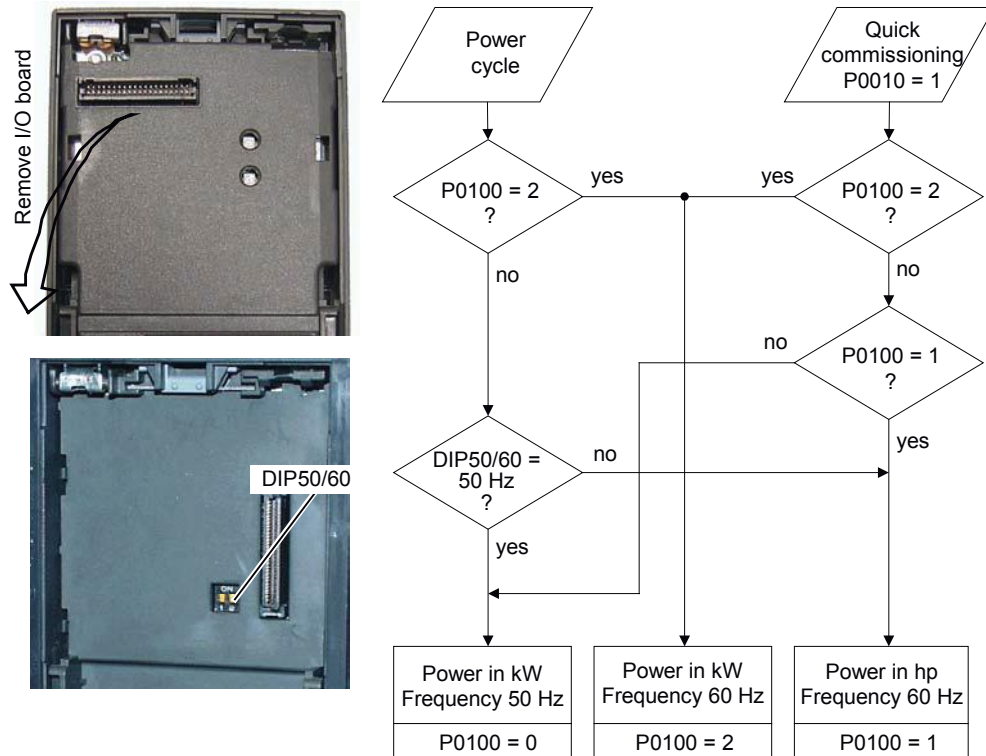

**Notice:**

P0100 setting 2 (==> [kW], frequency default 60 [Hz]) is not overwritten by the setting of DIP switch 2 (see diagram above).

<b>P0199</b>	<b>Equipment system number</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> UT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> -	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 255		

Equipment system number. This parameter has no operation effect.

<b>r0200</b>	<b>Act. power stack code number</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> U32	<b>Unit:</b> -	
	<b>P-Group:</b> INVERTER	<b>Def:</b> - <b>Max:</b> -	

Identifies hardware variant as shown in table below.

Code- No.	MM440 MLFB	Input Voltage & Frequency	CT Power kW	VT Power kW	Internal Filter	Frame Size
41	6SE6440-2UC11-2AAx	1/3AC200-240V +10% -10% 47-63Hz	0,12	0,12	no	A
42	6SE6440-2UC12-5AAx	1/3AC200-240V +10% -10% 47-63Hz	0,25	0,25	no	A
43	6SE6440-2UC13-7AAx	1/3AC200-240V +10% -10% 47-63Hz	0,37	0,37	no	A
44	6SE6440-2UC15-5AAx	1/3AC200-240V +10% -10% 47-63Hz	0,55	0,55	no	A
45	6SE6440-2UC17-5AAx	1/3AC200-240V +10% -10% 47-63Hz	0,75	0,75	no	A
46	6SE6440-2AB11-2AAx	1AC200-240V +10% -10% 47-63Hz	0,12	0,12	Cl. A	A
47	6SE6440-2AB12-5AAx	1AC200-240V +10% -10% 47-63Hz	0,25	0,25	Cl. A	A
48	6SE6440-2AB13-7AAx	1AC200-240V +10% -10% 47-63Hz	0,37	0,37	Cl. A	A
49	6SE6440-2AB15-5AAx	1AC200-240V +10% -10% 47-63Hz	0,55	0,55	Cl. A	A
50	6SE6440-2AB17-5AAx	1AC200-240V +10% -10% 47-63Hz	0,75	0,75	Cl. A	A
51	6SE6440-2UC21-1BAx	1/3AC200-240V +10% -10% 47-63Hz	1,1	1,1	no	B
52	6SE6440-2UC21-5BAx	1/3AC200-240V +10% -10% 47-63Hz	1,5	1,5	no	B
53	6SE6440-2UC22-2BAx	1/3AC200-240V +10% -10% 47-63Hz	2,2	2,2	no	B
54	6SE6440-2AB21-1BAx	1AC200-240V +10% -10% 47-63Hz	1,1	1,1	Cl. A	B
55	6SE6440-2AB21-5BAx	1AC200-240V +10% -10% 47-63Hz	1,5	1,5	Cl. A	B
56	6SE6440-2AB22-2BAx	1AC200-240V +10% -10% 47-63Hz	2,2	2,2	Cl. A	B
57	6SE6440-2UC23-0CAx	1/3AC200-240V +10% -10% 47-63Hz	3	3	no	C
58	6SE6440-2UC24-0CAx	3AC200-240V +10% -10% 47-63Hz	4	5,5	no	C
59	6SE6440-2UC25-5CAx	3AC200-240V +10% -10% 47-63Hz	5,5	7,5	no	C
60	6SE6440-2AB23-0CAx	1AC200-240V +10% -10% 47-63Hz	3	3	Cl. A	C
61	6SE6440-2AC23-0CAx	3AC200-240V +10% -10% 47-63Hz	3	3	Cl. A	C
62	6SE6440-2AC24-0CAx	3AC200-240V +10% -10% 47-63Hz	4	5,5	Cl. A	C
63	6SE6440-2AC25-5CAx	3AC200-240V +10% -10% 47-63Hz	5,5	7,5	Cl. A	C
64	6SE6440-2UC27-5DAx	3AC200-240V +10% -10% 47-63Hz	7,5	11	no	D
65	6SE6440-2UC31-1DAx	3AC200-240V +10% -10% 47-63Hz	11	15	no	D
66	6SE6440-2UC31-5DAx	3AC200-240V +10% -10% 47-63Hz	15	18,5	no	D
67	6SE6440-2AC27-5DAx	3AC200-240V +10% -10% 47-63Hz	7,5	11	Cl. A	D
68	6SE6440-2AC31-1DAx	3AC200-240V +10% -10% 47-63Hz	11	15	Cl. A	D
69	6SE6440-2AC31-5DAx	3AC200-240V +10% -10% 47-63Hz	15	18,5	Cl. A	D
70	6SE6440-2UC31-8EAx	3AC200-240V +10% -10% 47-63Hz	18,5	22	no	E
71	6SE6440-2UC32-2EAx	3AC200-240V +10% -10% 47-63Hz	22	30	no	E
72	6SE6440-2AC31-8EAx	3AC200-240V +10% -10% 47-63Hz	18,5	22	Cl. A	E
73	6SE6440-2AC32-2EAx	3AC200-240V +10% -10% 47-63Hz	22	30	Cl. A	E
74	6SE6440-2UC33-0FAx	3AC200-240V +10% -10% 47-63Hz	30	37	no	F
75	6SE6440-2UC33-7FAx	3AC200-240V +10% -10% 47-63Hz	37	45	no	F
76	6SE6440-2UC34-5FAx	3AC200-240V +10% -10% 47-63Hz	45	45	no	F
77	6SE6440-2AC33-0FAx	3AC200-240V +10% -10% 47-63Hz	30	37	Cl. A	F
78	6SE6440-2AC33-7FAx	3AC200-240V +10% -10% 47-63Hz	37	45	Cl. A	F
79	6SE6440-2AC34-5FAx	3AC200-240V +10% -10% 47-63Hz	45	45	Cl. A	F
80	6SE6440-2UD13-7AAx	3AC380-480V +10% -10% 47-63Hz	0,37	0,37	no	A
81	6SE6440-2UD15-5AAx	3AC380-480V +10% -10% 47-63Hz	0,55	0,55	no	A
82	6SE6440-2UD17-5AAx	3AC380-480V +10% -10% 47-63Hz	0,75	0,75	no	A
83	6SE6440-2UD21-1AAx	3AC380-480V +10% -10% 47-63Hz	1,1	1,1	no	A
84	6SE6440-2UD21-5AAx	3AC380-480V +10% -10% 47-63Hz	1,5	1,5	no	A
85	6SE6440-2UD22-2BAx	3AC380-480V +10% -10% 47-63Hz	2,2	2,2	no	B
86	6SE6440-2UD23-0BAx	3AC380-480V +10% -10% 47-63Hz	3	3	no	B
87	6SE6440-2UD24-0BAx	3AC380-480V +10% -10% 47-63Hz	4	4	no	B
88	6SE6440-2AD22-2BAx	3AC380-480V +10% -10% 47-63Hz	2,2	2,2	Cl. A	B
89	6SE6440-2AD23-0BAx	3AC380-480V +10% -10% 47-63Hz	3	3	Cl. A	B
90	6SE6440-2AD24-0BAx	3AC380-480V +10% -10% 47-63Hz	4	4	Cl. A	B
91	6SE6440-2UD25-5CAx	3AC380-480V +10% -10% 47-63Hz	5,5	7,5	no	C
92	6SE6440-2UD27-5CAx	3AC380-480V +10% -10% 47-63Hz	7,5	11	no	C
93	6SE6440-2UD31-1CAx	3AC380-480V +10% -10% 47-63Hz	11	15	no	C

Code- No.	MM440 MLFB	Input Voltage & Frequency	CT Power kW	VT Power kW	Internal Filter	Frame Size
94	6SE6440-2AD25-5CAx	3AC380-480V +10% -10% 47-63Hz	5,5	7,5	Cl. A	C
95	6SE6440-2AD27-5CAx	3AC380-480V +10% -10% 47-63Hz	7,5	11	Cl. A	C
96	6SE6440-2AD31-1CAx	3AC380-480V +10% -10% 47-63Hz	11	15	Cl. A	C
97	6SE6440-2UD31-5DAx	3AC380-480V +10% -10% 47-63Hz	15	18,5	no	D
98	6SE6440-2UD31-8DAx	3AC380-480V +10% -10% 47-63Hz	18,5	22	no	D
99	6SE6440-2UD32-2DAx	3AC380-480V +10% -10% 47-63Hz	22	30	no	D
100	6SE6440-2AD31-5DAx	3AC380-480V +10% -10% 47-63Hz	15	18,5	Cl. A	D
101	6SE6440-2AD31-8DAx	3AC380-480V +10% -10% 47-63Hz	18,5	22	Cl. A	D
102	6SE6440-2AD32-2DAx	3AC380-480V +10% -10% 47-63Hz	22	30	Cl. A	D
103	6SE6440-2UD33-0EAx	3AC380-480V +10% -10% 47-63Hz	30	37	no	E
104	6SE6440-2UD33-7EAx	3AC380-480V +10% -10% 47-63Hz	37	45	no	E
105	6SE6440-2AD33-0EAx	3AC380-480V +10% -10% 47-63Hz	30	37	Cl. A	E
106	6SE6440-2AD33-7EAx	3AC380-480V +10% -10% 47-63Hz	37	45	Cl. A	E
107	6SE6440-2UD34-5FAx	3AC380-480V +10% -10% 47-63Hz	45	55	no	F
108	6SE6440-2UD35-5FAx	3AC380-480V +10% -10% 47-63Hz	55	75	no	F
109	6SE6440-2UD37-5FAx	3AC380-480V +10% -10% 47-63Hz	75	90	no	F
110	6SE6440-2AD34-5FAx	3AC380-480V +10% -10% 47-63Hz	45	55	Cl. A	F
111	6SE6440-2AD35-5FAx	3AC380-480V +10% -10% 47-63Hz	55	75	Cl. A	F
112	6SE6440-2AD37-5FAx	3AC380-480V +10% -10% 47-63Hz	75	90	Cl. A	F
113	6SE6440-2UE17-5CAx	3AC500-600V +10% -10% 47-63Hz	0,75	1,5	no	C
114	6SE6440-2UE21-5CAx	3AC500-600V +10% -10% 47-63Hz	1,5	2,2	no	C
115	6SE6440-2UE22-2CAx	3AC500-600V +10% -10% 47-63Hz	2,2	4	no	C
116	6SE6440-2UE24-0CAx	3AC500-600V +10% -10% 47-63Hz	4	5,5	no	C
117	6SE6440-2UE25-5CAx	3AC500-600V +10% -10% 47-63Hz	5,5	7,5	no	C
118	6SE6440-2UE27-5CAx	3AC500-600V +10% -10% 47-63Hz	7,5	11	no	C
119	6SE6440-2UE31-1CAx	3AC500-600V +10% -10% 47-63Hz	11	15	no	C
120	6SE6440-2UE31-5DAx	3AC500-600V +10% -10% 47-63Hz	15	18,5	no	D
121	6SE6440-2UE31-8DAx	3AC500-600V +10% -10% 47-63Hz	18,5	22	no	D
122	6SE6440-2UE32-2DAx	3AC500-600V +10% -10% 47-63Hz	22	30	no	D
123	6SE6440-2UE33-0EAx	3AC500-600V +10% -10% 47-63Hz	30	37	no	E
124	6SE6440-2UE33-7EAx	3AC500-600V +10% -10% 47-63Hz	37	45	no	E
125	6SE6440-2UE34-5FAx	3AC500-600V +10% -10% 47-63Hz	45	55	no	F
126	6SE6440-2UE35-5FAx	3AC500-600V +10% -10% 47-63Hz	55	75	no	F
127	6SE6440-2UE37-5FAx	3AC500-600V +10% -10% 47-63Hz	75	90	no	F
1001	6SE6440-2UD38-8FAx	3AC400-480V +10% -10% 47-63Hz	90	110	no	FX
1002	6SE6440-2UD41-1FAx	3AC400-480V +10% -10% 47-63Hz	110	132	no	FX
1003	6SE6440-2UD41-3GAx	3AC400-480V +10% -10% 47-63Hz	132	160	no	GX
1004	6SE6440-2UD41-6GAx	3AC400-480V +10% -10% 47-63Hz	160	200	no	GX
1005	6SE6440-2UD42-0GAx	3AC400-480V +10% -10% 47-63Hz	200	250	no	GX

**Notice:**

Parameter r0200 = 0 indicates that no power stack has been identified.

<b>P0201</b>	<b>Power stack code number</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> C	<b>Datatype:</b> U16		<b>Def:</b> 0
	<b>P-Group:</b> INVERTER	<b>Unit:</b> -		<b>Max:</b> 65535
	<b>Active:</b> first confirm	<b>QuickComm.:</b> No		

Confirms actual power stack identified.

<b>r0203</b>	<b>Act. inverter type</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>	
		<b>Datatype:</b> U16		<b>Def:</b> -
	<b>P-Group:</b> INVERTER	<b>Unit:</b> -		<b>Max:</b> -

Type number of actual inverter identified.

**Possible Settings:**

- 1 MICROMASTER 420
- 2 MICROMASTER 440
- 3 MICRO- / COMBIMASTER 411
- 4 MICROMASTER 410
- 5 Reserved
- 6 MICROMASTER 440 PX
- 7 MICROMASTER 430

<b>r0204</b>	<b>Power stack features</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> INVERTER			<b>Def:</b> - <b>Max:</b> -	

Displays hardware features of power stack.

**Bitfields:**

Bit00	DC input voltage	0	NO	1	YES
Bit01	RFI filter	0	NO	1	YES

**Note:**

Parameter r0204 = 0 indicates that no power stack has been identified.

<b>P0205</b>	<b>Inverter application</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	Level <b>3</b>
	<b>CStat:</b> C	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes	<b>Def:</b> 0 <b>Max:</b> 1	

Selects inverter application.

The inverter and motor requirements are determined by the speed range and torque requirements of the load. The relationship between speed and torque for different loads (constant torque loads or variable torque loads).

**Possible Settings:**

0	Constant torque
1	Variable torque

**Note:**

Constant torque (CT):

CT is used if the application needs a constant torque on the whole frequency range. Many loads can be considered to be constant torque loads. Typical constant torque loads are conveyors, compressors and positive displacement pumps (see diagram).

Variable torque (VT):





VT is used if the application has a parabolic frequency-torque characteristic like many fans and pumps.

Variable torque allows with the same inverter:


- Higher rated inverter current r0207
- Higher rated inverter power r0206
- Higher threshold for I2t protection

If P0205 is modified in quick commissioning it immediately calculates various motor parameters:

- P0305 Rated motor current
- P0307 Rated motor power
- P0640 Motor overload factor

Torque	$M \sim \frac{1}{f}$	$M = \text{const.}$	$M \sim f$	$M \sim f^2$
Power	$P = \text{const.}$	$P \sim f$	$P \sim f^2$	$P \sim f^3$
Characteristic				
Application	Winders Facing lathes Rotary cutting machines	Hoisting gear Belt conveyors Process machines Involving forming Rolling mills Planers Compressors	Calenders with viscous friction Eddy-current brakes	Pumps Fans Centrifuges

It is recommended to modify P0205 first. Afterwards motor parameter may be adapted. Motor parameter will be overridden by changing this sequence.

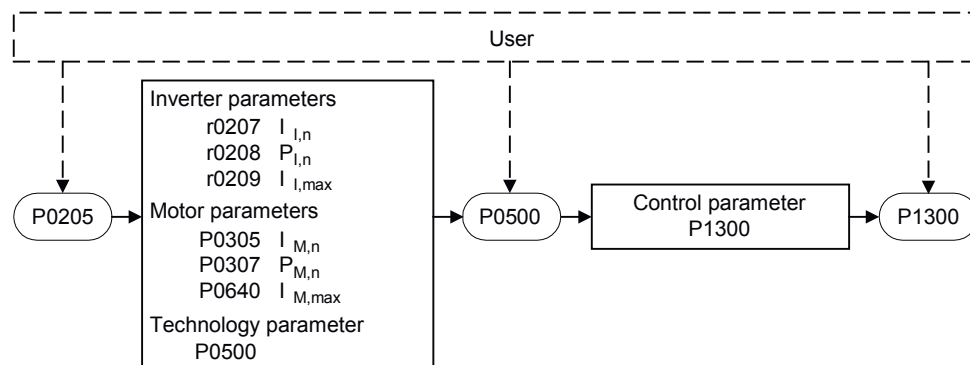

**Notice:**

- The parameter value is not reset by the factory setting (see P0970).
- To set P0205 = 1 (variable torque) is not possible for all inverters.
- Use setting 1 (variable torque) only for variable-torque applications (e.g. pumps and fans). If used for constant-load applications, I2t warning will be produced too late, causing overheating in the motor.

<b>r0206</b>	<b>Rated inverter power [kW] / [hp]</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>2</b>
<b>P-Group:</b> INVERTER					

Displays nominal rated motor power from inverter.

**Dependency:**

Value is displayed in [kW] or [hp] depending on setting for P0100 (operation for Europe / North America).

$$r0206 \text{ [hp]} = 0.75 \cdot r0206 \text{ [kW]}$$

<b>r0207</b>	<b>Rated inverter current</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>2</b>
<b>P-Group:</b> INVERTER					

Displays maximum continuous output current of inverter.

<b>r0208</b>	<b>Rated inverter voltage</b>	<b>Datatype:</b> U32	<b>Unit:</b> V	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>2</b>
<b>P-Group:</b> INVERTER					

Displays nominal AC supply voltage of inverter.

**Value:**

- r0208 = 230 : 200 - 240 V +/- 10 %
- r0208 = 400 : 380 - 480 V +/- 10 %
- r0208 = 575 : 500 - 600 V +/- 10 %

<b>r0209</b>	<b>Maximum inverter current</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	<b>Level</b>
	<b>P-Group:</b> INVERTER						<b>2</b>

Displays maximum output current of inverter.

**Dependency:**

Parameter r0209 depends on the derating which is affected by pulse frequency P1800, ambient temperature and altitude. The data of deration is given in the OPERATING INSTRUCTION.

<b>P0210</b>	<b>Supply voltage</b>	<b>Datatype:</b> U16	<b>Unit:</b> V	<b>Min:</b> 0	<b>Def:</b> 230	<b>Max:</b> 1000	<b>Level</b>
	<b>CStat:</b> CT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No				<b>3</b>

Parameter P0210 defines the supply voltage. Its default value depends upon the type of inverter. If P0210 does not correspond to the supply voltage, then it must be modified.

When P0210 has been modified, the following thresholds are changed:

**Dependency:**

Optimizes Vdc controller, which extends the ramp-down time if regenerative energy from motor would otherwise cause DC link overvoltage trips.

Reducing the value enables controller to cut in earlier and reduce the risk of overvoltage.

Set P1254 ("Auto detect Vdc switch-on levels") = 0. Cut-in levels for Vdc-controller and compound braking are then derived directly from P0210 (supply voltage).

$$\begin{aligned} \text{Vdc\_min switch-on level} &= P1245 \cdot \sqrt{2} \cdot P0210 \\ \text{Vdc\_max switch-on level} &= 1.15 \cdot \sqrt{2} \cdot P0210 \\ \text{Compound braking switch-on level} &= 1.13 \cdot \sqrt{2} \cdot P0210 \\ \text{Dynamic braking switch-on level} &= 1.13 \cdot \sqrt{2} \cdot P0210 \end{aligned}$$

**Note:**

- If mains voltage is higher than value entered, automatic deactivation of the Vdc controller may occur to avoid acceleration of the motor. An alarm will be issued in this case (A0910).
- Default value is depending on inverter type and its rating data.

<b>r0231[2]</b>	<b>Max. cable length</b>	<b>Datatype:</b> U16	<b>Unit:</b> m	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	<b>Level</b>
	<b>P-Group:</b> INVERTER						<b>3</b>

Indexed parameter to display maximum allowable cable length between inverter and motor.

**Index:**

- r0231[0] : Max. allowed unscreened cable length
- r0231[1] : Max. allowed screened cable length

**Notice:**


For full EMC compliance, the screened cable must not exceed 25 m in length when an EMC filter is fitted.

<b>P0290</b>	<b>Inverter overload reaction</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	<b>Def:</b> 2	<b>Max:</b> 3	<b>Level</b>
	<b>CStat:</b> CT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No				<b>3</b>

Selects reaction of inverter to an internal over-temperature.

Following physical values influence the inverter overload protection (see diagram):

- heat sink temperature
- junction temperature (IGBT temperature)
- inverter I<sup>2</sup>t

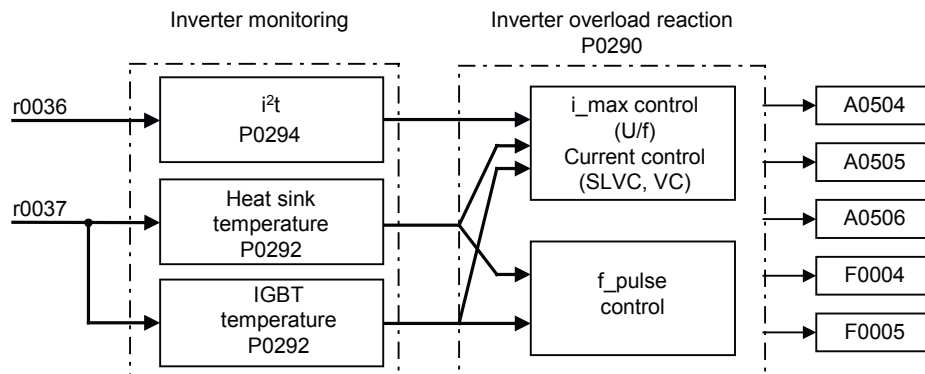



**Possible Settings:**

- 0 Reduce output frequency
- 1 Trip (F0004)
- 2 Reduce pulse frequency and output frequency
- 3 Reduce pulse frequency then trip (F0004)

**Notice:**

P0290 = 0:  
Reduction of output frequency is only effective if the load is also reduced. This is for example valid for variable torque applications with a quadratic torque characteristic as pumps or fans.

A trip will always result, if the action taken does not sufficiently reduce internal temperature.

The pulse frequency P1800 is reduced only if higher than 2 kHz. The actual pulse frequency is displayed in parameter r1801.

<b>P0291[3]</b>	<b>Inverter protection</b>	<b>Min:</b> 0	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> INVERTER	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Bit 02 shows if phase loss dedection (input phase) of 3 phase inverters is enabled after factory reset. Default setting of phase loss is disabled for FSA - FSC. FSD and greater it is enabled.

**Bitfields:**

Bit00	Reserved	0	NO	1	YES
Bit01	Reserved	0	NO	1	YES
Bit02	Phase loss detection enable	0	NO	1	YES

**Index:**

- P0291[0] : 1st. Drive data set (DDS)
- P0291[1] : 2nd. Drive data set (DDS)
- P0291[2] : 3rd. Drive data set (DDS)

**Details:**

See P0290 (inverter overload reaction)

<b>P0292</b>	<b>Inverter temperature warning</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> °C
	<b>P-Group:</b> INVERTER	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Defines the temperature difference (in °C) between the Overtemperature trip threshold and the warning threshold of the inverter. The trip threshold is stored internally by the inverter and cannot be changed by the user.

Temperature warning threshold of inverter T\_warn

$$T_{warn} = T_{trip} - P0292$$

Temperature shutdown threshold of inverter T\_trip

Temperature	MM440, Frame Size							
	A - C	D - F	F 600 V	FX 95 kW CT	110 kW CT	132 kW CT	GX 160 kW CT	200 kW CT
Heat sink	110 °C	95 °C	80 °C	88 °C	91 °C	80 °C	82 °C	88 °C
IGBT	140 °C	145 °C	145 °C	150 °C	150 °C	145 °C	147 °C	150 °C
Input rectifier	-	-	-	75 °C	75 °C	75 °C	75 °C	75 °C
Cooling air	-	-	-	55 °C	55 °C	55 °C	55 °C	50 °C
Control board	-	-	-	65 °C	65 °C	65 °C	65 °C	65 °C

If the actual inverter temperature (r0037) exceeds the corresponding threshold, a warning A0504, if the temperature still increases then a fault F0004 will be displayed.

<b>P0294</b>	<b>Inverter I2t overload warning</b>	<b>Min:</b> 10.0	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> %
	<b>P-Group:</b> INVERTER	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Defines the [%] value at which alarm A0505 (inverter I2t) is generated.

Inverter I2t calculation is used to determine a maximum tolerable period for inverter overload. The I2t calculation value is deemed = 100 % when this maximum tolerable period is reached.

**Dependency:**

That the output current of the inverter has been reduced and that the value of I2t does not exceed 100%.

**Note:**

P0294 = 100 % corresponds to stationary nominal load.

<b>P0295</b>	<b>Inverter fan off delay time</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> s
	<b>P-Group:</b> TERMINAL	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 0		
		<b>Max:</b> 3600		

Defines inverter fan switch off delay time in seconds after drive has stopped.

**Note:**

Setting to 0, inverter fan will switch off when the drive stops, that is no delay.

### 3.4 Motor parameters

<b>P0300[3]</b>	<b>Select motor type</b>	<b>Min:</b> 1	<b>Level</b> <b>2</b>	
	<b>CStat:</b> C	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm		<b>QuickComm.:</b> Yes
		<b>Def:</b> 1		
		<b>Max:</b> 2		

Selects motor type.

This parameter is required during commissioning to select motor type and optimize inverter performance. Most motors are asynchronous; if in doubt, use the formula below.

$$x = P0310 \cdot \frac{60}{P0311}$$

x = 1, 2, ..., n : Synchronous motor

x ≠ 1, 2, ..., n : Asynchronous motor

If the result is a whole number, the motor is synchronous.

**Possible Settings:**

- 1 Asynchronous rotational motor
- 2 Synchronous rotational motor

**Index:**

- P0300[0] : 1st. Drive data set (DDS)
- P0300[1] : 2nd. Drive data set (DDS)
- P0300[2] : 3rd. Drive data set (DDS)

**Dependency:**

Changeable only when P0010 = 1 (quick commissioning).


If synchronous motor is selected, the following functions are not available:

- P0308 Power factor
- P0309 Motor efficiency
- P0346 Magnetization time
- P0347 Demagnetization time
- P1335 Slip compensation
- P1336 Slip limit
- P0320 Motor magnetizing current
- P0330 Rated motor slip
- P0331 Rated magnetization current
- P0332 Rated power factor
- P0384 Rotor time constant
- P1200, P1202, P1203 Flying start
- P1230, P1232, P1233 DC braking



<b>P0304[3]</b>	<b>Rated motor voltage</b>	<b>Min:</b> 10	<b>Level</b> <b>1</b>	
	<b>CStat:</b> C	<b>Datatype:</b> U16		<b>Unit:</b> V
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm		<b>QuickComm.:</b> Yes
		<b>Def:</b> 230		
		<b>Max:</b> 2000		

Nominal motor voltage [V] from rating plate. Following diagram shows a typical rating plate with the locations of the relevant motor data.

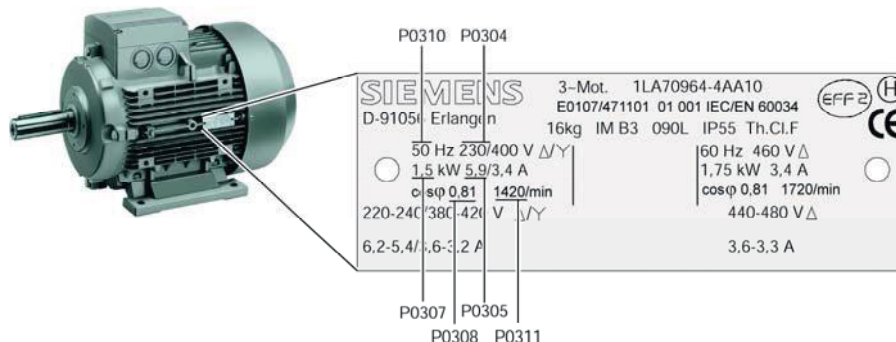

Line supply voltage	1 AC 110 V *)	1 AC 230 V	3 AC 230 V	3 AC 400 V	3 AC 500 V
MICROMASTER 410	X	X	-	-	-
MICROMASTER 411	-	-	-	X	-
MICROMASTER 420	-	X	X	X	-
MICROMASTER 430	-	-	-	X	-
MICROMASTER 440	-	X	X	X	X

\*) Line supply voltage 1-ph. 110 V AC is stepped-up --> frequency inverter output voltage 3-ph. 230 V AC

**Index:**

- P0304[0] : 1st. Drive data set (DDS)
- P0304[1] : 2nd. Drive data set (DDS)
- P0304[2] : 3rd. Drive data set (DDS)

**Dependency:**


- Changeable only when P0010 = 1 (quick commissioning).
- Default value is depending on inverter type and its rating data.



**Caution:**

The input of rating plate data must correspond with the wiring of the motor (star / delta). This means, if delta wiring is used for the motor, delta rating plate data has to be entered.

**IEC Motor**

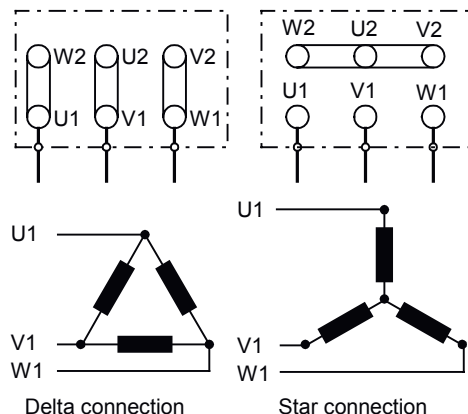


e.g.: Volts 230 V (Delta connection) / 400 V (Star connection)


### NEMA Motor

Volts	U	V	W	Connected together	Connection
low	T <sub>1</sub> -T <sub>7</sub>	T <sub>2</sub> -T <sub>8</sub>	T <sub>3</sub> -T <sub>9</sub>	T <sub>4</sub> -T <sub>5</sub> -T <sub>6</sub>	YY
high	T <sub>1</sub>	T <sub>2</sub>	T <sub>3</sub>	T <sub>1</sub> -T <sub>7</sub>   T <sub>2</sub> -T <sub>8</sub>   T <sub>3</sub> -T <sub>9</sub>	Y

e.g.: Volts 230 V YY (low) / 460 V Y (high)



Volts	U	V	W	Connected together	Connection
low	T <sub>1</sub> -T <sub>6</sub> -T <sub>7</sub>	T <sub>2</sub> -T <sub>4</sub> -T <sub>8</sub>	T <sub>3</sub> -T <sub>5</sub> -T <sub>9</sub>	-	Δ Δ
high	T <sub>1</sub>	T <sub>2</sub>	T <sub>3</sub>	T <sub>4</sub> -T <sub>7</sub>   T <sub>5</sub> -T <sub>8</sub>   T <sub>6</sub> -T <sub>9</sub>	Δ



<b>P0305[3]</b>	<b>Rated motor current</b>	<b>Min:</b> 0.01	<b>Level</b>
	<b>CStat:</b> C	<b>Datatype:</b> Float	<b>Unit:</b> A
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes
		<b>Def:</b> 3.25	<b>Max:</b> 10000.00
			<b>1</b>

Nominal motor current [A] from rating plate - see diagram in P0304.

#### Index:

- P0305[0] : 1st. Drive data set (DDS)
- P0305[1] : 2nd. Drive data set (DDS)
- P0305[2] : 3rd. Drive data set (DDS)

#### Dependency:

- Changeable only when P0010 = 1 (quick commissioning).
- Default value is depending on inverter type and its rating data.
- Depends also on P0320 (motor magnetization current).

#### Note:

The maximum value of P0305 depends on the maximum inverter current r0209 and the motor type:

Asynchronous motor : P0305<sub>max, asyn</sub> = r0209

Synchronous motor : P0305<sub>max, syn</sub> = 2 · r0209

It is recommended that the ratio of P0305 (rated motor current) and r0207 (rated inverter current) should not be lower than:

$$U/f : \frac{1}{8} \leq \frac{P0305}{r0207}$$

$$SLVC \text{ and } VC : \frac{1}{4} \leq \frac{P0305}{r0207}$$

<b>P0307[3]</b>	<b>Rated motor power</b>	<b>Min:</b> 0.01	<b>Level</b>
	<b>CStat:</b> C	<b>Datatype:</b> Float	<b>Unit:</b> -
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes
		<b>Def:</b> 0.12	<b>Max:</b> 2000.00
			<b>1</b>

Nominal motor power [kW/hp] from rating plate.

#### Index:

- P0307[0] : 1st. Drive data set (DDS)
- P0307[1] : 2nd. Drive data set (DDS)
- P0307[2] : 3rd. Drive data set (DDS)

#### Dependency:

- If P0100 = 1, values will be in [hp] - see diagram P0304 (rating plate).
- Changeable only when P0010 = 1 (quick commissioning).
- Default value is depending on inverter type and its rating data.

<b>P0308[3]</b>	<b>Rated motor cosPhi</b>	<b>Min:</b> 0.000	<b>Level</b> <b>2</b>	
	<b>CStat:</b> C	<b>Datatype:</b> Float		<b>Unit:</b> -
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm		<b>QuickComm.:</b> Yes

**Def:** 0.000  
**Max:** 1.000

Nominal motor power factor (cosPhi) from rating plate - see diagram P0304.

**Index:**

- P0308[0] : 1st. Drive data set (DDS)
- P0308[1] : 2nd. Drive data set (DDS)
- P0308[2] : 3rd. Drive data set (DDS)

**Dependency:**

- Changeable only when P0010 = 1 (quick commissioning).
- Visible only when P0100 = 0 or 2, (motor power entered in [kW]).
- Default value is depending on inverter type and its rating data.
- Setting 0 causes internal calculation of value. Calculated value see r0332.

<b>P0309[3]</b>	<b>Rated motor efficiency</b>	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> C	<b>Datatype:</b> Float		<b>Unit:</b> %
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm		<b>QuickComm.:</b> Yes

**Def:** 0.0  
**Max:** 99.9

Nominal motor efficiency in [%] from rating plate.

**Index:**

- P0309[0] : 1st. Drive data set (DDS)
- P0309[1] : 2nd. Drive data set (DDS)
- P0309[2] : 3rd. Drive data set (DDS)

**Dependency:**

- Changeable only when P0010 = 1 (quick commissioning).
- Visible only when P0100 = 1, (i.e. motor power entered in [hp]).
- Default value is depending on inverter type and its rating data.
- Setting 0 causes internal calculation of value. Calculated value see r0332.

**Note:**

P0309 = 100 % corresponds to superconducting.

**Details:**

See diagram in P0304 (rating plate).

<b>P0310[3]</b>	<b>Rated motor frequency</b>	<b>Min:</b> 12.00	<b>Level</b> <b>1</b>	
	<b>CStat:</b> C	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm		<b>QuickComm.:</b> Yes

**Def:** 50.00  
**Max:** 650.00

Nominal motor frequency [Hz] from rating plate.

**Index:**

- P0310[0] : 1st. Drive data set (DDS)
- P0310[1] : 2nd. Drive data set (DDS)
- P0310[2] : 3rd. Drive data set (DDS)

**Dependency:**

- Changeable only when P0010 = 1 (quick commissioning).
- Pole pair number recalculated automatically if parameter is changed.

**Details:**

See diagram in P0304 (rating plate)

<b>P0311[3]</b>	<b>Rated motor speed</b>	<b>Min:</b> 0	<b>Level</b> <b>1</b>	
	<b>CStat:</b> C	<b>Datatype:</b> U16		<b>Unit:</b> 1/min
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm		<b>QuickComm.:</b> Yes

**Def:** 0  
**Max:** 40000

Nominal motor speed [rpm] from rating plate.

**Index:**

- P0311[0] : 1st. Drive data set (DDS)
- P0311[1] : 2nd. Drive data set (DDS)
- P0311[2] : 3rd. Drive data set (DDS)

**Dependency:**

- Changeable only when P0010 = 1 (quick commissioning).
- Setting 0 causes internal calculation of value.
- Slip compensation in V/f control requires rated motor speed for correct operation.
- Pole pair number recalculated automatically if parameter is changed.
- Default value is depending on inverter type and its rating data.
- Required for vector control and V/f control with speed controller.

**Details:**

See diagram in P0304 (rating plate)

<b>r0313[3]</b>	<b>Motor pole pairs</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> MOTOR				

Displays number of motor pole pairs that the inverter is currently using for internal calculations.

**Index:**

r0313[0] : 1st. Drive data set (DDS)  
r0313[1] : 2nd. Drive data set (DDS)  
r0313[2] : 3rd. Drive data set (DDS)

**Value:**

r0313 = 1 : 2-pole motor  
r0313 = 2 : 4-pole motor  
etc.

**Dependency:**

Recalculated automatically when P0310 (rated motor frequency) or P0311 (rated motor speed) is changed.

$$r0313 = 60 \cdot \frac{P0310}{P0311}$$

<b>P0314[3]</b>	<b>Motor pole pair number</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0 <b>Def:</b> 0 <b>Max:</b> 99	<b>Level</b> <b>4</b>
	<b>CStat:</b> C <b>P-Group:</b> MOTOR	<b>Active:</b> first confirm	<b>QuickComm.:</b> No		

Specifies number of pole pairs of motor.

**Index:**

P0314[0] : 1st. Drive data set (DDS)  
P0314[1] : 2nd. Drive data set (DDS)  
P0314[2] : 3rd. Drive data set (DDS)

**Value:**

P0314 = 1 : 2-pole motor  
P0314 = 2 : 4-pole motor  
etc.

**Dependency:**

Recalculated automatically when P0310 (rated motor frequency) or P0311 (rated motor speed) is changed.

<b>P0320[3]</b>	<b>Motor magnetizing current</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> 0.0 <b>Def:</b> 0.0 <b>Max:</b> 99.0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT <b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> Yes		

Defines motor magnetization current in [%] relative to P0305 (rated motor current).

**Index:**

P0320[0] : 1st. Drive data set (DDS)  
P0320[1] : 2nd. Drive data set (DDS)  
P0320[2] : 3rd. Drive data set (DDS)

**Dependency:**

P0320 = 0:  
Setting 0 causes calculation by P0340 = 1 (data entered from rating plate) or by P3900 = 1 - 3 (end of quick commissioning). The calculated value is displayed in parameter r0331.

<b>r0330[3]</b>	<b>Rated motor slip</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> MOTOR				

Displays nominal motor slip in [%] relative to P0310 (rated motor frequency) and P0311 (rated motor speed).

$$r0330 [\%] = \frac{P0310 - \frac{P0311}{60} \cdot r0313}{P0310} \cdot 100 \%$$

**Index:**

r0330[0] : 1st. Drive data set (DDS)  
r0330[1] : 2nd. Drive data set (DDS)  
r0330[2] : 3rd. Drive data set (DDS)

<b>r0331[3]</b>	<b>Rated magnetization current</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> MOTOR				

Displays calculated magnetizing current of motor in [A].

**Index:**

r0331[0] : 1st. Drive data set (DDS)  
r0331[1] : 2nd. Drive data set (DDS)  
r0331[2] : 3rd. Drive data set (DDS)

<b>r0332[3]</b>	<b>Rated power factor</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>3</b>
	<b>P-Group:</b> MOTOR				

Displays power factor for motor

**Index:**

r0332[0] : 1st. Drive data set (DDS)  
r0332[1] : 2nd. Drive data set (DDS)  
r0332[2] : 3rd. Drive data set (DDS)

**Dependency:**

Value is calculated internally if P0308 (rated motor cosPhi) set to 0; otherwise, value entered in P0308 is displayed.

<b>r0333[3]</b>	<b>Rated motor torque</b>	<b>Datatype:</b> Float	<b>Unit:</b> Nm	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>3</b>
	<b>P-Group:</b> MOTOR				

Displays rated motor torque.

**Index:**

r0333[0] : 1st. Drive data set (DDS)  
r0333[1] : 2nd. Drive data set (DDS)  
r0333[2] : 3rd. Drive data set (DDS)

**Dependency:**

Value is calculated from P0307 (rated motor power) and P0311 (rated motor speed).

$$r0333 \text{ [Nm]} = \frac{P0307 \text{ [kW]} \cdot 1000}{\frac{P0311 \text{ [1/min]}}{60} \cdot 2\pi}$$

<b>P0335[3]</b>	<b>Motor cooling</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0 <b>Def:</b> 0 <b>Max:</b> 3	Level <b>2</b>
	<b>CStat:</b> CT <b>P-Group:</b> MOTOR	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes		

Selects motor cooling system used.

**Possible Settings:**

- 0 Self-cooled: Using shaft mounted fan attached to motor
- 1 Force-cooled: Using separately powered cooling fan
- 2 Self-cooled and internal fan
- 3 Force-cooled and internal fan

**Index:**

P0335[0] : 1st. Drive data set (DDS)  
P0335[1] : 2nd. Drive data set (DDS)  
P0335[2] : 3rd. Drive data set (DDS)

**Caution:**

The following combination of parameter setting should not be combined:

P0610 = 1 and P0335 = 0 or 2 :

When P0335 = 0 or 2 the inverter cools the motor using a shaft mounted fan. If this is used in conjunction with P0610 the cooling of the motor will be inefficient.

In essence, if the i2t calculation reduces the output frequency, then the shaft mounted fan will also reduce its cooling effect, the motor will then eventually overheat and trip.

**Exception:**

Applications with variable torque the reduction of max. current leads automatically to a reduction of the load / output current.

**Notice:**

Motors of series 1LA1 and 1LA8 have an internal fan. This internal motor fan must not be confused with the fan at the end of the motor shaft.

<b>P0340[3]</b>	<b>Calculation of motor parameters</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4		

Calculates various motor parameters (see table below). This parameter is required during commissioning to optimize inverter performance.

**Possible Settings:**

- 0 No calculation
- 1 Complete parameterization
- 2 Calculation of equivalent circuit data
- 3 Calculation of V/f and vector control data
- 4 Calculation of controller settings only

**Index:**

- P0340[0] : 1st. Drive data set (DDS)
- P0340[1] : 2nd. Drive data set (DDS)
- P0340[2] : 3rd. Drive data set (DDS)

**Note:**

P0340 = 0:  
No calculation

P0340 = 1:  
The motor weight/moment of inertia (P0344, P0341) are determined starting from the rating plate parameters (P0300 - P0335), the motor equivalent circuit diagram parameters (ESB, P0350 - P0369). The V/f control/vector control parameters and reference quantities are then pre-assigned (includes all of the calculations from P0340 = 2,3,4).

P0340 = 2:  
The motor equivalent circuit diagram parameters (ESB, P0350 - P0369) are calculated starting from the rating plate parameters (without any other pre-assignments made).

P0340 = 3:  
The V/f control/vector control parameters are determined (includes all calculations from P0340 = 4) starting from the motor equivalent circuit diagram parameters (ESB, P0350 - P0369) and motor weight/moment of inertia, moment of inertia ratio (P0344, P0341, P0342).

P0340 = 4:  
The vector control parameters are pre-assigned starting from the motor equivalent circuit diagram parameters (ESB, P0350 - P0369) and motor weight/moment of inertia, moment of inertia ratio (P0344, P0341, P0342).

	P0340 = 1	P0340 = 2	P0340 = 3	P0340 = 4
P0341[3] Motor inertia [kg*m^2]	x			
P0342[3] Total/motor inertia ratio	x			
P0344[3] Motor weight	x			
P0346[3] Magnetization time	x		x	
P0347[3] Demagnetization time	x		x	
P0350[3] Stator resistance (line-to-line)	x	x		
P0352[3] Cable resistance	x	x		
P0354[3] Rotor resistance	x	x		
P0356[3] Stator leakage inductance	x	x		
P0358[3] Rotor leakage inductance	x	x		
P0360[3] Main inductance	x	x		
P0362[3] Magnetizing curve flux 1	x	x		
P0363[3] Magnetizing curve flux 2	x	x		
P0364[3] Magnetizing curve flux 3	x	x		
P0365[3] Magnetizing curve flux 4	x	x		
P0366[3] Magnetizing curve imag 1	x	x		
P0367[3] Magnetizing curve imag 2	x	x		
P0368[3] Magnetizing curve imag 3	x	x		
P0369[3] Magnetizing curve imag 4	x	x		
P0625[3] Ambient motor temperature	x	x		
P1253[3] Vdc-controller output limitation	x		x	
P1316[3] Boost end frequency	x		x	
P1460[3] Gain speed controller	x		x	x
P1462[3] Integral time speed controller	x		x	x
P1470[3] Gain speed controller (SLVC)	x		x	x
P1472[3] Integral time n-ctrl. (SLVC)	x		x	x
P1520[3] CO: Upper torque limit	x			
P1521[3] CO: Lower torque limit	x			
P1530[3] Motoring power limitation	x			
P1531[3] Regenerative power limitation	x			
P1715[3] Gain current controller	x		x	x
P1717[3] Integral time current controller	x		x	x
P1764[3] Kp of n-adaption (SLVC)	x		x	x
P1767[3] Tn of n-adaption (SLVC)	x		x	x
P2000[3] Reference frequency	x			
P2002[3] Reference current	x			
P2003[3] Reference torque	x			
P2174[3] Torque threshold M_thresh	x			
P2185[3] Upper torque threshold 1	x			
P2186[3] Lower torque threshold 1	x			
P2187[3] Upper torque threshold 2	x			
P2188[3] Lower torque threshold 2	x			
P2189[3] Upper torque threshold 3	x			
P2190[3] Lower torque threshold 3	x			

<b>P0341[3]</b>	<b>Motor inertia [kg*m<sup>2</sup>]</b>	<b>Min:</b> 0.00010	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> -
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Sets no-load inertia of motor.

Together with P0342 (inertia ratio total/motor) and P1496 (scaling factor acceleration), this value produces the acceleration torque (r1517), which can be added to any additional torque produced from a BICO source (P1511), and incorporated in the torque control function.

**Index:**

P0341[0] : 1st. Drive data set (DDS)  
P0341[1] : 2nd. Drive data set (DDS)  
P0341[2] : 3rd. Drive data set (DDS)

**Note:**

The result of P0341 \* P0342 is included in the speed controller calculation.  
P0341 \* P0342 (inertia ratio total/motor) = total motor inertia

P1496 (scaling factor acceleration) = 100 % activates acceleration pre-control for the speed controller and calculates the torque from P0341 (motor inertia) and P0342 (inertia ratio total/motor).

<b>P0342[3]</b>	<b>Total/motor inertia ratio</b>	<b>Min:</b> 1.000	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> -
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Specifies ratio between total inertia (load + motor) and motor inertia.

**Index:**

P0342[0] : 1st. Drive data set (DDS)  
P0342[1] : 2nd. Drive data set (DDS)  
P0342[2] : 3rd. Drive data set (DDS)

<b>P0344[3]</b>	<b>Motor weight</b>	<b>Min:</b> 1.0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> kg
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Specifies motor weight [kg].

**Index:**

P0344[0] : 1st. Drive data set (DDS)  
P0344[1] : 2nd. Drive data set (DDS)  
P0344[2] : 3rd. Drive data set (DDS)

**Note:**

- This value is used in the motor thermal model.
- It is normally calculated automatically from P0340 (motor parameters) but can also be entered manually.
- Default value is depending on inverter type and its rating data.

<b>r0345[3]</b>	<b>Motor start-up time</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>	
		<b>Datatype:</b> Float		<b>Unit:</b> s
	<b>P-Group:</b> MOTOR	<b>Def:</b> -		<b>Max:</b> -

Displays motor start-up time. This time corresponds to the standardized motor inertia.

The start-up time is the time taken to reach rated motor speed from standstill at acceleration with rated motor torque (r0333).

**Index:**

r0345[0] : 1st. Drive data set (DDS)  
r0345[1] : 2nd. Drive data set (DDS)  
r0345[2] : 3rd. Drive data set (DDS)

<b>P0346[3]</b>	<b>Magnetization time</b>	<b>Min:</b> 0.000	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> s
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Sets magnetization time [s], i.e. waiting time between pulse enable and start of ramp-up. Motor magnetization builds up during this time.

Magnetization time is normally calculated automatically from the motor data and corresponds to the rotor time constant (r0384).

**Index:**

P0346[0] : 1st. Drive data set (DDS)  
P0346[1] : 2nd. Drive data set (DDS)  
P0346[2] : 3rd. Drive data set (DDS)

**Note:**


- If boost settings are higher than 100 %, magnetization time may be reduced.
- Default value is depending on inverter type and its rating data.
- An excessive reduction of this time can result in insufficient motor magnetization.



<b>P0347[3]</b>	<b>Demagnetization time</b>	<b>Min:</b> 0.000	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 1.000	<b>3</b>
		<b>Max:</b> 20.000	

Defines the de-magnetization time for the connected induction motor.

The de-magnetization time is the time that must expire between powering-down the drive (OFF2 or a drive inverter fault/error) and powering-up again. The drive inverter is prevented from being powered-up again within this time interval. The flux in the induction motor is reduced to a low value during this de-magnetization time.

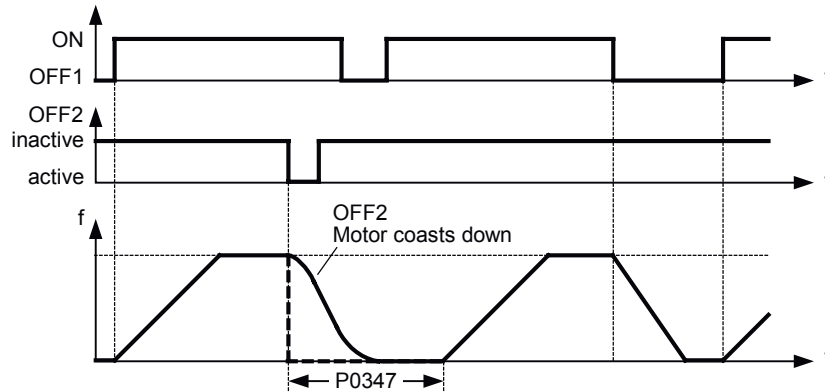

**Index:**

- P0347[0] : 1st. Drive data set (DDS)
- P0347[1] : 2nd. Drive data set (DDS)
- P0347[2] : 3rd. Drive data set (DDS)

**Note:**

- The de-magnetization time is approximately 250% of the rotor time constant (r0384) in seconds.
- The pre-assignment (default value) depends on the drive inverter type and its rated/nominal values.
- It is not active after a normal ramp-down - i.e. after OFF1 or OFF3.
- If this time is excessively shortened, then the drive inverter will be tripped (shut down) due to an overcurrent condition.
- If a synchronous motor is connected, the de-magnetization time should be set to 0.

<b>P0350[3]</b>	<b>Stator resistance (line-to-line)</b>	<b>Min:</b> 0.00001	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Ohm
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 4.00000	<b>2</b>
		<b>Max:</b> 2000.00000	

Stator resistance value in [Ohms] for connected motor (from line-to-line). The parameter value includes the cable resistance.

$$P0350 = 2 \cdot (R_{Cable} + R_S)$$

There are three ways to determine the value for this parameter:

1. Calculate using
  - P0340 = 1 (data entered from rating plate) or
  - P0010 = 1, P3900 = 1,2 or 3 (end of quick commissioning).
2. Measure using P1910 = 1 (motor data identification - value for stator resistance is overwritten).
3. Measure manually using an Ohmmeter.

**Index:**


- P0350[0] : 1st. Drive data set (DDS)
- P0350[1] : 2nd. Drive data set (DDS)
- P0350[2] : 3rd. Drive data set (DDS)

**Note:**

- Since measured line-to-line, this value may appear to be higher (up to 2 times higher) than expected.
- The value entered in P0350 (stator resistance) is the one obtained by the method last used.
- Default value is depending on inverter type and its rating data.

<b>P0352[3]</b>	<b>Cable resistance</b>	<b>Min:</b> 0.0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Ohm
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Describes cable resistance between inverter and motor for one phase.

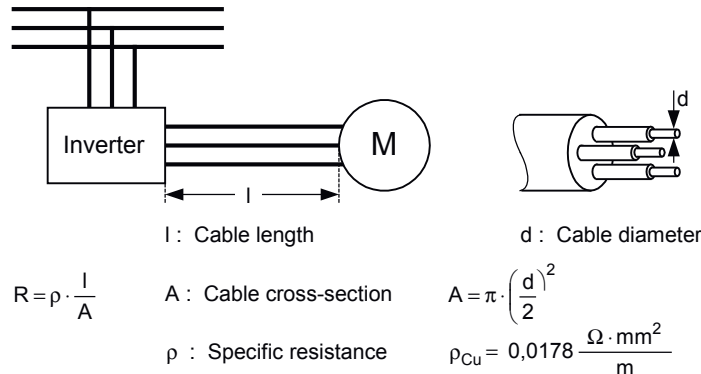

**Index:**

P0352[0] : 1st. Drive data set (DDS)  
P0352[1] : 2nd. Drive data set (DDS)  
P0352[2] : 3rd. Drive data set (DDS)

<b>P0354[3]</b>	<b>Rotor resistance</b>	<b>Min:</b> 0.0	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Ohm
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Sets rotor resistance of motor equivalent circuit (phase value).

**Index:**

P0354[0] : 1st. Drive data set (DDS)  
P0354[1] : 2nd. Drive data set (DDS)  
P0354[2] : 3rd. Drive data set (DDS)

**Dependency:**

Calculated automatically using the motor model or determined using P1910 (motor identification).

<b>P0356[3]</b>	<b>Stator leakage inductance</b>	<b>Min:</b> 0.00001	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> -
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Sets stator leakage inductance [mH] of motor equivalent circuit (phase value).

Stator leakage reactance:

$$X_{\sigma S} = \omega \cdot L_{\sigma S} = 2 \cdot \pi \cdot f \cdot L_{\sigma S} = 2 \cdot \pi \cdot P0310 \cdot \frac{P0356}{1000}$$

**Index:**

P0356[0] : 1st. Drive data set (DDS)  
P0356[1] : 2nd. Drive data set (DDS)  
P0356[2] : 3rd. Drive data set (DDS)

**Dependency:**

Calculated automatically using the motor model or determined using P1910 (motor identification).

<b>P0358[3]</b>	<b>Rotor leakage inductance</b>	<b>Min:</b> 0.0	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> -
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Sets rotor leakage inductance [mH] of motor equivalent circuit (phase value).

Rotor leakage reactance:

$$X_{\sigma R} = \omega \cdot L_{\sigma R} = 2 \cdot \pi \cdot f \cdot L_{\sigma R} = 2 \cdot \pi \cdot P0310 \cdot \frac{P0358}{1000}$$

**Index:**

P0358[0] : 1st. Drive data set (DDS)  
P0358[1] : 2nd. Drive data set (DDS)  
P0358[2] : 3rd. Drive data set (DDS)

**Dependency:**

Calculated automatically using the motor model or determined using P1910 (motor identification).

<b>P0360[3]</b>	<b>Main inductance</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> 0.0	<b>Level</b> <b>4</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 10.0	
	<b>P-Group:</b> MOTOR			<b>Max:</b> 3000.0	

Sets main inductance [mH] of the motor equivalent circuit (phase value), see diagram below.

Main reactance:

$$X_m = \omega \cdot L_m = 2 \cdot \pi \cdot f \cdot L_m = 2 \cdot \pi \cdot P0310 \cdot \frac{P0360}{1000}$$

**Index:**

- P0360[0] : 1st. Drive data set (DDS)
- P0360[1] : 2nd. Drive data set (DDS)
- P0360[2] : 3rd. Drive data set (DDS)

**Dependency:**

Calculated automatically using the motor model or determined using P1910 (motor identification).




**Caution:**


The data of equivalent circuit relates to the star equivalent circuit. Any data of the delta equivalent circuit available, therefore must be transformed to the star equivalent circuit before entering into the inverter.

**Note:**

**T-equivalent circuit :**

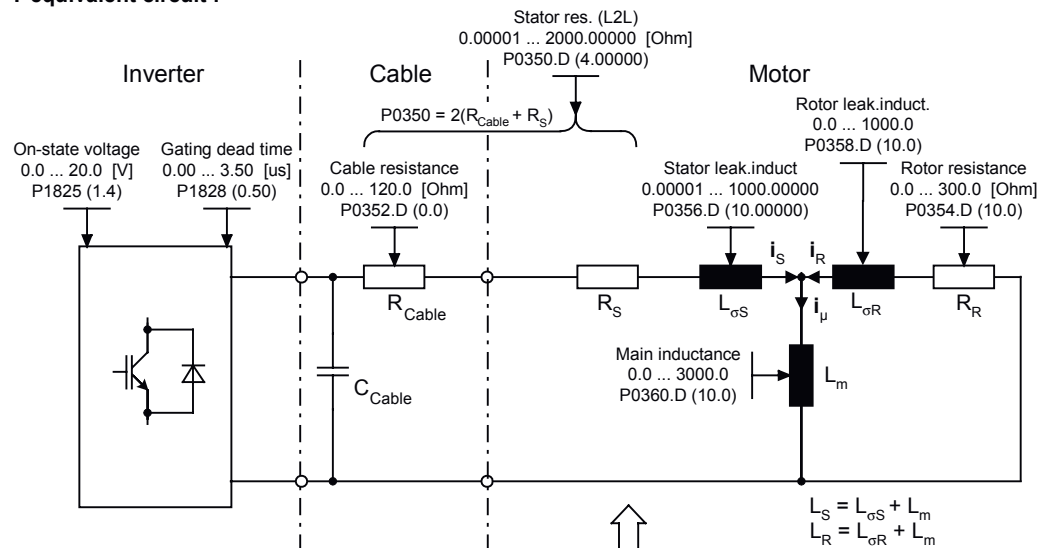

**Invers - Γ - equivalent circuit:**

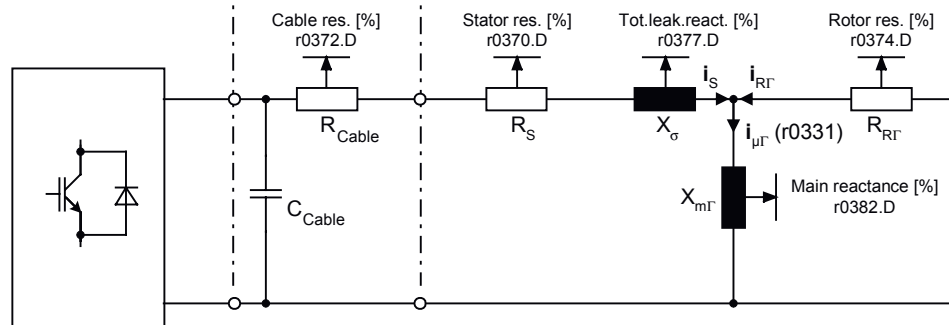

**Conversion: T-equivalent circuit --> Invers - Γ - equivalent circuit**

$$k_{\sigma R} = 1 + \frac{L_{\sigma R}}{L_m}$$

$$L_{m\Gamma} = \frac{L_m}{k_{\sigma R}}$$

$$R_{R\Gamma} = \frac{R_R}{k_{\sigma R}^2}$$

$$L_{\sigma} = L_{\sigma S} + \frac{L_{\sigma R}}{k_{\sigma R}}$$

**Conversion: Invers - Γ - equivalent circuit --> T-equivalent circuit**

$$k_{\sigma\Gamma} = 1 + (1 - k_{\sigma}) \cdot \frac{L_{\sigma}}{L_{m\Gamma}} = 1 + 0.5 \cdot \frac{L_{\sigma}}{L_{m\Gamma}}$$

$$R_R = R_{R\Gamma} \cdot k_{\sigma\Gamma}^2$$

$$L_{\sigma S} = k_{\sigma} \cdot L_{\sigma} = 0.5 \cdot L_{\sigma}$$

$$L_{\sigma R} = (1 - k_{\sigma}) \cdot L_{\sigma} \cdot k_{\sigma\Gamma} = 0.5 \cdot L_{\sigma} \cdot k_{\sigma\Gamma}$$


Rated motor impedance:

$$Z_N = \frac{V_{ph}}{I_{ph}} = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100 \%$$

<b>P0362[3]</b>	<b>Magnetizing curve flux 1</b>	<b>Min:</b> 0.0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Def:</b> 60.0
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 300.0	<b>4</b>

Specifies first flux value of saturation characteristic in [%] relative to rated motor voltage (P0304).

The parameter settings for the values of P0362 to P0365 respectively P0366 to P0369 are illustrated in the diagram below.

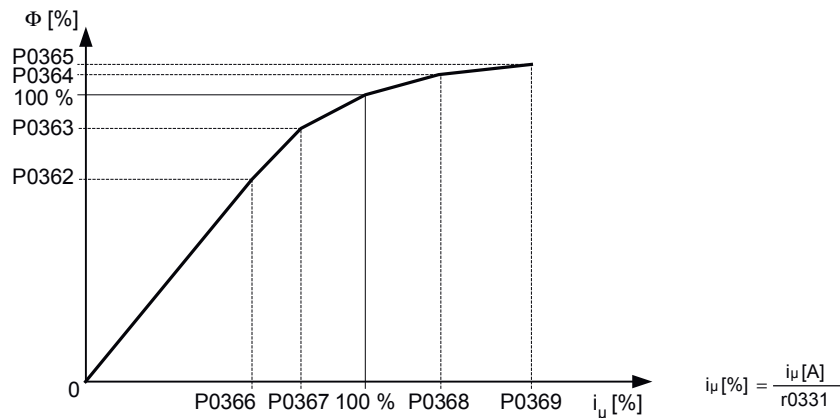

**Index:**

- P0362[0] : 1st. Drive data set (DDS)
- P0362[1] : 2nd. Drive data set (DDS)
- P0362[2] : 3rd. Drive data set (DDS)

**Note:**

- P0362 = 100 % corresponds to rated motor flux
- Rated flux = rated EMF
- The value belongs to the first magnetizing current value and must be smaller than or equal to magnetizing curve flux 2 (P0363).
- If the magnetization values entered in P0362 to P0365 respectively P0366 to P0369 do not match the conditions (see below), a linear characteristic is applied internally.
  - P0365 ≥ P0364 ≥ P0363 ≥ P0362
  - P0369 ≥ P0368 ≥ P0367 ≥ P0366

<b>P0363[3]</b>	<b>Magnetizing curve flux 2</b>				Level <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> 0.0	
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 85.0	
				<b>Max:</b> 300.0	

Specifies second flux value of saturation characteristic in [%] relative to rated motor voltage (P0304).

**Index:**

P0363[0] : 1st. Drive data set (DDS)  
P0363[1] : 2nd. Drive data set (DDS)  
P0363[2] : 3rd. Drive data set (DDS)

**Details:**

See P0362 (magnetizing curve flux 1).

<b>P0364[3]</b>	<b>Magnetizing curve flux 3</b>				Level <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> 0.0	
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 115.0	
				<b>Max:</b> 300.0	

Specifies third flux value of saturation characteristic in [%] relative to rated motor voltage (P0304).

**Index:**

P0364[0] : 1st. Drive data set (DDS)  
P0364[1] : 2nd. Drive data set (DDS)  
P0364[2] : 3rd. Drive data set (DDS)

**Details:**

See P0362 (magnetizing curve flux 1).

<b>P0365[3]</b>	<b>Magnetizing curve flux 4</b>				Level <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> 0.0	
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 125.0	
				<b>Max:</b> 300.0	

Specifies fourth flux value of saturation characteristic in [%] relative to rated motor voltage (P0304).

**Index:**

P0365[0] : 1st. Drive data set (DDS)  
P0365[1] : 2nd. Drive data set (DDS)  
P0365[2] : 3rd. Drive data set (DDS)

**Details:**

See P0362 (magnetizing curve flux 1).

<b>P0366[3]</b>	<b>Magnetizing curve imag 1</b>				Level <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> 0.0	
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 50.0	
				<b>Max:</b> 500.0	

Specifies first magnetizing current value of the saturation characteristic in [%] relative to the rated magnetizing current (P0331).

**Index:**

P0366[0] : 1st. Drive data set (DDS)  
P0366[1] : 2nd. Drive data set (DDS)  
P0366[2] : 3rd. Drive data set (DDS)

**Dependency:**

Affects P0320 (motor magnetizing current).

**Details:**

See P0362 (magnetizing curve flux 1).

<b>P0367[3]</b>	<b>Magnetizing curve imag 2</b>				Level <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> 0.0	
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 75.0	
				<b>Max:</b> 500.0	

Specifies second magnetizing current value of saturation characteristic in [%] relative to rated magnetizing current (P0331).

**Index:**

P0367[0] : 1st. Drive data set (DDS)  
P0367[1] : 2nd. Drive data set (DDS)  
P0367[2] : 3rd. Drive data set (DDS)

**Dependency:**

Affects P0320 (motor magnetizing current).

**Details:**

See P0362 (magnetizing curve flux 1).

<b>P0368[3]</b>	<b>Magnetizing curve imag 3</b>	<b>Min:</b> 0.0	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Def:</b> 135.0
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Specifies third magnetizing current value of saturation characteristic in [%] relative to rated magnetizing current (P0331).

**Index:**

P0368[0] : 1st. Drive data set (DDS)  
P0368[1] : 2nd. Drive data set (DDS)  
P0368[2] : 3rd. Drive data set (DDS)

**Dependency:**

Affects P0320 (motor magnetizing current).

**Details:**

See P0362 (magnetizing curve flux 1).

<b>P0369[3]</b>	<b>Magnetizing curve imag 4</b>	<b>Min:</b> 0.0	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Def:</b> 170.0
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Specifies fourth magnetizing current value of saturation characteristic in [%] relative to rated magnetizing current (P0331).

**Index:**

P0369[0] : 1st. Drive data set (DDS)  
P0369[1] : 2nd. Drive data set (DDS)  
P0369[2] : 3rd. Drive data set (DDS)

**Dependency:**

Affects P0320 (motor magnetizing current).

**Details:**

See P0362 (magnetizing curve flux 1).

<b>r0370[3]</b>	<b>Stator resistance [%]</b>	<b>Min:</b> -	<b>Level</b> <b>4</b>	
		<b>Datatype:</b> Float		<b>Def:</b> -
	<b>P-Group:</b> MOTOR	<b>Unit:</b> %		<b>Max:</b> -

Displays standardized stator resistance of motor equivalent circuit (phase value) in [%] of the temperature value in P0625.

**Index:**

r0370[0] : 1st. Drive data set (DDS)  
r0370[1] : 2nd. Drive data set (DDS)  
r0370[2] : 3rd. Drive data set (DDS)

**Note:**

Rated motor impedance:

$$Z_N = \frac{V_{ph}}{I_{ph}} = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100 \%$$

<b>r0372[3]</b>	<b>Cable resistance [%]</b>	<b>Min:</b> -	<b>Level</b> <b>4</b>	
		<b>Datatype:</b> Float		<b>Def:</b> -
	<b>P-Group:</b> MOTOR	<b>Unit:</b> %		<b>Max:</b> -

Displays standardized cable resistance of motor equivalent circuit (phase value) in [%]. It is estimated to be 20 % of the stator resistance.

**Index:**

r0372[0] : 1st. Drive data set (DDS)  
r0372[1] : 2nd. Drive data set (DDS)  
r0372[2] : 3rd. Drive data set (DDS)

**Note:**

Rated motor impedance:

$$Z_N = \frac{V_{ph}}{I_{ph}} = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100 \%$$

<b>r0373[3]</b>	<b>Rated stator resistance [%]</b>	<b>Min:</b> -	<b>Level</b> <b>4</b>	
		<b>Datatype:</b> Float		<b>Def:</b> -
	<b>P-Group:</b> MOTOR	<b>Unit:</b> %		<b>Max:</b> -

Displays the nominal stator resistance of the motor equivalent circuit diagram (phase value) as a [%] at the ambient temperature + temperature rise of the stator winding.

**Index:**

r0373[0] : 1st. Drive data set (DDS)  
r0373[1] : 2nd. Drive data set (DDS)  
r0373[2] : 3rd. Drive data set (DDS)

**Note:**

- ambient temperature, refer to P0625
  - temperature rise of the stator winding, refer to P0627
- Rated motor impedance:

$$Z_N = \frac{V_{ph}}{I_{ph}} = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100 \%$$

<b>r0374[3]</b>	<b>Rotor resistance [%]</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>4</b>
	<b>P-Group:</b> MOTOR				

Displays the rotor resistance of the motor equivalent circuit diagram (phase value) as a [%] at the ambient temperature (in the cold state).

$$r0374 = \frac{R_{RF}}{Z_N} \cdot 100\% = \frac{R_R}{k_{\sigma R} \cdot Z_N} \cdot 100\% = \frac{P0354 \cdot P0360^2}{Z_N(1+P0358)^2} \cdot 100\%$$

**Index:**

r0374[0] : 1st. Drive data set (DDS)  
r0374[1] : 2nd. Drive data set (DDS)  
r0374[2] : 3rd. Drive data set (DDS)

**Note:**

Ambient temperature, refer to P0625  
Rated motor impedance:

$$Z_N = \frac{V_{ph}}{I_{ph}} = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100\%$$

<b>r0376[3]</b>	<b>Rated rotor resistance [%]</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>4</b>
	<b>P-Group:</b> MOTOR				

Displays the nominal rotor resistance of the motor equivalent circuit diagram (phase value) as a [%] at the ambient temperature + temperature rise of the rotor winding.

**Index:**

r0376[0] : 1st. Drive data set (DDS)  
r0376[1] : 2nd. Drive data set (DDS)  
r0376[2] : 3rd. Drive data set (DDS)

**Note:**

- ambient temperature, refer to P0625  
- temperature rise of the rotor winding, refer to P0628  
Rated motor impedance:

$$Z_N = \frac{V_{ph}}{I_{ph}} = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100\%$$

<b>r0377[3]</b>	<b>Total leakage reactance [%]</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>4</b>
	<b>P-Group:</b> MOTOR				

Displays standardized total leakage reactance of the motor equivalent circuit (phase value) in [%].

$$r0377 = \frac{L_{\sigma}}{Z_N} \cdot 100\% = \frac{L_{\sigma S} + \frac{L_{\sigma R}}{k_{\sigma R}}}{Z_N} \cdot 100\% = \frac{P0356 + \frac{P0358 \cdot P0360}{P0358 + P0360}}{Z_N} \cdot 100\%$$

**Index:**

r0377[0] : 1st. Drive data set (DDS)  
r0377[1] : 2nd. Drive data set (DDS)  
r0377[2] : 3rd. Drive data set (DDS)

**Note:**

Rated motor impedance:

$$Z_N = \frac{V_{ph}}{I_{ph}} = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100\%$$

<b>r0382[3]</b>	<b>Main reactance [%]</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>4</b>
	<b>P-Group:</b> MOTOR				

Displays standardized main reactance of the motor equivalent circuit (phase value) in [%].

$$r0382 = \frac{L_{m\Gamma}}{Z_N} \cdot 100\% = \frac{L_m}{k_{\sigma R} \cdot Z_N} \cdot 100\% = \frac{P0360^2}{Z_N(P0360 + P0358)} \cdot 100\%$$

**Index:**

r0382[0] : 1st. Drive data set (DDS)  
r0382[1] : 2nd. Drive data set (DDS)  
r0382[2] : 3rd. Drive data set (DDS)

**Note:**

Rated motor impedance:

$$Z_N = \frac{V_{ph}}{I_{ph}} = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100\%$$

<b>r0384[3]</b>	<b>Rotor time constant</b>	<b>Datatype:</b> Float	<b>Unit:</b> ms	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>3</b>
	<b>P-Group:</b> MOTOR				

Displays calculated rotor time constant [ms].

**Index:**

r0384[0] : 1st. Drive data set (DDS)  
r0384[1] : 2nd. Drive data set (DDS)  
r0384[2] : 3rd. Drive data set (DDS)

<b>r0386[3]</b>	<b>Total leakage time constant</b>	<b>Datatype:</b> Float	<b>Unit:</b> ms	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>4</b>
	<b>P-Group:</b> MOTOR				

Displays total leakage time constant of motor.

**Index:**

r0386[0] : 1st. Drive data set (DDS)  
r0386[1] : 2nd. Drive data set (DDS)  
r0386[2] : 3rd. Drive data set (DDS)

<b>r0394</b>	<b>CO: Stator resistance IGBT [%]</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>4</b>
	<b>P-Group:</b> MOTOR				

Displays stator resistance calculated in [%] from IGBT ON voltage and current amplitude.

**Note:**

Rated motor impedance:

$$Z_N = \frac{V_{ph}}{I_{ph}} = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100 \%$$

<b>r0395</b>	<b>CO: Total stator resistance [%]</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>3</b>
	<b>P-Group:</b> MOTOR				

Displays the actual stator resistance (combined stator/cable resistance) of the motor as a [%] as a function of the actual stator winding temperature.

**Note:**

Actual stator winding temperature, refer to r0632

Rated motor impedance:

$$Z_N = \frac{V_{ph}}{I_{ph}} = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100 \%$$

<b>r0396</b>	<b>CO: Act. rotor resistance</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	Level <b>3</b>
	<b>P-Group:</b> MOTOR				

Displays the actual rotor resistance of the motor equivalent circuit diagram (phase value) as a [%] as a function of the actual rotor winding temperature.

**Note:**

- Actual rotor winding temperature, refer to r0633
- Values greater than 25 % tend to produce excessive motor slip. Check rated motor speed [rpm] value (P0311).

Rated motor impedance:

$$Z_N = \frac{V_{ph}}{I_{ph}} = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100 \%$$



### 3.5 Speed encoder

<b>P0400[3]</b>	<b>Select encoder type</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> ENCODER	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 0		
		<b>Max:</b> 2		

Selects encoder type (number of encoder channels).

**Possible Settings:**

- 0 Disabled
- 1 Single channel encoder
- 2 Quadrature encoder without zero pulse

**Index:**

- P0400[0] : 1st. Drive data set (DDS)
- P0400[1] : 2nd. Drive data set (DDS)
- P0400[2] : 3rd. Drive data set (DDS)

**Dependency:**

Following table displays the setting of P0400 which depends upon the number of encoder channels:

Parameter	Terminal	Track	Encoder output
P0400 = 1	A		single ended
	A AN		differential
P0400 = 2	A		single ended
	B		
	A AN		differential
	B BN		

Following table displays the setting the of the encoder DIPs on the encoder option modul which have to be set depending on the encoder type (TTL, HTL) and encoder output:

Type	Output	
	single ended	differential
TTL (e.g. 1XP8001-2)	111111	010101
HTL (e.g. 1XP8001-1)	101010	000000



**Caution:**

When using Vector Control with encoder-feedback , the direction of rotation of the Encoder and Motor must be the same. If this is not achieved, then the functional operation of the Vector Control will not be guaranteed (positive instead of negative feedback). Extreme care must therefore be taken with respect to the connection of the motor to the inverter as well as the correct connection of the encoder to the Encoder module. Motor and Encoder must not be incorrectly wired up !

When commissioning Vector Control with encoder-feedback (VC), the drive should be configured for V/f mode (see P1300) first. Run the drive and compare r0061 with r0021 that should agree in

- sign and
- magnitude (with a deviation of only a few percent).

Only if both criteria are fulfilled, change P1300 and select VC (P1300 = 21 or 23).

P0400 = 1 (single channel encoder) will only allow operation in one direction. If operation in both directions is required, connect an encoder with 2 channels (A and B) and select setting 2. See the Operating Instructions of the encoder module for more information.

**Note:**

Encoders with zero pulse can also be connected, but the zero pulse is not used in MM4.

The term "quadrature" in setting 2 refers to two periodic functions separated by a quarter cycle or 90 degrees.

<b>r0403</b>	<b>CO/BO: Encoder status word</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> COMMANDS	<b>Max:</b> -	

Displays status word of encoder (in bit format).

**Bitfields:**

Bit00	Encoder module active	0	NO	1	YES
Bit01	Encoder error	0	NO	1	YES
Bit02	Signal o.k.	0	NO	1	YES
Bit03	Encoder low speed loss	0	NO	1	YES
Bit04	HW timer used	0	NO	1	YES

**Details:**

See description of seven-segment display given in the "Introduction to MICROMASTER System Parameters" in this manual.

<b>P0408[3]</b>	<b>Encoder pulses per revolution</b>	<b>Min:</b> 2	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT <b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> 1024	
	<b>P-Group:</b> ENCODER <b>Active:</b> Immediately <b>QuickComm.:</b> No	<b>Max:</b> 20000	

Specifies the number of encoder pulses per revolution.

**Index:**

- P0408[0] : 1st. Drive data set (DDS)
- P0408[1] : 2nd. Drive data set (DDS)
- P0408[2] : 3rd. Drive data set (DDS)

**Note:**

The encoder resolution (pulses per revolution P0408) which may be entered will be limited by the max. pulse frequency of the encoder option board (f\_max = 300 kHz).

The following equation calculates the encoder frequency depending on the encoder resolution and the rotational speed (rpm). The encoder frequency has to be less than the max. pulse frequency:

$$f_{\max} > f = \frac{p0408 \times \text{rpm}}{60}$$

<b>P0491[3]</b>	<b>Reaction on freq. signal loss</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT <b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> ENCODER <b>Active:</b> first confirm <b>QuickComm.:</b> No	<b>Max:</b> 1	

Selects reaction on loss of frequency signal.

**Possible Settings:**

- 0 Do not change to SLVC
- 1 Change to SLVC

**Index:**

- P0491[0] : 1st. Drive data set (DDS)
- P0491[1] : 2nd. Drive data set (DDS)
- P0491[2] : 3rd. Drive data set (DDS)

<b>P0492[3]</b>	<b>Allowed frequency difference</b>	<b>Min:</b> 0.00	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT <b>Datatype:</b> Float <b>Unit:</b> Hz	<b>Def:</b> 10.00	
	<b>P-Group:</b> ENCODER <b>Active:</b> Immediately <b>QuickComm.:</b> No	<b>Max:</b> 100.00	

Parameter P0492 is used for low and high frequency encoder loss detection (fault: F0090).

1. High frequency encoder loss detection:  
This condition occurs when the allowed frequency and the allowed difference of the frequency signals between samples, set in P0492 is exceeded.  
Condition:  
- Act. freq. > P0492 and f(t\_2) - f(t\_1) > P0492
2. Low frequency encoder loss detection:  
This condition occurs when the actual frequency is < P0492 when encoder loss occurs.  
Condition a):  
- r0061 = 0 and torque limit and then  
- r0061 = 0 with setpoint frequency > 0 for time > P0494  
Condition b):  
- Act. freq. < P0492 and f(t\_2) < P0492 and ASIC detect channel B loss

**Dependency:**

This parameter is updated when motor start-up time P0345 is changed or when a frequency-loop optimisation is performed (P1960 = 1). There is a fixed delay of 40 ms before acting upon loss of encoder at high frequencies.



**Caution:**

P0492 = 0 (disabled):  
When allowed frequency difference is set to 0, both the high frequency and low frequency encoder loss detection is disabled, thus encoder loss will not be detected.

If encoder loss detection is disabled and encoder loss occurs, then operation of the motor may become unstable.

<b>P0494[3]</b>	<b>Delay frequency loss reaction</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Def:</b> 10		
	<b>P-Group:</b> ENCODER	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 65000		

Used for low frequency encoder loss detection. If the motor shaft frequency is less than the value in P0492 then encoder loss is detected using a low frequency encoder loss detection algorithm. This parameter selects the delay between loss of encoder at low frequency and reaction to the encoder loss.

**Index:**

P0494[0] : 1st. Drive data set (DDS)  
P0494[1] : 2nd. Drive data set (DDS)  
P0494[2] : 3rd. Drive data set (DDS)

**Dependency:**

This parameter is updated when motor start-up time P0345 is changed or when a frequency-loop optimisation is performed (P1960 = 1).



**Caution:**

P0494 = 0 (disabled):  
When the delay in P0494 is set to 0, then low frequency encoder loss detection is disabled and low frequency encoder loss cannot be detected (high frequency encoder loss detection will still operate if P0492 > 0).

If low frequency encoder loss detection is disabled and encoder should be lost at low frequency, then operation of motor may become unstable.

### 3.6 Application macros

<b>P0500[3]</b>	<b>Technological application</b>				<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> TECH_APL	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes	<b>Max:</b> 3		

Selects technological application. Sets control mode (P1300).

**Possible Settings:**

0 Constant torque  
1 Pumps and fans  
3 Simple Positioning

**Index:**

P0500[0] : 1st. Drive data set (DDS)  
P0500[1] : 2nd. Drive data set (DDS)  
P0500[2] : 3rd. Drive data set (DDS)

**Dependency:**

See parameter P0205

### 3.7 Motor temperature

<b>P0601[3]</b>	<b>Motor temperature sensor</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 2		

Selects motor temperature sensor.

**Possible Settings:**

0 No sensor  
1 PTC thermistor  
2 KTY84


**Index:**

P0601[0] : 1st. Drive data set (DDS)  
P0601[1] : 2nd. Drive data set (DDS)  
P0601[2] : 3rd. Drive data set (DDS)

**Dependency:**

If "no sensor" is selected, the motor temperature monitoring will be done based on the estimated value of the thermal motor model.

The temperature of the motor, when a thermal sensor is connected is calculated using the thermal motor model. When a KTY sensor is fitted, the loss of connection can be detected (Alarm F0015). Using the methods described above the monitoring of the temperature will automatically switch to the thermal model using values derived from the estimated value. Using a PTC sensor the temperature of the motor is calculated by the sensor in conjunction with the thermal model. This allows for redundancy of the monitoring process.

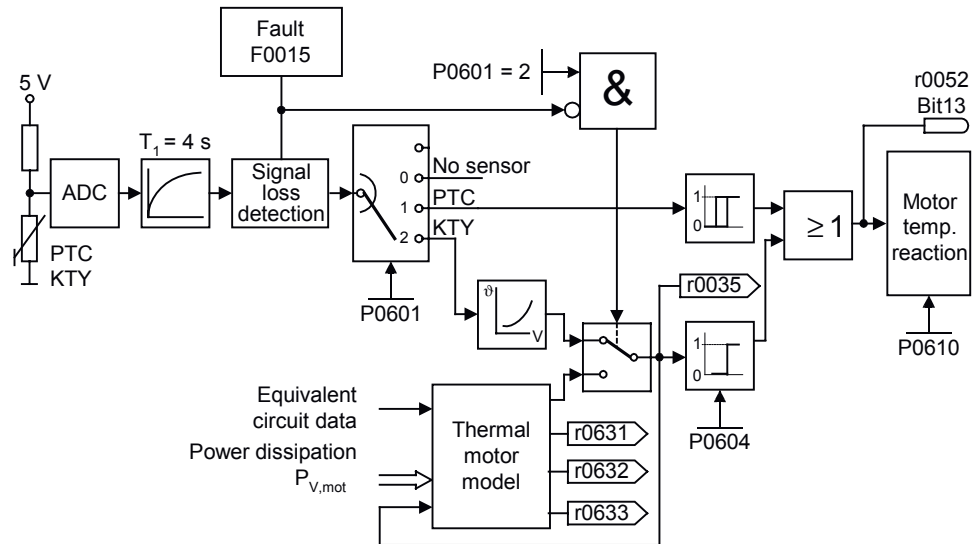

#### Thermal motor model:

The data, required for the thermal motor model, is estimated from the rating plate data entered during the quick commissioning. This data permits reliable, stable operation for standard Siemens motors. If required, parameter changes must be made for motors from third-party manufacturers. We always recommend that an automatic motor data identification run is made after quick commissioning so that the electrical equivalent circuit diagram data can be determined. This allows a more precise calculation of the losses which occur in the motor which has a positive impact on the accuracy of the thermal motor model.

#### PTC sensor:

A PTC temperature sensor (Positive-Temperature-Characteristic) is a resistor with a positive temperature characteristic which, at normal temperatures, has a low resistance value ( 50-100 Ohm). Normally, three PTC temperature sensors are connected in series in the motor (depending on the motor manufacturer), thus producing a "cold resistance value" ranging from 150 to 300 Ohm. PTC temperature sensors are also frequently referred to as cold conductors.

However, at a certain threshold temperature, the resistance rises rapidly. The threshold temperature is selected by the motor manufacturer in such a way that it corresponds to the nominal temperature value of the motor insulation. This allows the change in the resistance value to be deployed to protect the motor, as the PTCs are embedded in the motor windings. PTC temperature sensors are not suitable for measuring temperature.

When the PTC is connected to the control terminals 14 and 15 of the MM4. Once the selection motor temperature sensor has been activated by the setting P0601 = 1 (PTC sensor), the PTC temperature sensor then protects the motor by means of the trip device in the MM4.

Should the resistance value of 2000 Ohm be exceeded, the inverter displays error F0001 (motor overheating).

If the resistance value is below 100 Ohm, the error F0015 (no motor temperature signal) is then output.

This protects the motor from overheating and also from a sensor wire breakage.

The motor is additionally monitored by the thermal motor model in the inverter, thus providing a redundant system for monitoring the motor.

#### KTY84 sensor:

The sensor KTY84 is basically a semi-conductor thermo-sensor (diode), the resistance value of which varies from some 500 Ohm at 0°C to 2600 Ohm at 300°C. It has a positive temperature coefficient and, in contrast to the PTCs, has an almost linear temperature characteristic. The resistor behaviour is comparable to that of a measuring resistor with a very high temperature coefficient.

Note the following when connecting the polarity. Connect the sensor so that the diode is polarized in the operative direction. That means that the anode needs to be connected to terminal 14 = PTC A (+) and the cathode to terminal 15 = PTC B (-).

If the temperature monitoring function is activated with the setting P0601 = 2, the temperature of the sensor (thus that of the motor windings) is then written to parameter r0035.

The motor overheating warning threshold needs to be assigned with parameter P0604 (the works setting is 130°C). This warning threshold depends on the motor's thermal class. Also refer to the table below in this context.

Extract of IEC 85	
Insulation class	End temperature
Y	90 °C
A	105 °C
E	120 °C
B	130 °C
F	155 °C
H	180 °C

The motor overheating disturbance threshold is automatically set by the inverter at 10% higher than the temperature declared in parameter P0604.

If the sensor KTY84 is activated, the motor temperature is then additionally calculated via the thermal motor model. Should the sensor KTY84 recognise a wire breakage, an alarm F0015 (loss of the motor temperature signal) is then generated and the thermal motor model is automatically switched to.

Connection failure:

If the connection to the PTC or KTY84 sensor becomes open circuit or short circuit, a fault will be indicated, and by default the drive will trip.

<b>P0604[3]</b>	<b>Threshold motor temperature</b>	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> °C
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 130.0		<b>Max:</b> 200.0

Enters warning threshold for motor temperature protection.

The trip temperature defined always 10 % higher than the warning level P0604. When act. motor temperature exceeds trip temperature than inverter trip as defined in P0610.

$$\vartheta_{\text{trip}} = 1.1 \cdot \vartheta_{\text{warn}} = 1.1 \cdot P0604 \quad \vartheta_{\text{warn}} : \text{Warning threshold (P0604)}$$

$$\vartheta_{\text{trip}} : \text{Trip threshold (max. permissible temperature)}$$

**Index:**

P0604[0] : 1st. Drive data set (DDS)  
P0604[1] : 2nd. Drive data set (DDS)  
P0604[2] : 3rd. Drive data set (DDS)

**Dependency:**

This value should be at least 40°C greater than the motor ambient temperature P0625.  
 $P0604 \geq P0625 + 40 \text{ °C}$

**Note:**

Default value depends on P0300 (select motor type).

<b>P0610[3]</b>	<b>Motor temperature reaction</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 2		<b>Max:</b> 2

Defines reaction when motor temperature reaches warning threshold.

**Possible Settings:**

- 0 Warning, no reaction, no trip
- 1 Warning, I<sub>max</sub> reduction, trip F0011
- 2 Warning, no reaction, trip F0011

**Index:**

P0610[0] : 1st. Drive data set (DDS)  
P0610[1] : 2nd. Drive data set (DDS)  
P0610[2] : 3rd. Drive data set (DDS)

**Dependency:**

$$\vartheta_{\text{trip}} = 1.1 \cdot \vartheta_{\text{warn}} = 1.1 \cdot P0604 \quad \vartheta_{\text{warn}} : \text{Warning threshold (P0604)}$$

$$\vartheta_{\text{trip}} : \text{Trip threshold (max. permissible temperature)}$$

**Note:**


P0610 = 1:  
If the max. permissible current I<sub>max</sub> is reduced, this results in a lower output frequency.

The motor temperature depends on many factors. These factors include the size of the motor, the ambient temperature, the previous motor load and naturally the load current.

Because most motors are cooled by fans integrated in the motor and running at the motor speed, the speed of the motor is also important. Clearly a motor running with a high current (maybe due to boost) and a low speed, will overheat more quickly than one running at 50 or 60 Hz, full load. The MM4 take account of these factors.

<b>P0625[3]</b>	<b>Ambient motor temperature</b>				<b>Min:</b> -40.0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> °C	<b>Def:</b> 20.0	<b>3</b>	
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 80.0		

Ambient temperature of motor. The parameter for the stator resistance P0350 and rotor resistance P0354 relate to the ambient temperature.

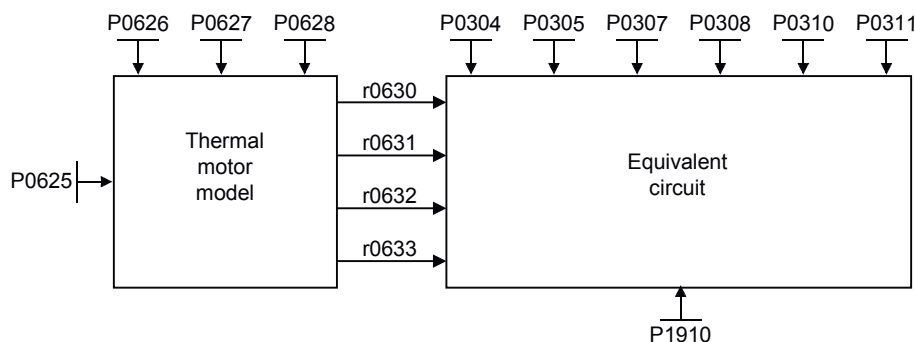

**Index:**

- P0625[0] : 1st. Drive data set (DDS)
- P0625[1] : 2nd. Drive data set (DDS)
- P0625[2] : 3rd. Drive data set (DDS)

**Note:**

- Following items should be considered when using P0625:
- The ambient temperature has to be entered prior to motor data identification.
  - An accuracy of +/- 5°C is adequate.
  - The motor data identification should be carried out on a cold motor (ambient temperature = stator temperature = rotor temperature).
  - The highest accuracy at temperature adaption of the stator resistance and rotor resistance can be achieved by connecting a KTY84 sensor.

<b>P0626[3]</b>	<b>Overtemperature stator iron</b>				<b>Min:</b> 20.0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> °C	<b>Def:</b> 50.0	<b>4</b>	
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.0		

Overtemperature of stator iron.

**Index:**

- P0626[0] : 1st. Drive data set (DDS)
- P0626[1] : 2nd. Drive data set (DDS)
- P0626[2] : 3rd. Drive data set (DDS)

**Note:**

See parameter P0627

<b>P0627[3]</b>	<b>Overtemperature stator winding</b>			<b>Min:</b> 20.0	Level <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> °C	<b>Def:</b> 80.0	
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.0	

Overtemperature of the stator winding.

**Index:**

P0627[0] : 1st. Drive data set (DDS)  
P0627[1] : 2nd. Drive data set (DDS)  
P0627[2] : 3rd. Drive data set (DDS)

**Note:**

Temperature rise:

The losses occurring in the motor are converted into heat (thermal energy). This is the reason that permissible limit temperature rises are defined for windings and other mechanical parts and components of the motors. The temperature rise of the motor is defined as the difference between the temperature of a motor component (e.g. rotor winding) and the temperature of the cooling medium (e.g. ambient air temperature) (EN 60034-1). The temperature rise determined by the motor manufacturer by making the appropriate measurements is the difference between the temperature of the winding at the end of the measurement and the temperature of the cooling medium.

$$\vartheta_u = \vartheta_2 - \vartheta_K$$

$\vartheta_u$  : Temperature rise  
 $\vartheta_2$  : Temperature at the end of the measurement  
 $\vartheta_K$  : Cooling-medium temperature

The permissible temperature rises of the windings is classified in insulating classes. The insulating class valid for the particular motor is specified on the motor rating plate.

The following points should be carefully observed:

- The temperature rises of the stator/rotor winding are only applicable for sinusoidal operation (basic fundamental).
- The temperature of stator/rotor winding rises when the motor is fed with a sinusoidal voltage as well as also losses (modulation losses, losses due to harmonics) caused as a result of drive converter operation.
- The value may only be modified if the motor is in the cold condition (ambient temperature). The motor identification run should be carried-out after the value has been changed.

<b>P0628[3]</b>	<b>Overtemperature rotor winding</b>			<b>Min:</b> 20.0	Level <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> °C	<b>Def:</b> 100.0	
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.0	

Overtemperature of the rotor winding.

**Index:**

P0628[0] : 1st. Drive data set (DDS)  
P0628[1] : 2nd. Drive data set (DDS)  
P0628[2] : 3rd. Drive data set (DDS)

**Note:**

See parameter P0627

<b>r0630[3]</b>	<b>CO: Ambient temperature</b>			<b>Min:</b> -	Level <b>4</b>
		<b>Datatype:</b> Float	<b>Unit:</b> °C	<b>Def:</b> -	
	<b>P-Group:</b> MOTOR			<b>Max:</b> -	

Displays ambient temperature of motor mass model.

**Index:**

r0630[0] : 1st. Drive data set (DDS)  
r0630[1] : 2nd. Drive data set (DDS)  
r0630[2] : 3rd. Drive data set (DDS)

<b>r0631[3]</b>	<b>CO: Stator iron temperature</b>			<b>Min:</b> -	Level <b>4</b>
		<b>Datatype:</b> Float	<b>Unit:</b> °C	<b>Def:</b> -	
	<b>P-Group:</b> MOTOR			<b>Max:</b> -	

Displays iron temperature of motor mass model.

**Index:**

r0631[0] : 1st. Drive data set (DDS)  
r0631[1] : 2nd. Drive data set (DDS)  
r0631[2] : 3rd. Drive data set (DDS)

<b>r0632[3]</b>	<b>CO: Stator winding temperature</b>			<b>Min:</b> -	Level <b>4</b>
		<b>Datatype:</b> Float	<b>Unit:</b> °C	<b>Def:</b> -	
	<b>P-Group:</b> MOTOR			<b>Max:</b> -	

Displays stator winding temperature of motor mass model.

**Index:**

r0632[0] : 1st. Drive data set (DDS)  
r0632[1] : 2nd. Drive data set (DDS)  
r0632[2] : 3rd. Drive data set (DDS)



<b>r0633[3]</b>	<b>CO: Rotor winding temperature</b>	<b>Datatype:</b> Float	<b>Unit:</b> °C	<b>Min:</b> -	Level <b>4</b>
	<b>P-Group:</b> MOTOR			<b>Def:</b> - <b>Max:</b> -	

Displays rotor winding temperature of motor mass model.

**Index:**

r0633[0] : 1st. Drive data set (DDS)  
r0633[1] : 2nd. Drive data set (DDS)  
r0633[2] : 3rd. Drive data set (DDS)

<b>P0640[3]</b>	<b>Motor overload factor [%]</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> 10.0	Level <b>2</b>
	<b>CStat:</b> CUT			<b>Def:</b> 150.0	
	<b>P-Group:</b> MOTOR	<b>Active:</b> Immediately	<b>QuickComm.:</b> Yes	<b>Max:</b> 400.0	

Defines motor overload current limit in [%] relative to P0305 (rated motor current).

**Index:**

P0640[0] : 1st. Drive data set (DDS)  
P0640[1] : 2nd. Drive data set (DDS)  
P0640[2] : 3rd. Drive data set (DDS)

**Dependency:**

Limited to maximum inverter current or to 400 % of rated motor current (P0305), whichever is the lower.

$$P0640_{\max} = \frac{\min(r0209, 4 \cdot P0305)}{P0305} \cdot 100$$

**Details:**

See function diagram for current limitation.



### 3.8 Command source

<b>P0700[3]</b>	<b>Selection of command source</b>				<b>Min:</b> 0	<b>Level</b> <b>1</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 2		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes	<b>Max:</b> 6		

Selects digital command source.

**Possible Settings:**


- 0 Factory default setting
- 1 BOP (keypad)
- 2 Terminal
- 4 USS on BOP link
- 5 USS on COM link
- 6 CB on COM link

**Index:**

- P0700[0] : 1st. Command data set (CDS)
- P0700[1] : 2nd. Command data set (CDS)
- P0700[2] : 3rd. Command data set (CDS)

**Example:**

Changing from P0700 = 1 to P0700 = 2 sets all digital inputs to default settings.

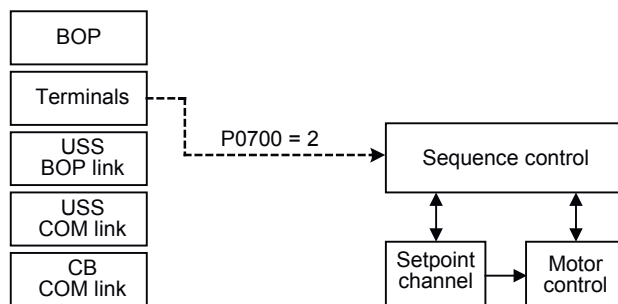

**Caution:**

Be aware, by changing of parameter P0700 all BI parameters are reset to the default value or modified as listed in the table below.

If the Inverter is being controlled via the AOP, select USS (with the corresponding interface) for the Command Source. If the AOP is connected to the BOP-Link Interface, then set Parameter P0700 to the value 4 (P0700 = 4).

**Note:**

Changing this parameter sets (to default) all settings on item selected (see table).

	<b>P0700 = 0</b>	<b>P0700 = 1</b>	<b>P0700 = 2</b>	<b>P0700 = 4</b>	<b>P0700 = 5</b>	<b>P0700 = 6</b>
P0701	1	0	1	0	0	0
P0702	12	0	12	0	0	0
P0703	9	9	9	9	9	9
P0704	15	15	15	15	15	15
P0705	15	15	15	15	15	15
P0706	15	15	15	15	15	15
P0707	0	0	0	0	0	0
P0708	0	0	0	0	0	0
P0731	52.3	52.3	52.3	52.3	52.3	52.3
P0732	52.7	52.7	52.7	52.7	52.7	52.7
P0733	0.0	0.0	0.0	0.0	0.0	0.0
P0800	0.0	0.0	0.0	0.0	0.0	0.0
P0801	0.0	0.0	0.0	0.0	0.0	0.0

P0840	722.0	19.0	722.0	2032.0	2036.0	2090.0
P0842	0.0	0.0	0.0	0.0	0.0	0.0
P0844	1.0	19.1	1.0	2032.1	2036.1	2090.1
P0845	19.1	19.1	19.1	19.1	19.1	19.1
P0848	1.0	1.0	1.0	2032.2	2036.2	2090.2
P0849	1.0	1.0	1.0	1.0	1.0	1.0
P0852	1.0	1.0	1.0	2032.3	2036.3	2090.3

	P0700 = 0	P0700 = 1	P0700 = 2	P0700 = 4	P0700 = 5	P0700 = 6
P1020	0.0	0.0	0.0	0.0	0.0	0.0
P1021	0.0	0.0	0.0	0.0	0.0	0.0
P1022	0.0	0.0	0.0	0.0	0.0	0.0
P1023	722.3	722.3	722.3	722.3	722.3	722.3
P1026	722.4	722.4	722.4	722.4	722.4	722.4
P1028	722.5	722.5	722.5	722.5	722.5	722.5
P1035	19.13	19.13	19.13	2032.13	2036.13	2090.13
P1036	19.14	19.14	19.14	2032.14	2036.14	2090.14
P1055	0.0	19.8	0.0	2032.8	2036.8	2090.8
P1056	0.0	0.0	0.0	2032.9	2036.9	2090.9
P1074	0.0	0.0	0.0	0.0	0.0	0.0
P1110	0.0	0.0	0.0	0.0	0.0	0.0
P1113	722.1	19.11	722.1	2032.11	2036.11	2090.11
P1124	0.0	0.0	0.0	0.0	0.0	0.0
P1140	1.0	1.0	1.0	2032.4	2036.4	2090.4
P1141	1.0	1.0	1.0	2032.5	2036.5	2090.5
P1142	1.0	1.0	1.0	2032.6	2036.6	2090.6
P1230	0.0	0.0	0.0	0.0	0.0	0.0

P1477	0.0	0.0	0.0	0.0	0.0	0.0
P1501	0.0	0.0	0.0	0.0	0.0	0.0

P2103	722.2	722.2	722.2	722.2	722.2	722.2
P2104	0.0	0.0	0.0	2032.7	2036.7	2090.7
P2106	1.0	1.0	1.0	1.0	1.0	1.0

P2200	0.0	0.0	0.0	0.0	0.0	0.0
P2220	0.0	0.0	0.0	0.0	0.0	0.0
P2221	0.0	0.0	0.0	0.0	0.0	0.0
P2222	0.0	0.0	0.0	0.0	0.0	0.0
P2223	722.3	722.3	722.3	722.3	722.3	722.3
P2226	722.4	722.4	722.4	722.4	722.4	722.4
P2228	722.5	722.5	722.5	722.5	722.5	722.5
P2235	19.13	19.13	19.13	2032.13	2036.13	2090.13
P2236	19.14	19.14	19.14	2032.14	2036.14	2090.14

The following parameters are not overwritten when changing P0700:

P0810	P0811	P0820	P0821	P2810	P2812	P2814
P2816	P2818	P2820	P2822	P2824	P2826	P2828
P2830	P2832	P2834	P2837	P2840	P2843	P2846
P2849	P2854	P2859	P2864			



<b>P0702[3]</b>	<b>Function of digital input 2</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 12		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 99		

Selects function of digital input 2.

**Possible Settings:**

- 0 Digital input disabled
- 1 ON/OFF1
- 2 ON reverse /OFF1
- 3 OFF2 - coast to standstill
- 4 OFF3 - quick ramp-down
- 9 Fault acknowledge
- 10 JOG right
- 11 JOG left
- 12 Reverse
- 13 MOP up (increase frequency)
- 14 MOP down (decrease frequency)
- 15 Fixed setpoint (Direct selection)
- 16 Fixed setpoint (Direct selection + ON)
- 17 Fixed setpoint (Binary coded selection + ON)
- 25 DC brake enable
- 29 External trip
- 33 Disable additional freq setpoint
- 99 Enable BICO parameterization

**Index:**

- P0702[0] : 1st. Command data set (CDS)
- P0702[1] : 2nd. Command data set (CDS)
- P0702[2] : 3rd. Command data set (CDS)

**Details:**

See P0701 (function of digital input1).

<b>P0703[3]</b>	<b>Function of digital input 3</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 9		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 99		

Selects function of digital input 3.

**Possible Settings:**

- 0 Digital input disabled
- 1 ON/OFF1
- 2 ON reverse /OFF1
- 3 OFF2 - coast to standstill
- 4 OFF3 - quick ramp-down
- 9 Fault acknowledge
- 10 JOG right
- 11 JOG left
- 12 Reverse
- 13 MOP up (increase frequency)
- 14 MOP down (decrease frequency)
- 15 Fixed setpoint (Direct selection)
- 16 Fixed setpoint (Direct selection + ON)
- 17 Fixed setpoint (Binary coded selection + ON)
- 25 DC brake enable
- 29 External trip
- 33 Disable additional freq setpoint
- 99 Enable BICO parameterization

**Index:**

- P0703[0] : 1st. Command data set (CDS)
- P0703[1] : 2nd. Command data set (CDS)
- P0703[2] : 3rd. Command data set (CDS)

**Details:**

See P0701 (function of digital input 1).

<b>P0704[3]</b>	<b>Function of digital input 4</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 15		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 99		

Selects function of digital input 4.

**Possible Settings:**

- 0 Digital input disabled
- 1 ON/OFF1
- 2 ON reverse /OFF1
- 3 OFF2 - coast to standstill
- 4 OFF3 - quick ramp-down
- 9 Fault acknowledge
- 10 JOG right
- 11 JOG left
- 12 Reverse
- 13 MOP up (increase frequency)
- 14 MOP down (decrease frequency)
- 15 Fixed setpoint (Direct selection)
- 16 Fixed setpoint (Direct selection + ON)
- 17 Fixed setpoint (Binary coded selection + ON)
- 25 DC brake enable
- 29 External trip
- 33 Disable additional freq setpoint
- 99 Enable BICO parameterization

**Index:**

- P0704[0] : 1st. Command data set (CDS)
- P0704[1] : 2nd. Command data set (CDS)
- P0704[2] : 3rd. Command data set (CDS)

**Details:**

See P0701 (function of digital input 1).

<b>P0705[3]</b>	<b>Function of digital input 5</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 15		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 99		

Selects function of digital input 5.

**Possible Settings:**

- 0 Digital input disabled
- 1 ON/OFF1
- 2 ON reverse /OFF1
- 3 OFF2 - coast to standstill
- 4 OFF3 - quick ramp-down
- 9 Fault acknowledge
- 10 JOG right
- 11 JOG left
- 12 Reverse
- 13 MOP up (increase frequency)
- 14 MOP down (decrease frequency)
- 15 Fixed setpoint (Direct selection)
- 16 Fixed setpoint (Direct selection + ON)
- 17 Fixed setpoint (Binary coded selection + ON)
- 25 DC brake enable
- 29 External trip
- 33 Disable additional freq setpoint
- 99 Enable BICO parameterization

**Index:**

- P0705[0] : 1st. Command data set (CDS)
- P0705[1] : 2nd. Command data set (CDS)
- P0705[2] : 3rd. Command data set (CDS)

**Details:**

See P0701 (function of digital input 1).

<b>P0706[3]</b>	<b>Function of digital input 6</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 15		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 99		

Selects function of digital input 6.

**Possible Settings:**

- 0 Digital input disabled
- 1 ON/OFF1
- 2 ON reverse /OFF1
- 3 OFF2 - coast to standstill
- 4 OFF3 - quick ramp-down
- 9 Fault acknowledge
- 10 JOG right
- 11 JOG left
- 12 Reverse
- 13 MOP up (increase frequency)
- 14 MOP down (decrease frequency)
- 15 Fixed setpoint (Direct selection)
- 16 Fixed setpoint (Direct selection + ON)
- 17 Fixed setpoint (Binary coded selection + ON)
- 25 DC brake enable
- 29 External trip
- 33 Disable additional freq setpoint
- 99 Enable BICO parameterization

**Index:**

- P0706[0] : 1st. Command data set (CDS)
- P0706[1] : 2nd. Command data set (CDS)
- P0706[2] : 3rd. Command data set (CDS)

**Details:**

See P0701 (function of digital input 1).

<b>P0707[3]</b>	<b>Function of digital input 7</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 99		

Selects function of digital input 7 (via analog input).

**Possible Settings:**

- 0 Digital input disabled
- 1 ON/OFF1
- 2 ON reverse /OFF1
- 3 OFF2 - coast to standstill
- 4 OFF3 - quick ramp-down
- 9 Fault acknowledge
- 10 JOG right
- 11 JOG left
- 12 Reverse
- 13 MOP up (increase freq.)
- 14 MOP down (decrease freq.)
- 25 DC brake enable
- 29 External trip
- 33 Disable additional freq setpoint
- 99 Enable BICO parameterization

**Index:**

- P0707[0] : 1st. Command data set (CDS)
- P0707[1] : 2nd. Command data set (CDS)
- P0707[2] : 3rd. Command data set (CDS)

**Note:**

Signals above 4 V are active, signals below 1,6 V are inactive.

**Details:**

See P0701 (function of digital input 1).

<b>P0708[3]</b>	<b>Function of digital input 8</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 99		

Selects function of digital input 8 (via analog input)

**Possible Settings:**

- 0 Digital input disabled
- 1 ON/OFF1
- 2 ON reverse /OFF1
- 3 OFF2 - coast to standstill
- 4 OFF3 - quick ramp-down
- 9 Fault acknowledge
- 10 JOG right
- 11 JOG left
- 12 Reverse
- 13 MOP up (increase freq.)
- 14 MOP down (decrease freq.)
- 25 DC brake enable
- 29 External trip
- 33 Disable additional freq setpoint
- 99 Enable BICO parameterization

**Index:**

- P0708[0] : 1st. Command data set (CDS)
- P0708[1] : 2nd. Command data set (CDS)
- P0708[2] : 3rd. Command data set (CDS)

**Note:**

Signals above 4 V are active, signals below 1,6 V are inactive.

**Details:**

See P0701 (function of digital input 1).

<b>P0719[3]</b>	<b>Selection of cmd. &amp; freq. setp.</b>				<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 66		

Central switch to select control command source for inverter.

Switches command and setpoint source between freely programmable BICO parameters and fixed command/setpoint profiles. Command and setpoint sources can be changed independently.

The tens digit chooses the command source and the units digit chooses the setpoint source.

**Possible Settings:**

- |    |                       |                            |
|----|-----------------------|----------------------------|
| 0  | Cmd = BICO parameter  | Setpoint = BICO parameter  |
| 1  | Cmd = BICO parameter  | Setpoint = MOP setpoint    |
| 2  | Cmd = BICO parameter  | Setpoint = Analog setpoint |
| 3  | Cmd = BICO parameter  | Setpoint = Fixed frequency |
| 4  | Cmd = BICO parameter  | Setpoint = USS on BOP link |
| 5  | Cmd = BICO parameter  | Setpoint = USS on COM link |
| 6  | Cmd = BICO parameter  | Setpoint = CB on COM link  |
| 10 | Cmd = BOP             | Setpoint = BICO parameter  |
| 11 | Cmd = BOP             | Setpoint = MOP setpoint    |
| 12 | Cmd = BOP             | Setpoint = Analog setpoint |
| 13 | Cmd = BOP             | Setpoint = Fixed frequency |
| 15 | Cmd = BOP             | Setpoint = USS on COM link |
| 16 | Cmd = BOP             | Setpoint = CB on COM link  |
| 40 | Cmd = USS on BOP link | Setpoint = BICO parameter  |
| 41 | Cmd = USS on BOP link | Setpoint = MOP setpoint    |
| 42 | Cmd = USS on BOP link | Setpoint = Analog setpoint |
| 43 | Cmd = USS on BOP link | Setpoint = Fixed frequency |
| 44 | Cmd = USS on BOP link | Setpoint = USS on BOP link |
| 45 | Cmd = USS on BOP link | Setpoint = USS on COM link |
| 46 | Cmd = USS on BOP link | Setpoint = CB on COM link  |
| 50 | Cmd = USS on COM link | Setpoint = BICO parameter  |
| 51 | Cmd = USS on COM link | Setpoint = MOP setpoint    |
| 52 | Cmd = USS on COM link | Setpoint = Analog setpoint |
| 53 | Cmd = USS on COM link | Setpoint = Fixed frequency |
| 54 | Cmd = USS on COM link | Setpoint = USS on BOP link |
| 55 | Cmd = USS on COM link | Setpoint = USS on COM link |
| 60 | Cmd = CB on COM link  | Setpoint = BICO parameter  |
| 61 | Cmd = CB on COM link  | Setpoint = MOP setpoint    |
| 62 | Cmd = CB on COM link  | Setpoint = Analog setpoint |
| 63 | Cmd = CB on COM link  | Setpoint = Fixed frequency |
| 64 | Cmd = CB on COM link  | Setpoint = USS on BOP link |
| 66 | Cmd = CB on COM link  | Setpoint = CB on COM link  |

**Index:**

P0719[0] : 1st. Command data set (CDS)  
P0719[1] : 2nd. Command data set (CDS)  
P0719[2] : 3rd. Command data set (CDS)

**Note:**

Using parameter P0719, it is possible to select the command or setpoint sources without changing the BICO connections (this is contrary to P0700 / P1000). However, it is not possible to change the complete connection table (refer to P0700 and P1000). Using P0719, depending on the value, only the BICO parameters listed in the following table are internally overwritten - this means that these BICO parameters are inactive.

**Command source:**

	P0719 =				
	0 ... 9	10 ... 19	40 ... 49	50 ... 59	60 ... 69
P0840	X	-	-	-	-
P0844	X	-	-	-	-
P0848	X	X	-	-	-
P0852	X	X	-	-	-
P1035	X	-	-	-	-
P1036	X	X	-	-	-
P1055	X	-	-	-	-
P1056	X	X	-	-	-
P1113	X	-	-	-	-
P1140	X	X	-	-	-
P1141	X	X	-	-	-
P1142	X	X	-	-	-
P1143	X	X	-	-	-

**Setpoint source:**

	P0719 =	
	0, 10, 20, 40, 50, 60	all other values
P1070	X	-

X = BICO parameter active  
- = BICO parameter inactive

BICO connections made previously remain unchanged.

<b>r0720</b>	<b>Number of digital inputs</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	<b>Level</b>
	<b>P-Group:</b> COMMANDS						<b>3</b>
	Displays number of digital inputs.						

<b>r0722</b>	<b>CO/BO: Binary input values</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	<b>Level</b>
	<b>P-Group:</b> COMMANDS						<b>2</b>
	Displays status of digital inputs.						

**Bitfields:**

Bit00	Digital input 1	0	OFF	1	ON
Bit01	Digital input 2	0	OFF	1	ON
Bit02	Digital input 3	0	OFF	1	ON
Bit03	Digital input 4	0	OFF	1	ON
Bit04	Digital input 5	0	OFF	1	ON
Bit05	Digital input 6	0	OFF	1	ON
Bit06	Digital input 7 (via ADC 1)	0	OFF	1	ON
Bit07	Digital input 8 (via ADC 2)	0	OFF	1	ON

**Note:**

Segment is lit when signal is active.



<b>P0724</b>	<b>Debounce time for digital inputs</b>				<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 3		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 3		

Defines debounce time (filtering time) used for digital inputs.

**Possible Settings:**

- 0 No debounce time
- 1 2.5 ms debounce time
- 2 8.2 ms debounce time
- 3 12.3 ms debounce time

<b>P0725</b>	<b>PNP / NPN digital inputs</b>				<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 1		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 1		

Switches between active high (PNP) and active low (NPN). This is valid for all digital inputs simultaneously.

The following is valid by using the internal supply:

**Possible Settings:**

- 0 NPN mode ==> low active
- 1 PNP mode ==> high active

**Value:**

NPN: Terminals 5/6/7/8/16/17 must be connected via terminal 28 ( 0 V).  
PNP: Terminals 5/6/7/8/16/17 must be connected via terminal 9 (24 V).

### 3.10 Digital outputs


<b>r0730</b>	<b>Number of digital outputs</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMMANDS			<b>Def:</b> - <b>Max:</b> -	

Displays number of digital outputs (relays).

<b>P0731[3]</b>	<b>BI: Function of digital output 1</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 52:3 <b>Max:</b> 4000:0	

Defines source of digital output 1.

**DOUT channel**

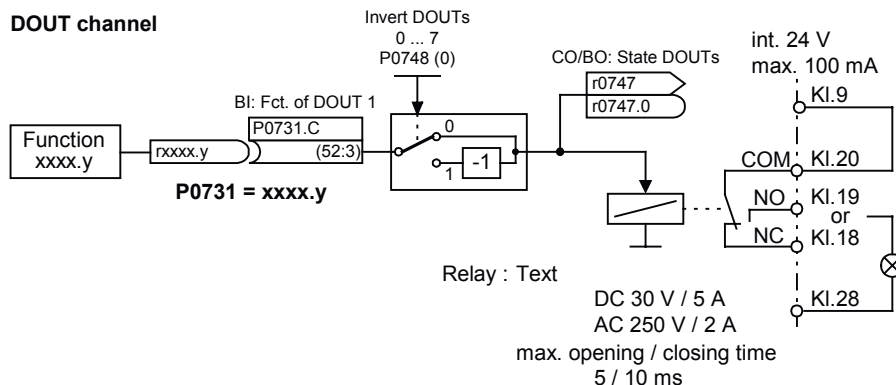

**Index:**

- P0731[0] : 1st. Command data set (CDS)
- P0731[1] : 2nd. Command data set (CDS)
- P0731[2] : 3rd. Command data set (CDS)

**Common Settings:**

52.0	Drive ready	0	Closed
52.1	Drive ready to run	0	Closed
52.2	Drive running	0	Closed
52.3	Drive fault active	0	Closed
52.4	OFF2 active	1	Closed
52.5	OFF3 active	1	Closed
52.6	Switch on inhibit active	0	Closed
52.7	Drive warning active	0	Closed
52.8	Deviation setpoint/actual value	1	Closed
52.9	PZD control (Process Data Control)	0	Closed
52.A	Maximum frequency reached	0	Closed
52.B	Warning: Motor current limit	1	Closed
52.C	Motor holding brake (MHB) active	0	Closed
52.D	Motor overload	1	Closed
52.E	Motor running direction right	0	Closed
52.F	Inverter overload	1	Closed
53.0	DC brake active	0	Closed
53.1	Act. freq. f_act > P2167 (f_off)	0	Closed
53.2	Act. freq. f_act <= P1080 (f_min)	0	Closed
53.3	Act. current r0027 > P2170	0	Closed
53.4	Act. freq. f_act > P2155 (f_1)	0	Closed
53.5	Act. freq. f_act <= P2155 (f_1)	0	Closed
53.6	Act. freq. f_act >= setpoint	0	Closed
53.7	Act. Vdc r0026 < P2172	0	Closed
53.8	Act. Vdc r0026 > P2172	0	Closed
53.A	PID output r2294 == P2292 (PID_min)	0	Closed
53.B	PID output r2294 == P2291 (PID_max)	0	Closed

<b>P0732[3]</b>	<b>BI: Function of digital output 2</b>				<b>Min:</b> 0:0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 52:7		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines source of digital output 2.

**Index:**

P0732[0] : 1st. Command data set (CDS)  
P0732[1] : 2nd. Command data set (CDS)  
P0732[2] : 3rd. Command data set (CDS)

**Common Settings:**

52.0	Drive ready	0	Closed
52.1	Drive ready to run	0	Closed
52.2	Drive running	0	Closed
52.3	Drive fault active	0	Closed
52.4	OFF2 active	1	Closed
52.5	OFF3 active	1	Closed
52.6	Switch on inhibit active	0	Closed
52.7	Drive warning active	0	Closed
52.8	Deviation setpoint/actual value	1	Closed
52.9	PZD control (Process Data Control)	0	Closed
52.A	Maximum frequency reached	0	Closed
52.B	Warning: Motor current limit	1	Closed
52.C	Motor holding brake (MHB) active	0	Closed
52.D	Motor overload	1	Closed
52.E	Motor running direction right	0	Closed
52.F	Inverter overload	1	Closed
53.0	DC brake active	0	Closed
53.1	Act. freq. f_act > P2167 (f_off)	0	Closed
53.2	Act. freq. f_act <= P1080 (f_min)	0	Closed
53.3	Act. current r0027 > P2170	0	Closed
53.4	Act. freq. f_act > P2155 (f_1)	0	Closed
53.5	Act. freq. f_act <= P2155 (f_1)	0	Closed
53.6	Act. freq. f_act >= setpoint	0	Closed
53.7	Act. Vdc r0026 < P2172	0	Closed
53.8	Act. Vdc r0026 > P2172	0	Closed
53.A	PID output r2294 == P2292 (PID_min)	0	Closed
53.B	PID output r2294 == P2291 (PID_max)	0	Closed

<b>P0733[3]</b>	<b>BI: Function of digital output 3</b>				<b>Min:</b> 0:0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines source of digital output 3.

**Index:**

P0733[0] : 1st. Command data set (CDS)  
P0733[1] : 2nd. Command data set (CDS)  
P0733[2] : 3rd. Command data set (CDS)

**Common Settings:**

52.0	Drive ready	0	Closed
52.1	Drive ready to run	0	Closed
52.2	Drive running	0	Closed
52.3	Drive fault active	0	Closed
52.4	OFF2 active	1	Closed
52.5	OFF3 active	1	Closed
52.6	Switch on inhibit active	0	Closed
52.7	Drive warning active	0	Closed
52.8	Deviation setpoint/actual value	1	Closed
52.9	PZD control (Process Data Control)	0	Closed
52.A	Maximum frequency reached	0	Closed
52.B	Warning: Motor current limit	1	Closed
52.C	Motor holding brake (MHB) active	0	Closed
52.D	Motor overload	1	Closed
52.E	Motor running direction right	0	Closed
52.F	Inverter overload	1	Closed
53.0	DC brake active	0	Closed
53.1	Act. freq. f_act > P2167 (f_off)	0	Closed
53.2	Act. freq. f_act <= P1080 (f_min)	0	Closed
53.3	Act. current r0027 > P2170	0	Closed
53.4	Act. freq. f_act > P2155 (f_1)	0	Closed
53.5	Act. freq. f_act <= P2155 (f_1)	0	Closed
53.6	Act. freq. f_act >= setpoint	0	Closed
53.7	Act. Vdc r0026 < P2172	0	Closed
53.8	Act. Vdc r0026 > P2172	0	Closed
53.A	PID output r2294 == P2292 (PID_min)	0	Closed
53.B	PID output r2294 == P2291 (PID_max)	0	Closed

<b>r0747</b>	<b>CO/BO: State of digital outputs</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMMANDS			<b>Def:</b> - <b>Max:</b> -	

Displays status of digital outputs (also includes inversion of digital outputs via P0748).

**Bitfields:**

Bit00	Digital output 1 energized	0	NO	1	YES
Bit01	Digital output 2 energized	0	NO	1	YES
Bit02	Digital output 3 energized	0	NO	1	YES

**Dependency:**

Bit 0 = 0 :  
Relay de-energized / contacts open

Bit 0 = 1 :  
Relay energized / contacts closed

<b>P0748</b>	<b>Invert digital outputs</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0 <b>Max:</b> 7	

Defines high and low states of relay for a given function.

**Bitfields:**

Bit00	Invert digital output 1	0	NO	1	YES
Bit01	Invert digital output 2	0	NO	1	YES
Bit02	Invert digital output 3	0	NO	1	YES

### 3.11 Analog inputs

<b>r0750</b>	<b>Number of ADCs</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TERMINAL			<b>Def:</b> - <b>Max:</b> -	

Displays number of analog inputs available.

<b>r0751</b>	<b>BO: Status word of ADC</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b> <b>4</b>
	<b>P-Group:</b> TERMINAL			<b>Def:</b> - <b>Max:</b> -	

Displays status of analog input.


**Bitfields:**

Bit00	Signal lost on ADC 1	0	NO	1	YES
Bit01	Signal lost on ADC 2	0	NO	1	YES

**Dependency:**

The following limitations/secondary conditions apply for the wire breakage monitoring:


- For P0756, the monitoring must be activated
- Width of the ADC deadzone P0761 > 0
- Wire breakage / signal loss F0080 is detected if the ADC input quantity is less than 0.5 \* P0761.

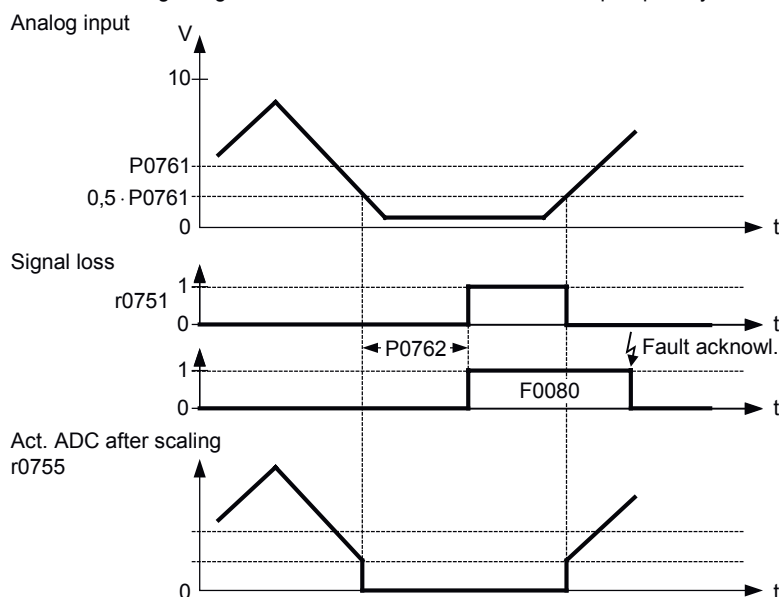

<b>r0752[2]</b>	<b>Act. input of ADC [V] or [mA]</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b>
	<b>P-Group:</b> TERMINAL			<b>Def:</b> - <b>Max:</b> -	<b>2</b>

Displays smoothed analog input value in volts before the characteristic block.

**ADC channel**

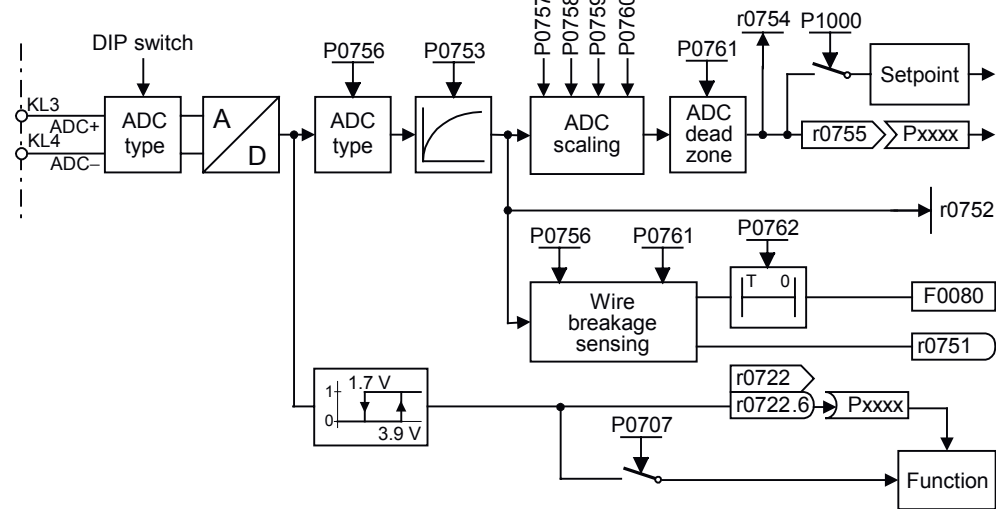

**Index:**

r0752[0] : Analog input 1 (ADC 1)  
r0752[1] : Analog input 2 (ADC 2)

<b>P0753[2]</b>	<b>Smooth time ADC</b>	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT <b>P-Group:</b> TERMINAL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 3 <b>Max:</b> 10000	<b>3</b>

Defines filter time (PT1 filter) in [ms] for analog input.

**Index:**

P0753[0] : Analog input 1 (ADC 1)  
P0753[1] : Analog input 2 (ADC 2)

**Note:**

Increasing this time (smooth) reduces jitter but slows down response to the analog input.

P0753 = 0 : No filtering

<b>r0754[2]</b>	<b>Act. ADC value after scaling [%]</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -	<b>Level</b>
	<b>P-Group:</b> TERMINAL			<b>Def:</b> - <b>Max:</b> -	<b>2</b>

Shows smoothed value of analog input in [%] after scaling block.

**Index:**

r0754[0] : Analog input 1 (ADC 1)  
r0754[1] : Analog input 2 (ADC 2)

**Dependency:**

P0757 to P0760 define range (ADC scaling).


<b>r0755[2]</b>	<b>CO: Act. ADC after scal. [4000h]</b>	<b>Min:</b> -	<b>Level</b>
	<b>Datatype:</b> I16 <b>Unit:</b> -	<b>Def:</b> -	<b>2</b>
<b>P-Group:</b> TERMINAL		<b>Max:</b> -	

Displays analog input, scaled using ASPmin and ASPmax.

Analog setpoint (ASP) from the analog scaling block can vary from min. analog setpoint (ASPmin) to a max. analog setpoint (ASPmax) as shown in P0757 (ADC scaling).

The largest magnitude (value without sign) of ASPmin and ASPmax defines the scaling of 16384.

By associating parameter r0755 with an internal value (e.g. frequency setpoint), a scaled value is calculated internally by the MM4. The frequency value is calculated using the following equation:

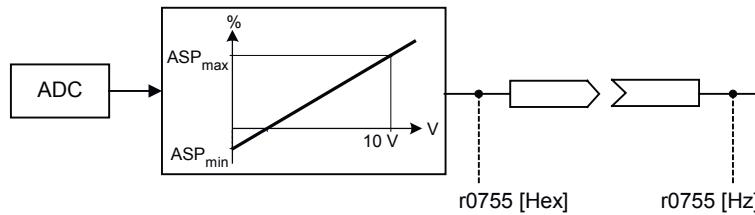

$$r0755 [Hz] = \frac{r0755 [Hex]}{4000 [Hex]} \cdot P2000 \cdot \frac{\max(|ASP_{max}|, |ASP_{min}|)}{100\%}$$

**Index:**

- r0755[0] : Analog input 1 (ADC 1)
- r0755[1] : Analog input 2 (ADC 2)

**Example:**



Case a:

- ASPmin = 300 %, ASPmax = 100 % then 16384 represents 300 %.
- This parameter will vary from 5461 to 16384.

Case b:

- ASPmin = -200 %, ASPmax = 100 % then 16384 represents 200 %.
- This parameter will vary from -16384 to +8192.

$$4000 h = \max(|ASP_{max}|, |ASP_{min}|)$$

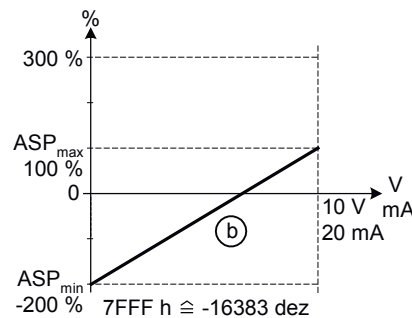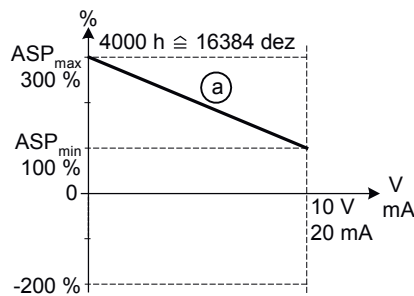

**Note:**

- This value is used as an input to analog BICO connectors.
- ASPmax represents the highest analog setpoint (this may be at 10 V).
- ASPmin represents the lowest analog setpoint (this may be at 0 V).

**Details:**

See parameters P0757 to P0760 (ADC scaling)

<b>P0756[2]</b>	<b>Type of ADC</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CT <b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> 0	<b>2</b>
<b>P-Group:</b> TERMINAL <b>Active:</b> first confirm <b>QuickComm.:</b> No		<b>Max:</b> 4	


Defines type of analog input and also enables analog input monitoring.

To switch over from voltage to current analog input it is not sufficient to merely modify parameter P0756. Rather, the DIPs on the terminal board must also be set to the correct position. The DIP settings are as follows:

- OFF = voltage input (10 V)
- ON = current input (20 mA)

Allocation of DIPs to analog inputs is as follows:

- DIP on left (DIP 1) = Analog input 1
- DIP on right (DIP 2) = Analog input 2

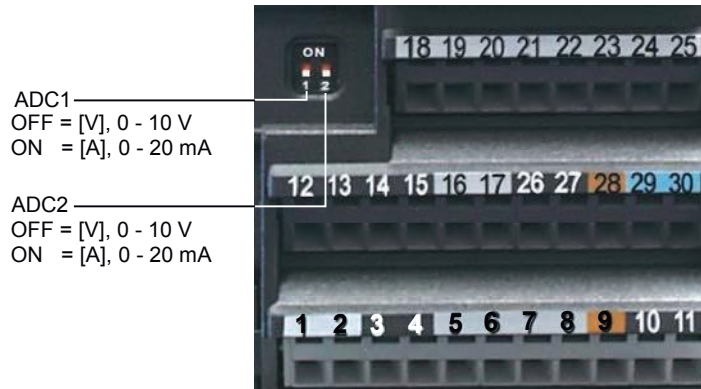

ADC1  
OFF = [V], 0 - 10 V  
ON = [A], 0 - 20 mA

ADC2  
OFF = [V], 0 - 10 V  
ON = [A], 0 - 20 mA

**Possible Settings:**

- 0 Unipolar voltage input (0 to +10 V)
- 1 Unipolar voltage input with monitoring (0 to 10 V)
- 2 Unipolar current input (0 to 20 mA)
- 3 Unipolar current input with monitoring (0 to 20 mA)
- 4 Bipolar voltage input (-10 V to +10 V)

**Index:**

P0756[0] : Analog input 1 (ADC 1)  
P0756[1] : Analog input 2 (ADC 2)

**Notice:**

When monitoring is enabled and a deadband defined (P0761), a fault condition will be generated (F0080) if the analog input voltage falls below 50 % of the deadband voltage.

On account of h/w restriction it is not possible to select the bipolar voltage (see Enum declaration) for analog input 2 (P0756[1] = 4).


**Details:**

See P0757 to P0760 (ADC scaling).

<b>P0757[2]</b>	<b>Value x1 of ADC scaling [V / mA]</b>				<b>Min:</b> -20	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> TERMINAL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 20		

Parameters P0757 - P0760 configure the input scaling as shown in the diagram:


**P0756 = 0 ... 3, P0761 = 0**

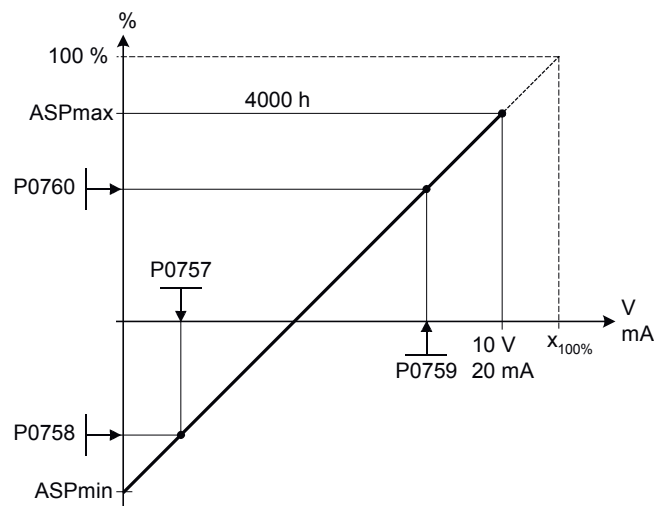

Where:

- Analog setpoints represent a [%] of the normalized frequency in P2000.
- Analog setpoints may be larger than 100 %.
- ASPmax represents highest analog setpoint (this may be at 10 V or 20 mA).
- ASPmin represents lowest analog setpoint (this may be at 0 V or 20 mA).
- Default values provide a scaling of 0 V or 0 mA = 0 %, and 10 V or 20 mA = 100 %.

P0756 = 4, P0761 = 0

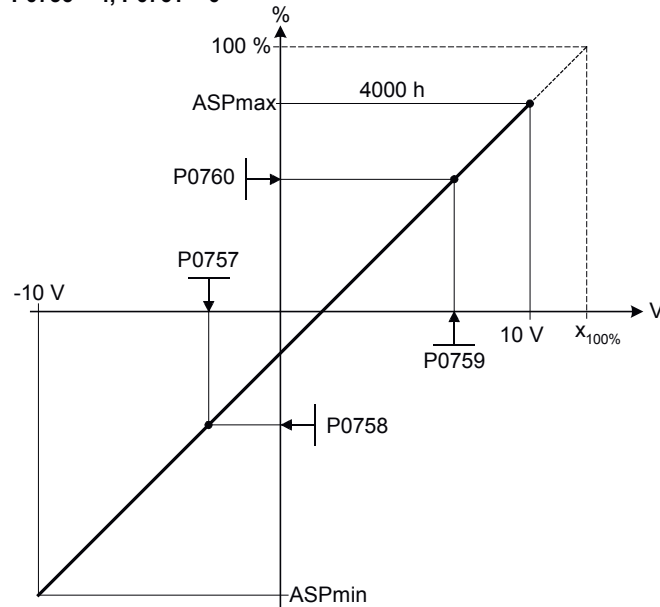

**Index:**

P0757[0] : Analog input 1 (ADC 1)  
P0757[1] : Analog input 2 (ADC 2)

**Note:**

The ADC-linear characteristic is described by 4 coordinates, based on a two-point equation:

$$\frac{y - P0758}{x - P0757} = \frac{P0760 - P0758}{P0759 - P0757}$$

For calculations the point-gradient form (offset and gradient) is more advantageous:

$$y = m \cdot x + y_0$$


The transformation between these two forms is given by:

$$m = \frac{P0760 - P0758}{P0759 - P0757} \quad y_0 = \frac{P0758 \cdot P0759 - P0757 \cdot P0760}{P0759 - P0757}$$

For scaling of the input the value of  $y_{max}$  and  $x_{min}$  has to be determined. This is done by the following equations:

$$x_{min} = \frac{P0760 \cdot P0757 - P0758 \cdot P0759}{P0760 - P0758}$$

$$y_{max} = (x_{max} - x_{min}) \cdot \frac{P0760 - P0758}{P0759 - P0757}$$

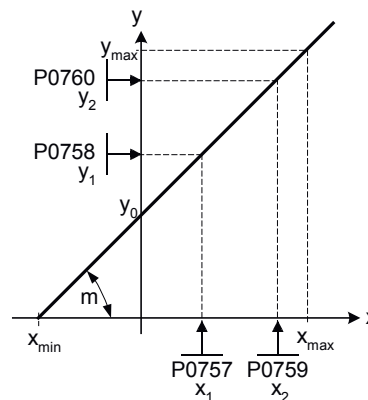

**Notice:**

The value  $x_2$  of ADC scaling P0759 must be greater than the value  $x_1$  of ADC scaling P0757.

<b>P0758[2]</b>	<b>Value <math>y_1</math> of ADC scaling</b>			<b>Min:</b> -99999.9	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 0.0	
	<b>P-Group:</b> TERMINAL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 99999.9	

Sets value of  $Y_1$  in [%] as described in P0757 (ADC scaling)

**Index:**

P0758[0] : Analog input 1 (ADC 1)  
P0758[1] : Analog input 2 (ADC 2)

**Dependency:**

Affects P2000 to P2003 (reference frequency, voltage, current or torque) depending on which setpoint is to be generated.



<b>P0759[2]</b>	<b>Value x2 of ADC scaling [V / mA]</b>	<b>Min:</b> -20	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> -
	<b>P-Group:</b> TERMINAL	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Sets value of X2 as described in P0757 (ADC scaling).

**Index:**

P0759[0] : Analog input 1 (ADC 1)  
P0759[1] : Analog input 2 (ADC 2)

**Notice:**

The value x2 of ADC scaling P0759 must be greater than the value x1 of ADC scaling P0757.

<b>P0760[2]</b>	<b>Value y2 of ADC scaling</b>	<b>Min:</b> -99999.9	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> %
	<b>P-Group:</b> TERMINAL	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Sets value of Y2 in [%] as described in P0757 (ADC scaling).

**Index:**

P0760[0] : Analog input 1 (ADC 1)  
P0760[1] : Analog input 2 (ADC 2)

**Dependency:**

Affects P2000 to P2003 (reference frequency, voltage, current or torque) depending on which setpoint is to be generated.

<b>P0761[2]</b>	<b>Width of ADC deadband [V / mA]</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> -
	<b>P-Group:</b> TERMINAL	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Defines width of deadband on analog input. The diagrams below explain its use.

**Index:**


P0761[0] : Analog input 1 (ADC 1)  
P0761[1] : Analog input 2 (ADC 2)

**Example:**

The below example produces a 2 to 10 V analog input 0 to 50 Hz (ADC value 2 to 10 V, 0 to 50 Hz):

- P2000 = 50 Hz
- P0759 = 8 V    P0760 = 75 %
- P0757 = 2 V    P0758 = 0 %
- P0761 = 2 V
- P0756 = 0 or 1


**P0761 > 0 and (0 < P0758 < P0760 or 0 > P0758 > P0760)**

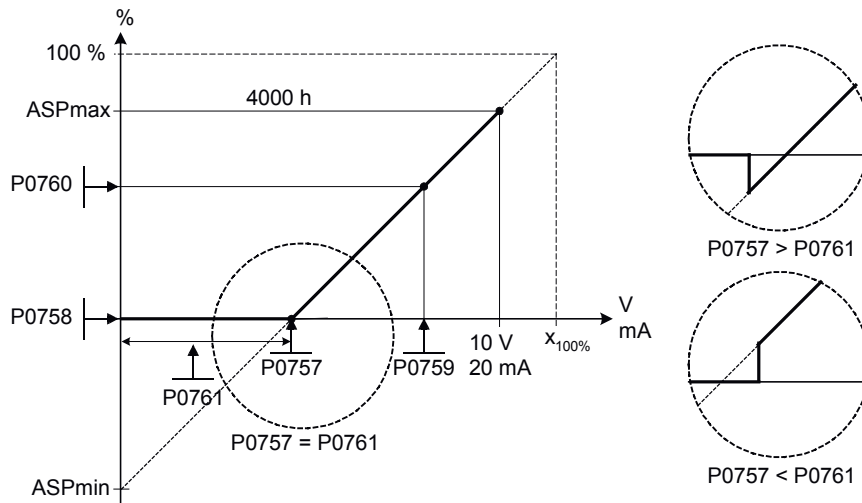

The below example produces a 0 to 10 V analog input (-50 to +50 Hz) with center zero and a "holding point" 0.2 V wide (0.1 V to each side of center, ADC value 0 to 10 V, -50 to +50 Hz):

- P2000 = 50 Hz
- P0759 = 8 V    P0760 = 75 %
- P0757 = 2 V    P0758 = -75 %
- P0761 = 0.1 V
- P0756 = 0 or 1


**P0761 > 0 and P0758 < 0 < P0760**

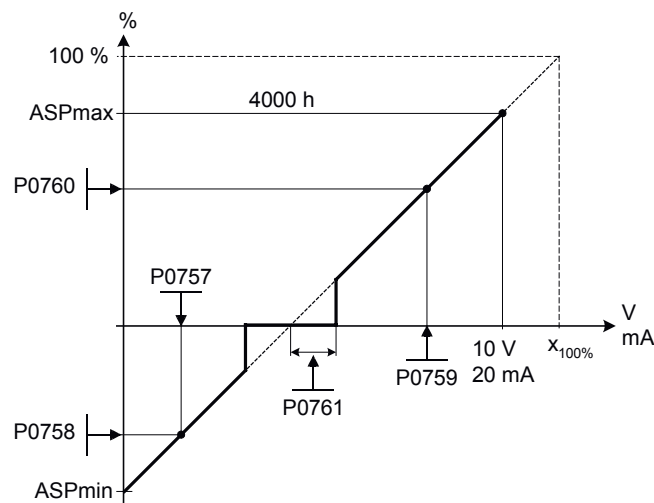

ADC value -10 to +10 V (-50 to +50 Hz):

The below example produces a -10 to +10 V analog input (-50 to +50 Hz) with center zero and a "holding point" 0.2 V wide (0.1 V to each side of center).

**P0756 = 4 and P0761 > 0 and P0758 < 0 < P0760**

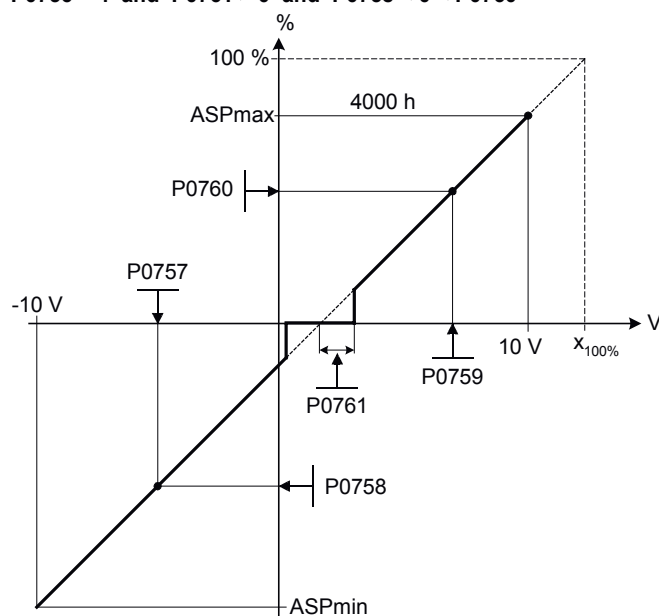

**Note:**

P0761[x] = 0 : No deadband active.

Deadband starts from 0 V to value of P0761, if both values of P0758 and P0760 (y coordinates of ADC scaling) are positive or negative respectively. However, deadband is active in both directions from point of intersection (x axis with ADC scaling curve), if sign of P0758 and P0760 are opposite.

Min. frequency P1080 should be zero when using center zero setup. There is no hysteresis at the end of the deadband.

<b>P0762[2]</b>	<b>Delay for loss of signal action</b>				<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Def:</b> 10		
	<b>P-Group:</b> TERMINAL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 10000		

Defines time delay between loss of analog setpoint and appearance of fault code F0080.

**Index:**

P0762[0] : Analog input 1 (ADC 1)  
P0762[1] : Analog input 2 (ADC 2)

**Note:**

Expert users can choose the desired reaction to F0080 (default is OFF2).

### 3.12 Analog outputs

<b>r0770</b>	<b>Number of DACs</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TERMINAL				

Displays number of analog outputs available.

<b>P0771[2]</b>	<b>CI: DAC</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0 <b>Def:</b> 21:0 <b>Max:</b> 4000:0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT <b>P-Group:</b> TERMINAL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No		


Defines function of the 0 - 20 mA analog output.

**Index:**

- P0771[0] : Analog output 1 (DAC 1)
- P0771[1] : Analog output 2 (DAC 2)

**Common Settings:**

- 21 CO: Act. frequency (scaled to P2000)
- 24 CO: Act. output frequency (scaled to P2000)
- 25 CO: Act. output voltage (scaled to P2001)
- 26 CO: Act. DC-link voltage (scaled to P2001)
- 27 CO: Act. output current (scaled to P2002)

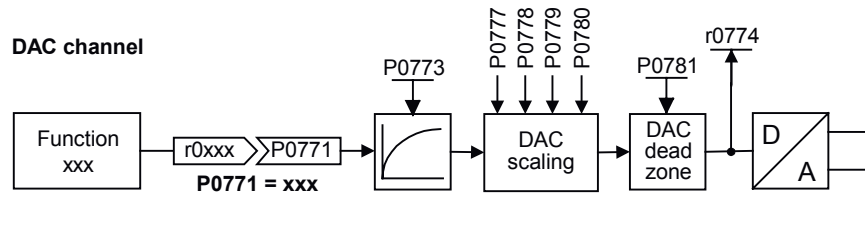

<b>P0773[2]</b>	<b>Smooth time DAC</b>	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Min:</b> 0 <b>Def:</b> 2 <b>Max:</b> 1000	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT <b>P-Group:</b> TERMINAL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No		

Defines smoothing time [ms] for analog output signal. This parameter enables smoothing for DAC using a PT1 filter.

**Index:**

- P0773[0] : Analog output 1 (DAC 1)
- P0773[1] : Analog output 2 (DAC 2)

**Dependency:**

P0773 = 0: Deactivates filter.

<b>r0774[2]</b>	<b>Act. DAC value [mA]</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>2</b>
	<b>P-Group:</b> TERMINAL				

Shows value of analog output in [mA] after filtering and scaling.

**Index:**

- r0774[0] : Analog output 1 (DAC 1)
- r0774[1] : Analog output 2 (DAC 2)

<b>P0776[2]</b>	<b>Type of DAC</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0 <b>Def:</b> 0 <b>Max:</b> 1	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT <b>P-Group:</b> TERMINAL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No		

Defines type of analog output.

**Possible Settings:**

- 0 Current output
- 1 Voltage output

**Index:**

- P0776[0] : Analog output 1 (DAC 1)
- P0776[1] : Analog output 2 (DAC 2)

**Note:**


The analog output is designed as a current output with a range of 0...20 mA.

For a voltage output with a range of 0...10 V an external resistor of 500 Ohms has to be connected at the terminals (12/13 or 26/27).

<b>P0777[2]</b>	<b>Value x1 of DAC scaling</b>			<b>Min:</b> -99999.0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 0.0	
	<b>P-Group:</b> TERMINAL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 99999.0	

Defines x1 output characteristic in [%]. Scaling block is responsible for adjustment of output value defined in P0771 (DAC connector input).

Parameters of DAC scaling block (P0777 ... P0781) work as follows:

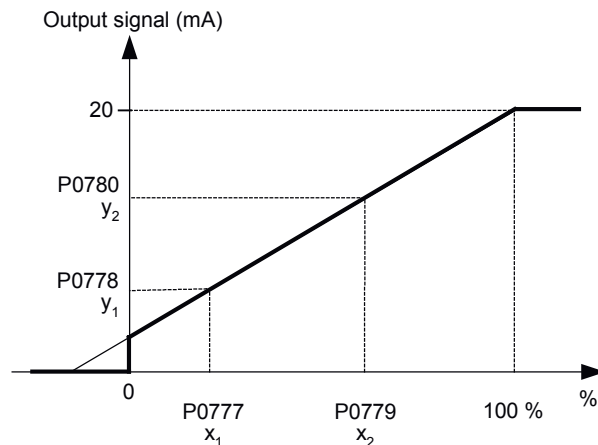

Where:  
Points P1 (x1, y1) and P2 (x2, y2) can be chosen freely.

**Index:**

P0777[0] : Analog output 1 (DAC 1)  
P0777[1] : Analog output 2 (DAC 2)

**Example:**

The default values of the scaling block provides a scaling of:  
P1: 0.0 % = 0 mA  
P2: 100.0 % = 20 mA

**Dependency:**

Affects P2000 to P2003 (referency frequency, voltage, current or torque) depending on which setpoint is to be generated.

**Note:**

The DAC-linear characteristic is described by 4 coordinates, based on a two-point equation:

$$\frac{y - P0778}{x - P0777} = \frac{P0780 - P0778}{P0779 - P0777}$$

For calculations the point-gradient form (offset and gradient) is more advantageous:

$$y = m \cdot x + y_0$$


The transformation between these two forms is given by:

$$m = \frac{P0780 - P0778}{P0779 - P0777} \quad y_0 = \frac{P0778 \cdot P0779 - P0777 \cdot P0780}{P0779 - P0777} \leq |200\%|$$

For scaling of the input the value of y\_max and x\_min has to be determined. This is done by the following equations:

$$x_{min} = \frac{P0780 \cdot P0777 - P0778 \cdot P0779}{P0780 - P0778}$$

$$y_{max} = (x_{max} - x_{min}) \cdot \frac{P0780 - P0778}{P0779 - P0777}$$

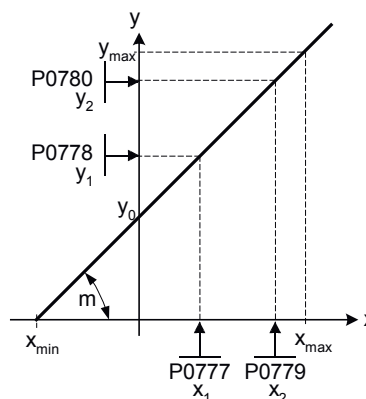

<b>P0778[2]</b>	<b>Value y1 of DAC scaling</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> - <b>Def:</b> 0		<b>2</b>
	<b>P-Group:</b> TERMINAL <b>Active:</b> first confirm <b>QuickComm.:</b> No <b>Max:</b> 20		

Defines y1 of output characteristic.

**Index:**

P0778[0] : Analog output 1 (DAC 1)  
P0778[1] : Analog output 2 (DAC 2)

<b>P0779[2]</b>	<b>Value x2 of DAC scaling</b>	<b>Min:</b> -99999.0	<b>Level</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> 100.0		<b>2</b>
	<b>P-Group:</b> TERMINAL <b>Active:</b> first confirm <b>QuickComm.:</b> No <b>Max:</b> 99999.0		

Defines x2 of output characteristic in [%].

**Index:**

P0779[0] : Analog output 1 (DAC 1)  
P0779[1] : Analog output 2 (DAC 2)

**Dependency:**

Affects P2000 to P2003 (referency frequency, voltage, current or torque) depending on which setpoint is to be generated.

<b>P0780[2]</b>	<b>Value y2 of DAC scaling</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> - <b>Def:</b> 20		<b>2</b>
	<b>P-Group:</b> TERMINAL <b>Active:</b> first confirm <b>QuickComm.:</b> No <b>Max:</b> 20		


Defines y2 of output characteristic.

**Index:**

P0780[0] : Analog output 1 (DAC 1)  
P0780[1] : Analog output 2 (DAC 2)

<b>P0781[2]</b>	<b>Width of DAC deadband</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> - <b>Def:</b> 0		<b>2</b>
	<b>P-Group:</b> TERMINAL <b>Active:</b> first confirm <b>QuickComm.:</b> No <b>Max:</b> 20		

Sets width of dead-band in [mA] for analog output.

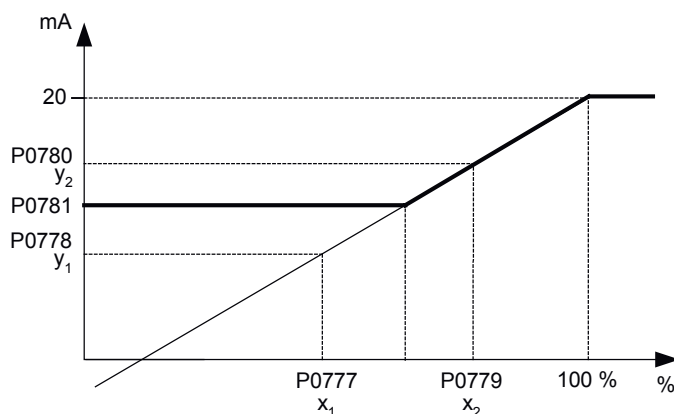

**Index:**

P0781[0] : Analog output 1 (DAC 1)  
P0781[1] : Analog output 2 (DAC 2)

### 3.13 Parameter / command / drive data set

<b>P0800[3]</b>	<b>BI: Download parameter set 0</b>				<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines source of command to start download of parameter set 0 from attached AOP.

**Index:**


- P0800[0] : 1st. Command data set (CDS)
- P0800[1] : 2nd. Command data set (CDS)
- P0800[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)

**Dependency:**

1. The parameter set 0 can only be downloaded in conjunction with the AOP
2. Establish communications between the frequency inverter and AOP
3. The frequency inverter must be selected using the AOP if the AOP is connected at the COM link interface (RS485)
4. Select the frequency inverter state "Ready" (r0002 = 1)
5. Signal from P0800:  
0 = Do not download.  
1 = Start to download parameter set 0 from the AOP.

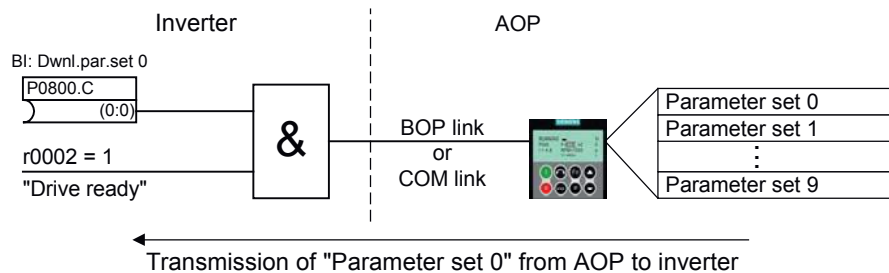

<b>P0801[3]</b>	<b>BI: Download parameter set 1</b>				<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines sources of command to start download of parameter set 1 from attached AOP.

**Index:**

- P0801[0] : 1st. Command data set (CDS)
- P0801[1] : 2nd. Command data set (CDS)
- P0801[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)

**Note:**

See parameter P0800

<b>P0809[3]</b>	<b>Copy command data set (CDS)</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 2		

Calls 'Copy Command Data Set (CDS)' function.

The list of all Command Data Sets (CDS) are shown in the opening instructions of the Parameter List (PLI).


**Index:**

- P0809[0] : Copy from CDS
- P0809[1] : Copy to CDS
- P0809[2] : Start copy

**Example:**

Copying of all values from CDS1 to CDS3 can be accomplished by the following procedure:

- P0809[0] = 0    1. CDS
- P0809[1] = 2    3. CDS
- P0809[2] = 1    Start copy

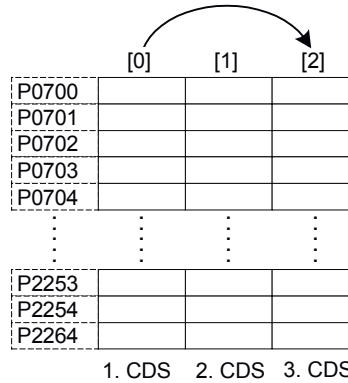


**Note:**

Start value in index 2 is automatically reset to '0' after execution of function.

<b>P0810</b>	<b>BI: CDS bit 0 (Local / Remote)</b>				<b>Min:</b> 0:0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4095:0		

Selects command source from which to read Bit 0 for selecting a command data set (CDS).

**Selecting CDS**

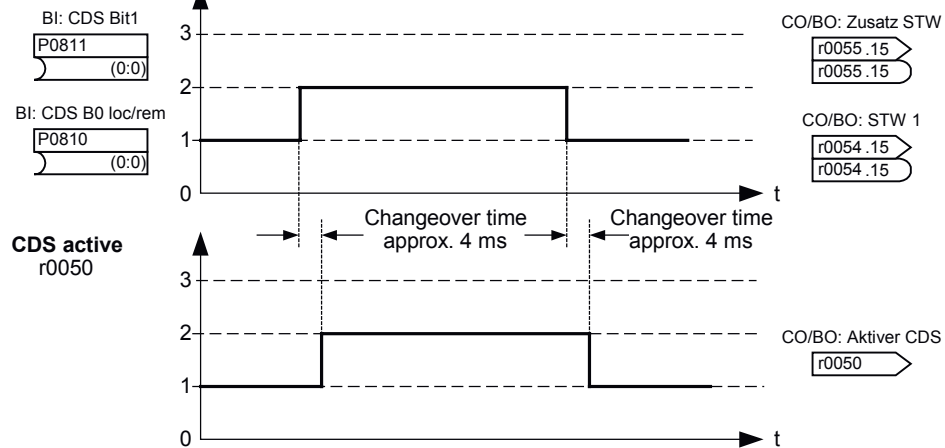

The actual active command data set (CDS) is displayed in parameter r0050.

	selected CDS		active CDS
	r0055 Bit15	r0054 Bit15	r0050
1. CDS	0	0	0
2. CDS	0	1	1
3. CDS	1	0	2
3. CDS	1	1	2

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)


**Example:**

Typical procedure for CDS switch-over:

- CDS1: Command source via terminal and setpoint source via analog input (ADC)
- CDS2: Command source via BOP and setpoint source via MOP
- CDS switch-over takes place via digital input 4 (DIN 4)

**Steps:**

1. Commissioning of inverter / drive
2. CDS1 set parameters (P0700[0] = 2 and P1000[0] = 2)
3. Connect P0810 (P0811 if necessary) with the source of CDS switch-over (P0704[0] = 99, P0810 = 722.3)
4. Copy CDS1 to CDS2 (P0809[0] = 0, P0809[1] = 1, P0809[2] = 2)
5. Change CDS2 parameter as required (set parameters for CDS2 [P0700=1 and P1000=1])

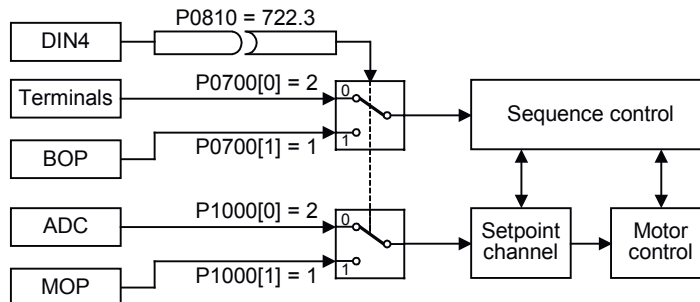

**Note:**

P0811 is also relevant for command data set (CDS) set selection.

<b>P0811</b>	<b>BI: CDS bit 1</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> COMMANDS			<b>Max:</b> 4095:0	

Selects command source from which to read Bit 1 for selecting a command data set (see P0810).

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)

**Note:**

P0810 is also relevant for command data set (CDS) selection.



<b>P0819[3]</b>	<b>Copy drive data set (DDS)</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 2		

Calls 'Copy Drive Data Set (DDS)' function.

The list of all Drive Data Sets (DDS) are shown in the opening instructions of the Parameter List (PLI).


**Index:**

- P0819[0] : Copy from DDS
- P0819[1] : Copy to DDS
- P0819[2] : Start copy

**Example:**

Copying of all values from DDS1 to DDS3 can be accomplished by the following procedure:

- P0819[0] = 0    1. DDS
- P0819[1] = 2    3. DDS
- P0819[2] = 1    Start copy

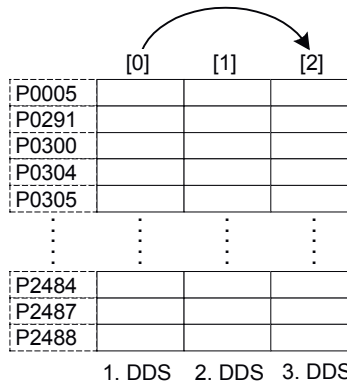


**Note:**

Start value in index 2 is automatically reset to '0' after execution of function.

<b>P0820</b>	<b>BI: DDS bit 0</b>				<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4095:0		

Selects command source from which to read Bit 0 for selecting a drive data set (DDS).

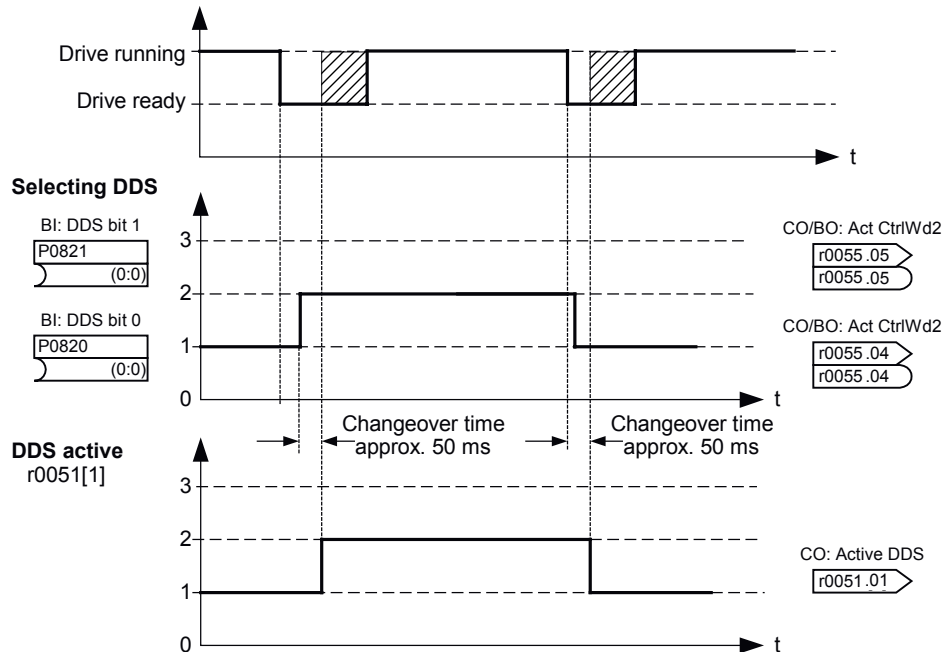

The actual active drive data set (DDS) is displayed in parameter r0051[1].


	selected DDS			active DDS
	r0055 Bit05	r0054 Bit04	r0051 [0]	r0051 [1]
1. DDS	0	0	0	0
2. DDS	0	1	1	1
3. DDS	1	0	2	2
3. DDS	1	1	2	2

**Common Settings:**


- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)

**Example:**

- a) Commissioning procedure with one motor:
- Apply commissioning to DDS1
  - Connect P0820 (P0821 if necessary) with DDS source (i.e. via DIN 4: P0704[0] = 99, P0820 = 722.3)
  - Copy DDS1 to DDS2 (P0819[0] = 0, P0819[1] = 1, P0819[2] = 2)
  - Adapt DDS2 parameters (e.g. Ramp-up time P1120[1] and Ramp-down time P1121[1])

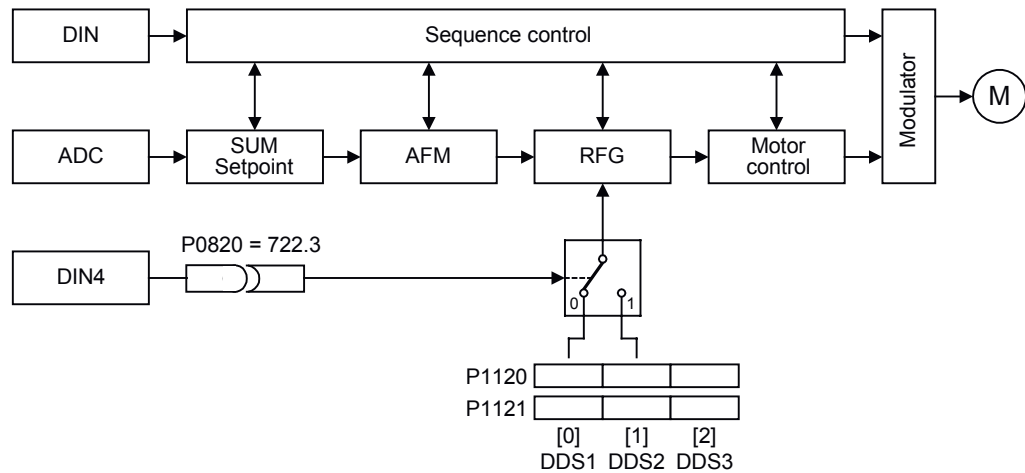

- b) Commissioning procedure with two motors (Motor 1, Motor 2):
- Commission Motor 1; Adapt all other DDS1 parameters (as required)
  - Connect P0820 (P0821 if necessary) with DDS source (i.e. via DIN 4: P0704[0] = 99, P0820 = 722.3)
  - Switch-over to DDS2 (check it via r0051)
  - Commission Motor 2; Adapt all other DDS2 parameters (as required)

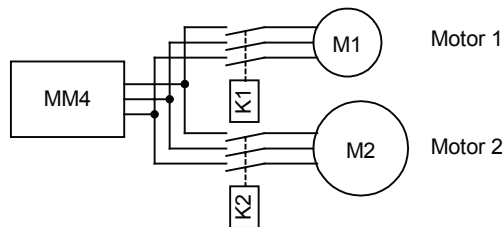

**Note:**

P0821 is also relevant for drive data set (DDS) selection.

<b>P0821</b>	<b>BI: DDS bit 1</b>			<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4095:0	

Selects command source from which Bit 1 for selecting a drive data set is to be read in (see parameter P0820).

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)

**Note:**


P0820 is also relevant for drive data set (DDS) selection.

### 3.14 BICO command parameters

<b>P0840[3]</b>	<b>BI: ON/OFF1</b>			<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 722:0	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Allows ON/OFF1 command source to be selected using BICO.

The first three digits describe the parameter number of the command source; the last digit denotes the bit setting for that parameter. The default setting (ON right) is digital input 1 (722.0). Alternative source possible only when function of digital input 1 is changed (via P0701) before changing value of P0840.

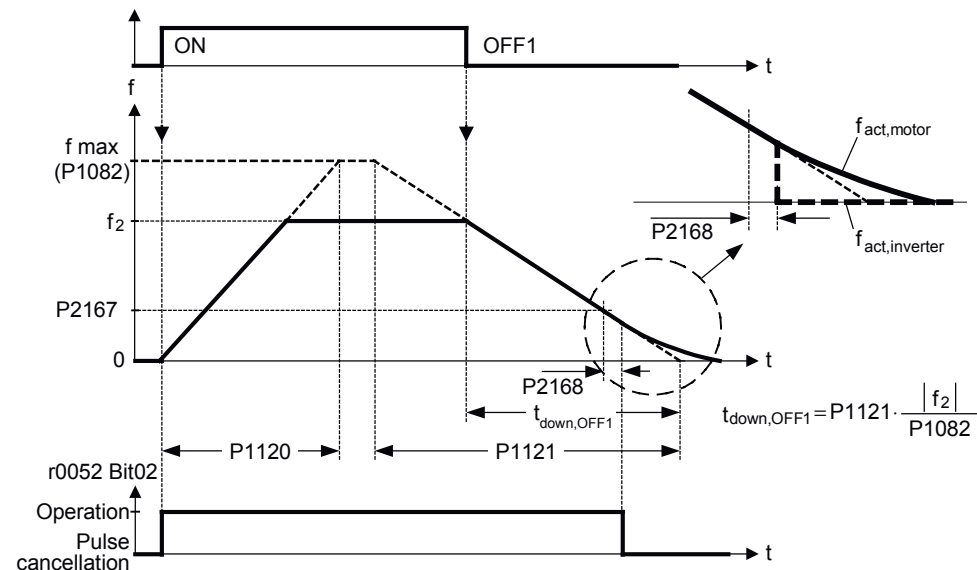

**Index:**

- P0840[0] : 1st. Command data set (CDS)
- P0840[1] : 2nd. Command data set (CDS)
- P0840[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)
- 19.0 = ON/OFF1 via BOP

**Dependency:**

Active only when P0719 < 10. See parameter P0719 (Selection of command/setpoint source).

**Note:**

- OFF1 means a ramp stop down to 0 using P1121.
- OFF1 is low active.
- For the priority of all soft commands, the following applies: OFF2, OFF3, OFF1

<b>P0842[3]</b>	<b>BI: ON reverse/OFF1</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Allows ON/OFF1 reverse command source to be selected using BICO.

The first three digits describe the parameter number of the command source and the last digit denotes the bit setting for that parameter.

**Index:**

- P0842[0] : 1st. Command data set (CDS)
- P0842[1] : 2nd. Command data set (CDS)
- P0842[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)
- 19.0 = ON/OFF1 via BOP


**Details:**

See parameter P0840.

<b>P0844[3]</b>	<b>BI: 1. OFF2</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U32		<b>Def:</b> 1:0
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Defines first source of OFF2.

The first three digits describe the parameter number of the command source and the last digit denotes the bit setting for that parameter. If one of the digital inputs is selected for OFF2, the inverter will not run unless the digital input is active.

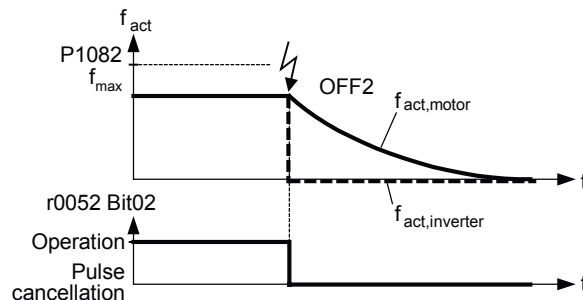

**Index:**

- P0844[0] : 1st. Command data set (CDS)
- P0844[1] : 2nd. Command data set (CDS)
- P0844[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)
- 19.0 = ON/OFF1 via BOP
- 19.1 = OFF2: Electrical stop via BOP

**Dependency:**

Active only when P0719 < 10. See parameter P0719 (Selection of command/setpoint source).

**Note:**

- OFF2 means an immediate pulse inhibit; the motor coasts down.
- OFF2 is low active.
- The following applies for the priority of all of the OFF commands: OFF2, OFF3, OFF1

<b>P0845[3]</b>	<b>BI: 2. OFF2</b>			<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 19:1	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Defines second source of OFF2.

The first three digits describe the parameter number of the command source and the last digit denotes the bit setting for that parameter. If one of the digital inputs is selected for OFF2, the inverter will not run unless the digital input is active.

**Index:**

- P0845[0] : 1st. Command data set (CDS)
- P0845[1] : 2nd. Command data set (CDS)
- P0845[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)
- 19.0 = ON/OFF1 via BOP


**Details:**

See parameter P0844.

<b>P0848[3]</b>	<b>BI: 1. OFF3</b>			<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 1:0	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Defines first source of OFF3.

The first three digits describe the parameter number of the command source and the last digit denotes the bit setting for that parameter. If one of the digital inputs is selected for OFF3, the inverter will not run unless the digital input is active.

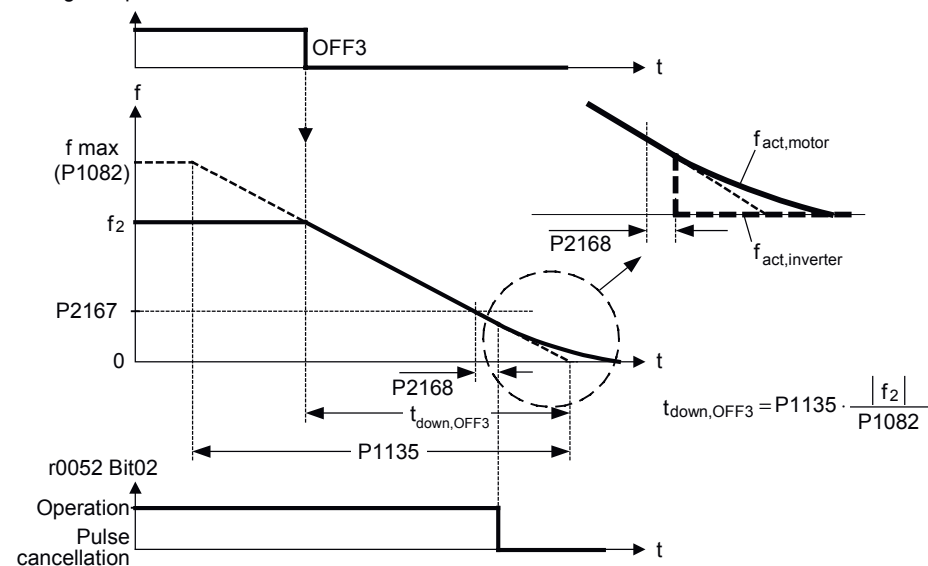

**Index:**

- P0848[0] : 1st. Command data set (CDS)
- P0848[1] : 2nd. Command data set (CDS)
- P0848[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)
- 19.0 = ON/OFF1 via BOP

**Dependency:**

Active only when P0719 < 10. See parameter P0719 (Selection of command/setpoint source).

**Note:**

- OFF3 means fast ramp-down to 0 Hz through P1135.
- OFF3 is low-active.
- Priority of all OFF commands: OFF2, OFF3, OFF1

<b>P0849[3]</b>	<b>BI: 2. OFF3</b>			<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 1:0	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Defines second source of OFF3.

The first three digits describe the parameter number of the command source and the last digit denotes the bit setting for that parameter. If one of the digital inputs is selected for OFF3, the inverter will not run unless the digital input is active.

**Index:**

- P0849[0] : 1st. Command data set (CDS)
- P0849[1] : 2nd. Command data set (CDS)
- P0849[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)
- 19.0 = ON/OFF1 via BOP

**Dependency:**

In contrast to P0848 (first source of OFF3), this parameter is always active, independent of P0719 (selection of command and frequency setpoint).

**Details:**

See parameter P0848.

<b>P0852[3]</b>	<b>BI: Pulse enable</b>			<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 1:0	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Defines source of pulse enable/disable signal.

**Index:**

- P0852[0] : 1st. Command data set (CDS)
- P0852[1] : 2nd. Command data set (CDS)
- P0852[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)

**Dependency:**

Active only when P0719 < 10. See parameter P0719 (Selection of command/setpoint source).

### 3.15 Communication parameters

<b>P0918</b>	<b>CB address</b>			<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 3	
	<b>P-Group:</b> COMM	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 65535	

Defines address of CB (communication board) or address of the other option modules.

- There are two ways to set the bus address:
- via DIP switches on the PROFIBUS module
  - via a user-entered value

**Note:**

- Possible PROFIBUS settings:
- 1 ... 125
  - 0, 126, 127 are not allowed

The following applies when a PROFIBUS module is used:

- DIP switch = 0 Address defined in P0918 (CB address) is valid
- DIP switch not = 0 DIP switch setting has priority and P0918 indicates DIP switch setting.

<b>P0927</b>	<b>Parameter changeable via</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> COMM	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Specifies the interfaces which can be used to change parameters.

This parameter allows the user to easily protect the inverter from unauthorized modification of parameters.  
Annotation: Parameter P0927 is not password protected.

**Bitfields:**

Bit00	PROFIBUS / CB	0	NO	1	YES
Bit01	BOP	0	NO	1	YES
Bit02	USS on BOP link	0	NO	1	YES
Bit03	USS on COM link	0	NO	1	YES

**Example:**

Bits 0, 1, 2 and 3 set:

The default setting allows parameters to be changed via any interface. If all bits are set, the parameter is displayed on BOP as follows:

BOP: 

Bits 0, 1, 2 and 3 reset:

This setting allows no parameters to be modified via any interface with the exception of P0003 and P0927. If all bits are reset, the parameter is displayed on BOP as follows:

BOP: 

**Details:**

The seven-segment display is explained in the "Introduction to MICROMASTER System Parameters" in this handbook.


<b>r0947[8]</b>	<b>Last fault code</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>	
		<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> ALARMS			<b>Def:</b> - <b>Max:</b> -

Displays fault history according to the diagram below

where:

- "F1" is the first active fault (not yet acknowledged).
- "F2" is the second active fault (not yet acknowledged).
- "F1e" is the occurrence of the fault acknowledgement for F1 & F2.

This moves the value in the 2 indices down to the next pair of indices, where they are stored. Indices 0 & 1 contain the active faults. When faults are acknowledged, indices 0 & 1 are reset to 0.

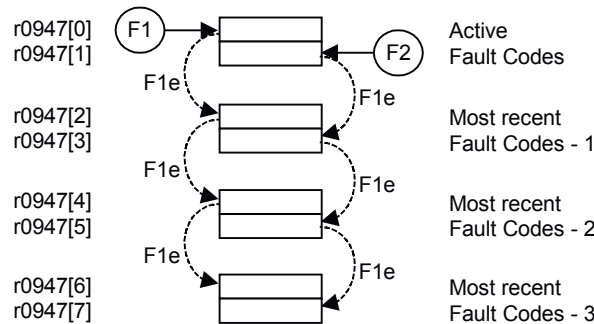

**Index:**

- r0947[0] : Recent fault trip --, fault 1
- r0947[1] : Recent fault trip --, fault 2
- r0947[2] : Recent fault trip -1, fault 3
- r0947[3] : Recent fault trip -1, fault 4
- r0947[4] : Recent fault trip -2, fault 5
- r0947[5] : Recent fault trip -2, fault 6
- r0947[6] : Recent fault trip -3, fault 7
- r0947[7] : Recent fault trip -3, fault 8

**Example:**

If the inverter trips on undervoltage and then receives an external trip before the undervoltage is acknowledged, you will obtain:

- r0947[0] = 3 Undervoltage (F0003)
- r0947[1] = 85 External trip (F0085)

Whenever a fault in index 0 is acknowledged (F1e), the fault history shifts as indicated in the diagram above.

**Dependency:**

Index 1 used only if second fault occurs before first fault is acknowledged.

**Details:**

See "Faults and Warnings"



<b>r0948[12]</b>	<b>Fault time</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> ALARMS				

Time stamp to indicate when the fault has occurred.

**Index:**

r0948[0] : Recent fault trip --, time stamp  
 r0948[1] : Recent fault trip --, time stamp  
 r0948[2] : Recent fault trip --, time stamp  
 r0948[3] : Recent fault trip -1, time stamp  
 r0948[4] : Recent fault trip -1, time stamp  
 r0948[5] : Recent fault trip -1, time stamp  
 r0948[6] : Recent fault trip -2, time stamp  
 r0948[7] : Recent fault trip -2, time stamp  
 r0948[8] : Recent fault trip -2, time stamp  
 r0948[9] : Recent fault trip -3, time stamp  
 r0948[10] : Recent fault trip -3, time stamp  
 r0948[11] : Recent fault trip -3, time stamp

**Details:**

Parameter r2114 (runtime counter) is a possible source of the time stamp. When using the runtime counter, the time is entered into the first two indices of the fault trip (shutdown) essentially the same as for r2114.

Time stamp when using r2114 (Refer to parameter r2114):

r0948[0] : Last fault trip --, system time, seconds, upper word  
 r0948[1] : Last fault trip --, system time, seconds, lower word  
 r0948[2] : 0  
 r0948[3] : Last fault trip --, system time, seconds, upper word  
 r0948[4] : Last fault trip --, system time, seconds, lower word  
 r0948[5] : 0  
 r0948[6] : Last fault trip --, system time, seconds, upper word  
 r0948[7] : Last fault trip --, system time, seconds, lower word  
 r0948[8] : 0  
 r0948[9] : Last fault trip --, system time, seconds, upper word  
 r0948[10] : Last fault trip --, system time, seconds, lower word  
 r0948[11] : 0

Parameter P2115 (AOP real-time clock) is an additional possible source of the time stamp. When using the real-time counter, instead of the system runtime r2114[0] and r2114[1], the value of the real-time clock P2115[0] to P2115[2] is read-in.

If the contents of parameter P2115 = 0, then the system assumes that there was no synchronization with the real time. In this case, if there is a fault, values are transferred from parameter r2114 into parameter P0948. If the contents of parameter P2115 are not equal to zero, then a synchronization with real time has taken place. In this case, if there is a fault, the values from parameter P2115 are transferred into parameter P0948.

Time stamp when using P2115 (Refer to parameter P2115 (AOP real-time clock)):

r0948[0] : Last fault trip --, fault time, seconds + minutes  
 r0948[1] : Last fault trip --, fault time, hours + days  
 r0948[2] : Last fault trip --, fault time, month + year  
 r0948[3] : Last fault trip -1, fault time, seconds + minutes  
 r0948[4] : Last fault trip -1, fault time, hours + days  
 r0948[5] : Last fault trip -1, fault time, month + year  
 r0948[6] : Last fault trip -2, fault time, seconds + minutes  
 r0948[7] : Last fault trip -2, fault time, hours + days  
 r0948[8] : Last fault trip -2, fault time, month + year  
 r0948[9] : Last fault trip -3, fault time, seconds + minutes  
 r0948[10] : Last fault trip -3, fault time, hours + days  
 r0948[11] : Last fault trip -3, fault time, month + year

<b>r0949[8]</b>	<b>Fault value</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> ALARMS				

Displays drive fault values. It is for service purposes and indicate the type of fault reported. The values are listed in the code where faults are reported.

**Index:**

r0949[0] : Recent fault trip --, fault value 1  
 r0949[1] : Recent fault trip --, fault value 2  
 r0949[2] : Recent fault trip -1, fault value 3  
 r0949[3] : Recent fault trip -1, fault value 4  
 r0949[4] : Recent fault trip -2, fault value 5  
 r0949[5] : Recent fault trip -2, fault value 6  
 r0949[6] : Recent fault trip -3, fault value 7  
 r0949[7] : Recent fault trip -3, fault value 8



<b>P0952</b>	<b>Total number of faults</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> ALARMS	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 0		
		<b>Max:</b> 8		

Displays number of faults stored in r0947 (last fault code).

**Dependency:**

Setting 0 resets fault history. (changing to 0 also resets parameter r0948 - fault time).

<b>r0964[5]</b>	<b>Firmware version data</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> U16	<b>Unit:</b> -	
	<b>P-Group:</b> COMM	<b>Def:</b> -	
		<b>Max:</b> -	

Firmware version data.

**Index:**

- r0964[0] : Company (Siemens = 42)
- r0964[1] : Product type
- r0964[2] : Firmware version
- r0964[3] : Firmware date (year)
- r0964[4] : Firmware date (day/month)

**Example:**

No.	Value	Meaning
r0964[0]	42	SIEMENS
r0964[1]	1001	MICROMASTER 420
	1002	MICROMASTER 440
	1003	MICRO- / COMBIMASTER 411
	1004	MICROMASTER 410
	1005	reserved
	1006	MICROMASTER 440 PX
	1007	MICROMASTER 430
r0964[2]	105	Firmware V1.05
r0964[3]	2001	27.10.2001
r0964[4]	2710	

<b>r0965</b>	<b>Profibus profile</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> U16	<b>Unit:</b> -	
	<b>P-Group:</b> COMM	<b>Def:</b> -	
		<b>Max:</b> -	

Identification for PROFIDrive. Profile number and version.

<b>r0967</b>	<b>Control word 1</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> U16	<b>Unit:</b> -	
	<b>P-Group:</b> COMM	<b>Def:</b> -	
		<b>Max:</b> -	

Displays control word 1.

**Bitfields:**

Bit00	ON/OFF1	0	NO	1	YES
Bit01	OFF2: Electrical stop	0	YES	1	NO
Bit02	OFF3: Fast stop	0	YES	1	NO
Bit03	Pulse enable	0	NO	1	YES
Bit04	RFG enable	0	NO	1	YES
Bit05	RFG start	0	NO	1	YES
Bit06	Setpoint enable	0	NO	1	YES
Bit07	Fault acknowledge	0	NO	1	YES
Bit08	JOG right	0	NO	1	YES
Bit09	JOG left	0	NO	1	YES
Bit10	Control from PLC	0	NO	1	YES
Bit11	Reverse (setpoint inversion)	0	NO	1	YES
Bit13	Motor potentiometer MOP up	0	NO	1	YES
Bit14	Motor potentiometer MOP down	0	NO	1	YES
Bit15	CDS Bit 0 (Local/Remote)	0	NO	1	YES

<b>r0968</b>	<b>Status word 1</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMM			<b>Def:</b> - <b>Max:</b> -	

Displays active status word of inverter (in binary) and can be used to diagnose which commands are active.

**Bitfields:**

Bit00	Drive ready	0	NO	1	YES
Bit01	Drive ready to run	0	NO	1	YES
Bit02	Drive running	0	NO	1	YES
Bit03	Drive fault active	0	NO	1	YES
Bit04	OFF2 active	0	YES	1	NO
Bit05	OFF3 active	0	YES	1	NO
Bit06	ON inhibit active	0	NO	1	YES
Bit07	Drive warning active	0	NO	1	YES
Bit08	Deviation setpoint / act. value	0	YES	1	NO
Bit09	PZD control	0	NO	1	YES
Bit10	Maximum frequency reached	0	NO	1	YES
Bit11	Warning: Motor current limit	0	YES	1	NO
Bit12	Motor holding brake active	0	NO	1	YES
Bit13	Motor overload	0	YES	1	NO
Bit14	Motor runs right	0	NO	1	YES
Bit15	Inverter overload	0	YES	1	NO

<b>P0970</b>	<b>Factory reset</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	<b>Level</b> <b>1</b>
	<b>CStat:</b> C	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0 <b>Max:</b> 1	

P0970 = 1 resets all parameters to their default values.

**Possible Settings:**

- 0 Disabled
- 1 Parameter reset

**Dependency:**

First set P0010 = 30 (factory settings).

Stop drive (i.e. disable all pulses) before you can reset parameters to default values.

**Note:**

The following parameters retain their values after a factory reset:

- P0014 Store mode
- r0039 CO: Energy consumption meter [kWh]
- P0100 Europe / North America
- P0918 CB address
- P2010 USS baud rate
- P2011 USS address

<b>P0971</b>	<b>Transfer data from RAM to EEPROM</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0 <b>Max:</b> 1	

Transfers values from RAM to EEPROM when set to 1.

**Possible Settings:**

- 0 Disabled
- 1 Start transfer

**Note:**

All values in RAM are transferred to EEPROM.

Parameter is automatically reset to 0 (default) after successful transfer.

The storage from RAM to EEPROM is accomplished via P0971. The communications are reset, if the transfer was successful. During the reset process communications will be interrupted. This creates the following conditions:

- PLC (e.g. SIMATIC S7) enters Stop mode
- Starter automatically recovers communications once they are re-established.
- BOP displays "busy"

After completion of the transfer process, the communication between the inverter and the PC-tools (e.g. Starter) or BOP is automatically re-established.

### 3.16 Setpoint source

<b>P1000[3]</b>	<b>Selection of frequency setpoint</b>				<b>Min:</b> 0	<b>Level</b> <b>1</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 2		
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes	<b>Max:</b> 77		

Selects frequency setpoint source. In the table of possible settings below, the main setpoint is selected from the least significant digit (i.e., 0 to 7) and any additional setpoint from the most significant digit (i.e., x0 through to x7).

**Possible Settings:**

- 0 No main setpoint
- 1 MOP setpoint
- 2 Analog setpoint
- 3 Fixed frequency
- 4 USS on BOP link
- 5 USS on COM link
- 6 CB on COM link
- 7 Analog setpoint 2
- 10 No main setpoint + MOP setpoint
- 11 MOP setpoint + MOP setpoint
- 12 Analog setpoint + MOP setpoint
- 13 Fixed frequency + MOP setpoint
- 14 USS on BOP link + MOP setpoint
- 15 USS on COM link + MOP setpoint
- 16 CB on COM link + MOP setpoint
- 17 Analog setpoint 2 + MOP setpoint
- 20 No main setpoint + Analog setpoint
- 21 MOP setpoint + Analog setpoint
- 22 Analog setpoint + Analog setpoint
- 23 Fixed frequency + Analog setpoint
- 24 USS on BOP link + Analog setpoint
- 25 USS on COM link + Analog setpoint
- 26 CB on COM link + Analog setpoint
- 27 Analog setpoint 2 + Analog setpoint
- 30 No main setpoint + Fixed frequency
- 31 MOP setpoint + Fixed frequency
- 32 Analog setpoint + Fixed frequency
- 33 Fixed frequency + Fixed frequency
- 34 USS on BOP link + Fixed frequency
- 35 USS on COM link + Fixed frequency
- 36 CB on COM link + Fixed frequency
- 37 Analog setpoint 2 + Fixed frequency
- 40 No main setpoint + USS on BOP link
- 41 MOP setpoint + USS on BOP link
- 42 Analog setpoint + USS on BOP link
- 43 Fixed frequency + USS on BOP link
- 44 USS on BOP link + USS on BOP link
- 45 USS on COM link + USS on BOP link
- 46 CB on COM link + USS on BOP link
- 47 Analog setpoint 2 + USS on BOP link
- 50 No main setpoint + USS on COM link
- 51 MOP setpoint + USS on COM link
- 52 Analog setpoint + USS on COM link
- 53 Fixed frequency + USS on COM link
- 54 USS on BOP link + USS on COM link
- 55 USS on COM link + USS on COM link
- 57 Analog setpoint 2 + USS on COM link
- 60 No main setpoint + CB on COM link
- 61 MOP setpoint + CB on COM link
- 62 Analog setpoint + CB on COM link
- 63 Fixed frequency + CB on COM link
- 64 USS on BOP link + CB on COM link
- 66 CB on COM link + CB on COM link
- 67 Analog setpoint 2 + CB on COM link
- 70 No main setpoint + Analog setpoint 2
- 71 MOP setpoint + Analog setpoint 2
- 72 Analog setpoint + Analog setpoint 2
- 73 Fixed frequency + Analog setpoint 2
- 74 USS on BOP link + Analog setpoint 2
- 75 USS on COM link + Analog setpoint 2
- 76 CB on COM link + Analog setpoint 2
- 77 Analog setpoint 2 + Analog setpoint 2

**Index:**


- P1000[0] : 1st. Command data set (CDS)
- P1000[1] : 2nd. Command data set (CDS)
- P1000[2] : 3rd. Command data set (CDS)

**Example:**

Setting 12 selects main setpoint (2) derived from analog input with additional setpoint (1) taken from the motor potentiometer.

**Example P1000 = 12 :**

P1000 = 12 ⇒ P1070 = 755	P1070 CI: Main setpoint
	r0755 CO: Act. ADC after scal. [4000h]
P1000 = 12 ⇒ P1075 = 1050	P1075 CI: Additional setpoint
	r1050 CO: Act. Output freq. of the MOP

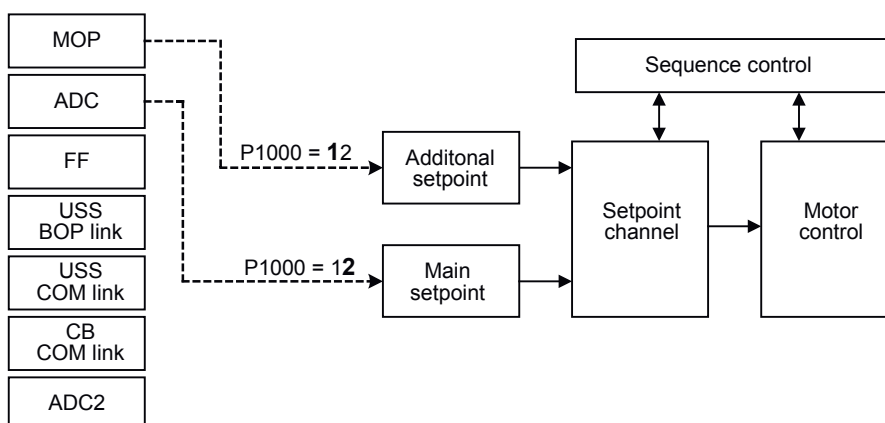

**Caution:**

Be aware, by changing of parameter P1000 all BICO parameters (see table below) are modified.

**Note:**

Single digits denote main setpoints that have no additional setpoint.

Changing this parameter sets (to default) all settings on item selected (see table).

		P1000 = xy								
		y = 0	y = 1	y = 2	y = 3	y = 4	y = 5	y = 6		y = 7
x = 0		0.0	1050.0	755.0	1024.0	2015.1	2018.1	2050.1	755.1	P1070
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1071
		0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	P1075
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1076
x = 1		0.0	1050.0	755.0	1024.0	2015.1	2018.1	2050.1	755.1	P1070
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1071
		1050.0	1050.0	1050.0	1050.0	1050.0	1050.0	1050.0	1050.0	P1075
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1076
x = 2		0.0	1050.0	755.0	1024.0	2015.1	2018.1	2050.1	755.1	P1070
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1071
		755.0	755.0	755.0	755.0	755.0	755.0	755.0	755.0	P1075
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1076
x = 3		0.0	1050.0	755.01	1024.0	2015.1	2018.1	2050.1	755.1	P1070
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1071
		1024.0	1024.0	1024.0	1024.0	1024.0	1024.0	1024.0	1024.0	P1075
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1076
x = 4		0.0	1050.0	755.0	1024.0	2015.1	2018.1	2050.1	755.1	P1070
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1071
		2015.1	2015.1	2015.1	2015.1	2015.1	2015.1	2015.1	2015.1	P1075
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1076
x = 5		0.0	1050.0	755.0	1024.0	2015.1	2018.1		755.1	P1070
		1.0	1.0	1.0	1.0	1.0	1.0		1.0	P1071
		2018.1	2018.1	2018.1	2018.1	2018.1	2018.1		2018.1	P1075
		1.0	1.0	1.0	1.0	1.0	1.0		1.0	P1076
x = 6		0.0	1050.0	755.0	1024.0	2015.1		2050.1	755.1	P1070
		1.0	1.0	1.0	1.0	1.0		1.0	1.0	P1071
		2050.1	2050.1	2050.1	2050.1	2050.1		2050.1	2050.1	P1075
		1.0	1.0	1.0	1.0	1.0		1.0	1.0	P1076
x = 7		0.0	1050.0	755.0	1024.0	2015.1	2018.1	2050.1	755.1	P1070
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1071
		755.1	755.1	755.1	755.1	755.1	755.1	755.1	755.1	P1075
		1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	P1076

**Example:**

P1000 = 21 → P1070 = 1050.0  
 P1071 = 1.0  
 P1075 = 755.0  
 P1076 = 1.0

### 3.17 Fixed frequencies

<b>P1001[3]</b>	<b>Fixed frequency 1</b>			<b>Min:</b> -650.00	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> 0.00	
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 650.00	

Defines fixed frequency setpoint 1.

There are three options available for selection of the fixed frequencies:

1. Direct selection
  2. Direct selection + ON command
  3. Binary coded selection + ON command
1. Direct selection (P0701 - P0706 = 15):
    - In this mode of operation 1 digital input selects 1 fixed frequency.
    - If several inputs are active together, the selected frequencies are summed.
    - E.g.: FF1 + FF2 + FF3 + FF4 + FF5 + FF6.
  2. Direct selection + ON command (P0701 - P0706 = 16):
    - The fixed frequency selection combines the fixed frequencies with an ON command.
    - In this mode of operation 1 digital input selects 1 fixed frequency.
    - If several inputs are active together, the selected frequencies are summed.
    - E.g.: FF1 + FF2 + FF3 + FF4 + FF5 + FF6.
  3. Binary coded selection + ON command (P0701 - P0706 = 17):
    - Up to 16 fixed frequencies can be selected using this method.
    - The fixed frequencies are selected according to the following table:

**Index:**

- P1001[0] : 1st. Drive data set (DDS)  
 P1001[1] : 2nd. Drive data set (DDS)  
 P1001[2] : 3rd. Drive data set (DDS)


**Example:**

Binary coded selection :

		DIN4	DIN3	DIN2	DIN1
0 Hz	FF0	0	0	0	0
P1001	FF1	0	0	0	1
P1002	FF2	0	0	1	0
P1003	FF3	0	0	1	1
P1004	FF4	0	1	0	0
P1005	FF5	0	1	0	1
P1006	FF6	0	1	1	0
P1007	FF7	0	1	1	1
P1008	FF8	1	0	0	0
P1009	FF9	1	0	0	1
P1010	FF10	1	0	1	0
P1011	FF11	1	0	1	1
P1012	FF12	1	1	0	0
P1013	FF13	1	1	0	1
P1014	FF14	1	1	1	0
P1015	FF15	1	1	1	1

Direct selection of FF P1001 via DIN 1:

P0701 = 15 or P0701 = 99, P1020 = 722.0, P1016 = 1  
P0702 = 15 or P0702 = 99, P1021 = 722.1, P1017 = 1

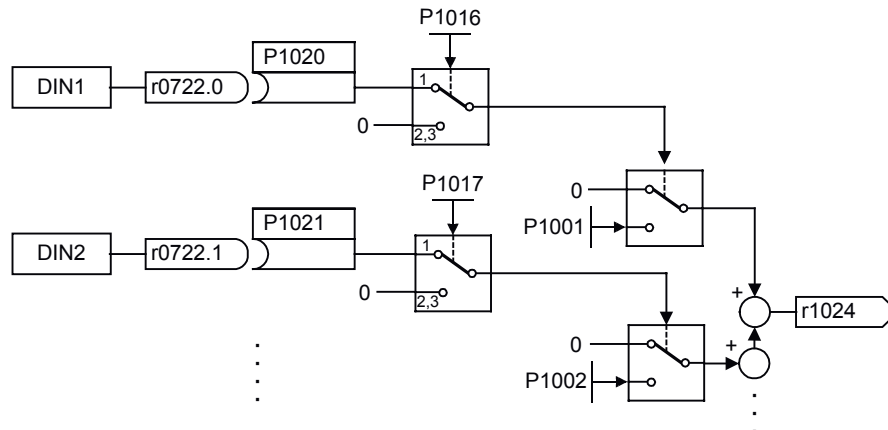

**Dependency:**

Select fixed frequency operation (using P1000).

Inverter requires ON command to start in the case of direct selection (P0701 - P0706 = 15).

**Note:**

Fixed frequencies can be selected using the digital inputs, and can also be combined with an ON command.

<b>P1002[3]</b>	<b>Fixed frequency 2</b>	<b>Min:</b> -650.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 5.00	<b>2</b>
		<b>Max:</b> 650.00	

Defines fixed frequency setpoint 2.

**Index:**

P1002[0] : 1st. Drive data set (DDS)  
P1002[1] : 2nd. Drive data set (DDS)  
P1002[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1003[3]</b>	<b>Fixed frequency 3</b>	<b>Min:</b> -650.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 10.00	<b>2</b>
		<b>Max:</b> 650.00	

Defines fixed frequency setpoint 3.

**Index:**

P1003[0] : 1st. Drive data set (DDS)  
P1003[1] : 2nd. Drive data set (DDS)  
P1003[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1004[3]</b>	<b>Fixed frequency 4</b>	<b>Min:</b> -650.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 15.00	<b>2</b>
		<b>Max:</b> 650.00	

Defines fixed frequency setpoint 4.

**Index:**

P1004[0] : 1st. Drive data set (DDS)  
P1004[1] : 2nd. Drive data set (DDS)  
P1004[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1005[3]</b>	<b>Fixed frequency 5</b>	<b>Min:</b> -650.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 20.00	<b>2</b>
		<b>Max:</b> 650.00	

Defines fixed frequency setpoint 5.

**Index:**

P1005[0] : 1st. Drive data set (DDS)  
P1005[1] : 2nd. Drive data set (DDS)  
P1005[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1006[3]</b>	<b>Fixed frequency 6</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -650.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 25.00	
	<b>P-Group:</b> SETPOINT			<b>Max:</b> 650.00	

Defines fixed frequency setpoint 6.

**Index:**

P1006[0] : 1st. Drive data set (DDS)  
P1006[1] : 2nd. Drive data set (DDS)  
P1006[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1007[3]</b>	<b>Fixed frequency 7</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -650.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 30.00	
	<b>P-Group:</b> SETPOINT			<b>Max:</b> 650.00	

Defines fixed frequency setpoint 7.

**Index:**

P1007[0] : 1st. Drive data set (DDS)  
P1007[1] : 2nd. Drive data set (DDS)  
P1007[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1008[3]</b>	<b>Fixed frequency 8</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -650.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 35.00	
	<b>P-Group:</b> SETPOINT			<b>Max:</b> 650.00	

Defines fixed frequency setpoint 8.

**Index:**

P1008[0] : 1st. Drive data set (DDS)  
P1008[1] : 2nd. Drive data set (DDS)  
P1008[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1009[3]</b>	<b>Fixed frequency 9</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -650.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 40.00	
	<b>P-Group:</b> SETPOINT			<b>Max:</b> 650.00	

Defines fixed frequency setpoint 9.

**Index:**

P1009[0] : 1st. Drive data set (DDS)  
P1009[1] : 2nd. Drive data set (DDS)  
P1009[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1010[3]</b>	<b>Fixed frequency 10</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -650.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 45.00	
	<b>P-Group:</b> SETPOINT			<b>Max:</b> 650.00	

Defines fixed frequency setpoint 10.

**Index:**

P1010[0] : 1st. Drive data set (DDS)  
P1010[1] : 2nd. Drive data set (DDS)  
P1010[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1011[3]</b>	<b>Fixed frequency 11</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -650.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 50.00	
	<b>P-Group:</b> SETPOINT			<b>Max:</b> 650.00	

Defines fixed frequency setpoint 11.

**Index:**

P1011[0] : 1st. Drive data set (DDS)  
P1011[1] : 2nd. Drive data set (DDS)  
P1011[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).



<b>P1012[3]</b>	<b>Fixed frequency 12</b>	<b>Min:</b> -650.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Defines fixed frequency setpoint 12.

**Index:**

P1012[0] : 1st. Drive data set (DDS)  
P1012[1] : 2nd. Drive data set (DDS)  
P1012[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1013[3]</b>	<b>Fixed frequency 13</b>	<b>Min:</b> -650.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Defines fixed frequency setpoint 13.

**Index:**

P1013[0] : 1st. Drive data set (DDS)  
P1013[1] : 2nd. Drive data set (DDS)  
P1013[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1014[3]</b>	<b>Fixed frequency 14</b>	<b>Min:</b> -650.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Defines fixed frequency setpoint 14.

**Index:**

P1014[0] : 1st. Drive data set (DDS)  
P1014[1] : 2nd. Drive data set (DDS)  
P1014[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1015[3]</b>	<b>Fixed frequency 15</b>	<b>Min:</b> -650.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Defines fixed frequency setpoint 15.

**Index:**

P1015[0] : 1st. Drive data set (DDS)  
P1015[1] : 2nd. Drive data set (DDS)  
P1015[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1001 (fixed frequency 1).

<b>P1016</b>	<b>Fixed frequency mode - Bit 0</b>	<b>Min:</b> 1	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Fixed frequencies can be selected in three different modes. Parameter P1016 defines the mode of selection Bit 0.

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command
- 3 Binary coded selection + ON command

**Details:**

See table in P1001 (fixed frequency 1) for description of how to use fixed frequencies.

<b>P1017</b>	<b>Fixed frequency mode - Bit 1</b>	<b>Min:</b> 1	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Fixed frequencies can be selected in three different modes. Parameter P1017 defines the mode of selection Bit 1.

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command
- 3 Binary coded selection + ON command

**Details:**

See table in P1001 (fixed frequency 1) for description of how to use fixed frequencies.

<b>P1018</b>	<b>Fixed frequency mode - Bit 2</b>				Min: 1	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 1		
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 3		

Fixed frequencies can be selected in three different modes. Parameter P1018 defines the mode of selection Bit 2.

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command
- 3 Binary coded selection + ON command

**Details:**

See table in P1001 (fixed frequency 1) for description of how to use fixed frequencies.

<b>P1019</b>	<b>Fixed frequency mode - Bit 3</b>				Min: 1	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 1		
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 3		

Fixed frequencies can be selected in three different modes. Parameter P1019 defines the mode of selection Bit 3.

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command
- 3 Binary coded selection + ON command

**Details:**

See table in P1001 (fixed frequency 1) for description of how to use fixed frequencies.

<b>P1020[3]</b>	<b>BI: Fixed freq. selection Bit 0</b>				Min: 0:0	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines origin of fixed frequency selection.

**Index:**

- P1020[0] : 1st. Command data set (CDS)
- P1020[1] : 2nd. Command data set (CDS)
- P1020[2] : 3rd. Command data set (CDS)

**Common Settings:**

- P1020 = 722.0 ==> Digital input 1
- P1021 = 722.1 ==> Digital input 2
- P1022 = 722.2 ==> Digital input 3
- P1023 = 722.3 ==> Digital input 4
- P1026 = 722.4 ==> Digital input 5
- P1028 = 722.5 ==> Digital input 6

**Dependency:**

Accessible only if P0701 - P0706 = 99 (function of digital inputs = BICO)

<b>P1021[3]</b>	<b>BI: Fixed freq. selection Bit 1</b>				Min: 0:0	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines origin of fixed frequency selection.

**Index:**

- P1021[0] : 1st. Command data set (CDS)
- P1021[1] : 2nd. Command data set (CDS)
- P1021[2] : 3rd. Command data set (CDS)

**Dependency:**

Accessible only if P0701 - P0706 = 99 (function of digital inputs = BICO)

**Details:**

See P1020 (fixed frequency selection Bit 0) for most common settings

<b>P1022[3]</b>	<b>BI: Fixed freq. selection Bit 2</b>				Min: 0:0	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines origin of fixed frequency selection.

**Index:**

- P1022[0] : 1st. Command data set (CDS)
- P1022[1] : 2nd. Command data set (CDS)
- P1022[2] : 3rd. Command data set (CDS)

**Dependency:**

Accessible only if P0701 - P0706 = 99 (function of digital inputs = BICO)

**Details:**

See P1020 (fixed frequency selection Bit 0) for most common settings

<b>P1023[3]</b>	<b>BI: Fixed freq. selection Bit 3</b>				<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 722:3		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines origin of fixed frequency selection.

**Index:**

P1023[0] : 1st. Command data set (CDS)  
P1023[1] : 2nd. Command data set (CDS)  
P1023[2] : 3rd. Command data set (CDS)

**Dependency:**

Accessible only if P0701 - P0706 = 99 (function of digital inputs = BICO)

**Details:**

See P1020 (fixed frequency selection Bit 0) for most common settings

<b>r1024</b>	<b>CO: Act. fixed frequency</b>			<b>Min:</b> -	Level <b>3</b>
		<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> -	
	<b>P-Group:</b> SETPOINT			<b>Max:</b> -	

Displays sum total of selected fixed frequencies.

<b>P1025</b>	<b>Fixed frequency mode - Bit 4</b>				<b>Min:</b> 1	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 1		
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 2		

Direct selection or direct selection + ON for bit 4

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command

**Details:**

See parameter P1001 for description of how to use fixed frequencies.

<b>P1026[3]</b>	<b>BI: Fixed freq. selection Bit 4</b>				<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 722:4		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines origin of fixed frequency selection.

**Index:**

P1026[0] : 1st. Command data set (CDS)  
P1026[1] : 2nd. Command data set (CDS)  
P1026[2] : 3rd. Command data set (CDS)

**Dependency:**

Accessible only if P0701 - P0706 = 99 (function of digital inputs = BICO).

**Details:**

See P1020 (fixed frequency selection Bit 0) for most common settings.

<b>P1027</b>	<b>Fixed frequency mode - Bit 5</b>				<b>Min:</b> 1	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 1		
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 2		

direct selection or direct selection + ON for bit 5

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command

**Details:**

See parameter P1001 for description of how to use fixed frequencies.

<b>P1028[3]</b>	<b>BI: Fixed freq. selection Bit 5</b>				<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 722:5		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines origin of fixed frequency selection.

**Index:**

P1028[0] : 1st. Command data set (CDS)  
P1028[1] : 2nd. Command data set (CDS)  
P1028[2] : 3rd. Command data set (CDS)

**Dependency:**

Accessible only if P0701 - P0706 = 99 (function of digital inputs = BICO).

**Details:**

See P1020 (fixed frequency selection Bit 0) for most common settings.

### 3.18 Motorized potentiometer (MOP)

<b>P1031[3]</b>	<b>Setpoint memory of the MOP</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 1		

Saves last motor potentiometer setpoint (MOP) that was active before OFF command or power down.

**Possible Settings:**

- 0 MOP setpoint will not be stored
- 1 MOP setpoint will be stored (P1040 is updated)

**Index:**

- P1031[0] : 1st. Drive data set (DDS)
- P1031[1] : 2nd. Drive data set (DDS)
- P1031[2] : 3rd. Drive data set (DDS)

**Note:**

On next ON command, motor potentiometer setpoint will be the saved value in parameter P1040 (setpoint of the MOP).

<b>P1032</b>	<b>Inhibit negative MOP setpoints</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 1		
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 1		

This parameter suppresses negative setpoints of the MOP output r1050.

**Possible Settings:**

- 0 Neg. MOP setpoint is allowed
- 1 Neg. MOP setpoint inhibited

**Note:**

The reversing functions (e.g. BOP-Reverse button if P0700 = 1) are not affected by the settings of P1032. Use P1110 to fully prevent change of direction in setpoint channel.

<b>P1035[3]</b>	<b>BI: Enable MOP (UP-command)</b>				<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 19:13		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines source for motor potentiometer setpoint increase frequency.

**Index:**

- P1035[0] : 1st. Command data set (CDS)
- P1035[1] : 2nd. Command data set (CDS)
- P1035[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)
- 19.D = MOP up via BOP

<b>P1036[3]</b>	<b>BI: Enable MOP (DOWN-command)</b>				<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 19:14		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines source for motor potentiometer setpoint decrease frequency.

**Index:**

- P1036[0] : 1st. Command data set (CDS)
- P1036[1] : 2nd. Command data set (CDS)
- P1036[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)
- 19.E = MOP down via BOP

<b>P1040[3]</b>	<b>Setpoint of the MOP</b>	<b>Min:</b> -650.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 5.00	<b>2</b>
		<b>Max:</b> 650.00	

Determines setpoint for motor potentiometer control (P1000 = 1).

**Index:**

- P1040[0] : 1st. Drive data set (DDS)
- P1040[1] : 2nd. Drive data set (DDS)
- P1040[2] : 3rd. Drive data set (DDS)


**Note:**

If motor potentiometer setpoint is selected either as main setpoint or additional setpoint, the reverse direction will be inhibited by default of P1032 (inhibit reverse direction of MOP).

To re-enable reverse direction, set P1032 = 0.

<b>r1050</b>	<b>CO: Act. Output freq. of the MOP</b>	<b>Min:</b> -	<b>Level</b>
		<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Def:</b> -	<b>3</b>
		<b>Max:</b> -	

Displays output frequency of motor potentiometer setpoint ([Hz]).

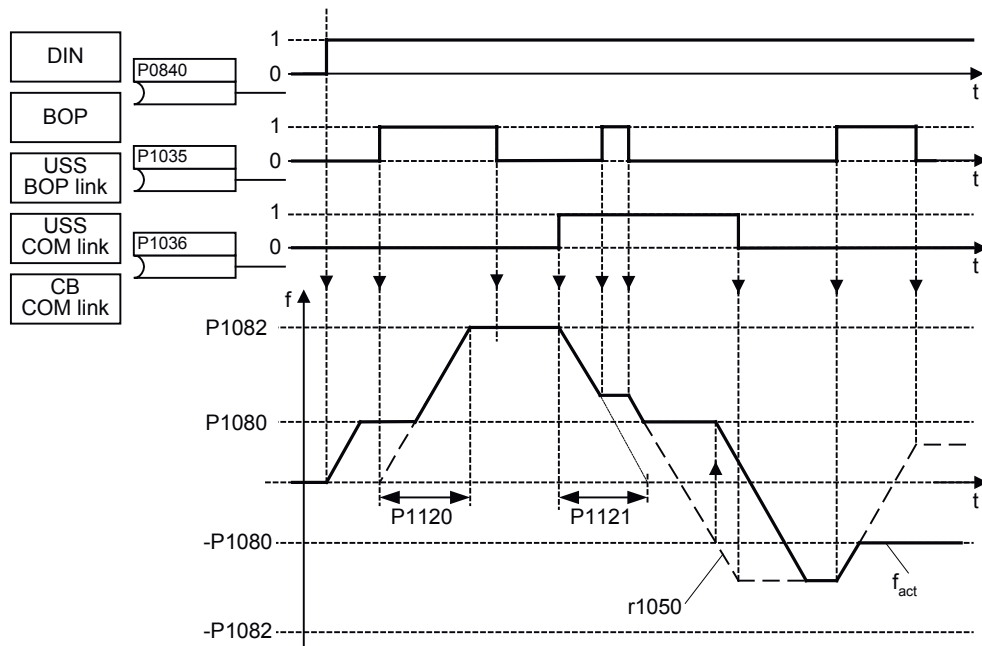

Possible parameter settings for the selection of MOP:

	<b>Selection</b>	<b>MOP up</b>	<b>MOP down</b>
<b>DIN</b>	P0719 = 0, P0700 = 2, P1000 = 1 or P0719 = 1, P0700 = 2	P0702 = 13 (DIN2)	P0703 = 14 (DIN3)
<b>BOP</b>	P0719 = 0, P0700 = 1, P1000 = 1 or P0719 = 1, P0700 = 1 or P0719 = 11	UP button	DOWN button
<b>USS on BOP link</b>	P0719 = 0, P0700 = 4, P1000 = 1 or P0719 = 1, P0700 = 4 or P0719 = 41	USS control word r2032 Bit13	USS control word r2032 Bit14
<b>USS on COM link</b>	P0719 = 0, P0700 = 5, P1000 = 1 or P0719 = 1, P0700 = 5 or P0719 = 51	USS control word r2036 Bit13	USS control word r2036 Bit14
<b>CB</b>	P0719 = 0, P0700 = 6, P1000 = 1 or P0719 = 1, P0700 = 6 or P0719 = 61	CB control word r2090 Bit13	CB control word r2090 Bit14

### 3.19 JOG

<b>P1055[3]</b>	<b>BI: Enable JOG right</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U32		<b>Unit:</b> -
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 0:0		<b>Max:</b> 4000:0

Defines source of JOG right.

**Index:**

- P1055[0] : 1st. Command data set (CDS)
- P1055[1] : 2nd. Command data set (CDS)
- P1055[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)
- 19.8 = JOG right via BOP

**Dependency:**

Active only when P0719 < 10. See parameter P0719 (Selection of command/setpoint source).

<b>P1056[3]</b>	<b>BI: Enable JOG left</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U32		<b>Unit:</b> -
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 0:0		<b>Max:</b> 4000:0

Defines source of JOG left.

**Index:**

- P1056[0] : 1st. Command data set (CDS)
- P1056[1] : 2nd. Command data set (CDS)
- P1056[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)
- 19.9 = JOG left via BOP


**Dependency:**

Active only when P0719 < 10. See parameter P0719 (Selection of command/setpoint source).

<b>P1058[3]</b>	<b>JOG frequency right</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 5.00	<b>2</b>
		<b>Max:</b> 650.00	

Jogging increases the motor frequency by small amounts. The JOG buttons uses a non-latching switch on one of the digital inputs to control the motor frequency.

If JOG clockwise (jogging clockwise) or JOG counter-clockwise is selected, the speed is increased until the value, set in P1058 is reached.

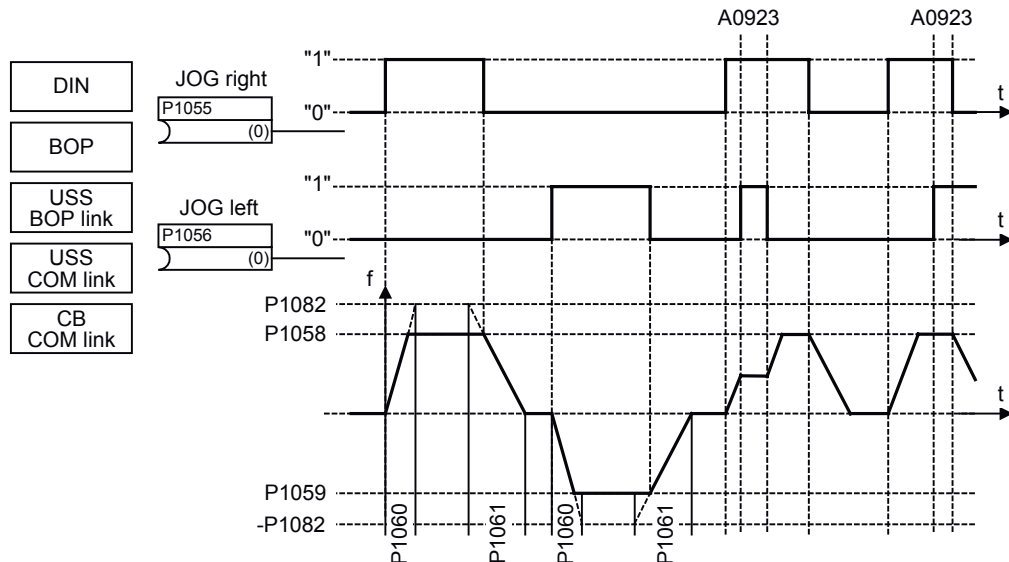

**Index:**

- P1058[0] : 1st. Drive data set (DDS)
- P1058[1] : 2nd. Drive data set (DDS)
- P1058[2] : 3rd. Drive data set (DDS)

**Dependency:**

P1060 and P1061 set up and down ramp times respectively for jogging.

<b>P1059[3]</b>	<b>JOG frequency left</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 5.00	<b>2</b>
		<b>Max:</b> 650.00	

While JOG left is selected, this parameter determines the frequency at which the inverter will run.

**Index:**

- P1059[0] : 1st. Drive data set (DDS)
- P1059[1] : 2nd. Drive data set (DDS)
- P1059[2] : 3rd. Drive data set (DDS)


**Dependency:**

P1060 and P1061 set up and down ramp times respectively for jogging.



<b>P1060[3]</b>	<b>JOG ramp-up time</b>	<b>Min:</b> 0.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> s
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 10.00		
		<b>Max:</b> 650.00		

Sets jog ramp-up time. This is the time used while jogging is active.

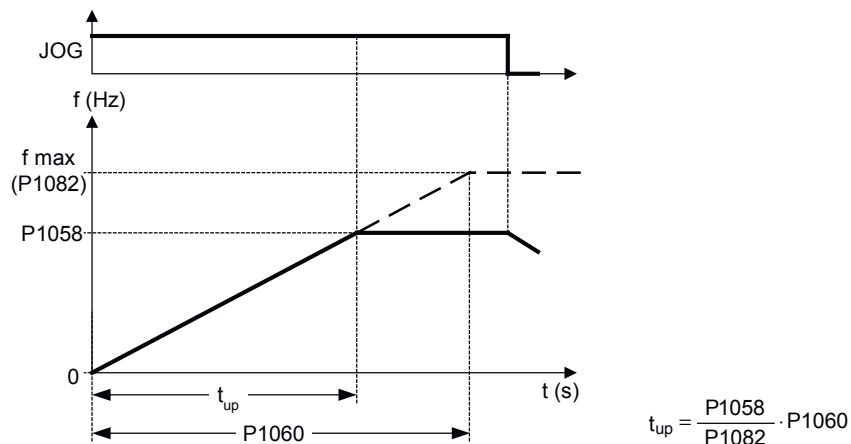

**Index:**


- P1060[0] : 1st. Drive data set (DDS)
- P1060[1] : 2nd. Drive data set (DDS)
- P1060[2] : 3rd. Drive data set (DDS)

**Notice:**

- Ramp times will be used as follows:
- P1060 / P1061 : JOG mode is active
  - P1120 / P1121 : Normal mode (ON/OFF) is active
  - P1060 / P1061 : Normal mode (ON/OFF) and P1124 is active

<b>P1061[3]</b>	<b>JOG ramp-down time</b>	<b>Min:</b> 0.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> s
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 10.00		
		<b>Max:</b> 650.00		

Sets ramp-down time. This is the time used while jogging is active.

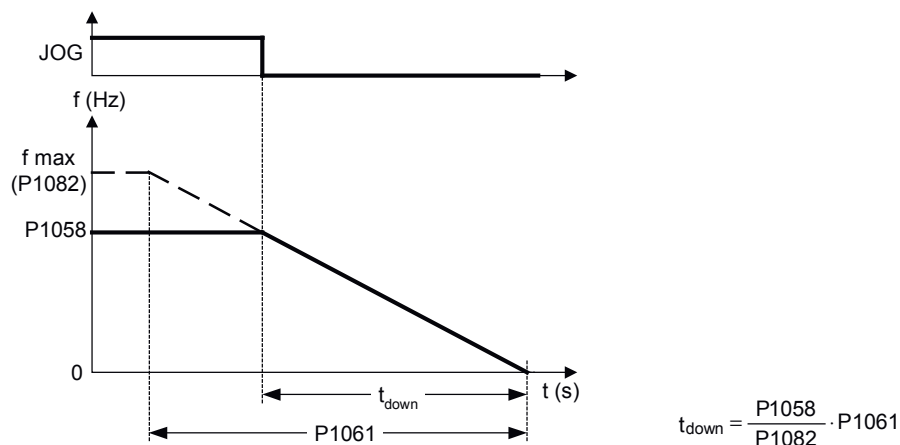

**Index:**

- P1061[0] : 1st. Drive data set (DDS)
- P1061[1] : 2nd. Drive data set (DDS)
- P1061[2] : 3rd. Drive data set (DDS)

**Notice:**

- Ramp times will be used as follows:
- P1060 / P1061 : JOG mode is active
  - P1120 / P1121 : Normal mode (ON/OFF) is active
  - P1060 / P1061 : Normal mode (ON/OFF) and P1124 is active



## 3.20 Setpoint channel

<b>P1070[3]</b>	<b>CI: Main setpoint</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U32		<b>Def:</b> 755:0
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Defines source of main setpoint.

**Index:**

P1070[0] : 1st. Command data set (CDS)  
P1070[1] : 2nd. Command data set (CDS)  
P1070[2] : 3rd. Command data set (CDS)

**Common Settings:**

755 = Analog input 1 setpoint  
1024 = Fixed frequency setpoint  
1050 = Motor potentiometer (MOP) setpoint

<b>P1071[3]</b>	<b>CI: Main setpoint scaling</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U32		<b>Def:</b> 1:0
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Defines source of the main setpoint scaling.

**Index:**

P1071[0] : 1st. Command data set (CDS)  
P1071[1] : 2nd. Command data set (CDS)  
P1071[2] : 3rd. Command data set (CDS)

**Common Settings:**

755 = Analog input 1 setpoint  
1024 = Fixed frequency setpoint  
1050 = Motor potentiometer (MOP) setpoint

<b>P1074[3]</b>	<b>BI: Disable additional setpoint</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Disables additional setpoint

**Index:**

P1074[0] : 1st. Command data set (CDS)  
P1074[1] : 2nd. Command data set (CDS)  
P1074[2] : 3rd. Command data set (CDS)

**Common Settings:**

722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)  
722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)  
722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)  
722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)  
722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)  
722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)  
722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)  
722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)

<b>P1075[3]</b>	<b>CI: Additional setpoint</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Defines source of the additional setpoint (to be added to main setpoint).

**Index:**

P1075[0] : 1st. Command data set (CDS)  
P1075[1] : 2nd. Command data set (CDS)  
P1075[2] : 3rd. Command data set (CDS)

**Common Settings:**

755 = Analog input 1 setpoint  
1024 = Fixed frequency setpoint  
1050 = Motor potentiometer (MOP) setpoint

<b>P1076[3]</b>	<b>CI: Additional setpoint scaling</b>				<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 1:0		
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines source of scaling for additional setpoint (to be added to main setpoint).

**Index:**

P1076[0] : 1st. Command data set (CDS)  
P1076[1] : 2nd. Command data set (CDS)  
P1076[2] : 3rd. Command data set (CDS)

**Common Settings:**

1 = Scaling of 1.0 (100%)  
755 = Analog input 1 Setpoint  
1024 = Fixed Frequency Setpoint  
1050 = MOP Setpoint

<b>r1078</b>	<b>CO: Total frequency setpoint</b>				<b>Min:</b> -	Level <b>3</b>
		<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> -		
	<b>P-Group:</b> SETPOINT			<b>Max:</b> -		

Displays sum of main and additional setpoints in [Hz].

<b>r1079</b>	<b>CO: Selected frequency setpoint</b>				<b>Min:</b> -	Level <b>3</b>
		<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> -		
	<b>P-Group:</b> SETPOINT			<b>Max:</b> -		

Displays selected frequency setpoint.

Following frequency setpoints are displayed:

- r1078 Total frequency setpoint
- P1058 JOG frequency right
- P1059 JOG frequency left

**Dependency:**

P1055 (BI: Enable JOG right) or P1056 (BI: Enable JOG left) define command source of JOG right or JOG left respectively.

**Note:**

P1055 = 0 and P1056 = 0 ==> Total frequency setpoint is selected.

<b>P1080[3]</b>	<b>Min. frequency</b>			<b>Min:</b> 0.00	<b>Level</b> <b>1</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> 0.00	
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> Yes	<b>Max:</b> 650.00	

Sets minimum motor frequency [Hz] at which motor will run irrespective of frequency setpoint.


The minimum frequency P1080 represents a masking frequency of 0 Hz for all frequency target value sources (e.g. ADC, MOP, FF, USS), with the exception of the JOG target value source (analogous to P1091). Thus the frequency band +/- P1080 is run through in optimum time by means of the acceleration/deceleration ramps. Dwelling in the frequency band is not possible (see example).

Furthermore, an undershoot of the actual frequency  $f_{act}$  below min. frequency P1080 is output by the following signal function.

**Index:**

- P1080[0] : 1st. Drive data set (DDS)
- P1080[1] : 2nd. Drive data set (DDS)
- P1080[2] : 3rd. Drive data set (DDS)

**Example:**

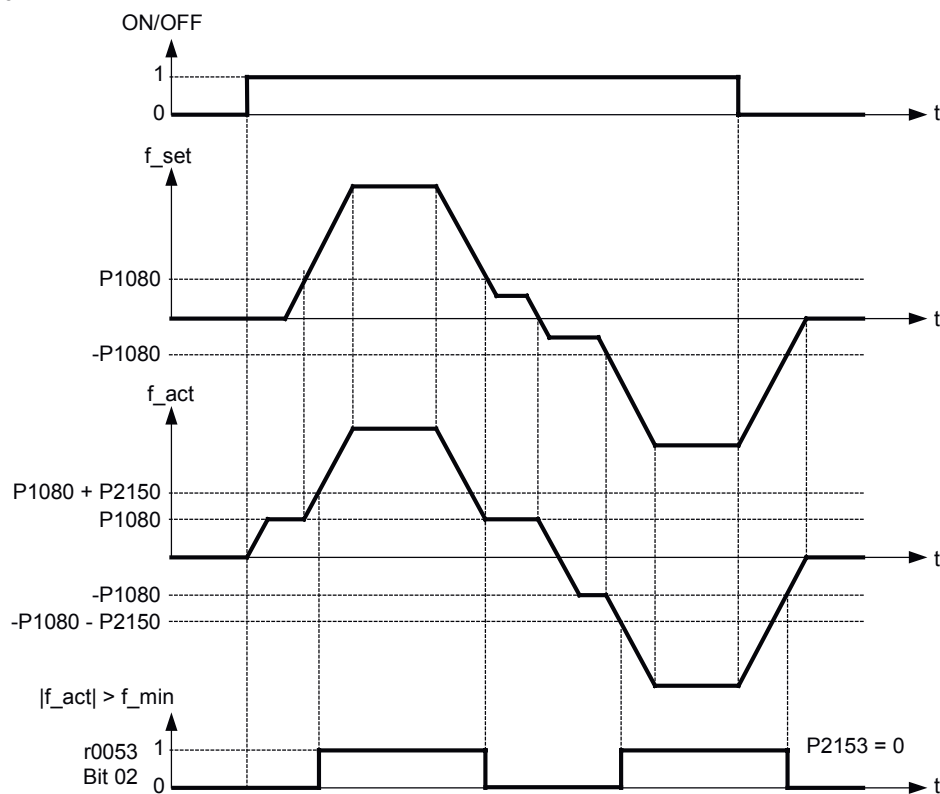

**Note:**

Value set here is valid both for clockwise and for anticlockwise rotation.

Under certain conditions (e.g. ramping, current limiting), motor can run below minimum frequency.

<b>P1082[3]</b>	<b>Max. frequency</b>			<b>Min:</b> 0.00	<b>Level</b> <b>1</b>
	<b>CStat:</b> CT	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> 50.00	
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes	<b>Max:</b> 650.00	


Sets maximum motor frequency [Hz] at which motor will run irrespective of the frequency setpoint. The value set here is valid for both clockwise and anticlockwise rotation.

Futhermore, the monitoring function  $|f_{act}| \geq P1082$  (r0052 Bit10, see example below) is affected by this parameter.

**Index:**

- P1082[0] : 1st. Drive data set (DDS)
- P1082[1] : 2nd. Drive data set (DDS)
- P1082[2] : 3rd. Drive data set (DDS)

**Example:**

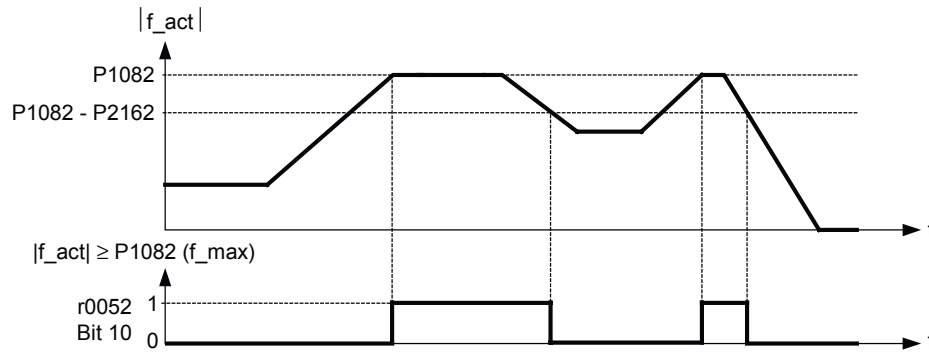

**Dependency:**

The maximal value of motor frequency P1082 is limited to pulse frequency P1800. P1082 is dependent on the derating characteristic as followed:

		P1800			
		2 kHz	4 kHz	6 kHz	8 - 16 kHz
$f_{max}$	P1082	0 - 133.3 Hz	0 - 266.6 Hz	0 - 400 Hz	0 - 650 Hz

If closed-loop vector control (P1300 > 19) is selected, then the maximum frequency is internally limited by the following equation:

$$f_{max} = \min(P1082, 5 \cdot P0310, 200.00)$$

The resultant value is displayed in r1084 (resultant maximum frequency).

The maximum output frequency of inverter can be exceeded if one of the following is active:

- p1335 ≠ 0 (Slip compensation active) :

$$f_{max}(p1335) = f_{max} + f_{slip,max} = p1082 + \frac{p1336}{100} \cdot \frac{r0330}{100} \cdot p0310$$

- p1200 ≠ 0 (Flying restart active) :

$$f_{max}(p1200) = f_{max} + 2 \cdot f_{slip,nom} = p1082 + 2 \cdot \frac{r0330}{100} \cdot p0310$$

**Note:**

When using the setpoint source

- Analog Input
- USS
- CB (e.g. PROFIBUS)

the setpoint frequency (in Hz) is cyclically calculated using a percentage value or a hexadecimal value and the reference frequency P2000.

If for example P1082 = 80 Hz, P2000 = 50 Hz and the analog input is parameterised with P0757 = 0 V, P0758 = 0 %, P0759 = 10 V, P0760 = 100 %, a setpoint frequency of 50 Hz will be applied at 10 V of the analog input.

<b>r1084</b>	<b>Resultant max. frequency</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> CONTROL			<b>Def:</b> - <b>Max:</b> -	

Displays resultant maximum frequency.

P1300 < 20

$$P1800 \leq 6 \text{ kHz} \rightarrow r1084 = \min(P1082, \frac{P1800}{15}, 650.00)$$


$$P1800 \geq 8 \text{ kHz} \rightarrow r1084 = \min(P1082, 650.00)$$

P1300 ≥ 20

$$r1084 = \min(P1082, 5 \cdot P0310, 200.00)$$

<b>P1091[3]</b>	<b>Skip frequency 1</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> 0.00	Level <b>3</b>
	<b>CStat:</b> CUT <b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 0.00 <b>Max:</b> 650.00	

Defines skip frequency 1 which avoids effects of mechanical resonance and suppresses frequencies within +/- P1101 (skip frequency bandwidth).

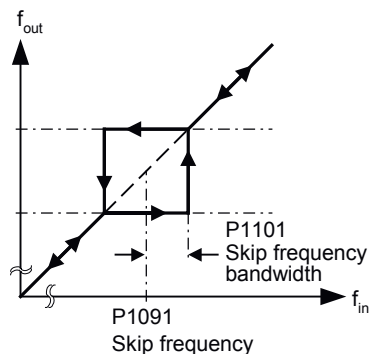

**Index:**

P1091[0] : 1st. Drive data set (DDS)  
P1091[1] : 2nd. Drive data set (DDS)  
P1091[2] : 3rd. Drive data set (DDS)

**Notice:**

Stationary operation is not possible within the suppressed frequency range; the range is merely passed through (on the ramp).

For example, if P1091 = 10 Hz and P1101 = 2 Hz, it is not possible to operate continuously between 10 Hz +/- 2 Hz (i.e. between 8 and 12 Hz).

<b>P1092[3]</b>	<b>Skip frequency 2</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> 0.00	Level <b>3</b>
	<b>CStat:</b> CUT <b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 0.00 <b>Max:</b> 650.00	

Defines skip frequency 2 which avoids effects of mechanical resonance and suppresses frequencies within +/- P1101 (skip frequency bandwidth).

**Index:**

P1092[0] : 1st. Drive data set (DDS)  
P1092[1] : 2nd. Drive data set (DDS)  
P1092[2] : 3rd. Drive data set (DDS)

**Details:**

See P1091 (skip frequency 1).

<b>P1093[3]</b>	<b>Skip frequency 3</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> 0.00	Level <b>3</b>
	<b>CStat:</b> CUT <b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 0.00 <b>Max:</b> 650.00	

Defines skip frequency 3 which avoids effects of mechanical resonance and suppresses frequencies within +/- P1101 (skip frequency bandwidth).

**Index:**

P1093[0] : 1st. Drive data set (DDS)  
P1093[1] : 2nd. Drive data set (DDS)  
P1093[2] : 3rd. Drive data set (DDS)

**Details:**

See P1091 (skip frequency 1).

<b>P1094[3]</b>	<b>Skip frequency 4</b>	<b>Min:</b> 0.00	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Defines skip frequency 4 which avoids effects of mechanical resonance and suppresses frequencies within +/- P1101 (skip frequency bandwidth).

**Index:**

P1094[0] : 1st. Drive data set (DDS)  
P1094[1] : 2nd. Drive data set (DDS)  
P1094[2] : 3rd. Drive data set (DDS)

**Details:**

See P1091 (skip frequency 1).

<b>P1101[3]</b>	<b>Skip frequency bandwidth</b>	<b>Min:</b> 0.00	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Delivers frequency bandwidth to be applied to skip frequencies (in [Hz]).

**Index:**

P1101[0] : 1st. Drive data set (DDS)  
P1101[1] : 2nd. Drive data set (DDS)  
P1101[2] : 3rd. Drive data set (DDS)

**Details:**

See P1091 (skip frequency 1).

<b>P1110[3]</b>	<b>BI: Inhibit neg. freq. setpoint</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U32		<b>Unit:</b> -
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

This parameter suppresses negative setpoints. Therefore, modification of the motor direction is inhibited to the setpoint channel.

**Index:**

P1110[0] : 1st. Command data set (CDS)  
P1110[1] : 2nd. Command data set (CDS)  
P1110[2] : 3rd. Command data set (CDS)

**Common Settings:**


0 = Disabled  
1 = Enabled

**Notice:**

Where

- If a min. frequency (P1080) and a negative setpoint are given, the motor is accelerated by a positive value in relationship to the min. frequency.
- This function does not disable the "reverse command functions" (e.g. Reverse, ON left); rather, a reverse command causes motor to run in the positive direction only, as described above.

**P1110 = 1**

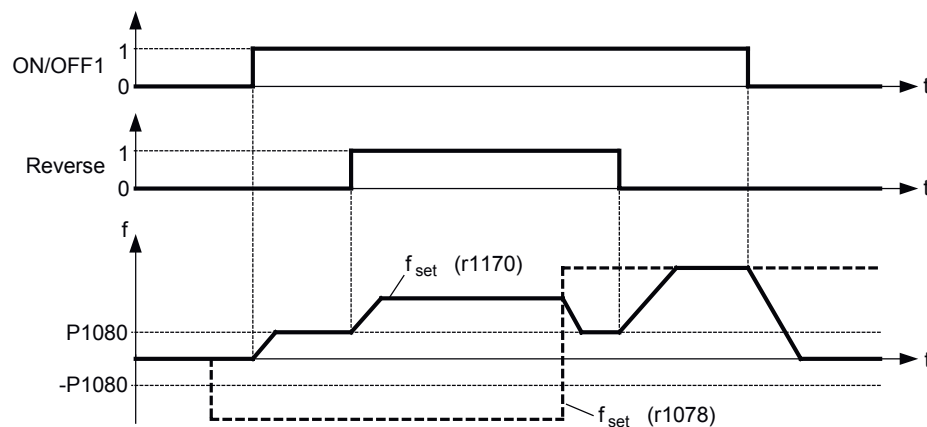

<b>P1113[3]</b>	<b>BI: Reverse</b>			<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 722:1	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Defines source of reverse command.

**Index:**

- P1113[0] : 1st. Command data set (CDS)
- P1113[1] : 2nd. Command data set (CDS)
- P1113[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 19.B = Reverse via BOP

**Dependency:**

Active only when P0719 < 10. See parameter P0719 (Selection of command/setpoint source).

<b>r1114</b>	<b>CO: Freq. setp. after dir. ctrl.</b>			<b>Min:</b> -	<b>Level</b> <b>3</b>
		<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> -	
	<b>P-Group:</b> SETPOINT			<b>Max:</b> -	

Displays setpoint frequency after change of direction.

### 3.21 Ramp-function generator


<b>r1119</b>	<b>CO: Freq. setpoint before RFG</b>			<b>Min:</b> -	<b>Level</b> <b>3</b>
		<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> -	
	<b>P-Group:</b> SETPOINT			<b>Max:</b> -	

Displays output frequency after modification by other functions, e.g.:

- P1110 BI: Inhibit neg. freq. setpoint,
- P1091 - P1094 skip frequencies,
- P1080 Min. frequency,
- P1082 Max. frequency, limitations,
- etc.

<b>P1120[3]</b>	<b>Ramp-up time</b>			<b>Min:</b> 0.00	<b>Level</b> <b>1</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s	<b>Def:</b> 10.00	
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes	<b>Max:</b> 650.00	

Time taken for motor to accelerate from standstill up to maximum motor frequency (P1082) when no rounding is used.

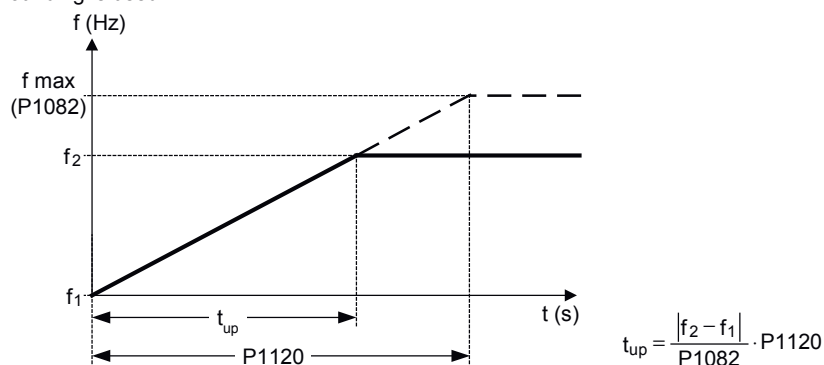

Setting the ramp-up time too short can cause the inverter to trip (overcurrent).

**Index:**

- P1120[0] : 1st. Drive data set (DDS)
- P1120[1] : 2nd. Drive data set (DDS)
- P1120[2] : 3rd. Drive data set (DDS)

**Note:**


If an external frequency setpoint with set ramp rates is used (e.g. from a PLC). The best way to achieve optimum drive performance is to set ramp times in P1120 and P1121 slightly shorter than those of the PLC.

**Notice:**

- Ramp times will be used as follows:
- P1060 / P1061 : JOG mode is active
  - P1120 / P1121 : Normal mode (ON/OFF) is active
  - P1060 / P1061 : Normal mode (ON/OFF) and P1124 is active

<b>P1121[3]</b>	<b>Ramp-down time</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes
		<b>Def:</b> 10.00	<b>1</b>
		<b>Max:</b> 650.00	

Time taken for motor to decelerate from maximum motor frequency (P1082) down to standstill when no rounding is used.

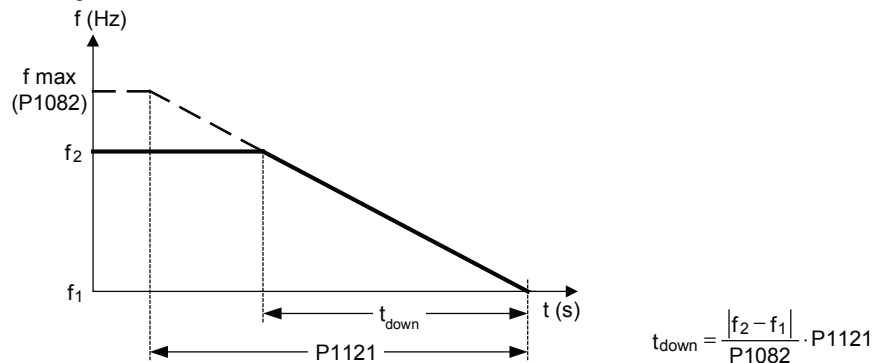

**Index:**

- P1121[0] : 1st. Drive data set (DDS)
- P1121[1] : 2nd. Drive data set (DDS)
- P1121[2] : 3rd. Drive data set (DDS)

**Notice:**

Setting the ramp-down time too short can cause the inverter to trip (overcurrent (F0001) / overvoltage (F0002)).

Ramp times will be used as follows:

- P1060 / P1061 : JOG mode is active
- P1120 / P1121 : Normal mode (ON/OFF) is active
- P1060 / P1061 : Normal mode (ON/OFF) and P1124 is active

<b>P1124[3]</b>	<b>BI: Enable JOG ramp times</b>	<b>Min:</b> 0:0	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
		<b>Def:</b> 0:0	<b>3</b>
		<b>Max:</b> 4000:0	

Defines source for switching between jog ramp times (P1060, P1061) and normal ramp times (P1120, P1121) as applied to the RFG. This parameter is valid for normal mode (ON/OFF) only.

**Index:**

- P1124[0] : 1st. Command data set (CDS)
- P1124[1] : 2nd. Command data set (CDS)
- P1124[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)

**Notice:**

P1124 does not have any impact when JOG mode is selected. In this case, jog ramp times (P1060, P1061) will be used all the time.


Ramp times will be used as follows:

- P1060 / P1061 : JOG mode is active
- P1120 / P1121 : Normal mode (ON/OFF) is active
- P1060 / P1061 : Normal mode (ON/OFF) and P1124 is active



<b>P1130[3]</b>	<b>Ramp-up initial rounding time</b>			<b>Min:</b> 0.00	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s	<b>Def:</b> 0.00	
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 40.00	

Defines initial rounding time in seconds as shown on the diagram below.

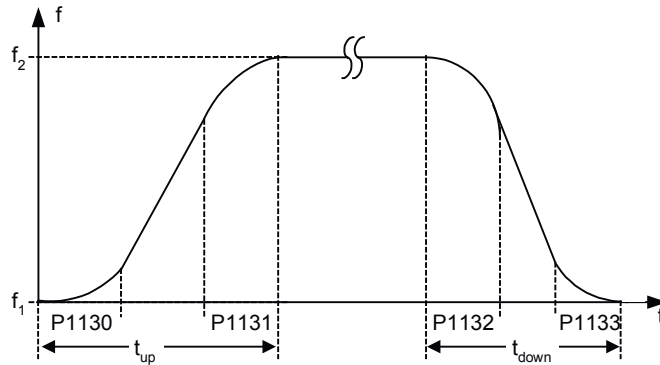

where:

$$\text{for } \frac{f_2 - f_1}{P1082} \cdot P1120 \geq \frac{1}{2}(P1130 + P1131)$$

$$t_{up} = \frac{1}{2}(P1130 + P1131) + \frac{f_2 - f_1}{P1082} \cdot P1120$$

$$\text{for } \frac{f_2 - f_1}{P1082} \cdot P1121 \geq \frac{1}{2}(P1132 + P1133)$$

$$t_{down} = \frac{1}{2}(P1132 + P1133) + \frac{f_2 - f_1}{P1082} \cdot P1121$$

**Index:**

P1130[0] : 1st. Drive data set (DDS)  
P1130[1] : 2nd. Drive data set (DDS)  
P1130[2] : 3rd. Drive data set (DDS)

**Note:**

- If short or zero ramp times (P1120, P1121 < P1130, P1131, P1132, P1133) are set, the total ramp up time (t<sub>up</sub>) or ramp down time (t<sub>down</sub>) will not depend on P1130.
- See equations above for valid conditions to calculate t<sub>up</sub> and t<sub>down</sub>.
- Rounding times are recommended, since they prevent an abrupt response, thus avoiding detrimental effects on the mechanics.
- Rounding times are not recommended when analog inputs are used, since they would result in overshoot/undershoot in the inverter response.

<b>P1131[3]</b>	<b>Ramp-up final rounding time</b>			<b>Min:</b> 0.00	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s	<b>Def:</b> 0.00	
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 40.00	

Defines rounding time at end of ramp-up as shown in P1130 (ramp-up initial rounding time).

**Index:**

P1131[0] : 1st. Drive data set (DDS)  
P1131[1] : 2nd. Drive data set (DDS)  
P1131[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1130.

<b>P1132[3]</b>	<b>Ramp-down initial rounding time</b>			<b>Min:</b> 0.00	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s	<b>Def:</b> 0.00	
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 40.00	

Defines rounding time at start of ramp-down as shown in P1130 (ramp-up initial rounding time).

**Index:**

P1132[0] : 1st. Drive data set (DDS)  
P1132[1] : 2nd. Drive data set (DDS)  
P1132[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1130.

<b>P1133[3]</b>	<b>Ramp-down final rounding time</b>	<b>Min:</b> 0.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> s
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 0.00		
		<b>Max:</b> 40.00		

Defines rounding time at end of ramp-down as shown in P1130 (ramp-up initial rounding time).

**Index:**

P1133[0] : 1st. Drive data set (DDS)  
P1133[1] : 2nd. Drive data set (DDS)  
P1133[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1130.


<b>P1134[3]</b>	<b>Rounding type</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> SETPOINT	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 0		
		<b>Max:</b> 1		

Defines the smoothing which is active by setpoint modifications during acceleration or deceleration (e.g. new setpoint, OFF1, OFF3, REV).

This smoothing is applied, if the motor is ramped-up or ramped-down and

- P1134 = 0,
- P1132 > 0, P1133 > 0 and
- the setpoint is not yet reached.

**P1132 > 0, P1133 > 0**

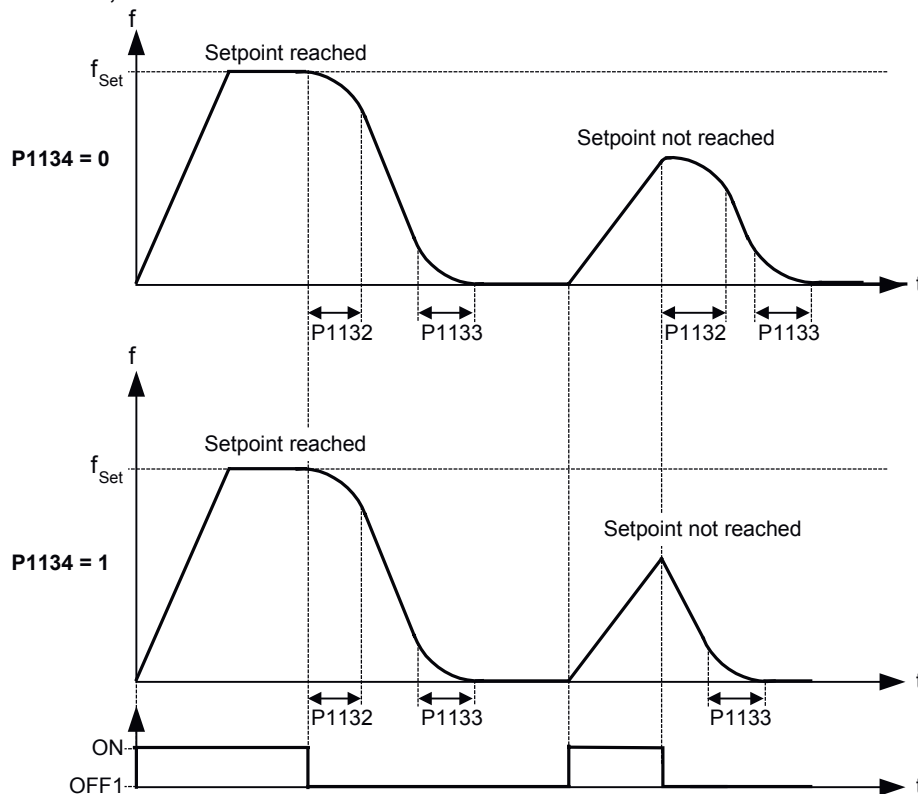

**Possible Settings:**

- 0 Continuous smoothing
- 1 Discontinuous smoothing

**Index:**


P1134[0] : 1st. Drive data set (DDS)  
P1134[1] : 2nd. Drive data set (DDS)  
P1134[2] : 3rd. Drive data set (DDS)

**Dependency:**

No effect until P1132 (Ramp-down initial rounding time) or P1133 (Ramp-down final rounding time) > 0 s.

<b>P1135[3]</b>	<b>OFF3 ramp-down time</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes
		<b>Def:</b> 5.00	<b>2</b>
		<b>Max:</b> 650.00	

Defines ramp-down time from maximum frequency to standstill for OFF3 command.

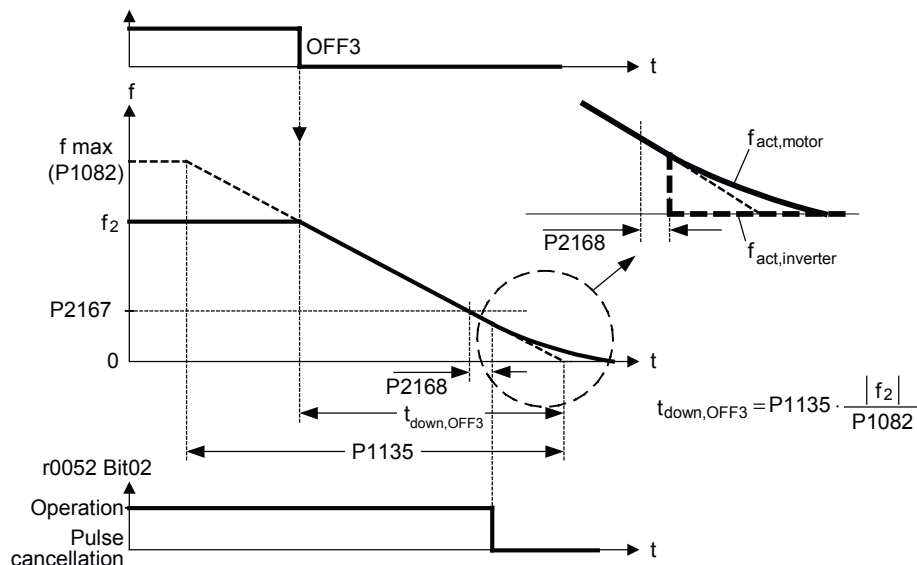

**Index:**

- P1135[0] : 1st. Drive data set (DDS)
- P1135[1] : 2nd. Drive data set (DDS)
- P1135[2] : 3rd. Drive data set (DDS)

**Note:**

This time may be exceeded if the VDC\_max. level is reached.

<b>P1140[3]</b>	<b>BI: RFG enable</b>	<b>Min:</b> 0:0	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
		<b>Def:</b> 1:0	<b>3</b>
		<b>Max:</b> 4000:0	

Defines command source of RFG enable command (RFG: ramp function generator). If binary input is equal to zero then the RFG output will be set immediately to 0.

**Index:**

- P1140[0] : 1st. Command data set (CDS)
- P1140[1] : 2nd. Command data set (CDS)
- P1140[2] : 3rd. Command data set (CDS)

<b>P1141[3]</b>	<b>BI: RFG start</b>	<b>Min:</b> 0:0	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
		<b>Def:</b> 1:0	<b>3</b>
		<b>Max:</b> 4000:0	

Defines command source of RFG start command (RFG: ramp function generator). If binary input is equal to zero then the RFG output is held at it present value.

**Index:**

- P1141[0] : 1st. Command data set (CDS)
- P1141[1] : 2nd. Command data set (CDS)
- P1141[2] : 3rd. Command data set (CDS)

<b>P1142[3]</b>	<b>BI: RFG enable setpoint</b>	<b>Min:</b> 0:0	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
		<b>Def:</b> 1:0	<b>3</b>
		<b>Max:</b> 4000:0	

Defines command source of RFG enable setpoint command (RFG: ramp function generator). If binary input is equal to zero then the RFG input will be set to zero and the RFG output will be ramp-down to zero.

**Index:**

- P1142[0] : 1st. Command data set (CDS)
- P1142[1] : 2nd. Command data set (CDS)
- P1142[2] : 3rd. Command data set (CDS)


<b>r1170</b>	<b>CO: Frequency setpoint after RFG</b>	<b>Min:</b> -	<b>Level</b>
		<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
		<b>Def:</b> -	<b>3</b>
		<b>Max:</b> -	

Displays overall frequency setpoint after ramp generator.

## 3.22 Flying restart

P1200	<b>Flying start</b>			Min: 0	Level
	CStat: CUT	Datatype: U16	Unit: -	Def: 0	<b>2</b>
	P-Group: FUNC	Active: first confirm	QuickComm.: No	Max: 6	

Starts inverter onto a spinning motor by rapidly changing the output frequency of the inverter until the actual motor speed has been found. Then, the motor runs up to setpoint using the normal ramp time.

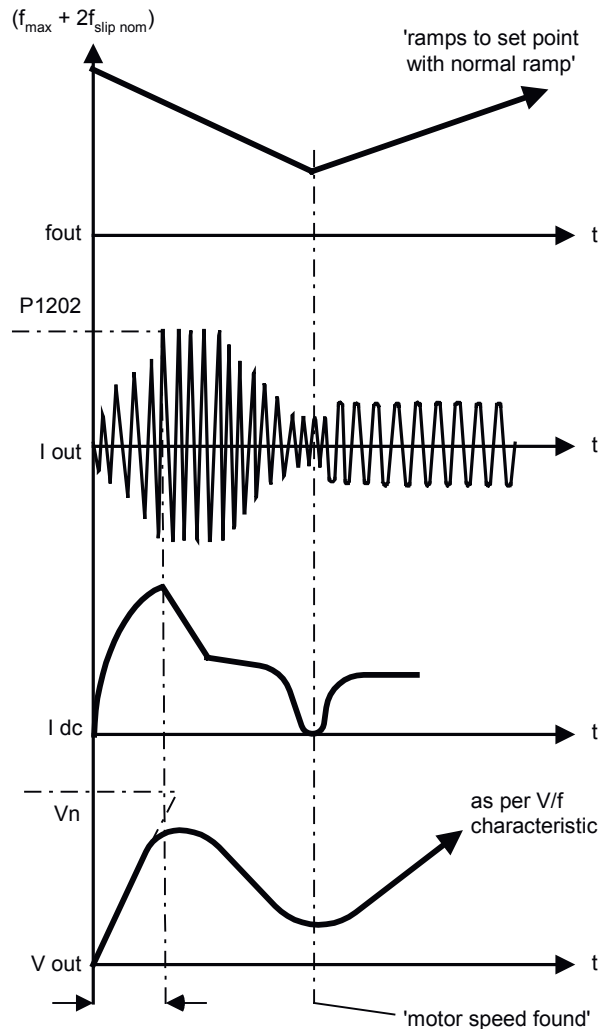

### Possible Settings:

- 0 Flying start disabled
- 1 Flying start is always active, start in direction of setpoint
- 2 Flying start is active if power on, fault, OFF2, start in direction of setpoint
- 3 Flying start is active if fault, OFF2, start in direction of setpoint
- 4 Flying start is always active, only in direction of setpoint
- 5 Flying start is active if power on, fault, OFF2, only in direction of setpoint
- 6 Flying start is active if fault, OFF2, only in direction of setpoint

### Note:

- Useful for motors with high inertia loads.
- Settings 1 to 3 search in both directions.
- Settings 4 to 6 search only in direction of setpoint.
- Flying start must be used in cases where the motor may still be turning (e.g. after a short mains break) or can be driven by the load. Otherwise, overcurrent trips will occur.

<b>P1202[3]</b>	<b>Motor-current: Flying start</b>			<b>Min:</b> 10	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> %	<b>Def:</b> 100	
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 200	

Defines search current used for flying start. Value is in [%] based on rated motor current (P0305).

**Index:**

P1202[0] : 1st. Drive data set (DDS)  
P1202[1] : 2nd. Drive data set (DDS)  
P1202[2] : 3rd. Drive data set (DDS)


**Note:**

- If the search current is reduced, the flying restart behavior can be improved if the system inertia is not very high.
- The search algorithm for the flying restart is different for V/f control and closed-loop vector control.
- This is the reason that, depending on the control technique, parameter P1202 must be appropriately adapted.
- Values gained from experience indicate that good results can be achieved by
  - Increasing P1202 for V/f controls
  - Reducing P1202 for closed-loop vector controls

<b>P1203[3]</b>	<b>Search rate: Flying start</b>			<b>Min:</b> 10	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> %	<b>Def:</b> 100	
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 200	

Sets factor by which the output frequency changes during flying start to synchronize with turning motor. This value is entered in [%] defines the reciprocal initial gradient in the search sequence (see curve below). Parameter P1203 influences the time taken to search for the motor frequency.

The search time is the time taken to search through all frequencies between max. frequency  $f_{max} + 2 \cdot f_{slip}$  to 0 Hz.

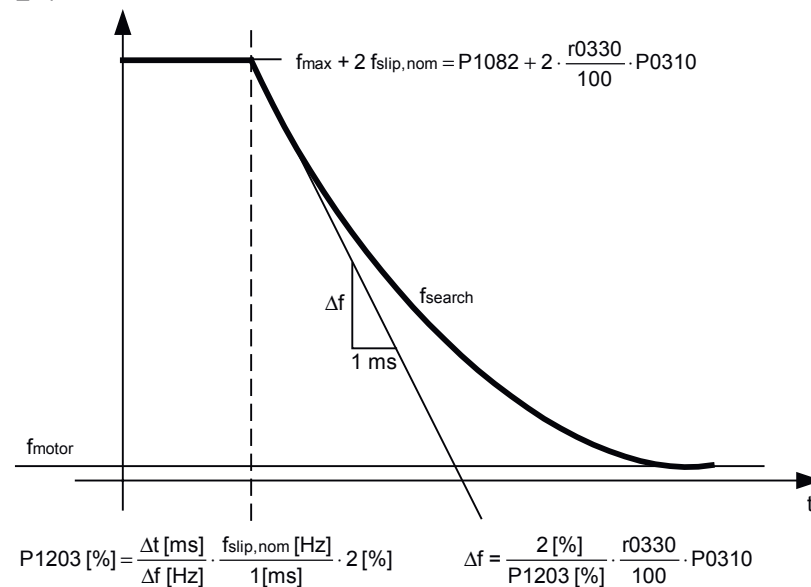

P1203 = 100 % is defined as giving a rate of 2 % of  $f_{slip, nom}$  / [ms].

P1203 = 200 % would result in a rate of frequency change of 1 % of  $f_{slip, nom}$  / [ms].

**Index:**

P1203[0] : 1st. Drive data set (DDS)  
P1203[1] : 2nd. Drive data set (DDS)  
P1203[2] : 3rd. Drive data set (DDS)

**Example:**

For a motor with 50 Hz, 1350 rpm, 100 % would produce a maximum search time of 600 ms. If the motor is turning, the motor frequency is found in a shorter time.

**Note:**

- A higher value produces a flatter gradient and thus a longer search time.
- A lower value has the opposite effect.
- For closed-loop vector control, parameter P1203 is de-activated

<b>r1204</b>	<b>Status word: Flying start V/f</b>	<b>Datatype: U16</b>	<b>Unit: -</b>	<b>Min: -</b>	<b>Def: -</b>	<b>Max: -</b>	<b>Level</b>
	<b>P-Group: FUNC</b>						<b>4</b>

Bit parameter for checking and monitoring states during search, if V/f control mode is selected (see P1300).

**Bitfields:**

Bit00	Current applied	0	NO	1	YES
Bit01	Current could not be applied	0	NO	1	YES
Bit02	Voltage reduced	0	NO	1	YES
Bit03	Slope-filter started	0	NO	1	YES
Bit04	Current less threshold	0	NO	1	YES
Bit05	Current-minimum	0	NO	1	YES
Bit07	Speed could not be found	0	NO	1	YES

<b>r1205</b>	<b>Status word: Flying start SLVC</b>	<b>Datatype: U16</b>	<b>Unit: -</b>	<b>Min: -</b>	<b>Def: -</b>	<b>Max: -</b>	<b>Level</b>
	<b>P-Group: FUNC</b>						<b>3</b>

Bit parameter for checking status of flying start performed with n-adaption of observer. Parameter is only valid, if sensorless vector control (SLVC) is selected (see P1300).

**Bitfields:**

Bit00	Transformation active	0	NO	1	YES
Bit01	Initialize n-adaption	0	NO	1	YES
Bit02	Current applying	0	NO	1	YES
Bit03	N-controller closed	0	NO	1	YES
Bit04	Isd-controller open	0	NO	1	YES
Bit05	RFG hold	0	NO	1	YES
Bit06	N-adaption set to zero	0	NO	1	YES
Bit07	Reserved	0	NO	1	YES
Bit08	Reserved	0	NO	1	YES
Bit09	Reserved	0	NO	1	YES
Bit10	Direction Positive	0	NO	1	YES
Bit11	Search is started	0	NO	1	YES
Bit12	Current is applied	0	NO	1	YES
Bit13	Search is aborted	0	NO	1	YES
Bit14	Deviation is zero	0	NO	1	YES
Bit15	N-controller is active	0	NO	1	YES

### 3.23 Automatic restart

<b>P1210</b>	<b>Automatic restart</b>			<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 1	
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 6	

Configures automatic restart function

**Possible Settings:**

0	Disabled	
1	Trip reset after power on,	P1211 disabled
2	Restart after mains blackout,	P1211 disabled
3	Restart after mains brownout or fault,	P1211 enabled
4	Restart after mains brownout,	P1211 enabled
5	Restart after mains blackout and fault,	P1211 disabled
6	Restart after mains brown- /blackout or fault,	P1211 disabled

**Dependency:**

Automatic restart requires constant ON command via a digital input wire link.



**Caution:**

P1210 > 2 can cause the motor to restart automatically without toggling the ON command !

**Notice:**

A "mains brownout" is where the power is interrupted and re-applied before the display on the BOP (if one is fitted to the inverter) has gone dark (a very short mains break where the DC link has not fully collapsed).

A "mains blackout" is where the display has gone dark (a long mains break where the DC link has fully collapsed) before the power is re-applied.

P1210 = 0:

Automatic restart is disabled.

P1210 = 1:

The inverter will acknowledge (reset) faults i.e. it will reset a fault when the is re-applied. This means the inverter must be fully powered down, a brownout is not sufficed. The inverter will not run until the ON command has been toggled.

P1210 = 2:

The inverter will acknowledge the fault F0003 at power on after blackout and restarts the drive. It is necessary that the ON command is wired via digital input (DIN).

P1210 = 3:

For these settings it is fundamental that the drive only restarts if it has been in a RUN state at the time of the faults (F0003, etc.). The inverter will acknowledge the fault and restarts the drive after a blackout or brownout. It is necessary that the ON command is wired via digital input (DIN).

P1210 = 4:

For these settings it is fundamental that the drive only restarts if it has been in a RUN state at the time of the fault (F0003). The inverter will acknowledge the fault and restarts the drive after a blackout or brownout. It is necessary that the ON command is wired via digital input (DIN).

P1210 = 5:

The inverter will acknowledge the faults F0003 etc. at power on after blackout and restarts the drive. It is necessary that the ON command is wired via digital input (DIN).

P1210 = 6:

The inverter will acknowledge the faults (F0003 etc.) at power on after blackout or brownout and restarts the drive. It is necessary that the ON command is wired via digital input (DIN). Setting 6 causes the motor to restart immediately.

Following table presents an overview of parameter P1210 and its functionality.

P1210	ON always active (permanent)				ON in no-voltage condition	
	Fault F0003 on Blackout	Fault F0003 on Brownout	All other faults on Blackout	All other faults on Brownout	All faults on Blackout	No faults on Blackout
0	-	-	-	-	-	-
1	Fault acknowl.	-	Fault acknowl.	-	Fault acknowl.	-
2	Fault acknowl. + restart	-	-	-	-	Restart
3	Fault acknowl. + restart	Fault acknowl. + restart	Fault acknowl. + restart	Fault acknowl. + restart	Fault acknowl. + restart	-
4	Fault acknowl. + restart	Fault acknowl. + restart	-	-	-	-
5	Fault acknowl. + restart	-	Fault acknowl. + restart	-	Fault acknowl. + restart	Restart
6	Fault acknowl. + restart	Fault acknowl. + restart	Fault acknowl. + restart	Fault acknowl. + restart	Fault acknowl. + restart	Restart

Flying start must be used in cases where the motor may still be turning (e.g. after a short mains break) or can be driven by the load (P1200).

<b>P1211</b>	<b>Number of restart attempts</b>				Min: 0	Level <b>3</b>
	CStat: CUT	Datatype: U16	Unit: -	Def: 3		
	P-Group: FUNC	Active: first confirm	QuickComm.: No	Max: 10		

Specifies number of times inverter will attempt to restart if automatic restart P1210 is activated.




### 3.24 Motor holding brake

<b>P1215</b>	<b>Holding brake enable</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> T	<b>Datatype:</b> U16	<b>Def:</b> 0
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
		<b>Max:</b> 1	<b>2</b>


Enables/disables holding brake function.

This function applies the following profile to the inverter:

**ON / OFF1/OFF3:**

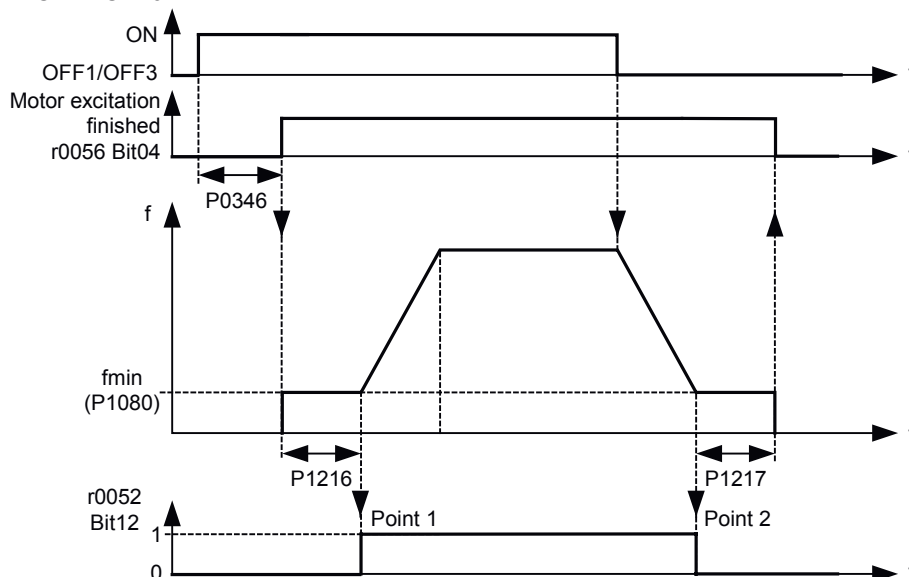

**ON / OFF2:**

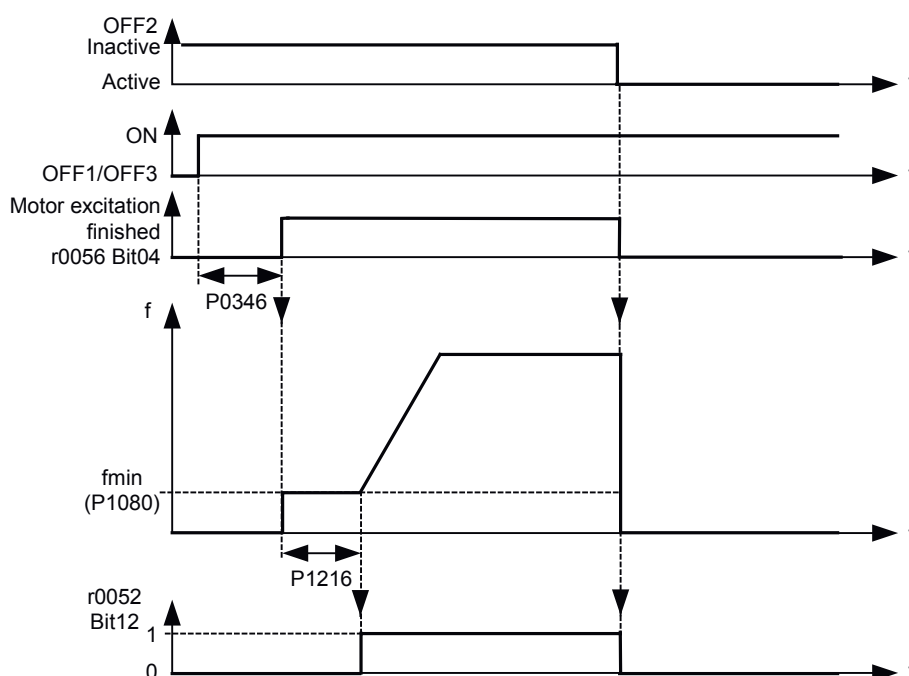

**Possible Settings:**

- 0 Motor holding brake disabled
- 1 Motor holding brake enabled



**Caution:**

1. To activate the motor holding brake, in addition to parameter P1215 = 1, the status signal r0052 bit 12 "motor holding brake active" must be output via a digital output. The user must also select the signal - e.g. in parameter P0731.
2. If the motor holding brake is controlled by the drive inverter, then for potentially hazardous loads (e.g. suspended/hanging loads for crane applications) the drive inverter may not be conditioned unless the load has been secured. Before commissioning, potentially hazardous loads can be secured as follows:
  - lower the load to the floor, or
  - during commissioning or after replacing the drive inverter, prevent the drive inverter from controlling the motor holding brake. Only then should STARTER be used to carry-out a quick commissioning or a parameter download, etc. The motor holding brake terminals can then be re-used (for the motor holding brake, in this case, it is not permissible to parameterize the system so that the digital output P0748 is inverted).
3. In order to hold the motor against the mechanical brake at a certain frequency, it is important that the min. frequency P1080 approximately corresponds to the slip frequency.
  - If the value is selected to be too high, then the current drawn can be too high so that the drive inverter trips (shuts down) due to an overcurrent condition.
  - For a low value, it is possible that the torque cannot be established to hold the load.
4. It is not permissible to use the motor holding brake as operating brake as generally it is only designed and dimensioned for a limited number of emergency braking operations.

**Note:**

Parameter settings:

- To open/close, a digital output controls the motor holding brake at point 1/2 (refer to the diagram). In this case, as prerequisite, the motor holding brake P1215 must be activated as well as the motor holding brake selected at the digital output.
- Brake opening time P1216 greater than/equal to the time for the holding brake to open.
- Brake delay time P1217 greater than/equal to the time to close the holding brake.
- Select the minimum frequency P1080 so that it acts like weight equalization.
- A typical value of the minimum frequency P1080 for the motor holding brake is the slip frequency of the motor r0330. The rated slip frequency can be calculated using the following formula:

$$f_{\text{slip}}[\text{Hz}] = \frac{r0330}{100} \cdot P0310 = \frac{n_{\text{syn}} - n_n}{n_{\text{syn}}} \cdot f_n$$

The following closed-loop control parameters should be observed in conjunction with the motor holding brake:

- P1310, P1311, P1333, P1335 for U/f
- P1610, P1611, P1750, P1755 for SLVC

<b>P1216</b>	<b>Holding brake release delay</b>	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> T	<b>Datatype:</b> Float		<b>Unit:</b> s
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 1.0		
		<b>Max:</b> 20.0		

Defines the brake opening time of the motor holding brake (MHB).

When the motor holding brake (P1215) is activated, then the setpoint enable is delayed by the selected time. The time that it takes to open the mechanical brake is subject to certain fluctuations. This is the reason that the drive inverter applies the min. frequency P1080 to the motor during this time. This means that the brake can reliably open before the motor starts.

$$P1216 \geq \text{Text\_8pt\_e}$$

**Details:**

See parameter P1215.

<b>P1217</b>	<b>Holding time after ramp down</b>	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> T	<b>Datatype:</b> Float		<b>Unit:</b> s
	<b>P-Group:</b> FUNC	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 1.0		
		<b>Max:</b> 20.0		

Defines the brake delay time of the motor holding brake (MHB).

When the motor holding brake (P1215) is activated, after an off command, the pulse inhibit is delayed by this selected time. The time that it takes to open the mechanical brake is subject to certain fluctuations. This means that after braking to the min. frequency P1080, the motor is held at the minimum frequency for this time. This means that the brake can reliably close before the motor is switched into a no-current condition.

$$P1217 \geq \text{Text\_8pt\_e}$$

**Details:**

See parameter P1215.


### 3.25 DC braking

P1230[3]	<b>BI: Enable DC braking</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Unit:</b> -
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 0:0		
		<b>Max:</b> 4000:0		

Enables DC braking via a signal applied from an external source. Function remains active while external input signal is active.

DC braking causes the motor to stop rapidly by applying a DC braking current (current applied also holds shaft stationary).

When the DC braking signal is applied, the inverter output pulses are blocked and the DC current is not applied until the motor has been sufficiently demagnetized.

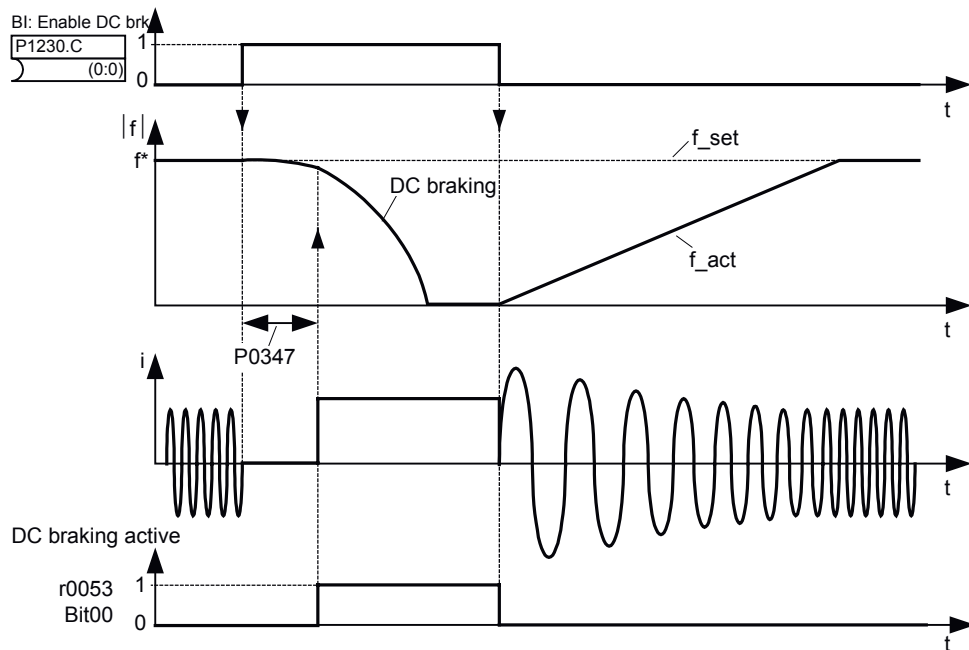

Note: DC brake can be applied in drive states r0002 = 1, 4, 5

The level of DC braking is set in P1232 (DC braking current - relative to the rated motor current) which is set to 100 % by default.

**Index:**

- P1230[0] : 1st. Command data set (CDS)
- P1230[1] : 2nd. Command data set (CDS)
- P1230[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)



**Caution:**

With the DC braking, the kinetic energy of the motor is converted into heat in the motor. The drive could overheat if it remains in this status for an excessive period of time !

DC braking is not possible when using a synchronous motor (i.e. P0300 = 2).

**Notice:**

This delay time is set in P0347 (demagnetization time). If this delay is too short, overcurrent trips can occur.

<b>P1232[3]</b>	<b>DC braking current</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> %
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 100		
		<b>Max:</b> 250		

Defines level of DC current in [%] relative to rated motor current (P0305).

$$r0027_{DC-Brake}[A] \approx \frac{1}{\sqrt{2}} \cdot P0305 \cdot \frac{P1232}{100\%}$$



The current of the DC-braking is limited by r0067.

**Index:**

- P1232[0] : 1st. Drive data set (DDS)
- P1232[1] : 2nd. Drive data set (DDS)
- P1232[2] : 3rd. Drive data set (DDS)

<b>P1233[3]</b>	<b>Duration of DC braking</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> s
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 0		
		<b>Max:</b> 250		

Defines duration for which DC injection braking is to be active following an OFF1 or OFF3 command. When an OFF1 or OFF3 command is received by the drive, the output frequency starts to ramp to 0 Hz. When the output frequency reaches the value set in P1234, the drive injects a DC braking current P1232 for the time duration set in P1233.

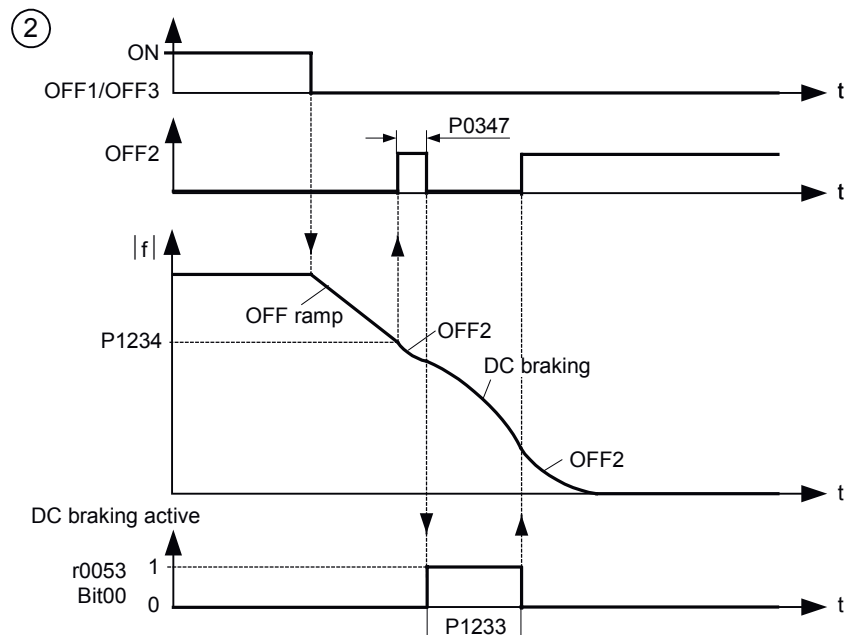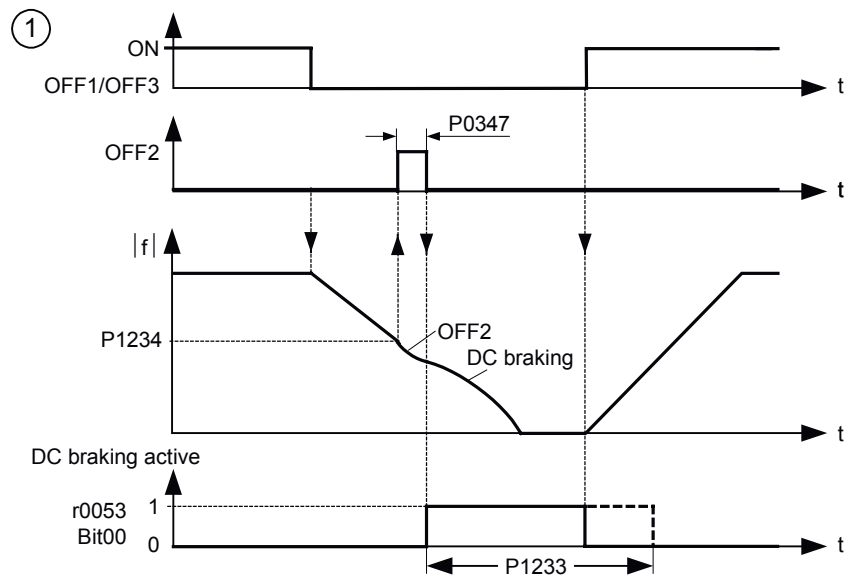

Parameter P1232 still controls the level of DC injection.

**Index:**

P1233[0] : 1st. Drive data set (DDS)  
P1233[1] : 2nd. Drive data set (DDS)  
P1233[2] : 3rd. Drive data set (DDS)

**Value:**

P1233 = 0 :  
Not active following OFF1 / OFF3.

P1233 = 1 - 250 :  
Active for the specified duration.



**Caution:**

With the DC braking, the kinetic energy of the motor is converted into heat in the motor. The drive could overheat if it remains in this status for an excessive period of time !

DC braking is not possible when using a synchronous motor (i.e. P0300 = 2).

**Notice:**

The DC braking function causes the motor to stop rapidly by applying a DC braking current (the current applied also holds the shaft stationary). When the DC braking signal is applied, the inverter output pulses are blocked and the DC current not applied until the motor has been sufficiently demagnetized (demagnetization time is calculated automatically from motor data).

The inverter will not restart if an ON-command is given during this period.

<b>P1234[3]</b>	<b>DC braking start frequency</b>				<b>Min:</b> 0.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> 650.00		
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 650.00		

Sets start frequency for DC braking.

When an OFF1 or OFF3 command is received by the drive, the output frequency starts to ramp to 0 Hz. When the output frequency reaches the value set in start frequency of DC braking P1234, the drive injects a DC braking current P1232 for the time duration set in P1233.

**Index:**

P1234[0] : 1st. Drive data set (DDS)  
P1234[1] : 2nd. Drive data set (DDS)  
P1234[2] : 3rd. Drive data set (DDS)

**Details:**

See P1232 (DC braking current) and P1233 (duration of DC braking)

## 3.26 Compound braking

<b>P1236[3]</b>	<b>Compound braking current</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> %
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 0		
		<b>Max:</b> 250		

Defines DC level superimposed on AC waveform after exceeding DC-link voltage threshold of compound braking. The value is entered in [%] relative to rated motor current (P0305).


If P1254 = 0 :

$$\text{Compound braking switch-on level} \quad U_{DC\_Comp} = 1.13 \cdot \sqrt{2} \cdot V_{mains} = 1.13 \cdot \sqrt{2} \cdot P0210$$

otherwise :

$$\text{Compound braking switch-on level} \quad U_{DC\_Comp} = 0.98 \cdot r1242$$

The Compound Brake is an overlay of the DC brake function with regenerative braking (effective braking at the ramp) after OFF1 or OFF3. This enables braking with controlled motor frequency and a minimum of energy returned to the motor. Through optimization of the ramp-down time and the compound braking an efficient braking without additional HW components is possible.

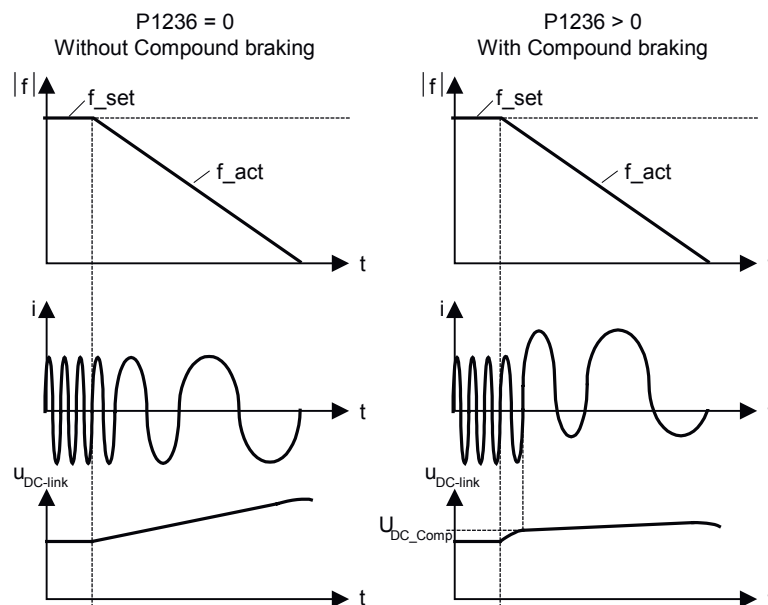

### Index:

P1236[0] : 1st. Drive data set (DDS)  
P1236[1] : 2nd. Drive data set (DDS)  
P1236[2] : 3rd. Drive data set (DDS)

### Value:

P1236 = 0 :  
Compound braking disabled.

P1236 = 1 - 250 :  
Level of DC braking current defined as a [%] of rated motor current (P0305).

### Dependency:

Compound braking depends on the DC link voltage only (see threshold above).

It is disabled, when:

- DC braking is active
- Flying start is active
- Vector mode (SLVC, VC) is selected

### Notice:

Increasing the value will generally improve braking performance; however, if you set the value too high, an overcurrent trip may result.

If used with dynamic braking enabled as well compound braking will take priority.

If used with the Vdc max controller enabled the drive behaviour whilst braking may be worsened particularly with high values of compound braking.

Compound braking does not function when the drive is in vector control.

### 3.27 Dynamic braking

<b>P1237</b>	<b>Dynamic braking</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 0	
	<b>P-Group:</b> FUNC			<b>Max:</b> 5	

Dynamic braking absorbs the braking energy. This parameter defines the rated duty cycle of the braking resistor (chopper resistor). Dynamic braking is active when the function is enabled and DC-link voltage exceeds the dynamic braking switch-on level, see below.

Dynamic braking switch-on level

If P1254 = 0 :

$$V_{DC, Chopper} = 1.13 \cdot \sqrt{2} \cdot V_{mains} = 1.13 \cdot \sqrt{2} \cdot P0210$$

otherwise :

$$V_{DC, Chopper} = 0.98 \cdot r1242$$


**Possible Settings:**

- 0 Disabled
- 1 5 % duty cycle
- 2 10 % duty cycle
- 3 20 % duty cycle
- 4 50 % duty cycle
- 5 100 % duty cycle

**Dependency:**


This function is not available for for MM440 PX (FSFX and FSGX).



If used with DC braking enabled as well compound braking will take priority.

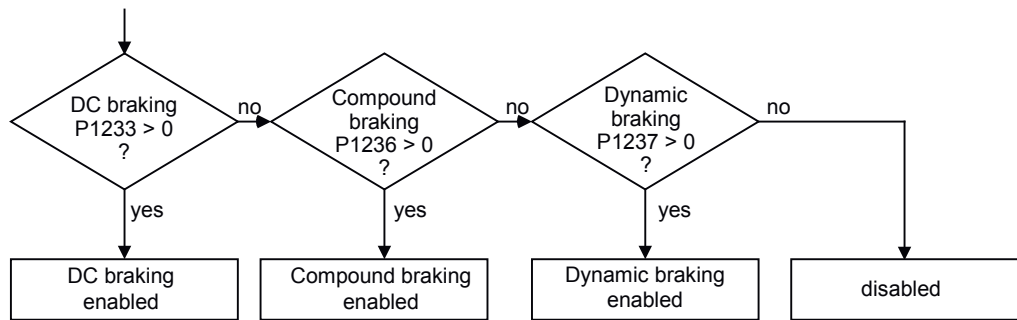

**Notice:**

Initially the brake will operate at a high duty cycle dependant on the DC link level until the thermal limit is approached. The duty cycle specified by this parameter will then be imposed. The resistor should be able to operate at this level indefinitely without overheating.

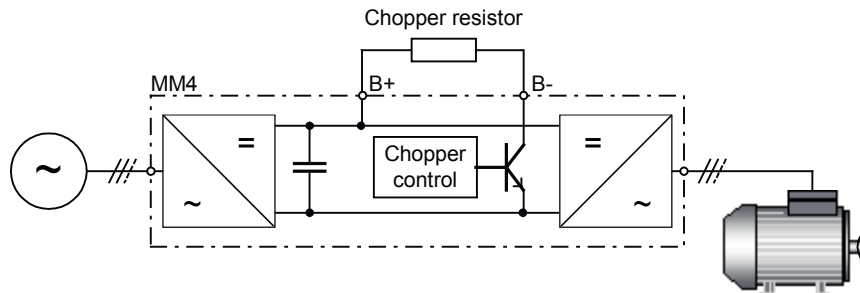

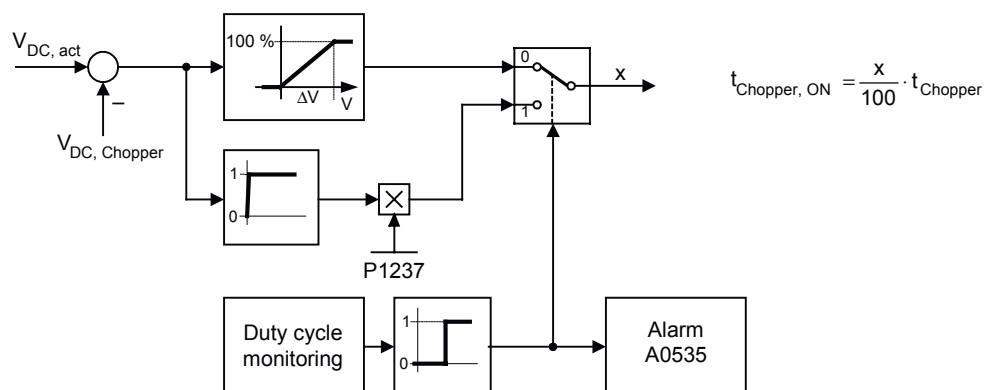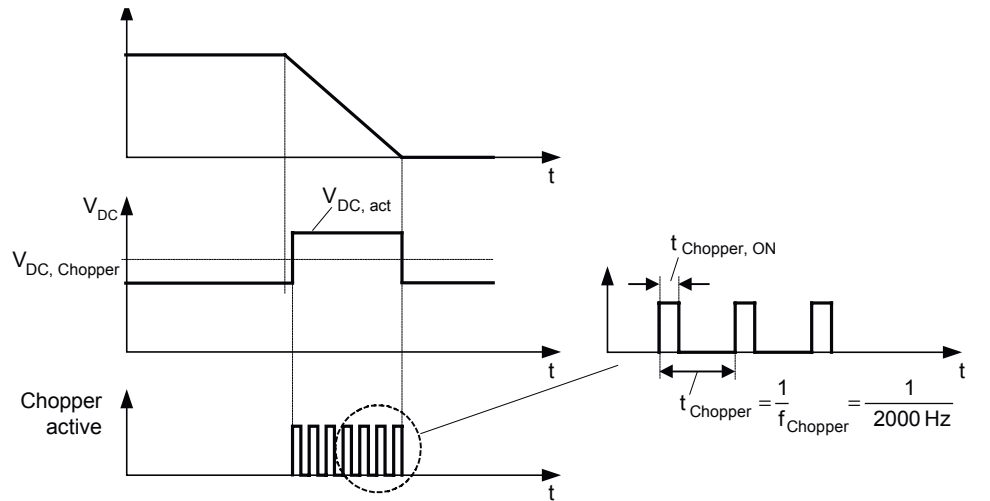

	Mains		
	200 - 240 V	380 - 480 V	500 - 600 V
$\Delta V$	9.8 V	17.0 V	21.3 V

The threshold for the warning A0535 is equivalent to 10 seconds running at 95 % duty cycle. The duty cycle will be limited when it was running 12 seconds at 95 % duty cycle.

### 3.28 Vdc controller

<b>P1240[3]</b>	<b>Configuration of Vdc controller</b>				Min: 0	Level <b>3</b>
	CStat: CT	Datatype: U16	Unit: -	Def: 1		
	P-Group: FUNC	Active: Immediately	QuickComm.: No	Max: 3		

Enables / disables Vdc controller.

The Vdc controller dynamically controls the DC link voltage to prevent overvoltage trips on high inertia systems.

**Possible Settings:**

- 0 Vdc controller disabled
- 1 Vdc-max controller enabled
- 2 Kinetic buffering (Vdc-min controller) enabled
- 3 Vdc-max controller and kinetic buffering (KIB) enabled

**Index:**

- P1240[0] : 1st. Drive data set (DDS)
- P1240[1] : 2nd. Drive data set (DDS)
- P1240[2] : 3rd. Drive data set (DDS)





**Caution:**

If P1245 increased too much, it may interfere with the drive normal operation.


**Note:**

Vdc max controller automatically increases ramp-down times to keep the DC-link voltage (r0026) within limits (r1242).

Vdc min is activated if DC-link voltage falls below the switch on level, P1245. The kinetic energy of the motor is then used to buffer the DC-link voltage, thus causing deceleration of the drive. If the drive trips F0003 immediately, try increasing the dynamic factor first, P1247. If still tripping F0003 try then increasing the switch on level, P1245.

<b>r1242</b>	<b>CO: Switch-on level of Vdc-max</b>	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> FUNC			<b>Def:</b> -	
				<b>Max:</b> -	

Displays switch-on level of Vdc max controller.

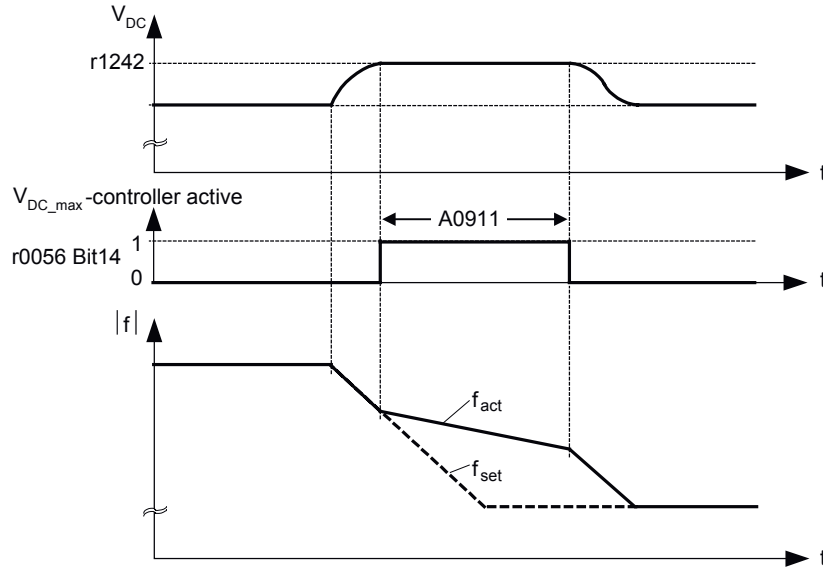

Following equation is only valid, if P1254 = 0 :

$$r1242 = 1.15 \cdot \sqrt{2} \cdot V_{mains} = 1.15 \cdot \sqrt{2} \cdot P0210$$

otherwise :

r1242 is internally calculated

**Note:**

Parameter r1242 (switch-in threshold) is determined by each power cycle, when precharging of the DC-link is finished.

<b>P1243[3]</b>	<b>Dynamic factor of Vdc-max</b>	<b>Datatype:</b> U16	<b>Unit:</b> %	<b>Min:</b> 10	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 100	
	<b>P-Group:</b> FUNC			<b>Max:</b> 200	

Defines dynamic factor for DC link controller in [%].

**Index:**

- P1243[0] : 1st. Drive data set (DDS)
- P1243[1] : 2nd. Drive data set (DDS)
- P1243[2] : 3rd. Drive data set (DDS)

**Dependency:**

P1243 = 100 % means parameters P1250, P1251 and P1252 (gain, integration time and differential time) are used as set. Otherwise, these are multiplied by P1243 (dynamic factor of Vdc-max).

**Note:**

Vdc controller adjustment is calculated automatically from motor and inverter data.

<b>P1245[3]</b>	<b>Switch on level kin. buffering</b>				<b>Min:</b> 65	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> %	<b>Def:</b> 76		
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 115		

Enter switch-on level for kinetic buffering (KIB) in [%] relative to supply voltage (P0210).

$$P1245 [V] = \frac{P1245 [\%]}{100} \cdot \sqrt{2} \cdot P0210$$

**Index:**

P1245[0] : 1st. Drive data set (DDS)  
P1245[1] : 2nd. Drive data set (DDS)  
P1245[2] : 3rd. Drive data set (DDS)



**Warning:**

Increasing the value too much, may interfere with the drive normal operation.

**Note:**

Changing P1254 doesn't affect the switch-on-level for KIB.

<b>r1246[3]</b>	<b>CO:Switch-on level kin buffering</b>				<b>Min:</b> -	<b>Level</b> <b>3</b>
		<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Def:</b> -		
	<b>P-Group:</b> FUNC			<b>Max:</b> -		

Displays switch-on level of kinetic buffering (KIB, Vdc min controller).

<b>P1247[3]</b>	<b>Dyn. factor of kinetic buffering</b>				<b>Min:</b> 10	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> %	<b>Def:</b> 100		
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200		

Enters dynamic factor for kinetic buffering (KIB, Vdc-min controller).

P1247 = 100 %  
means parameters P1250, P1251 and P1252 (gain, integration time and differential time) are used as set. Otherwise, these are multiplied by P1247 (dynamic factor of Vdc-min).

**Index:**

P1247[0] : 1st. Drive data set (DDS)  
P1247[1] : 2nd. Drive data set (DDS)  
P1247[2] : 3rd. Drive data set (DDS)

**Note:**

Vdc controller adjustment is calculated automatically from motor and inverter data.

<b>P1250[3]</b>	<b>Gain of Vdc-controller</b>				<b>Min:</b> 0.00	<b>Level</b> <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Def:</b> 1.00		
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 10.00		

Enters gain for Vdc controller.

**Index:**

P1250[0] : 1st. Drive data set (DDS)  
P1250[1] : 2nd. Drive data set (DDS)  
P1250[2] : 3rd. Drive data set (DDS)

<b>P1251[3]</b>	<b>Integration time Vdc-controller</b>				<b>Min:</b> 0.1	<b>Level</b> <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> ms	<b>Def:</b> 40.0		
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 1000.0		

Enters integral time constant for Vdc controller.

**Index:**

P1251[0] : 1st. Drive data set (DDS)  
P1251[1] : 2nd. Drive data set (DDS)  
P1251[2] : 3rd. Drive data set (DDS)

<b>P1252[3]</b>	<b>Differential time Vdc-controller</b>				<b>Min:</b> 0.0	<b>Level</b> <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> ms	<b>Def:</b> 1.0		
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 1000.0		

Enters differential time constant for Vdc controller.

**Index:**

P1252[0] : 1st. Drive data set (DDS)  
P1252[1] : 2nd. Drive data set (DDS)  
P1252[2] : 3rd. Drive data set (DDS)

<b>P1253[3]</b>	<b>Vdc-controller output limitation</b>				<b>Min:</b> 0.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> 10.00		
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 600.00		

Limits maximum effect of Vdc max controller.

**Index:**

P1253[0] : 1st. Drive data set (DDS)  
P1253[1] : 2nd. Drive data set (DDS)  
P1253[2] : 3rd. Drive data set (DDS)

<b>P1254</b>	<b>Auto detect Vdc switch-on levels</b>				<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 1		
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 1		

Enables/disables auto-detection of switch-on levels for Vdc control functionalities.

Following switch-on levels are calculated

- Switch-on level chopper
- Switch-on level compound brake
- Switch-on level Vdc\_max controller r1242

P1254 does not have any effect on the

- Switch-on level kin. buffering r1246

**Possible Settings:**

- 0 Disabled
- 1 Enabled

**Note:**

The switch-on thresholds are only calculated during the start-up of the inverter after connection to the mains. An online-adaption is not performed during operation. This means that modification of P1254 does not immediately take effect and variations in the mains are also not initially taken into account.

P1254 = 0 (Automatic Detection disabled):

The above thresholds are calculated via P0210, if automatic detection is disabled.

<b>P1256[3]</b>	<b>Reaction of kinetic buffering</b>				<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> FUNC	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 2		

Enters reaction for kinetic buffering controller (Vdc-min controller).

Depending on the setting selected, the frequency limit defined in P1257 is used to either hold the speed or disable pulses. If not enough regeneration is produced, drive may trip undervoltage.

**Possible Settings:**


- 0 Maintain DC-link until trip
- 1 Maintain DC-link until trip / stop
- 2 Control stop

**Index:**


- P1256[0] : 1st. Drive data set (DDS)
- P1256[1] : 2nd. Drive data set (DDS)
- P1256[2] : 3rd. Drive data set (DDS)

**Note:**


P1256 = 0:  
Maintain dclink voltage until mains is returned or drive is tripped undervoltage. The frequency is kept above the frequency limit provided in P1257.

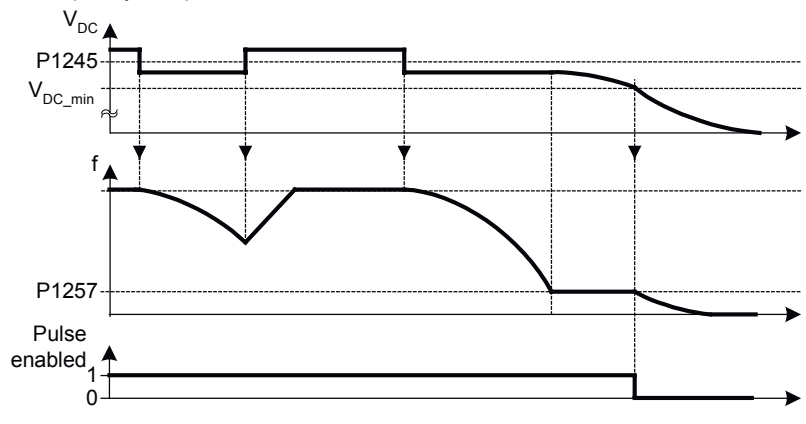

P1256 = 1:  
Maintain dclink voltage until mains is returned or drive is tripped undervoltage or pulses disabled when frequency falls below the limit in P1257.

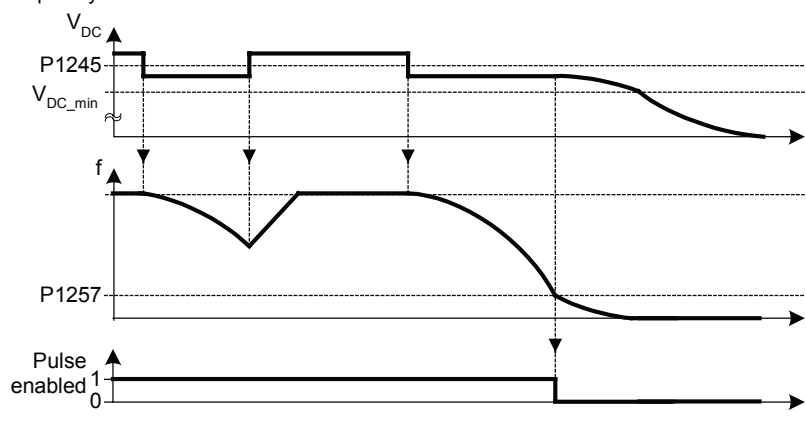

P1256 = 2:  
This option ramps down the frequency to stand still even when mains return. If mains does not return, frequency brought down under the control of vdc-min controller until P1257 limit then pulses disabled or undervoltage has occurred. If mains return, then an OFF1 is active until P1257 limit then pulses disabled.

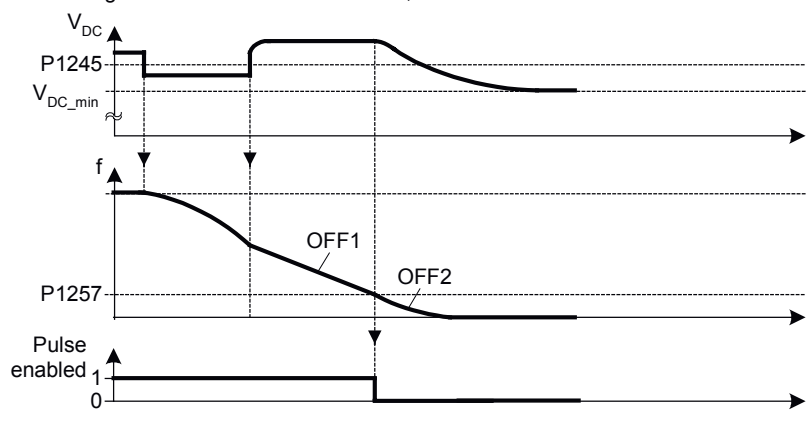

<b>P1257[3]</b>	<b>Freq limit for kinetic buffering</b>	<b>Min:</b> 0.00	<b>Level</b>
<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>3</b>
<b>P-Group:</b> SETPOINT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	
		<b>Def:</b> 2.50	
		<b>Max:</b> 600.00	

Frequency which kinetic buffering (KIB) either hold speed or disable pulses depending on P1256.


**Index:**

- P1257[0] : 1st. Drive data set (DDS)
- P1257[1] : 2nd. Drive data set (DDS)
- P1257[2] : 3rd. Drive data set (DDS)

### 3.29 Control mode

P1300[3]	<b>Control mode</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes	<b>Def:</b> 0	
	<b>P-Group:</b> CONTROL			<b>Max:</b> 23	

Controls relationship between speed of motor and voltage supplied by inverter as illustrated in the diagram below.

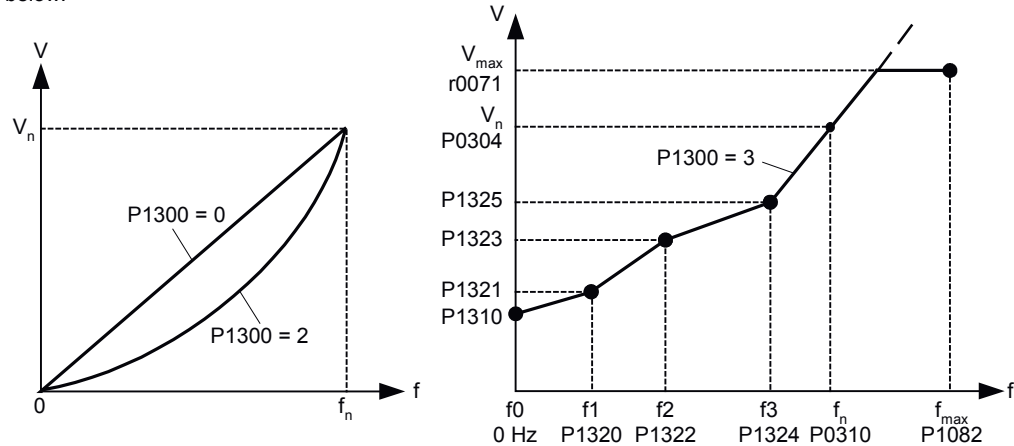

**Possible Settings:**

- 0 V/f with linear characteristic
- 1 V/f with FCC
- 2 V/f with parabolic characteristic
- 3 V/f with programmable characteristic
- 4 Reserved
- 5 V/f for textile applications
- 6 V/f with FCC for textile applications
- 19 V/f control with independent voltage setpoint
- 20 Sensorless vector control
- 21 Vector control with sensor
- 22 Sensorless vector torque-control
- 23 Vector torque-control with sensor

**Index:**

- P1300[0] : 1st. Drive data set (DDS)
- P1300[1] : 2nd. Drive data set (DDS)
- P1300[2] : 3rd. Drive data set (DDS)

**Dependency:**

See parameter P0205, P0500



**Caution:**

When commissioning Vector Control with encoder-feedback (VC), the drive should be configured for V/f mode (see P1300) first. Run the drive and compare r0061 with r0021 that should agree in

- sign and
- magnitude (with a deviation of only a few percent).

Only if both criteria are fulfilled, change P1300 and select VC (P1300 = 21 or 23).

P0400 = 1 (single channel encoder) will only allow operation in one direction. If operation in both directions is required, connect an encoder with 2 channels (A and B) and select setting 2. See the Operating Instructions of the encoder module for more information.

**Note:**

- P1300 = 1 : V/f with FCC (flux current control)
- Maintains motor flux current for improved efficiency.
  - If FCC is chosen, linear V/f is active at low frequencies.

- P1300 = 2 : V/f with a quadratic characteristic
- Suitable for centrifugal fans / pumps

- P1300 = 3 : V/f with a programmable characteristic
- User defined characteristic (see P1320)
  - For synchronous motors (e.g. SIEMOSYN motors)

- P1300 = 5,6 : V/f for textil applications
- Slip compensation disabled.
  - I<sub>max</sub> controller modifies the output voltage only.
  - I<sub>max</sub> controller does not influence the output frequency.

P1300 = 19 : V/f control with independent voltage setpoint

The following table presents an overview of control parameters (V/f) that can be modify in relationship to P1300 dependencies:

ParNo.	Parameter name	Level	V/f										SLVC	VC	
			P1300 =												
			0	1	2	3	5	6	19	20	22	21	23		
P1300[3]	Control mode	2	x	x	x	x	x	x	x	x	x	x	x	x	x
P1310[3]	Continuous boost	2	x	x	x	x	x	x	x	x	-	-	-	-	-
P1311[3]	Acceleration boost	2	x	x	x	x	x	x	x	x	-	-	-	-	-
P1312[3]	Starting boost	2	x	x	x	x	x	x	x	x	-	-	-	-	-
P1316[3]	Boost end frequency	3	x	x	x	x	x	x	x	x	-	-	-	-	-
P1320[3]	Programmable V/f freq. coord. 1	3	-	-	-	x	-	-	-	-	-	-	-	-	-
P1321[3]	Programmable V/f volt. coord. 1	3	-	-	-	x	-	-	-	-	-	-	-	-	-
P1322[3]	Programmable V/f freq. coord. 2	3	-	-	-	x	-	-	-	-	-	-	-	-	-
P1323[3]	Programmable V/f volt. coord. 2	3	-	-	-	x	-	-	-	-	-	-	-	-	-
P1324[3]	Programmable V/f freq. coord. 3	3	-	-	-	x	-	-	-	-	-	-	-	-	-
P1325[3]	Programmable V/f volt. coord. 3	3	-	-	-	x	-	-	-	-	-	-	-	-	-
P1330[3]	CI: Voltage setpoint	3	-	-	-	-	-	-	x	-	-	-	-	-	-
P1333[3]	Start frequency for FCC	3	-	x	-	-	-	x	-	-	-	-	-	-	-
P1335[3]	Slip compensation	2	x	x	x	x	-	-	-	-	-	-	-	-	-
P1336[3]	CO: U/f Slip limit	2	x	x	x	x	-	-	-	-	-	-	-	-	-
P1338[3]	Resonance damping gain V/f	3	x	x	x	x	-	-	-	-	-	-	-	-	-
P1340[3]	I <sub>max</sub> freq. controller prop. gain	3	x	x	x	x	x	x	x	x	-	-	-	-	-
P1341[3]	I <sub>max</sub> controller integral time	3	x	x	x	x	x	x	x	x	-	-	-	-	-
P1345[3]	I <sub>max</sub> controller prop. gain	3	x	x	x	x	x	x	x	x	-	-	-	-	-
P1346[3]	I <sub>max</sub> voltage ctrl. integral time	3	x	x	x	x	x	x	x	x	-	-	-	-	-
P1350[3]	Voltage soft start	3	x	x	x	x	x	x	x	x	-	-	-	-	-

SLVC / VC can provide excellent performance for the following types of application:

- Applications which require high torque performance
- Applications which require fast respond to shock loading
- Applications which require torque holding while passing through 0 Hz
- Applications which require very accurate speed holding
- Applications which require motor pull out protection

SLVC/VC-Restrictions:

- SLVC / VC is dependent on the accuracy of the motor model being used and the measurements being performed by the inverter. There are therefore certain restrictions on the use of SLVC / VC:

- $f_{max} = \min(200 \text{ Hz}, 5 \cdot P0310)$  (max. frequency)
- $\frac{1}{4} \leq \frac{P0305}{r0207} \leq \frac{r0209}{r0207}$  (ratio of rated motor current to rated inverter current)
- no synchronuos motor

Recommended means of SLVC/VC-commissioning:

- For correct operation under SLVC / VC control it is imperative that the name plate data of the motor (P0304 - P0310) is correctly entered and that the motor data identification (P1910) must be carried out on a cold motor. It is also necessary to ensure that the motor ambient temperature is correctly entered in P0625 if this is significantly different from the default value of 20°C. This must be done after the quick commissioning has been completed (P3900) but before the motor data identification measurements are carried out.
- See parameter P0400 and documentation of encoder and encoder module when commissioning VC (P1300 = 21 or 23).

SLVC/VC-Optimisation:

The following parameters can be adjusted by the user to improve performance.

- P0003 = 3
- P0342: Total / motor inertia ratio

Sensorless Vector Control (SLVC):

- P1470: P gain (SLVC)
- P1472: I term (SLVC)
- P1610: Continuous torque boost (SLVC, open loop boost)
- P1611: Acceleration torque boost (SLVC, open loop boost)
- P1750: Control word of motor model
- P1755: Start-frequency motor model (SLVC)

Vector Control (VC):

- P1460: P gain
- P1462: I term

The following table presents an overview of control parameters (SLVC, VC) that can be modify in relationship to P1300 dependencies:

ParNo.	Parameter name	Level	V/f							SLVC		VC	
			P1300 =										
			0	1	2	3	5	6	19	20	22	21	23
P1400[3]	Configuration of speed control	3	-	-	-	-	-	-	-	-	-	x	-
P1442[3]	Filter time for act. speed	3	-	-	-	-	-	-	-	-	-	x	-
P1452[3]	Filter time for act.speed (SLVC)	3	-	-	-	-	-	-	-	x	-	-	-
P1460[3]	Gain speed controller	2	-	-	-	-	-	-	-	-	-	x	-
P1462[3]	Integral time speed controller	2	-	-	-	-	-	-	-	-	-	x	-
P1470[3]	Gain speed controller (SLVC)	2	-	-	-	-	-	-	-	x	-	-	-
P1472[3]	Integral time n-ctrl. (SLVC)	2	-	-	-	-	-	-	-	x	-	-	-
P1477[3]	BI: Set integrator of n-ctrl.	3	-	-	-	-	-	-	-	x	-	x	-
P1478[3]	CI: Set integrator value n-ctrl.	3	-	-	-	-	-	-	-	x	-	x	-
P1488[3]	Droop input source	3	-	-	-	-	-	-	-	x	-	x	-
P1489[3]	Droop scaling	3	-	-	-	-	-	-	-	x	-	x	-
P1492[3]	Enable droop	3	-	-	-	-	-	-	-	x	-	x	-
P1496[3]	Scaling accel. precontrol	3	-	-	-	-	-	-	-	x	-	x	-
P1499[3]	Scaling accel. torque control	3	-	-	-	-	-	-	-	-	x	-	-
P1500[3]	Selection of torque setpoint	2	-	-	-	-	-	-	-	x	x	x	x
P1501[3]	BI: Change to torque control	3	-	-	-	-	-	-	-	x	x	x	x
P1503[3]	CI: Torque setpoint	3	-	-	-	-	-	-	-	-	x	-	x
P1511[3]	CI: Additional torque setpoint	3	-	-	-	-	-	-	-	x	x	x	x
P1520[3]	CO: Upper torque limit	2	-	-	-	-	-	-	-	x	x	x	x
P1521[3]	CO: Lower torque limit	2	-	-	-	-	-	-	-	x	x	x	x
P1522[3]	CI: Upper torque limit	3	-	-	-	-	-	-	-	x	x	x	x
P1523[3]	CI: Lower torque limit	3	-	-	-	-	-	-	-	x	x	x	x
P1525[3]	Scaling lower torque limit	3	-	-	-	-	-	-	-	x	x	x	x
P1530[3]	Motoring power limitation	2	-	-	-	-	-	-	-	x	x	x	x
P1531[3]	Regenerative power limitation	2	-	-	-	-	-	-	-	x	x	x	x
P1570[3]	CO: Fixed value flux setpoint	2	-	-	-	-	-	-	-	x	x	x	x
P1574[3]	Dynamic voltage headroom	3	-	-	-	-	-	-	-	x	x	x	x
P1580[3]	Efficiency optimization	2	-	-	-	-	-	-	-	x	x	x	x
P1582[3]	Smooth time for flux setpoint	3	-	-	-	-	-	-	-	x	x	x	x
P1596[3]	Int. time field weak. controller	3	-	-	-	-	-	-	-	x	x	x	x
P1610[3]	Continuous torque boost (SLVC)	2	-	-	-	-	-	-	-	x	x	-	-
P1611[3]	Acc. torque boost (SLVC)	2	-	-	-	-	-	-	-	x	x	-	-
P1740	Gain for oscillation damping	3	-	-	-	-	-	-	-	x	x	-	-
P1750[3]	Control word of motor model	3	-	-	-	-	-	-	-	x	x	x	x
P1755[3]	Start-freq. motor model (SLVC)	3	-	-	-	-	-	-	-	x	x	-	-
P1756[3]	Hyst.-freq. motor model (SLVC)	3	-	-	-	-	-	-	-	x	x	-	-
P1758[3]	T(wait) transit to feed-fwd-mode	3	-	-	-	-	-	-	-	x	x	-	-
P1759[3]	T(wait) for n-adaption to settle	3	-	-	-	-	-	-	-	x	x	-	-
P1764[3]	Kp of n-adaption (SLVC)	3	-	-	-	-	-	-	-	x	x	-	-
P1780[3]	Control word of Rs/Rr-adaption	3	-	-	-	-	-	-	-	x	x	-	-
P0400[3]	Select encoder type	2	-	-	-	-	-	-	-	-	-	x	x
P0408[3]	Encoder pulses per revolution	2	-	-	-	-	-	-	-	-	-	x	x
P0491[3]	Reaction on speed signal loss	2	-	-	-	-	-	-	-	-	-	x	x
P0492[3]	Allowed speed difference	2	-	-	-	-	-	-	-	-	-	x	x
P0494[3]	Delay speed loss reaction	2	-	-	-	-	-	-	-	-	-	x	x

1) If the speed control (main setpoint) is selected a torque setpoint is available via the additional setpoint channel.



### 3.29.1 V/f control technique

P1310[3]	<b>Continuous boost</b>	<b>Min:</b> 0.0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Def:</b> 50.0
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 250.0	<b>2</b>

At low output frequencies the output voltage is low to keep the flux level constant. However, the output voltage may be too low

- for magnetisation the asynchronous motor
- to hold the load
- to overcome losses in the system. The output voltage can be increased using parameter P1310.

Defines boost level in [%] relative to P0305 (rated motor current) applicable to both linear and quadratic V/f curves according to the diagram below:

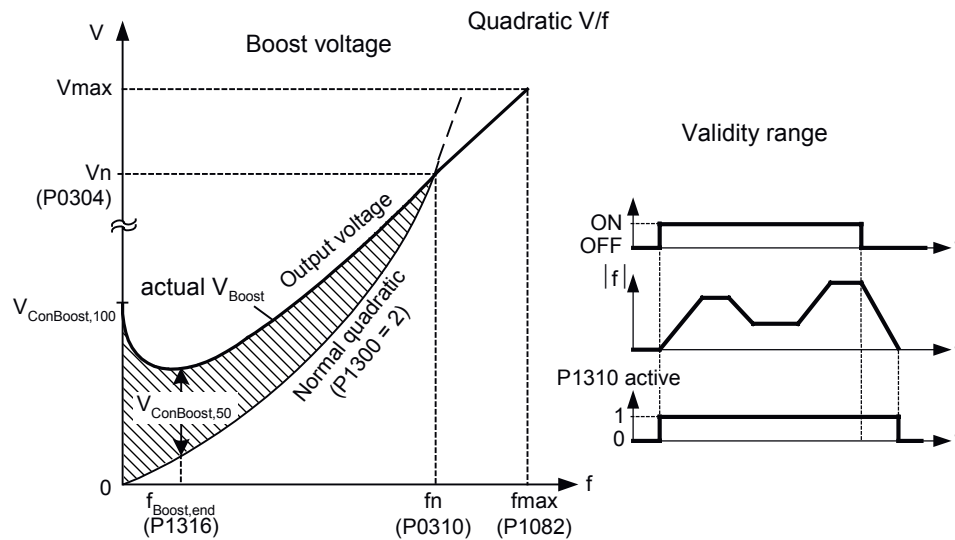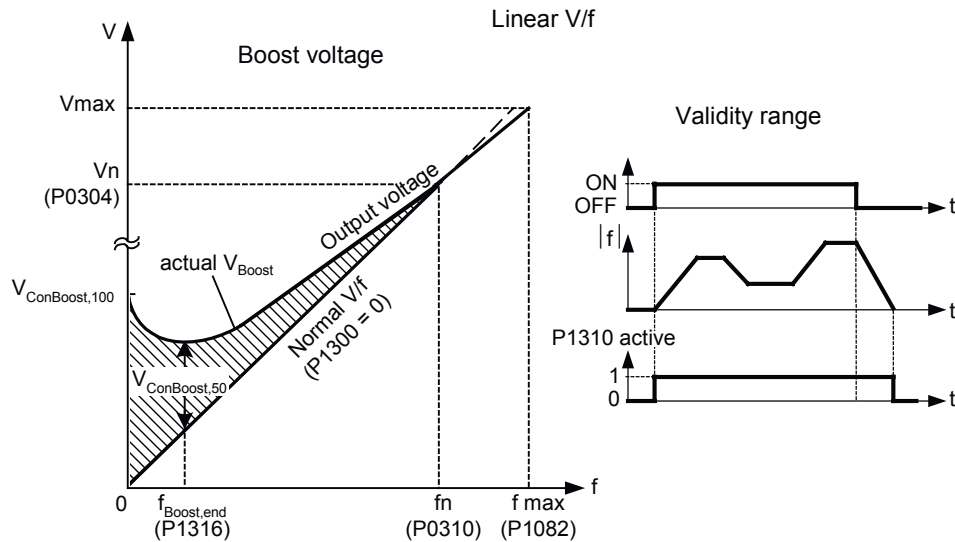

where voltage values are given

$$V_{ConBoost,100} = P0305 \cdot P0350 \cdot \frac{P1310}{100}$$

$$V_{ConBoost,50} = \frac{V_{ConBoost,100}}{2}$$

**Index:**

- P1310[0] : 1st. Drive data set (DDS)
- P1310[1] : 2nd. Drive data set (DDS)
- P1310[2] : 3rd. Drive data set (DDS)

**Dependency:**

Continuous boost P1310 has no effect during vector operation because the inverter calculates continuously the optimum operating conditions.



**Note:**

Increasing the boost levels increases motor heating (especially at standstill).

The boost values are combined when continuous boost (P1310) used in conjunction with other boost parameters (acceleration boost P1311 and starting boost P1312).

However priorities are allocated to these parameters as follows:  
P1310 > P1311 > P1312

The total boost is limited by following equation:

$$V_{Boost} \leq 3 \cdot R_s \cdot I_{Mot} = 3 \cdot P0305 \cdot P0350$$


Setting in P0640 (motor overload factor [%]) limits the boost:

$$\frac{V_{Boost}}{P0305 \cdot P0350} \leq \frac{P0640}{100}$$

<b>P1311[3]</b>	<b>Acceleration boost</b>	<b>Min:</b> 0.0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 0.0	<b>2</b>
		<b>Max:</b> 250.0	

P1311 will only produce boost during ramping, and is therefore useful for additional torque during acceleration and deceleration.

Applies boost in [%] relative to P0305 (rated motor current) following a positive setpoint change and drops back out once the setpoint is reached.

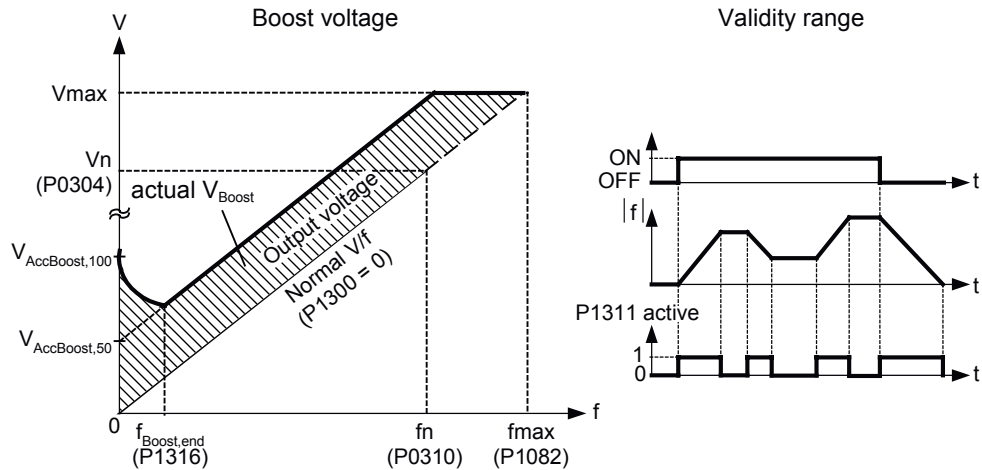

where voltage values are given

$$V_{AccBoost,100} = P0305 \cdot P0350 \cdot \frac{P1311}{100}$$

$$V_{AccBoost,50} = \frac{V_{AccBoost,100}}{2}$$

**Index:**

- P1311[0] : 1st. Drive data set (DDS)
- P1311[1] : 2nd. Drive data set (DDS)
- P1311[2] : 3rd. Drive data set (DDS)

**Dependency:**

Acceleration boost P1311 has no effect during vector operation.

**Note:**


See parameter P1310

<b>P1312[3]</b>	<b>Starting boost</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 0.0	
	<b>P-Group:</b> CONTROL			<b>Max:</b> 250.0	

Applies a constant linear offset (in [%] relative to P0305 (rated motor current)) to active V/f curve (either linear or quadratic) after an ON command and is active until  
1) ramp output reaches setpoint for the first time respectively  
2) setpoint is reduced to less than present ramp output

This is useful for starting loads with high inertia.

Setting the starting boost (P1312) too high will cause the inverter to limit the current, which will in turn restrict the output frequency to below the setpoint frequency.

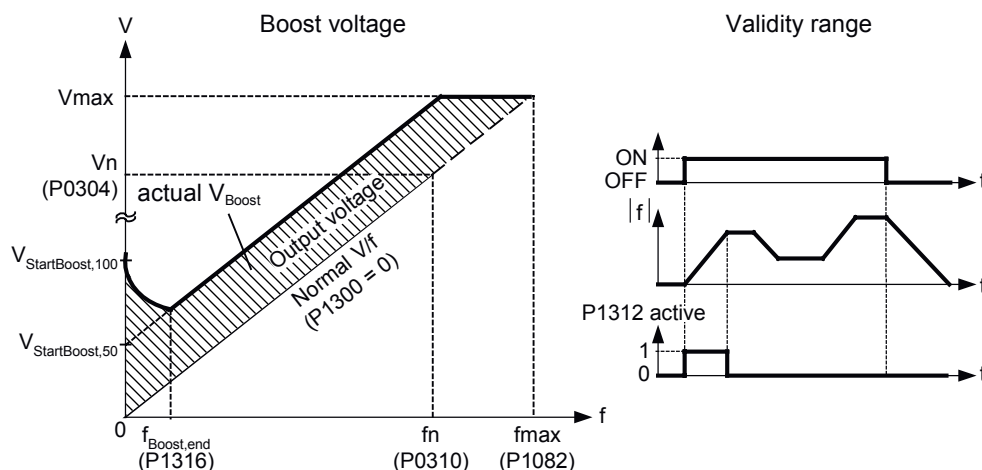

where voltage values are given

$$V_{StartBoost,100} = P0305 \cdot P0350 \cdot \frac{P1312}{100}$$

$$V_{StartBoost,50} = \frac{V_{StartBoost,100}}{2}$$

**Index:**

- P1312[0] : 1st. Drive data set (DDS)
- P1312[1] : 2nd. Drive data set (DDS)
- P1312[2] : 3rd. Drive data set (DDS)

**Example:**

Setpoint = 50Hz. Ramping up with starting boost. During ramp up, setpoint changed to 20Hz. As soon as setpoint changed, starting boost removed because setpoint smaller than present ramp output.

**Dependency:**

Acceleration boost P1312 has no effect during vector operation.

**Note:**

See parameter P1310

<b>r1315</b>	<b>CO: Total boost voltage</b>	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> -	<b>Level</b> <b>4</b>
	<b>P-Group:</b> CONTROL			<b>Def:</b> -	
				<b>Max:</b> -	

Displays total value of voltage boost (in volts).

<b>P1316[3]</b>	<b>Boost end frequency</b>	<b>Min:</b> 0.0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> %
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Defines point at which programmed boost reaches 50 % of its value. This value is expressed in [%] relative to P0310 (rated motor frequency).

The default frequency is defined as follows:

$$f_{\text{Boost min}} = 2 \cdot \left( \frac{153}{\sqrt{P_{\text{motor}}}} + 3 \right)$$

**Index:**

- P1316[0] : 1st. Drive data set (DDS)
- P1316[1] : 2nd. Drive data set (DDS)
- P1316[2] : 3rd. Drive data set (DDS)

**Note:**


- The expert user may change this value to alter the shape of the curve, e.g. to increase torque at a particular frequency.
- Default value is depending on inverter type and its rating data.

**Details:**

See diagram in P1310 (continuous boost).

<b>P1320[3]</b>	<b>Programmable V/f freq. coord. 1</b>	<b>Min:</b> 0.00	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Sets V/f coordinates (P1320/1321 to P1324/1325) to define V/f characteristic.

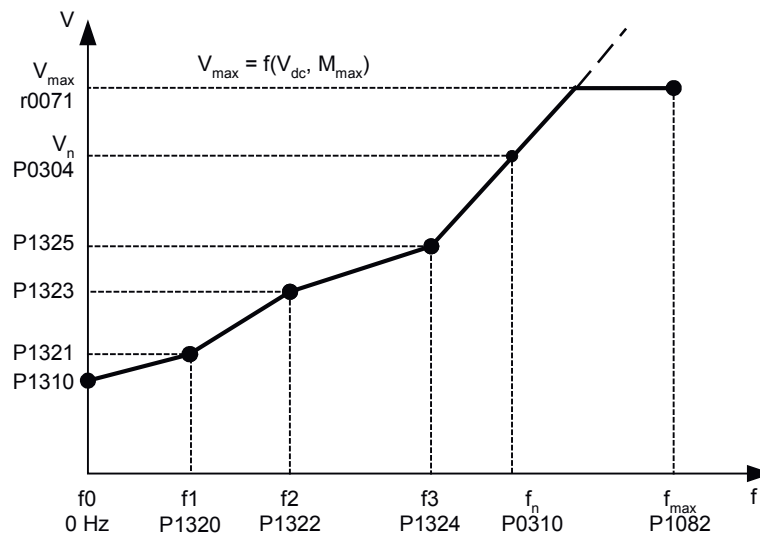

$$P1310[V] = \frac{P1310[\%]}{100[\%]} \cdot \frac{r0395[\%]}{100[\%]} \cdot P0304[V]$$

**Index:**

- P1320[0] : 1st. Drive data set (DDS)
- P1320[1] : 2nd. Drive data set (DDS)
- P1320[2] : 3rd. Drive data set (DDS)

**Example:**

This parameter can be used to provide correct torque at correct frequency and is useful when used with synchronous motors.

**Dependency:**

To set parameter, select P1300 = 3 (V/f with programmable characteristic).

**Note:**

Linear interpolation will be applied between the individual data points.

V/f with programmable characteristic (P1300 = 3) has 3 programmable points. The two non-programmable points are:

- Continuous boost P1310 at zero 0 Hz
- Rated motor voltage P0304 at rated motor frequency P0310

The acceleration boost and starting boost defined in P1311 and P1312 are applied to V/f with programmable characteristic.

<b>P1321[3]</b>	<b>Programmable V/f volt. coord. 1</b>	<b>Min:</b> 0.0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> V <b>Def:</b> 0.0		
	<b>P-Group:</b> CONTROL <b>Active:</b> Immediately <b>QuickComm.:</b> No <b>Max:</b> 3000.0		

See P1320 (programmable V/f freq. coord. 1).

**Index:**

P1321[0] : 1st. Drive data set (DDS)  
P1321[1] : 2nd. Drive data set (DDS)  
P1321[2] : 3rd. Drive data set (DDS)

<b>P1322[3]</b>	<b>Programmable V/f freq. coord. 2</b>	<b>Min:</b> 0.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT <b>Datatype:</b> Float <b>Unit:</b> Hz <b>Def:</b> 0.00		
	<b>P-Group:</b> CONTROL <b>Active:</b> Immediately <b>QuickComm.:</b> No <b>Max:</b> 650.00		

See P1320 (programmable V/f freq. coord. 1).

**Index:**

P1322[0] : 1st. Drive data set (DDS)  
P1322[1] : 2nd. Drive data set (DDS)  
P1322[2] : 3rd. Drive data set (DDS)

<b>P1323[3]</b>	<b>Programmable V/f volt. coord. 2</b>	<b>Min:</b> 0.0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> V <b>Def:</b> 0.0		
	<b>P-Group:</b> CONTROL <b>Active:</b> Immediately <b>QuickComm.:</b> No <b>Max:</b> 3000.0		

See P1320 (programmable V/f freq. coord. 1).

**Index:**

P1323[0] : 1st. Drive data set (DDS)  
P1323[1] : 2nd. Drive data set (DDS)  
P1323[2] : 3rd. Drive data set (DDS)

<b>P1324[3]</b>	<b>Programmable V/f freq. coord. 3</b>	<b>Min:</b> 0.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT <b>Datatype:</b> Float <b>Unit:</b> Hz <b>Def:</b> 0.00		
	<b>P-Group:</b> CONTROL <b>Active:</b> Immediately <b>QuickComm.:</b> No <b>Max:</b> 650.00		

See P1320 (programmable V/f freq. coord. 1).

**Index:**

P1324[0] : 1st. Drive data set (DDS)  
P1324[1] : 2nd. Drive data set (DDS)  
P1324[2] : 3rd. Drive data set (DDS)

<b>P1325[3]</b>	<b>Programmable V/f volt. coord. 3</b>	<b>Min:</b> 0.0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> V <b>Def:</b> 0.0		
	<b>P-Group:</b> CONTROL <b>Active:</b> Immediately <b>QuickComm.:</b> No <b>Max:</b> 3000.0		

See P1320 (programmable V/f freq. coord. 1).

**Index:**

P1325[0] : 1st. Drive data set (DDS)  
P1325[1] : 2nd. Drive data set (DDS)  
P1325[2] : 3rd. Drive data set (DDS)

<b>P1330[3]</b>	<b>CI: Voltage setpoint</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> T <b>Datatype:</b> U32 <b>Unit:</b> - <b>Def:</b> 0:0		
	<b>P-Group:</b> CONTROL <b>Active:</b> first confirm <b>QuickComm.:</b> No <b>Max:</b> 4000:0		

BICO parameter for selecting source of voltage setpoint for independent V/f control.

**Index:**

P1330[0] : 1st. Command data set (CDS)  
P1330[1] : 2nd. Command data set (CDS)  
P1330[2] : 3rd. Command data set (CDS)


<b>P1333[3]</b>	<b>Start frequency for FCC</b>			<b>Min:</b> 0.0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 10.0	
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 100.0	

Defines the FCC starting frequency as a percentage of the rated motor frequency (P0310).

When FCC is activated using P1300 = 1, then as a function of the FCC starting frequency plus hysteresis and the actual frequency, a changeover is made with a continuous transition between the linear V/f characteristic (P1300 = 0) and FCC (refer to the diagram).

$$f_{FCC} = \frac{P0310}{100} \cdot P1333$$

$$f_{FCC+Hys} = \frac{P0310}{100} \cdot (P1333 + 6\%)$$

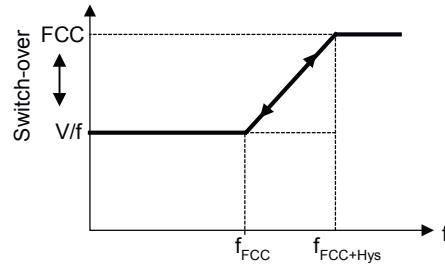

**Index:**

- P1333[0] : 1st. Drive data set (DDS)
- P1333[1] : 2nd. Drive data set (DDS)
- P1333[2] : 3rd. Drive data set (DDS)

**Notice:**

- A value that is excessively low can result in instability.
- The constant voltage boost P1310 is continuously de-activated - essentially the same as when switching-in FCC.
- Contrary, the voltage boosts P1311 and P1312 remain active over the complete frequency range.


### 3.29.1.1 Slip compensation

<b>P1335[3]</b>	<b>Slip compensation</b>	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> %
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 0.0		
		<b>Max:</b> 600.0		

Dynamically adjusts output frequency of inverter so that motor speed is kept constant independent of motor load.

In the V/f-control, the motor speed will always be less than the command speed due to the slip speed. For a given speed command, the speed will drop as load is increased. The speed regulation of drive can be improved by the technique known as slip compensation.

Increasing the load from M1 to M2 (see diagram) will decrease the motor speed from f1 to f2, due to the slip. The inverter can compensate for this by increasing the output frequency slightly as the load increases. The inverter measures the current and increases the output frequency to compensate for the expected slip.

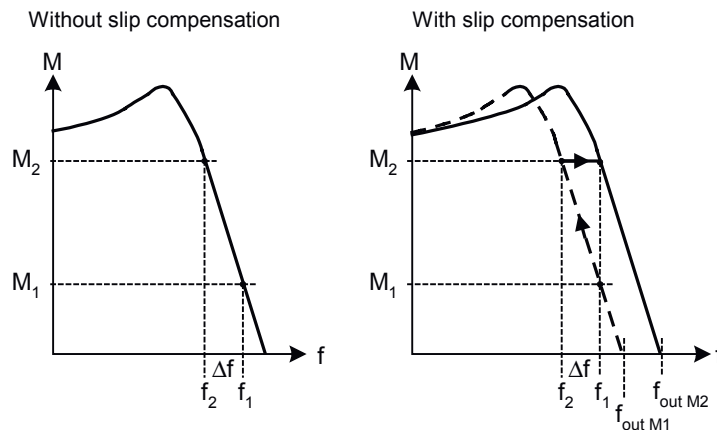


**Index:**

- P1335[0] : 1st. Drive data set (DDS)
- P1335[1] : 2nd. Drive data set (DDS)
- P1335[2] : 3rd. Drive data set (DDS)

**Value:**


- P1335 = 0 % : Slip compensation disabled.
- P1335 = 50 % - 70 % : Full slip compensation at cold motor (partial load).
- P1335 = 100 % : Full slip compensation at warm motor (full load).

Range of slip compensation :

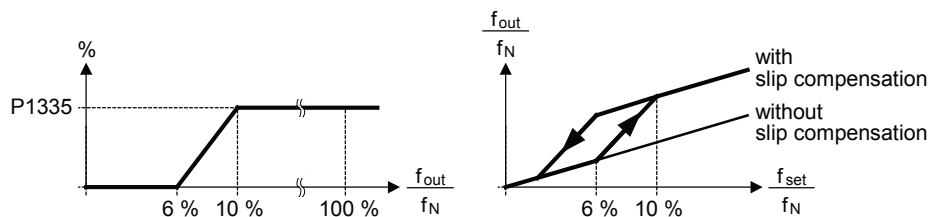

**Notice:**

The applied value of the slip compensation (scaled by P1335) is limited by following equation:

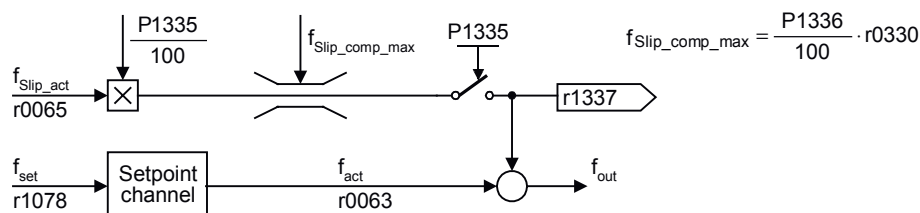

<b>P1336[3]</b>	<b>Slip limit</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Def:</b> 250
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 600	<b>2</b>

Compensation slip limit in [%] relative to r0330 (rated motor slip), which is added to frequency setpoint.

**Index:**

P1336[0] : 1st. Drive data set (DDS)  
P1336[1] : 2nd. Drive data set (DDS)  
P1336[2] : 3rd. Drive data set (DDS)

**Dependency:**

Slip compensation (P1335) active.

<b>r1337</b>	<b>CO: V/f slip frequency</b>	<b>Min:</b> -	<b>Level</b>
		<b>Datatype:</b> Float	<b>Def:</b> -
	<b>P-Group:</b> CONTROL	<b>Unit:</b> %	<b>Max:</b> -
			<b>3</b>

Displays actual compensated motor slip as [%]


**Dependency:**

Slip compensation (P1335) active.

### 3.29.1.2 Resonance damping

<b>P1338[3]</b>	<b>Resonance damping gain V/f</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Def:</b> 0.00
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 10.00	<b>3</b>

Defines resonance damping gain for V/f. Here, di/dt of the active current will be scaled by P1338 (see diagram below). If di/dt increases the resonance damping circuit decreases the inverter output frequency.

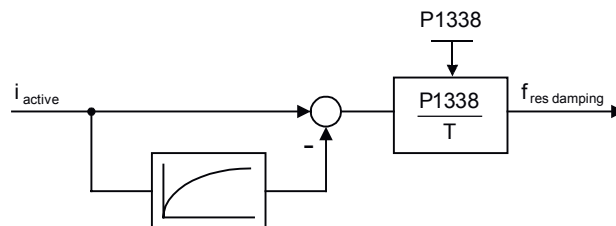

**Index:**

P1338[0] : 1st. Drive data set (DDS)  
P1338[1] : 2nd. Drive data set (DDS)  
P1338[2] : 3rd. Drive data set (DDS)

**Note:**

- The resonance damping function is used to dampen oscillations in the active current. These especially occur when rotating field motors are operating under no-load conditions. The parameter is not used to optimize the stabilizing behavior.
- In the V/f control modes (refer to P1300), the resonance damping controller is activate in a range from approximately 5 % up to 70 % of the rated motor frequency (P0310).
- An excessively high value results in instability (positive feedback).


### 3.29.1.3 I<sub>max</sub> controller

<b>P1340[3]</b>	<b>I<sub>max</sub> freq. controller prop. gain</b>				<b>Min:</b> 0.000	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Def:</b> 0.000		
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 0.499		

Proportional gain of the I<sub>max</sub> frequency controller.

The I<sub>max</sub> controller reduces inverter current if the output current exceeds the maximum motor current (r0067).

In linear V/f, parabolic V/f, FCC, and programmable V/f modes the I<sub>max</sub> controller uses both a frequency controller (see parameters P1340 and P1341) and a voltage controller (see parameters P1345 and P1346). The frequency controller seeks to reduce current by limiting the inverter output frequency (to a minimum of the two times nominal slip frequency). If this action does not successfully remove the overcurrent condition, the inverter output voltage is reduced using the I<sub>max</sub> voltage controller. When the overcurrent condition has been removed successfully, frequency limiting is removed using the ramp-up time set in P1120.

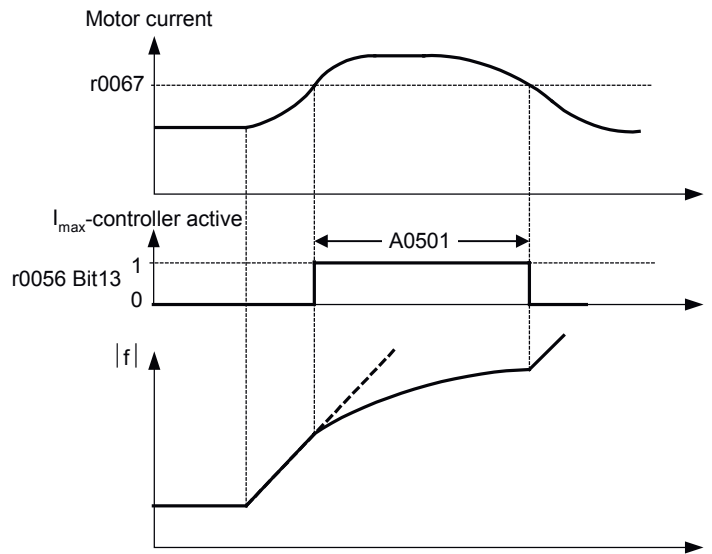

In linear V/f for textiles, FCC for textiles, or external V/f modes only the I<sub>max</sub> voltage controller is used to reduce current (See parameters P1345 and P1346).

**Index:**

- P1340[0] : 1st. Drive data set (DDS)
- P1340[1] : 2nd. Drive data set (DDS)
- P1340[2] : 3rd. Drive data set (DDS)

**Note:**

The I<sub>max</sub> controller can be disabled by setting the frequency controller integral time P1341 to zero. This disables both the frequency and voltage controllers. Note that when disabled, the I<sub>max</sub> controller will take no action to reduce current but overcurrent warnings will still be generated, and the Drive will trip in excessive overcurrent or overload conditions.

<b>P1341[3]</b>	<b>I<sub>max</sub> freq. ctrl. integral time</b>				<b>Min:</b> 0.000	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s	<b>Def:</b> 0.300		
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 50.000		

Integral time constant of the I<sub>max</sub> controller.

- P1341 = 0 :  
I<sub>max</sub> frequency and voltage controllers disabled
- P1340 = 0 and P1341 > 0 :  
frequency controller enhanced integral
- P1340 > 0 and P1341 > 0 :  
frequency controller normal PI control

See description in parameter P1340 for further information.

**Index:**

- P1341[0] : 1st. Drive data set (DDS)
- P1341[1] : 2nd. Drive data set (DDS)
- P1341[2] : 3rd. Drive data set (DDS)



<b>r1343</b>	<b>CO: I<sub>max</sub> controller freq. output</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> CONTROL			<b>Def:</b> - <b>Max:</b> -	

Displays effective frequency limitation.

**Dependency:**

If I<sub>max</sub> controller not in operation, parameter normally shows max. frequency P1082.

<b>r1344</b>	<b>CO: I<sub>max</sub> controller volt. output</b>	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> CONTROL			<b>Def:</b> - <b>Max:</b> -	

Displays amount by which the I<sub>max</sub> controller is reducing the inverter output voltage.

<b>P1345[3]</b>	<b>I<sub>max</sub> voltage ctrl. prop. gain</b>			<b>Min:</b> 0.000	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Def:</b> 0.250	
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 5.499	

Proportional gain of the I<sub>max</sub> voltage controller. See parameter P1340 for further information.

**Index:**

P1345[0] : 1st. Drive data set (DDS)  
P1345[1] : 2nd. Drive data set (DDS)  
P1345[2] : 3rd. Drive data set (DDS)

<b>P1346[3]</b>	<b>I<sub>max</sub> voltage ctrl. integral time</b>			<b>Min:</b> 0.000	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s	<b>Def:</b> 0.300	
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 50.000	

Integral time constant of the I<sub>max</sub> voltage controller.

P1341 = 0 :  
I<sub>max</sub> frequency and voltage controllers disabled.  
P1345 = 0 and P1346 > 0 :  
I<sub>max</sub> voltage controller enhanced integral  
P1345 > 0 and P1346 > 0 :  
I<sub>max</sub> voltage controller normal PI control


**Index:**

P1346[0] : 1st. Drive data set (DDS)  
P1346[1] : 2nd. Drive data set (DDS)  
P1346[2] : 3rd. Drive data set (DDS)

### 3.29.1.4 Soft starting

<b>P1350[3]</b>	<b>Voltage soft start</b>			<b>Min:</b> 0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 1	

Sets whether voltage is built up smoothly during magnetization time (ON) or whether it simply jumps to boost voltage (OFF).

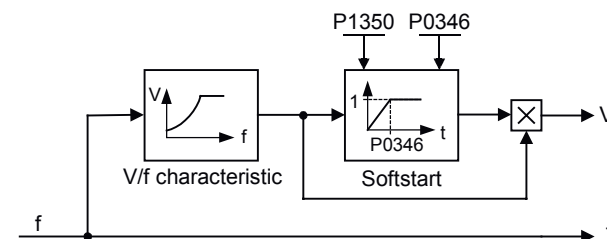

**Possible Settings:**

0 OFF  
1 ON

**Index:**

P1350[0] : 1st. Drive data set (DDS)  
P1350[1] : 2nd. Drive data set (DDS)  
P1350[2] : 3rd. Drive data set (DDS)

**Note:**

The settings for this parameter bring benefits and drawbacks:

- P1350 = 0: OFF (jump to boost voltage)
  - Benefit: flux is built up quickly
  - Drawback: motor may move
- P1350 = 1: ON (smooth voltage build-up)
  - Benefit: motor less likely to move
  - Drawback: flux build-up takes longer

### 3.29.2 Field-orientated vector control

<b>P1400[3]</b>	<b>Configuration of speed control</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT <b>Datatype:</b> U16 <b>Unit:</b> - <b>Def:</b> 1		
	<b>P-Group:</b> CONTROL <b>Active:</b> Immediately <b>QuickComm.:</b> No <b>Max:</b> 3		

Configuration for speed control.

**Bitfields:**


Bit00	Automatic Kp adaption	0	NO	1	YES
Bit01	Integral freeze (SLVC)	0	NO	1	YES

**Index:**

- P1400[0] : 1st. Drive data set (DDS)
- P1400[1] : 2nd. Drive data set (DDS)
- P1400[2] : 3rd. Drive data set (DDS)

**Note:**

P1400 Bit 00 = 1:  
Automatic gain adaption of speed controller is enabled. In the area of field weakening the gain is reduced in dependence on flux.

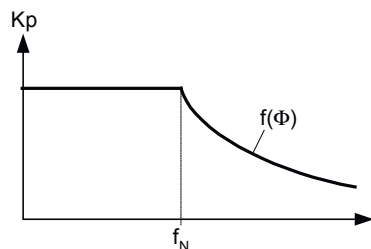

P1400 Bit 01 = 1:  
The integrator of the speed controller is frozen if Sensorless Vector Control (SLVC) is selected and the control is switched from closed-loop to open-loop operation.

**Advantage:**

The correct amount of slip compensation is calculated and applied to the open-loop function for a motor under load.

<b>r1407</b>	<b>CO/BO: Status 2 of motor control</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> U16 <b>Unit:</b> - <b>Def:</b> -		
	<b>P-Group:</b> CONTROL <b>Max:</b> -		

Displays status of motor control, which can be used to diagnose inverter status.

**Bitfields:**

Bit00	V/f control enable	0	NO	1	YES
Bit01	SLVC enable	0	NO	1	YES
Bit02	Torque control enable	0	NO	1	YES
Bit05	Stop I-comp. speed control	0	NO	1	YES
Bit06	Set I-comp. speed controller	0	NO	1	YES
Bit08	Upper torque limit active	0	NO	1	YES
Bit09	Lower torque limit active	0	NO	1	YES
Bit10	Enable droop	0	NO	1	YES
Bit15	DDS change active	0	NO	1	YES

**Details:**

See P052 (CO/BO: Status word 1)


<b>r1438</b>	<b>CO: Freq. setpoint to controller</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> Float <b>Unit:</b> Hz <b>Def:</b> -		
	<b>P-Group:</b> CONTROL <b>Max:</b> -		

Displays setpoint of speed controller.



<b>P1470[3]</b>	<b>Gain speed controller (SLVC)</b>				<b>Min:</b> 0.0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Def:</b> 3.0		
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 2000.0		

Enters gain of speed controller for sensorless vector control (SLVC).

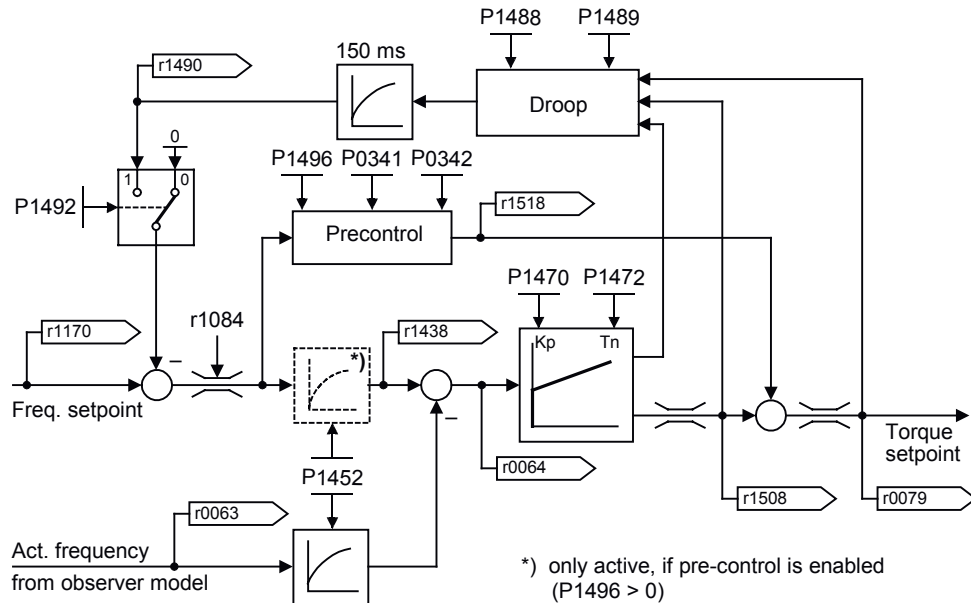

**Index:**

- P1470[0] : 1st. Drive data set (DDS)
- P1470[1] : 2nd. Drive data set (DDS)
- P1470[2] : 3rd. Drive data set (DDS)

<b>P1472[3]</b>	<b>Integral time n-ctrl. (SLVC)</b>				<b>Min:</b> 25	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Def:</b> 400		
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 32001		

Enters integral time of speed controller for sensorless vector control (SLVC).

**Index:**

- P1472[0] : 1st. Drive data set (DDS)
- P1472[1] : 2nd. Drive data set (DDS)
- P1472[2] : 3rd. Drive data set (DDS)

<b>P1477[3]</b>	<b>BI: Set integrator of n-ctrl.</b>				<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0		
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Selects source to read in command to enable speed controller.

**Index:**

- P1477[0] : 1st. Command data set (CDS)
- P1477[1] : 2nd. Command data set (CDS)
- P1477[2] : 3rd. Command data set (CDS)

<b>P1478[3]</b>	<b>CI: Set integrator value n-ctrl.</b>				<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> UT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0		
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Selects source for integral part of speed controller.

**Index:**

- P1478[0] : 1st. Command data set (CDS)
- P1478[1] : 2nd. Command data set (CDS)
- P1478[2] : 3rd. Command data set (CDS)

**Dependency:**

In case of sensorless vector control, integrator freezing must be selected (Bit 1 "Integral freeze (SLVC)" of P1400 has to be set) to save the integrator output.

**Note:**

If the setting command is not connected (P1477=0), a pending value is read in after pulse enable at the end of the excitation time (P0346) and the integral component of the speed controller is set once. If the P1482 (integral component of speed controller) is connected upon pulse enable, the integral component of the controller is set to the last value prior the pulse inhibit.

**Notice:**

Neither function works after flying start.

<b>r1482</b>	<b>CO: Integral output of n-ctrl.</b>	<b>Min:</b> -	<b>Level</b>
	<b>Datatype:</b> Float <b>Unit:</b> Nm	<b>Def:</b> -	<b>3</b>
<b>P-Group:</b> CONTROL		<b>Max:</b> -	


Displays integral part of speed controller output.

### 3.29.2.2 Droop

<b>P1488[3]</b>	<b>Droop input source</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT <b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> 0	<b>3</b>
<b>P-Group:</b> CONTROL <b>Active:</b> first confirm		<b>QuickComm.:</b> No	<b>Max:</b> 3

Selects source of droop input signal.

With mechanically coupled motors it is very important that an even load distribution is applied to each motor. The load sharing can be achieved by enabling the droop function on both inverters.

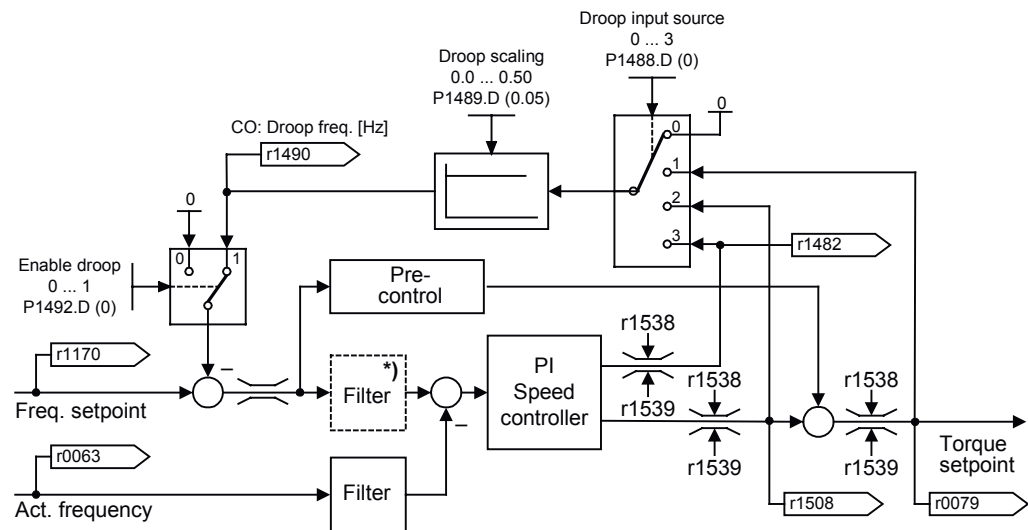

\*) only active, if pre-control is enabled  
(P1496 > 0)

1. Droop is applied as a frequency setpoint on each inverter.  
The droop increases the slip via the negative feedback of the torque setpoint to the frequency setpoint. In a steady-state an even load distribution can be achieved if the slip characteristics are identical.
  - P1488 > 0
  - P1489 > 0
  - P1492 = 1
2. Droop can act as a setpoint or limitation for a group of inverters (i.e. master-slave inverters)  
By use of the master-slave inverter technique an even load distribution is achieved across the whole application. This is accomplished by setting the torque setpoint (r1490) on the master inverter which then controls the frequency of the master inverter and all connected slave inverters.
  - P1488 > 0
  - P1489 > 0
  - P1492 = 0

**Possible Settings:**

- 0 Droop input disabled
- 1 Torque setpoint
- 2 Speed controller output
- 3 Speed controller integral output

**Index:**

- P1488[0] : 1st. Drive data set (DDS)
- P1488[1] : 2nd. Drive data set (DDS)
- P1488[2] : 3rd. Drive data set (DDS)

**Dependency:**

Droop scaling (P1489) must be > 0 for droop to be effective.

<b>P1489[3]</b>	<b>Droop scaling</b>			<b>Min:</b> 0.00	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Def:</b> 0.05	
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 0.50	

Defines amount of droop in per unit at full load in [%].

**Index:**

P1489[0] : 1st. Drive data set (DDS)  
P1489[1] : 2nd. Drive data set (DDS)  
P1489[2] : 3rd. Drive data set (DDS)

**Note:**

If 0 is entered as value, no droop is applied.

<b>r1490</b>	<b>CO: Droop frequency</b>			<b>Min:</b> -	Level <b>3</b>
		<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> -	
	<b>P-Group:</b> CONTROL			<b>Max:</b> -	

Displays output signal of droop function.

This result of droop calculation is subtracted from the speed controller setpoint.

<b>P1492[3]</b>	<b>Enable droop</b>			<b>Min:</b> 0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 1	

Enables droop.

**Possible Settings:**

0 Disabled  
1 Enabled

**Index:**

P1492[0] : 1st. Drive data set (DDS)  
P1492[1] : 2nd. Drive data set (DDS)  
P1492[2] : 3rd. Drive data set (DDS)

**Dependency:**


Effective only if droop scaling P1489 > 0.

### 3.29.2.3 Speed controller pre-control

<b>P1496[3]</b>	<b>Scaling accel. precontrol</b>	<b>Min:</b> 0.0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> %
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 0.0		
		<b>Max:</b> 400.0		

Enters scaling of acceleration in [%].

The response of setpoint changes for the speed control loop can be improved using the precontrol function (P1496). Precontrol is derived from the differential frequency setpoint multiplied by the mass inertia P0341; P0342 is then supplied as a torque setpoint to the current controller. If the filter (VC: P1442, SLVC: P1452) is applied in the correct manner, the derived speed controller is only required to control a small deviation in the value of the corrected variable. Setpoint changes are then passed by the speed controller and are quickly executed.

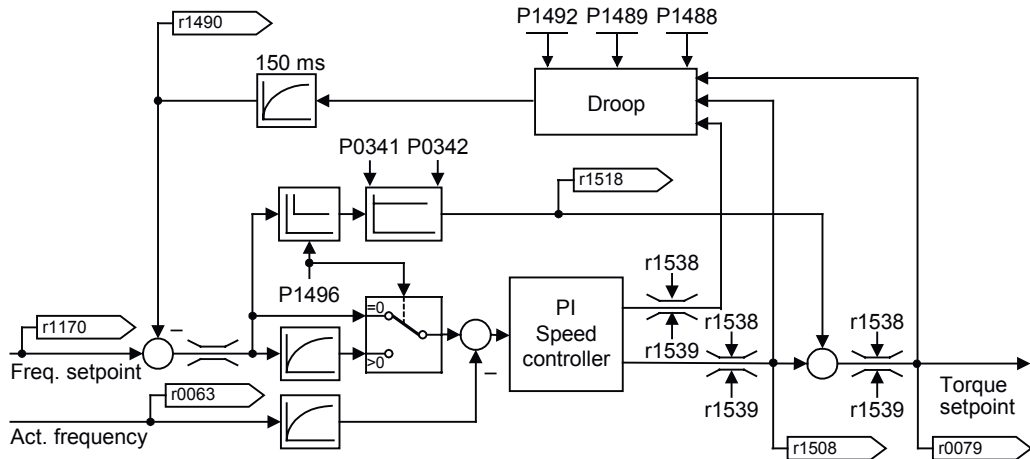

**Index:**

- P1496[0] : 1st. Drive data set (DDS)
- P1496[1] : 2nd. Drive data set (DDS)
- P1496[2] : 3rd. Drive data set (DDS)

**Note:**

- P1496 = 0:  
Precontrol disabled
- P1496 > 0:  
Precontrol enabled
- P1496 = 100:  
Standard setting for precontrol

<b>P1499[3]</b>	<b>Scaling accel. torque control</b>	<b>Min:</b> 0.0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> %
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 100.0		
		<b>Max:</b> 400.0		

Enters scaling of acceleration in [%] for sensorless torque control (SLVC) at low frequencies.

**Index:**

- P1499[0] : 1st. Drive data set (DDS)
- P1499[1] : 2nd. Drive data set (DDS)
- P1499[2] : 3rd. Drive data set (DDS)

### 3.29.2.4 Torque control

<b>P1500[3]</b>	<b>Selection of torque setpoint</b>			<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> Yes	<b>Max:</b> 77	

Selects torque setpoint source. In the table of possible settings below, the main setpoint is selected from the least significant digit (i.e., 0 to 7) and any additional setpoint from the most significant digit (i.e., x0 through to x7).

**Possible Settings:**

- 0 No main setpoint
- 2 Analog setpoint
- 4 USS on BOP link
- 5 USS on COM link
- 6 CB on COM link
- 7 Analog setpoint 2
- 20 No main setpoint + Analog setpoint
- 22 Analog setpoint + Analog setpoint
- 24 USS on BOP link + Analog setpoint
- 25 USS on COM link + Analog setpoint
- 26 CB on COM link + Analog setpoint
- 27 Analog setpoint 2 + Analog setpoint
- 40 No main setpoint + USS on BOP link
- 42 Analog setpoint + USS on BOP link
- 44 USS on BOP link + USS on BOP link
- 45 USS on COM link + USS on BOP link
- 46 CB on COM link + USS on BOP link
- 47 Analog setpoint 2 + USS on BOP link
- 50 No main setpoint + USS on COM link
- 52 Analog setpoint + USS on COM link
- 54 USS on BOP link + USS on COM link
- 55 USS on COM link + USS on COM link
- 57 Analog setpoint 2 + USS on COM link
- 60 No main setpoint + CB on COM link
- 62 Analog setpoint + CB on COM link
- 64 USS on BOP link + CB on COM link
- 66 CB on COM link + CB on COM link
- 67 Analog setpoint 2 + CB on COM link
- 70 No main setpoint + Analog setpoint 2
- 72 Analog setpoint + Analog setpoint 2
- 74 USS on BOP link + Analog setpoint 2
- 75 USS on COM link + Analog setpoint 2
- 76 CB on COM link + Analog setpoint 2
- 77 Analog setpoint 2 + Analog setpoint 2

**Index:**


- P1500[0] : 1st. Command data set (CDS)
- P1500[1] : 2nd. Command data set (CDS)
- P1500[2] : 3rd. Command data set (CDS)

**Example:**

Setting 24 selects the main setpoint (4) derived from the USS on BOP link with the additional setpoint (2) derived from the analog input. Single digits are main setpoints only with no additional setpoint.

**Example P1500 = 24 :**

P1500 = 24	P1503 = 755.0	P1503	CI: Torque setpoint
		r0755	CO: Act. ADC after scal. [4000h]
P1500 = 24	P1511 = r2015.1	P1511	CI: Additional torque setpoint
		r2015	CO: PZD from BOP link (USS)

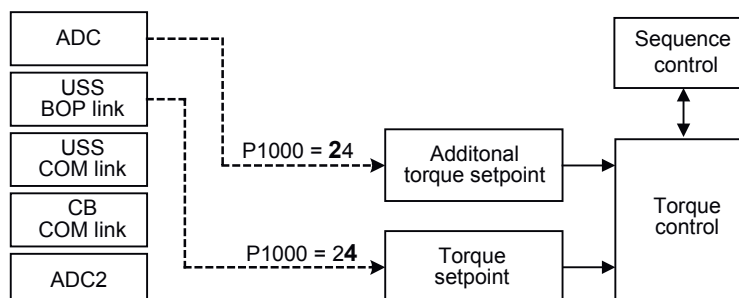





**Caution:**

Be aware, by changing of parameter P1500 all BICO parameters (see table below) are modified.

**Note:**

Changing this parameter sets (to default) all settings on item selected (see table).


		P1500 = xy						
		y = 0	y = 2	y = 4	y = 5	y = 6	y = 7	
P1500 = xy	x = 0	0.0	755.0	2015.1	2018.1	2050.1	755.1	P1503
		0.0	0.0	0.0	0.0	0.0	0.0	P1511
	x = 2	0.0	755.0	2015.1	2018.1	2050.1	755.1	P1503
		755.0	755.0	755.0	755.0	755.0	755.0	P1511
	x = 4	0.0	755.0	2015.1	2018.1	2050.1	755.1	P1503
		2015.1	2015.1	2015.1	2015.1	2015.1	2015.1	P1511
	x = 5	0.0	755.0	2015.1	2018.1		755.1	P1503
		2018.1	2018.1	2018.1	2018.1		2018.1	P1511
	x = 6	0.0	755.0	2015.1		2050.1	755.1	P1503
		2050.1	2050.1	2050.1		2050.1	2050.1	P1511
	x = 7	0.0	755.0	2015.1	2018.1	2050.1	755.1	P1503
		755.1	755.1	755.1	755.1	755.1	755.1	P1511

**Example:**

P1500 = 24 → P1503 = 2015.1  
P1511 = 755.0

<b>P1501[3]</b>	<b>BI: Change to torque control</b>	<b>Min:</b> 0:0	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Def:</b> 0:0
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
			<b>3</b>

Selects command source from which it is possible to change between master (speed control) and slave (torque control).

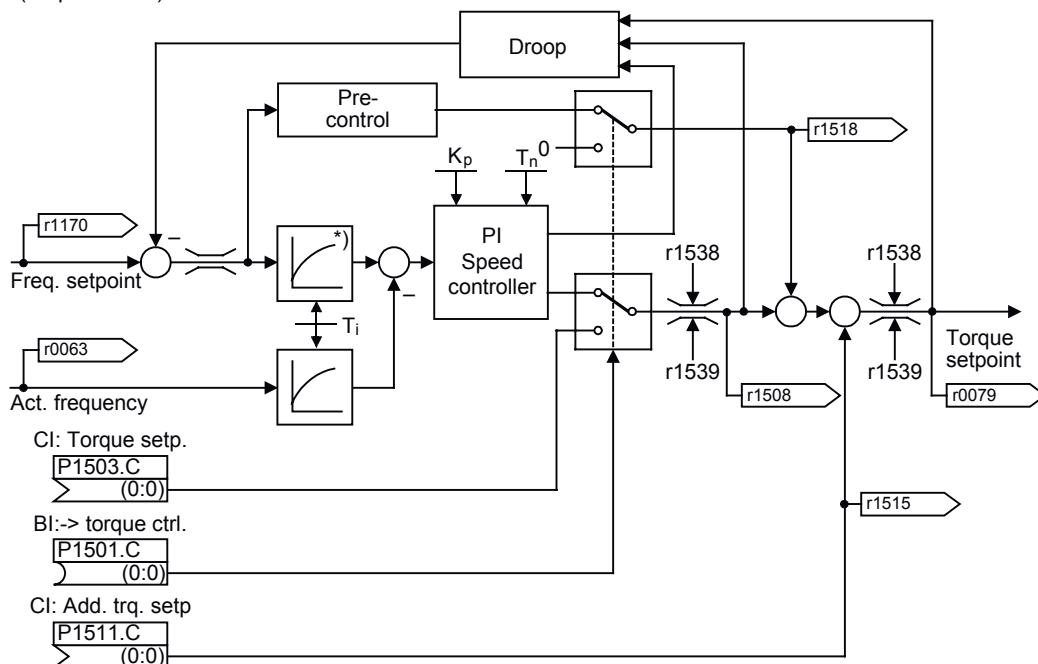

\*) only active, if pre-control is enabled  
(P1496 > 0)

	$T_i$	$K_p$	$T_n$
SLVC:	P1452	P1470	P1472
VC:	P1442	P1460	P1462

**Index:**


- P1501[0] : 1st. Command data set (CDS)
- P1501[1] : 2nd. Command data set (CDS)
- P1501[2] : 3rd. Command data set (CDS)



**Caution:**

If direct selection of torque control is used (P1300=22, 23) the OFF1 command is recognized as OFF2.

However, the OFF1 command is not recognized when torque control is selected indirectly (P1300=20, 21 and P1501=1). If indirect selection of torque control is used, it is recommended to program an OFF2 command using, for example a digital input or create the following circuit using the Free Function Blocks (FFB):

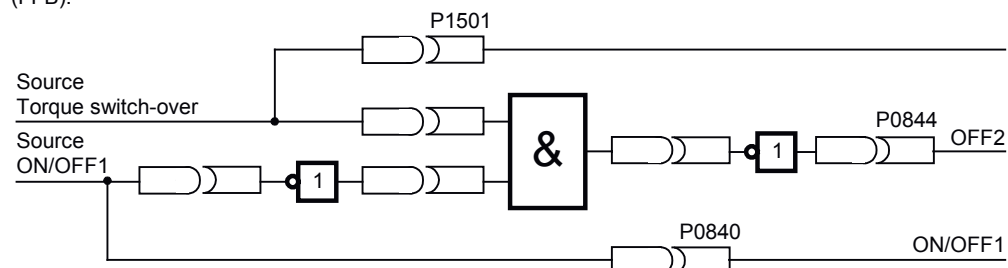

**Details:**

- Speed control with encoder feedback see P1460
- Speed control without encoder feedback see P1470

<b>P1503[3]</b>	<b>CI: Torque setpoint</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> T	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Selects source of torque setpoint for torque control.

**Index:**

P1503[0] : 1st. Command data set (CDS)  
P1503[1] : 2nd. Command data set (CDS)  
P1503[2] : 3rd. Command data set (CDS)

**Details:**

See parameter P1501.

<b>r1508</b>	<b>CO: Torque setpoint</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>	
	<b>Datatype:</b> Float	<b>Unit:</b> Nm		<b>Def:</b> -
	<b>P-Group:</b> CONTROL			<b>Max:</b> -

Displays torque setpoint before limitation.

**Details:**

See parameter P1501.

### 3.29.2.5 Supplementary torque setpoint

<b>P1511[3]</b>	<b>CI: Additional torque setpoint</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> T	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Selects source of additional torque setpoint for torque and speed control.

**Index:**

P1511[0] : 1st. Command data set (CDS)  
P1511[1] : 2nd. Command data set (CDS)  
P1511[2] : 3rd. Command data set (CDS)

**Details:**

See parameter P1501.

<b>r1515</b>	<b>CO: Additional torque setpoint</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>	
	<b>Datatype:</b> Float	<b>Unit:</b> Nm		<b>Def:</b> -
	<b>P-Group:</b> CONTROL			<b>Max:</b> -

Displays additional torque setpoint.

**Details:**

See parameter P1501.

<b>r1518</b>	<b>CO: Acceleration torque</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>	
	<b>Datatype:</b> Float	<b>Unit:</b> Nm		<b>Def:</b> -
	<b>P-Group:</b> CONTROL			<b>Max:</b> -

Displays acceleration torque.

**Details:**

See parameter P1501.

<b>P1520[3]</b>	<b>CO: Upper torque limit</b>	<b>Min:</b> -99999.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Def:</b> 5.13
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Specifies fixed value for upper torque limitation.

$P1520_{def} = 1.5 \cdot r0333$

$P1520_{max} = \pm 4 \cdot r0333$

**Index:**

P1520[0] : 1st. Drive data set (DDS)  
P1520[1] : 2nd. Drive data set (DDS)  
P1520[2] : 3rd. Drive data set (DDS)

### 3.29.2.6 Torque / power limiting

<b>P1521[3]</b>	<b>CO: Lower torque limit</b>	<b>Min:</b> -99999.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Nm
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Enters fixed value of lower torque limitation.

$$P1521_{def} = -1.5 \cdot r0333$$

$$P1521_{max} = \pm 4 \cdot r0333$$

**Index:**

- P1521[0] : 1st. Drive data set (DDS)
- P1521[1] : 2nd. Drive data set (DDS)
- P1521[2] : 3rd. Drive data set (DDS)

<b>P1522[3]</b>	<b>CI: Upper torque limit</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> T	<b>Datatype:</b> U32		<b>Unit:</b> -
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Selects source of upper torque limitation.

**Index:**

- P1522[0] : 1st. Command data set (CDS)
- P1522[1] : 2nd. Command data set (CDS)
- P1522[2] : 3rd. Command data set (CDS)

<b>P1523[3]</b>	<b>CI: Lower torque limit</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> T	<b>Datatype:</b> U32		<b>Unit:</b> -
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Selects source of lower torque limitation.

**Index:**

- P1523[0] : 1st. Command data set (CDS)
- P1523[1] : 2nd. Command data set (CDS)
- P1523[2] : 3rd. Command data set (CDS)

<b>P1525[3]</b>	<b>Scaling lower torque limit</b>	<b>Min:</b> -400.0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> %
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Enters scaling of lower torque limitation in [%].

**Index:**


- P1525[0] : 1st. Drive data set (DDS)
- P1525[1] : 2nd. Drive data set (DDS)
- P1525[2] : 3rd. Drive data set (DDS)

**Note:**

P1525 = 100 % = standard setting

<b>r1526</b>	<b>CO: Upper torque limitation</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>	
		<b>Datatype:</b> Float		<b>Unit:</b> Nm
	<b>P-Group:</b> CONTROL	<b>Def:</b> -		<b>Max:</b> -

Displays actual upper torque limitation.

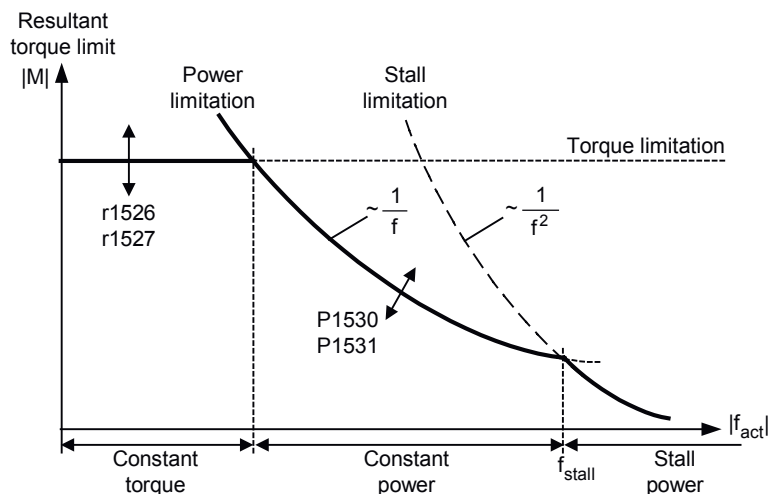

**Dependency:**

The parameters r1526 and r1527 depend on P1520, P1521, P1522, P1523 and P1525.

<b>r1527</b>	<b>CO: Lower torque limitation</b>	<b>Datatype:</b> Float	<b>Unit:</b> Nm	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> CONTROL			<b>Def:</b> - <b>Max:</b> -	

Displays actual lower torque limitation.

**Details:**

See parameter r1526.

<b>P1530[3]</b>	<b>Motoring power limitation</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> 0.00	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 0.12 <b>Max:</b> 8000.00	


Defines fixed value for the max. permissible motoring active power (motoring power limitation).

$$P1530_{def} = 2.5 \cdot P0307$$

$$P1530_{max} = 3 \cdot P0307$$

Parameter P1530 limits the torque in addition to the act. frequency as displayed in the following characteristic.

Power limitation (motoring, regenerative)

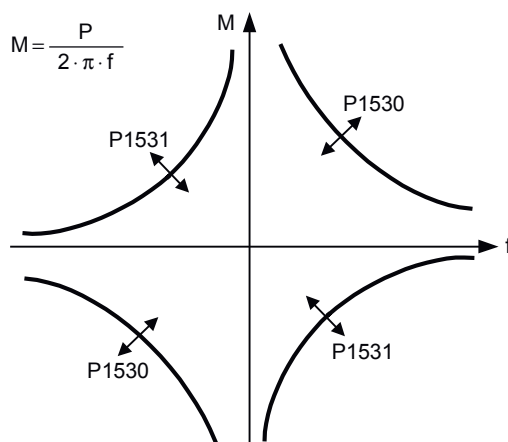

**Index:**

- P1530[0] : 1st. Drive data set (DDS)
- P1530[1] : 2nd. Drive data set (DDS)
- P1530[2] : 3rd. Drive data set (DDS)

<b>P1531[3]</b>	<b>Regenerative power limitation</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> -8000.00	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> -0.12 <b>Max:</b> 0.00	

Enters fixed value for the max. permissible regenerative active power (regenerative power limitation).

$$P1531_{def} = -2.5 \cdot P0307$$

$$P1531_{max} = -3 \cdot P0307$$

**Index:**

- P1531[0] : 1st. Drive data set (DDS)
- P1531[1] : 2nd. Drive data set (DDS)
- P1531[2] : 3rd. Drive data set (DDS)

**Details:**

See parameter P1530.

<b>r1536</b>	<b>CO: Max. trq. motoring current</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> -	<b>Level</b> <b>4</b>
	<b>P-Group:</b> CONTROL			<b>Def:</b> - <b>Max:</b> -	

Displays maximum torque motoring current component.


<b>r1537</b>	<b>CO: Max trq regenerative current</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> -	<b>Level</b> <b>4</b>
	<b>P-Group:</b> CONTROL			<b>Def:</b> - <b>Max:</b> -	

Displays maximum torque of the regenerative current component.

<b>r1538</b>	<b>CO: Upper torque limit (total)</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> Float <b>Unit:</b> Nm <b>Def:</b> - <b>Max:</b> -		
<b>P-Group:</b> CONTROL			

Displays total upper torque limitation.

**Torque limitation :**

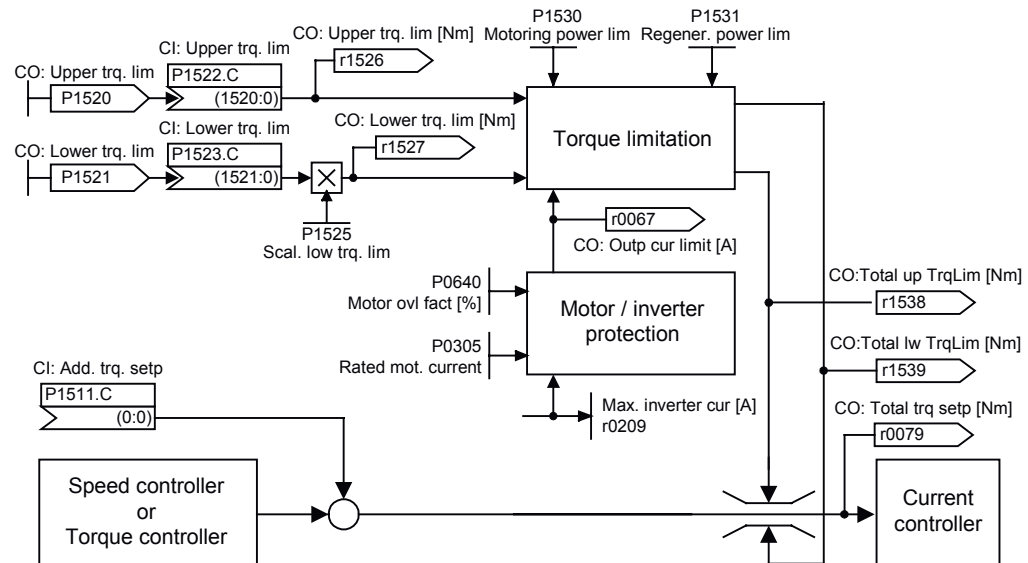

<b>r1539</b>	<b>CO: Lower torque limit (total)</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> Float <b>Unit:</b> Nm <b>Def:</b> - <b>Max:</b> -		
<b>P-Group:</b> CONTROL			

Displays total lower torque limitation.

**Details:**

See parameter r1538.

### 3.29.2.7 Flux control

<b>P1570[3]</b>	<b>CO: Fixed value flux setpoint</b>	<b>Min:</b> 50.0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> 100.0		
	<b>P-Group:</b> CONTROL <b>Active:</b> Immediately <b>QuickComm.:</b> No <b>Max:</b> 200.0		


Parameter to set the flux setpoint as a % relative to the rated motor flux.

**Index:**

- P1570[0] : 1st. Drive data set (DDS)
- P1570[1] : 2nd. Drive data set (DDS)
- P1570[2] : 3rd. Drive data set (DDS)

**Note:**

- In the base speed range, the flux setpoint P1570 is converted into the field-generating current component  $i_{sd}$  (P1570 = 100% corresponds to r0331).
- For values below 100%, the drive is under-magnetized and above this, is over-magnetized.
- If P1570 is set to more than 100%, then the flux setpoint, depending on the load, is increased from 100% (under no-load conditions) to this value (under rated load, refer to the diagram).
- If in so doing, the maximum drive inverter output voltage is reached, the rotor flux is reduced in order to keep the output voltage constant (or the EMF) with increasing speed.
- The maximum possible output voltage r0071 of the drive inverter is determined by the DC link voltage r0026 and the maximum modulation depth P1803 in the gating unit.

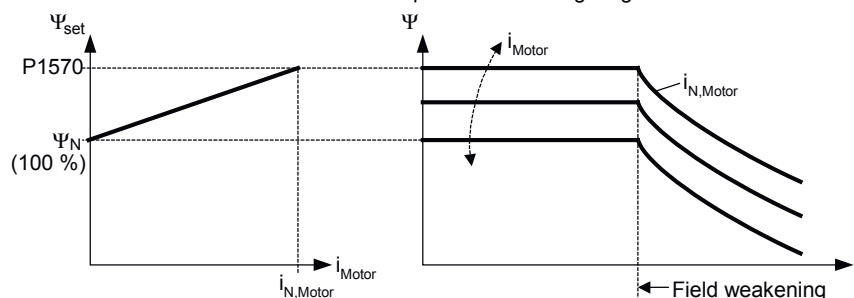

<b>P1574[3]</b>	<b>Dynamic voltage headroom</b>				<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> V	<b>Def:</b> 10		
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 150		

Sets dynamic voltage headroom for vector control.

**Index:**

P1574[0] : 1st. Drive data set (DDS)  
P1574[1] : 2nd. Drive data set (DDS)  
P1574[2] : 3rd. Drive data set (DDS)

<b>P1580[3]</b>	<b>Efficiency optimization</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> %	<b>Def:</b> 0		
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 100		

The efficiency for load-dependent magnetization can be optimized using parameter P1580.

P1580 = 0% :  
No load-dependent magnetization (de-activated)

P1580 > 0% :  
Load-dependent magnetization activated


When the flux is decreased, the motor stator losses in the partial load range are reduced. When the load increases, the setpoint flux increases and therefore the magnetizing current corresponding to the torque-generating current.

**Index:**


P1580[0] : 1st. Drive data set (DDS)  
P1580[1] : 2nd. Drive data set (DDS)  
P1580[2] : 3rd. Drive data set (DDS)

**Note:**

- When using the optimization routine, it is necessary to increase the smoothing time of the flux setpoint (P1582).
- The load-dependent magnetization (P1580 > 0) in the partial load range restricts the dynamic performance of the drive.
- Under no-load conditions, a value of 100 % represents the full flux reduction (i.e. 50 % of the rated motor flux, refer to the diagram).

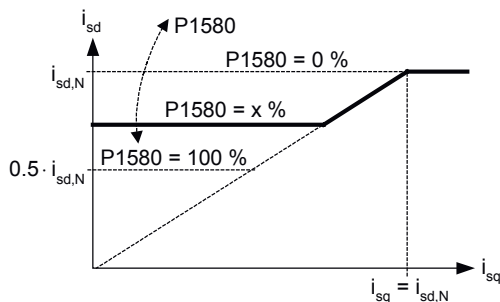

- P1580 can be activated at the same time with P1570. This allows an optimum adaptation both under no-load conditions/in the partial load range using P1580 as well as in the full load range using P1570.

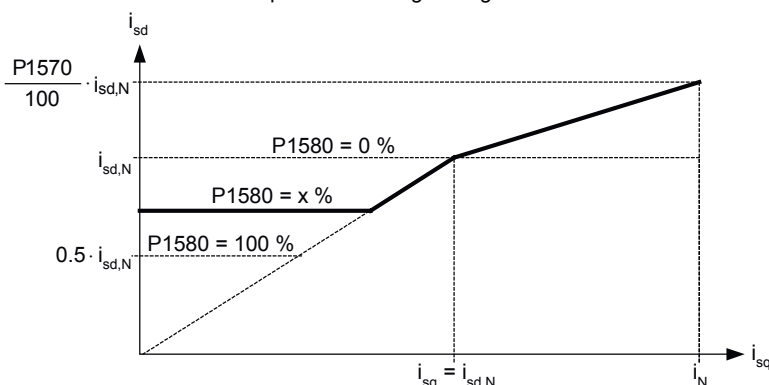

<b>P1582[3]</b>	<b>Smooth time for flux setpoint</b>	<b>Min:</b> 4	<b>Level</b>
	<b>CStat:</b> CUT <b>Datatype:</b> U16 <b>Unit:</b> ms <b>Def:</b> 15		<b>3</b>
	<b>P-Group:</b> CONTROL <b>Active:</b> Immediately <b>QuickComm.:</b> No <b>Max:</b> 500		

Sets time constant of PT1 filter to smooth flux setpoint.

**Index:**

P1582[0] : 1st. Drive data set (DDS)  
P1582[1] : 2nd. Drive data set (DDS)  
P1582[2] : 3rd. Drive data set (DDS)

<b>r1583</b>	<b>CO: Flux setpoint (smoothed)</b>	<b>Min:</b> -	<b>Level</b>
	<b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> -		<b>4</b>
	<b>P-Group:</b> CONTROL <b>Max:</b> -		

Displays smoothed flux setpoint in [%] relative to rated motor flux.

<b>P1596[3]</b>	<b>Int. time field weak. controller</b>	<b>Min:</b> 20	<b>Level</b>
	<b>CStat:</b> CUT <b>Datatype:</b> U16 <b>Unit:</b> ms <b>Def:</b> 50		<b>3</b>
	<b>P-Group:</b> CONTROL <b>Active:</b> Immediately <b>QuickComm.:</b> No <b>Max:</b> 32001		

Sets integral time for field weakening controller.

**Index:**

P1596[0] : 1st. Drive data set (DDS)  
P1596[1] : 2nd. Drive data set (DDS)  
P1596[2] : 3rd. Drive data set (DDS)

<b>r1597</b>	<b>CO: Outp. field weak. controller</b>	<b>Min:</b> -	<b>Level</b>
	<b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> -		<b>4</b>
	<b>P-Group:</b> CONTROL <b>Max:</b> -		

Displays output signal of field weakening controller in [%] relative to rated motor flux.


<b>r1598</b>	<b>CO: Flux setpoint (total)</b>	<b>Min:</b> -	<b>Level</b>
	<b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> -		<b>3</b>
	<b>P-Group:</b> CONTROL <b>Max:</b> -		

Displays total flux setpoint in [%] relative to the rated motor flux.

<b>P1610[3]</b>	<b>Continuous torque boost (SLVC)</b>	<b>Min:</b> 0.0	<b>Level</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> 50.0		<b>2</b>
	<b>P-Group:</b> CONTROL <b>Active:</b> Immediately <b>QuickComm.:</b> No <b>Max:</b> 200.0		

Sets the constant torque boost for the low frequency range when sensorless closed-loop vector control is being used (SLVC). The parameter is entered as a % referred to the rated motor torque (r0333).

For sensorless closed-loop vector control, when the motor model is disabled, an absolute current is impressed. P1610 represents the maximum load that occurs at a constant setpoint.

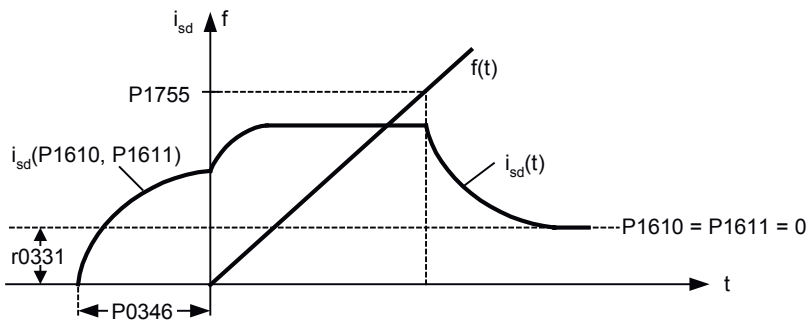

**Index:**

P1610[0] : 1st. Drive data set (DDS)  
P1610[1] : 2nd. Drive data set (DDS)  
P1610[2] : 3rd. Drive data set (DDS)

**Caution:**

P1610 should always be set at least 10% higher than the maximum steady-state load that occurs.

**Note:**

- For P1610 = 0 %, a current setpoint is calculated that corresponds to the no-load case (rated magnetization current).
- For P1610 = 100 %, a current setpoint is calculated that corresponds to the rated motor torque.



<b>P1611[3]</b>	<b>Acc. torque boost (SLVC)</b>				Level <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 0.0	
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.0	

Enters the dynamic torque boost for the low frequency range for sensorless closed-loop vector control (SLVC). The parameter is entered as a % referred to the rated motor torque (r0333).

**Index:**

P1611[0] : 1st. Drive data set (DDS)  
P1611[1] : 2nd. Drive data set (DDS)  
P1611[2] : 3rd. Drive data set (DDS)

**Note:**

- When accelerating and braking, P1611 is added to P1610 and the resulting total torque is converted into an appropriate current setpoint and controlled (closed-loop).
- For pure accelerating torques, it is always more favorable to utilize the torque pre-control of the speed controller (P1496).

### 3.29.2.8 Current controller

<b>P1654[3]</b>	<b>Smooth time for Isq setpoint</b>				Level <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> ms	<b>Def:</b> 6.0	
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 20.0	

Sets time constant of PT1 filter to filter setpoint of torque generating current component in field weakening range.

**Index:**

P1654[0] : 1st. Drive data set (DDS)  
P1654[1] : 2nd. Drive data set (DDS)  
P1654[2] : 3rd. Drive data set (DDS)

<b>P1715[3]</b>	<b>Gain current controller</b>				Level <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Def:</b> 0.25	
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 5.00	

Enters gain of current controller.

**Index:**

P1715[0] : 1st. Drive data set (DDS)  
P1715[1] : 2nd. Drive data set (DDS)  
P1715[2] : 3rd. Drive data set (DDS)

<b>P1717[3]</b>	<b>Integral time current controller</b>				Level <b>4</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> ms	<b>Def:</b> 4.1	
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 50.0	

Enters integral time of current controller.

**Index:**

P1717[0] : 1st. Drive data set (DDS)  
P1717[1] : 2nd. Drive data set (DDS)  
P1717[2] : 3rd. Drive data set (DDS)

<b>r1718</b>	<b>CO: Output of Isq controller</b>				Level <b>4</b>
	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> CONTROL	<b>Max:</b> -			

Displays actual output of Isq current (torque current) controller (PI controller). It contains the proportional and integral part of the PI controller.

<b>r1719</b>	<b>CO: Integral output of Isq ctrl.</b>				Level <b>4</b>
	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> CONTROL	<b>Max:</b> -			

Displays integral output of Isq current (torque current) controller (PI controller).

<b>r1723</b>	<b>CO: Output of Isd controller</b>				Level <b>4</b>
	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> CONTROL	<b>Max:</b> -			

Displays actual output of Isd current (flux current) controller (PI controller). It contains the proportional and integral part of the PI controller.

<b>r1724</b>	<b>CO: Integral output of Isd ctrl.</b>				Level <b>4</b>
	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> CONTROL	<b>Max:</b> -			

Displays integral output of Isd current (flux current) controller (PI controller).

<b>r1725</b>	<b>CO: Integral limit of Isd ctrl.</b>	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	<b>Level</b>
	<b>P-Group:</b> CONTROL						<b>4</b>


Displays limit of integral output voltage setpoint of Isd current controller.

<b>r1728</b>	<b>CO: Decoupling voltage</b>	<b>Datatype:</b> Float	<b>Unit:</b> V	<b>Min:</b> -	<b>Def:</b> -	<b>Max:</b> -	<b>Level</b>
	<b>P-Group:</b> CONTROL						<b>4</b>

Displays actual output voltage setpoint of cross channel decoupling.

<b>P1740</b>	<b>Gain for oscillation damping</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> 0.000	<b>Def:</b> 0.000	<b>Max:</b> 10.000	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> -				<b>3</b>
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No				

Sets the controller gain to dampen oscillations in the sensorless vector control (SLVC) at low frequencies (open-loop).

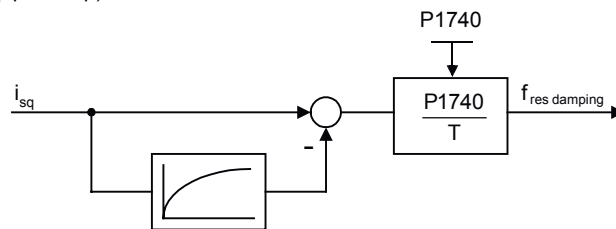


**Dependency:**  
Siehe P1750, P1755, P1756

### 3.29.2.9 Motor model

<b>P1750[3]</b>	<b>Control word of motor model</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	<b>Def:</b> 1	<b>Max:</b> 3	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -				<b>3</b>
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No				

Control word of motor model. This parameter controls the operation of the sensorless vector control (SLVC) at very low frequencies. This therefore includes the following conditions:


- Operation directly after an ON command
- zero crossing.

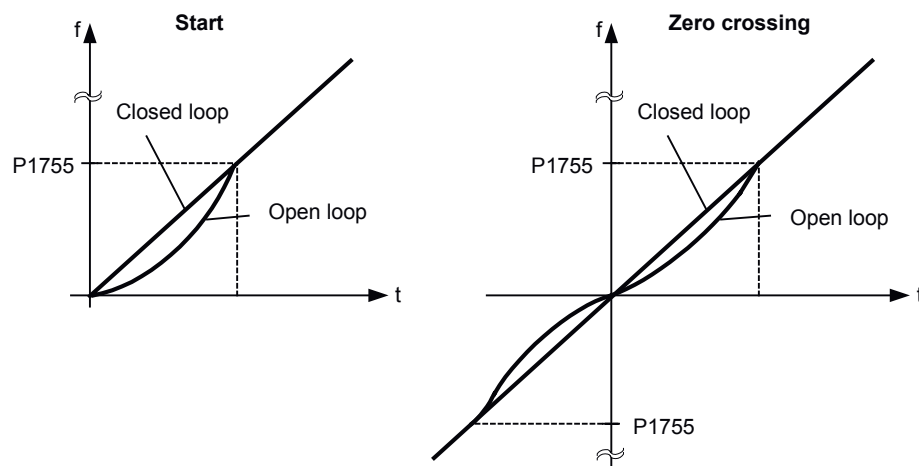



<b>P1755[3]</b>	<b>Start-freq. motor model (SLVC)</b>				<b>Min:</b> 0.1	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> 5.0		
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 250.0		

Enter the start frequency of sensorless vector control (SLVC), thereby SLVC switches over from open-loop to closed-loop at that frequency.

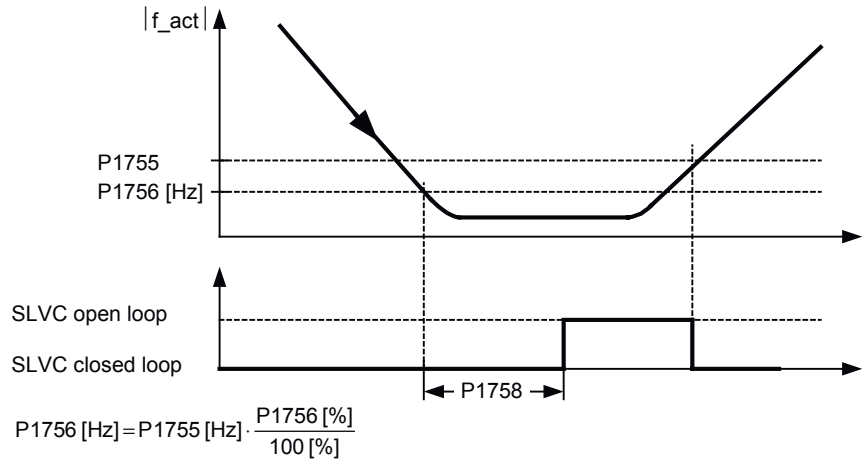

**Index:**

- P1755[0] : 1st. Drive data set (DDS)
- P1755[1] : 2nd. Drive data set (DDS)
- P1755[2] : 3rd. Drive data set (DDS)

<b>P1756[3]</b>	<b>Hyst.-freq. motor model (SLVC)</b>				<b>Min:</b> 10.0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 50.0		
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 100.0		

Enters hysteresis frequency (in percent of start-frequency) to switch back from sensorless-vector-control (SLVC) to current model.

Value is entered in the range 0 % to 50 % relative to P1755 (SLVC stop frequency).

**Index:**

- P1756[0] : 1st. Drive data set (DDS)
- P1756[1] : 2nd. Drive data set (DDS)
- P1756[2] : 3rd. Drive data set (DDS)

<b>P1758[3]</b>	<b>Chng-ov. del. t SLVC op.-lp ctrl</b>				<b>Min:</b> 100	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Def:</b> 1500		
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 2000		

Sets the minimum time when the changeover frequency is fallen below when changing from the closed-loop into the open-loop controlled mode.

**Index:**

- P1758[0] : 1st. Drive data set (DDS)
- P1758[1] : 2nd. Drive data set (DDS)
- P1758[2] : 3rd. Drive data set (DDS)

**Dependency:**

Refer to P1750, P1755, P1756

<b>P1759[3]</b>	<b>Chng-ov. del. t SLVC cl.-lp ctrl</b>				<b>Min:</b> 50	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Def:</b> 100		
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 2000		

Sets the minimum time when the changeover frequency is exceeded when changing from the open-loop controlled into the closed-loop controlled mode.

**Index:**


- P1759[0] : 1st. Drive data set (DDS)
- P1759[1] : 2nd. Drive data set (DDS)
- P1759[2] : 3rd. Drive data set (DDS)

**Dependency:**

Refer to P1750, P1755, P1756

<b>P1764[3]</b>	<b>Kp of n-adaption (SLVC)</b>	<b>Min:</b> 0.0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Def:</b> 0.2
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 2.5	<b>3</b>

Enters gain of speed adaptation controller for sensorless vector control.

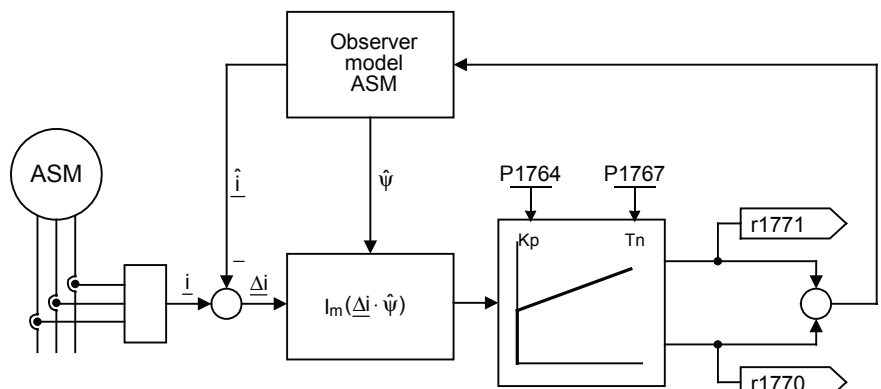

Index:

P1764[0] : 1st. Drive data set (DDS)  
P1764[1] : 2nd. Drive data set (DDS)  
P1764[2] : 3rd. Drive data set (DDS)

<b>P1767[3]</b>	<b>Tn of n-adaption (SLVC)</b>	<b>Min:</b> 1.0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Def:</b> 4.0
	<b>P-Group:</b> CONTROL	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 200.0	<b>4</b>

Enters speed adaptation controller integral time.

Index:

P1767[0] : 1st. Drive data set (DDS)  
P1767[1] : 2nd. Drive data set (DDS)  
P1767[2] : 3rd. Drive data set (DDS)

<b>r1770</b>	<b>CO: Prop. output of n-adaption</b>	<b>Min:</b> -	<b>Level</b>
		<b>Datatype:</b> Float	<b>Def:</b> -
	<b>P-Group:</b> CONTROL	<b>Unit:</b> Hz	<b>Max:</b> -
			<b>3</b>

Displays proportional part of speed adaptation controller.

<b>r1771</b>	<b>CO: Int. output of n-adaption</b>	<b>Min:</b> -	<b>Level</b>
		<b>Datatype:</b> Float	<b>Def:</b> -
	<b>P-Group:</b> CONTROL	<b>Unit:</b> Hz	<b>Max:</b> -
			<b>3</b>

Displays integral part of speed adaptation controller.

<b>r1778</b>	<b>CO: Flux angle difference</b>	<b>Min:</b> -	<b>Level</b>
		<b>Datatype:</b> Float	<b>Def:</b> -
	<b>P-Group:</b> CONTROL	<b>Unit:</b> °	<b>Max:</b> -
			<b>4</b>

Displays flux angle difference between motor model and current transformation before motor model is active.

<b>P1780[3]</b>	<b>Control word of Rs/Rr-adaption</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Def:</b> 3
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
		<b>Max:</b> 3	<b>3</b>

Enables thermal adaptation of stator and rotor resistance to reduce torque errors in speed/torque regulation with speed sensor, or frequency errors in speed/torque regulation without speed sensor.

Bitfields:

Bit00	Enable thermal Rs/Rr-adapt.	0	NO	1	YES
Bit01	Enable observer Rs/Xm-adapt.	0	NO	1	YES

Index:

P1780[0] : 1st. Drive data set (DDS)  
P1780[1] : 2nd. Drive data set (DDS)  
P1780[2] : 3rd. Drive data set (DDS)

Note:

Only stator resistance adaptation is carried out for synchronous motors.

<b>P1781[3]</b>	<b>Tn of Rs-adaption</b>	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Min:</b> 10	Level <b>4</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 100	
	<b>P-Group:</b> CONTROL			<b>Max:</b> 2000	

Enters Rs-adaptation controller integral time.

**Index:**

P1781[0] : 1st. Drive data set (DDS)  
P1781[1] : 2nd. Drive data set (DDS)  
P1781[2] : 3rd. Drive data set (DDS)

<b>r1782</b>	<b>Output of Rs-adaptation</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> CONTROL			<b>Def:</b> -	
				<b>Max:</b> -	

Displays stator resistance adaptation from controller in [%] relative to rated motor resistance.

Stator resistance is obtained as a function of the motor temperature as:

a)  $\vartheta_{act} \approx P0625$ :

$$R_{sact} = R_{sStart} + R_{sadapt} = Z_N \cdot \frac{r0370 - r1782}{100\%} \quad \text{with } R_{sStart} = R_s(P0625)$$

b)  $\vartheta_{act} = r0633$ :

$$R_{sact} = R_s(r0633) + R_{sadapt} = Z_N \cdot \frac{r0395 - r1782}{100\%}$$

**Note:**

Rated motor impedance:

$$Z_N = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100\%$$

<b>P1786[3]</b>	<b>Tn of Xm-adaption</b>	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Min:</b> 10	Level <b>4</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 100	
	<b>P-Group:</b> CONTROL			<b>Max:</b> 2000	

Enters Xm-adaptation controller integral time.

**Index:**

P1786[0] : 1st. Drive data set (DDS)  
P1786[1] : 2nd. Drive data set (DDS)  
P1786[2] : 3rd. Drive data set (DDS)

<b>r1787</b>	<b>Output of Xm-adaption</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> CONTROL			<b>Def:</b> -	
				<b>Max:</b> -	

Displays main reactance adaptation from controller in [%] relative to rated impedance.

For  $f \leq f_N$  is valid

$$X_{m\Gamma act} = X_{m\Gamma Start} + X_{m\Gamma adapt} = Z_N \cdot \frac{r0382 - r1787}{100\%}$$

**Note:**

Rated motor impedance:

$$Z_N = \frac{V_N}{\sqrt{3} \cdot I_N} = \frac{P0304}{\sqrt{3} \cdot P0305} \Leftrightarrow 100\%$$

### 3.30 Inverter parameters (Modulator)

<b>P1800</b>	<b>Pulse frequency</b>	<b>Min:</b> 2	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> kHz
	<b>P-Group:</b> INVERTER	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 4		
		<b>Max:</b> 16		

Sets pulse frequency of power switches in inverter. The frequency can be changed in steps of 2 kHz.

**Dependency:**

- Minimum pulse frequency depends on P1082 (maximum frequency) and P0310 (rated motor frequency).
- see derating in P1082
  - $P1800 > 30 * P0310$

**Note:**

- If the pulse frequency is increased, max. inverter current r0209 can be reduced (derating). The derating characteristic depends on the type and power of the inverter (see manual OPERATING INSTRUCTION).
- If silent operation is not absolutely necessary, lower pulse frequencies may be selected to reduce inverter losses and radio-frequency emissions.
- Under certain circumstances, the inverter may reduce the switching frequency to provide protection against over-temperature (see P0290).

<b>r1801</b>	<b>CO: Act. pulse frequency</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>	
		<b>Datatype:</b> U16		<b>Unit:</b> kHz
	<b>P-Group:</b> INVERTER	<b>Active:</b> -		<b>QuickComm.:</b> -
		<b>Def:</b> -		
		<b>Max:</b> -		

Actual pulse frequency of power switches in inverter.

**Notice:**

Under certain conditions (inverter overtemperature, see P0290), this can differ from the values selected in P1800 (pulse frequency).

<b>P1802</b>	<b>Modulator mode</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> INVERTER	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 0		
		<b>Max:</b> 2		

Selects inverter modulator mode.

**Possible Settings:**

- 0 SVM/ASVM automatic mode
- 1 Asymmetric SVM
- 2 Space vector modulation

**Notice:**

- Asymmetric space vector modulation (ASVM) produces lower switching losses than space vector modulation (SVM), but may cause irregular rotation at very low frequencies.
- Space vector modulation (SVM) with over-modulation may produce current waveform distortion at high output voltages.
- Space vector modulation (SVM) without over-modulation will reduce maximum output voltage available to motor.

<b>P1803[3]</b>	<b>Max. modulation</b>	<b>Min:</b> 20.0	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> %
	<b>P-Group:</b> INVERTER	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 106.0		
		<b>Max:</b> 150.0		

Sets maximum modulation index.

**Index:**

- P1803[0] : 1st. Drive data set (DDS)
- P1803[1] : 2nd. Drive data set (DDS)
- P1803[2] : 3rd. Drive data set (DDS)

**Note:**

- $P1803 = 100\%$  : Limit for over-control (for ideal inverter without switching delay).
- For vector control the modulation limit will be reduced automatically with 4 %.

<b>P1820[3]</b>	<b>Reverse output phase sequence</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> INVERTER	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 0		
		<b>Max:</b> 1		

Changes direction of motor rotation without changing setpoint polarity.

**Possible Settings:**

- 0 OFF
- 1 ON

**Index:**

- P1820[0] : 1st. Drive data set (DDS)
- P1820[1] : 2nd. Drive data set (DDS)
- P1820[2] : 3rd. Drive data set (DDS)

**Dependency:**

If positive and negative revolution is enabled, frequency setpoint is directly used.  
If both positive and negative revolution are disabled, reference value is set to zero.

**Details:**

See P1000 (select frequency setpoint)

<b>P1825</b>	<b>On-state voltage of IGBT</b>	<b>Min:</b> 0.0	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> V
	<b>P-Group:</b> INVERTER	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 1.4		
		<b>Max:</b> 20.0		

Corrects on-state voltage of the IGBTs.

<b>P1828</b>	<b>Gating unit dead time</b>	<b>Min:</b> 0.00	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> us
	<b>P-Group:</b> INVERTER	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 0.50		
		<b>Max:</b> 3.50		

Sets compensation time of gating unit interlock.

### 3.31 Motor data identification

<b>P1909[3]</b>	<b>Ctrl. word of motor data ident.</b>	<b>Min:</b> 0	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 1		
		<b>Max:</b> 1		

Control word of motor data identification.

**Bitfields:**

Bit00 Estimation of Xs 0 NO 1 YES

**Index:**

P1909[0] : 1st. Drive data set (DDS)  
P1909[1] : 2nd. Drive data set (DDS)  
P1909[2] : 3rd. Drive data set (DDS)

<b>P1910</b>	<b>Select motor data identification</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm		<b>QuickComm.:</b> Yes
		<b>Def:</b> 0		
		<b>Max:</b> 20		

Performs a motor data identification.

**Possible Settings:**

- 0 Disabled
- 1 Identification of all parameters with parameter change
- 2 Identification of all parameters without parameter change
- 3 Identification of saturation curve with parameter change
- 4 Identification of saturation curve without parameter change
- 5 Identification of XsigDyn (r1920) without parameter change
- 6 Identification of Tdead (r1926) without parameter change
- 7 Identification of Rs (r1912 ) without parameter change
- 8 Identification of Xs (r1915) without parameter change
- 9 Identification of Tr (r1913) without parameter change
- 10 Identification of Xsigma (r1914) without parameter change
- 20 Set voltage vector

**Common Settings:**

- P1910 = 1:  
All motor data and inverter characteristic will be identified and parameter will be changed.
- P0350 stator resistance,
  - P0354 rotor resistance,
  - P0356 stator leakage inductance,
  - P0358 rotor leakage inductance,
  - P0360 main inductance
  - P1825 on-state voltage of IGBTs
  - P1828 compensation time of gating unit interlock

- P1910 = 3:  
Saturation curve will be identified and parameter will be changed.
- P0362 ... P0365 magnetizing curve flux 1 .. 4
  - P0366 ... P0369 magnetizing curve imag 1 .. 4





**Caution:**

Motor identification should normally be performed on a cold motor. However, the identification of the motor data should only be performed if the motor temperature is within 5°C of the measured ambient temperature stored in P0625. If the motor identification is not within the 5°C limit then the correct functioning of Vector Control (VC, SLVC) cannot be guaranteed.

The motor rating plate information with respect to the connection of the motor windings (Star or delta connection) must be correct in order to establish the correct equivalent circuit data. The motor identification calculates this data based on a Phase of a Star equivalent circuit P0350 - P0360, irrespective of whether the motor is connected star or delta. This must be considered when the motor data is input directly.

**Note:**

Before selecting motor data identification, "Quick commissioning" has to be performed in advance.

Once enabled (P1910 = 1), A0541 generates a warning that the next ON command will initiate measurement of motor parameters.

**Notice:**

When choosing the setting for measurement, observe the following:

1. "with parameter change"  
means that the values are actually adopted as Pxxxx parameter settings (see common settings above) and applied to the controller as well as being shown in the read-only parameters below.
2. "without parameter change"  
means that the values are only displayed, i.e. shown for checking purposes in the read-only parameters r1912 (identified stator resistance), r1913 (identified rotor time constant), r1914 (ident. total leakage reactance), r1915/r1916/r1917/r1918/r1919 (identified nominal stator reactance/identified stator reactance 1 to 4), r1925 (IGBT on-state voltage) and r1926 (identified gating unit dead time). The values are not applied to the controller.

<b>P1911</b>	<b>No. of phase to be identified</b>	<b>Min:</b> 1	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT <b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> 3	
	<b>P-Group:</b> INVERTER <b>Active:</b> Immediately <b>QuickComm.:</b> No	<b>Max:</b> 3	

Selects maximum number of motor phases to be identified.

<b>r1912[3]</b>	<b>Identified stator resistance</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> Float <b>Unit:</b> Ohm	<b>Def:</b> -	
	<b>P-Group:</b> MOTOR	<b>Max:</b> -	

Displays measured stator resistance value (line-to-line) in [Ohms]

**Index:**

r1912[0] : U\_phase  
r1912[1] : V\_phase  
r1912[2] : W\_phase

**Note:**

This value is measured using P1910 = 1 or 2, i.e., identification of all parameters with/without change.

<b>r1913[3]</b>	<b>Identified rotor time constant</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> Float <b>Unit:</b> ms	<b>Def:</b> -	
	<b>P-Group:</b> MOTOR	<b>Max:</b> -	

Displays identified rotor time constant.

**Index:**

r1913[0] : U\_phase  
r1913[1] : V\_phase  
r1913[2] : W\_phase

<b>r1914[3]</b>	<b>Ident. total leakage inductance</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> Float <b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> MOTOR	<b>Max:</b> -	

Displays identified total leakage inductance.

**Index:**

r1914[0] : U\_phase  
r1914[1] : V\_phase  
r1914[2] : W\_phase

<b>r1915[3]</b>	<b>Ident. nom. stator inductance</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> Float <b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> MOTOR	<b>Max:</b> -	

Displays identified stator inductance.

**Index:**

r1915[0] : U\_phase  
r1915[1] : V\_phase  
r1915[2] : W\_phase

**Notice:**

If the value identified (Ls = stator inductance) does not lie within the range 50 % < Xs [p. u.] < 500 % fault message 41 (motor data identification failure) is issued.

r0949 provides further information (fault value = 4 in this case).

<b>r1916[3]</b>	<b>Identified stator inductance 1</b>	Datatype: Float	Unit: -	Min: - Def: - Max: -	Level <b>2</b>
	<b>P-Group:</b> MOTOR				
	Displays identified stator inductance.				
<b>Index:</b>	r1916[0] : U_phase r1916[1] : V_phase r1916[2] : W_phase				
<b>Details:</b>	See P1915 (identified nominal stator inductance).				
<b>r1917[3]</b>	<b>Identified stator inductance 2</b>	Datatype: Float	Unit: -	Min: - Def: - Max: -	Level <b>2</b>
	<b>P-Group:</b> MOTOR				
	Displays identified stator inductance.				
<b>Index:</b>	r1917[0] : U_phase r1917[1] : V_phase r1917[2] : W_phase				
<b>Details:</b>	See P1915 (identified nominal stator inductance)				
<b>r1918[3]</b>	<b>Identified stator inductance 3</b>	Datatype: Float	Unit: -	Min: - Def: - Max: -	Level <b>2</b>
	<b>P-Group:</b> MOTOR				
	Displays identified stator inductance.				
<b>Index:</b>	r1918[0] : U_phase r1918[1] : V_phase r1918[2] : W_phase				
<b>Details:</b>	See P1915 (identified nominal stator reactance)				
<b>r1919[3]</b>	<b>Identified stator inductance 4</b>	Datatype: Float	Unit: -	Min: - Def: - Max: -	Level <b>2</b>
	<b>P-Group:</b> MOTOR				
	Displays identified stator inductance.				
<b>Index:</b>	r1919[0] : U_phase r1919[1] : V_phase r1919[2] : W_phase				
<b>Details:</b>	See P1915 (identified nominal stator inductance)				
<b>r1920[3]</b>	<b>Identified dyn. leak. inductance</b>	Datatype: Float	Unit: -	Min: - Def: - Max: -	Level <b>2</b>
	<b>P-Group:</b> MOTOR				
	Displays identified total dynamic leakage inductance.				
<b>Index:</b>	r1920[0] : U_phase r1920[1] : V_phase r1920[2] : W_phase				
<b>r1925</b>	<b>Identified on-state voltage</b>	Datatype: Float	Unit: V	Min: - Def: - Max: -	Level <b>2</b>
	<b>P-Group:</b> INVERTER				
	Displays identified on-state voltage of IGBT.				
<b>r1926</b>	<b>Ident. gating unit dead time</b>	Datatype: Float	Unit: us	Min: - Def: - Max: -	Level <b>2</b>
	<b>P-Group:</b> INVERTER				
	Displays identified dead time of gating unit interlock.				
<b>P1930</b>	<b>Voltage setpoint for calibration</b>	Datatype: Float	Unit: V	Min: 0 Def: 0 Max: 1000	Level <b>4</b>
	<b>CStat:</b> CUT				
	<b>P-Group:</b> INVERTER	<b>Active:</b> Immediately	<b>QuickComm.:</b> No		
	Specifies reference voltage for generation of a test voltage vector (e.g. used for shunt calibration).				
<b>P1931</b>	<b>Phase</b>	Datatype: U16	Unit: -	Min: 1 Def: 1 Max: 6	Level <b>4</b>
	<b>CStat:</b> CUT				
	<b>P-Group:</b> INVERTER	<b>Active:</b> Immediately	<b>QuickComm.:</b> No		
	Defines phase of voltage vector				

### 3.32 Speed optimization

<b>P1960</b>	<b>Speed control optimisation</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> MOTOR	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

The drive should be set into a vector mode (P1300 = 20 or 21) to carry out speed controller optimisation. When speed controller optimisation is enabled (P1960 = 1) the warning A0542 will become active.

When the drive is next started it will do the optimisation tests. The drive will accelerate the motor to 20 % of P0310 (rated motor frequency) using the ramp up time P1120 and then under torque control go to 50 % of P0310 (rated motor frequency). The drive will then ramp back down to 20 % using the ramp down time P1121. This procedure is repeated several times and then average time taken. From this an estimation of the inertia of the load on the motor can be derived. From this the inertia ratio parameter (P0342) and the Kp gains for VC (P1460) and SLVC (P1470) are modified to give a response suitable for the measured inertia.

**Possible Settings:**

- 0 Disable
- 1 Enable

**Note:**

When the test is complete P1960 will be cleared to zero.

**Notice:**

If there is a problem due to instability the drive may trip with an F0042 fault if a stable value has not been obtained on the ramp up within a reasonable time.

It should be noted that the Dc link controller should be enabled whilst doing the test as otherwise overvoltage trips maybe experienced. This will however depend on the ramp down time and the system inertia.

The speed loop optimisation may not be suitable for some applications due to the nature of the test i.e. accelerating under torque control from 20 % to 50 %.

### 3.33 Reference parameters

<b>P2000[3]</b>	<b>Reference frequency</b>	<b>Min:</b> 1.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> COMM	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Parameter P2000 represents the reference frequency for frequency values which are displayed/transferred as a percentage or a hexadecimal value. Where:


- hexadecimal 4000 H ==> P2000 (e.g.: USS-PZD)
- percentage 100 % ==> P2000 (e.g.: ADC)

**Index:**

- P2000[0] : 1st. Drive data set (DDS)
- P2000[1] : 2nd. Drive data set (DDS)
- P2000[2] : 3rd. Drive data set (DDS)

**Example:**


If a BICO connection is made between two parameters or alternatively using P0719 or P1000, the 'unit' of the parameters (standardized (Hex) or physical (i.e. Hz) values) may differ. MICROMASTER implicitly makes an automatic conversion to the target value.

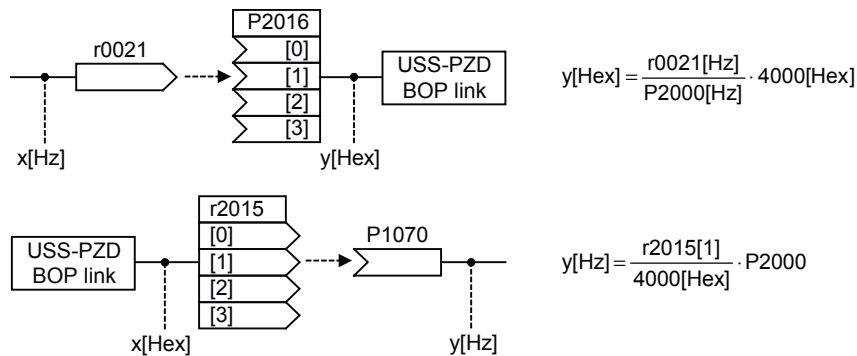



**Caution:**

Parameter P2000 represents the reference frequency of the above mentioned interfaces. A maximum frequency setpoint of 2\*P2000 can be applied via the corresponding interface. Unlike parameter P1082 (Max. Frequency) this limits the inverter frequency internally independent of the reference frequency. By modification of P2000 it will also adapt the parameter to the new settings.

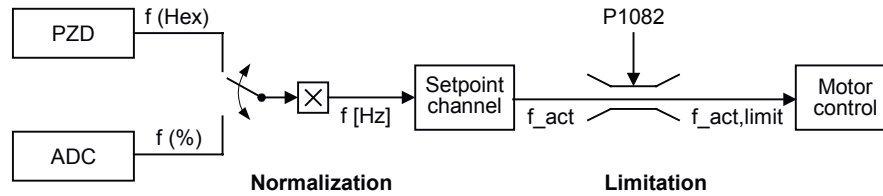

$$f[\text{Hz}] = \frac{f(\text{Hex})}{4000(\text{Hex})} \cdot P2000 = \frac{f(\%)}{100\%} \cdot P2000$$

$$f_{\text{act,limit}} = \min(P1082, f_{\text{act}})$$

**Notice:**

Reference variables are intended as an aid to presenting setpoint and actual value signals in a uniform manner. This also applies to fixed settings entered as a percentage. A value of 100 % (USS / CB) corresponds to a process data value of 4000H, or 4000 0000H in the case of double values.

In this respect, the following parameters are available:

P2000	Reference frequency	Hz
P2001	Reference voltage	V
P2002	Reference current	A
P2003	Reference torque	Nm
P2004	Reference power	kW hp

— f(P0100)

<b>P2001[3]</b>	<b>Reference voltage</b>	<b>Min:</b> 10	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U16		<b>Unit:</b> V
	<b>P-Group:</b> COMM	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 1000		
		<b>Max:</b> 2000		

Full-scale output voltage (i.e. 100 %) used over serial link (corresponds to 4000H).


**Index:**

- P2001[0] : 1st. Drive data set (DDS)
- P2001[1] : 2nd. Drive data set (DDS)
- P2001[2] : 3rd. Drive data set (DDS)

**Example:**

P2001 = 230 specifies that 4000H received via USS denotes 230 V.

If a BICO connection is made between two parameters, the 'unit' of the parameters (standardized (Hex) or physical (i.e. V) values) may differ. MICROMASTER implicitly makes an automatic conversion to the target value.

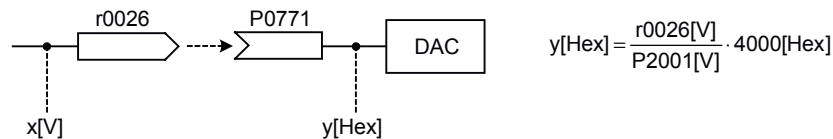

<b>P2002[3]</b>	<b>Reference current</b>	<b>Datatype:</b> Float	<b>Unit:</b> A	<b>Min:</b> 0.10	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0.10	
	<b>P-Group:</b> COMM			<b>Max:</b> 10000.00	


Full-scale output current used over serial link (corresponds to 4000H).

**Index:**

- P2002[0] : 1st. Drive data set (DDS)
- P2002[1] : 2nd. Drive data set (DDS)
- P2002[2] : 3rd. Drive data set (DDS)

**Example:**

If a BICO connection is made between two parameters, the 'unit' of the parameters (standardized (Hex) or physical (i.e. A) values) may differ. MICROMASTER implicitly makes an automatic conversion to the target value.

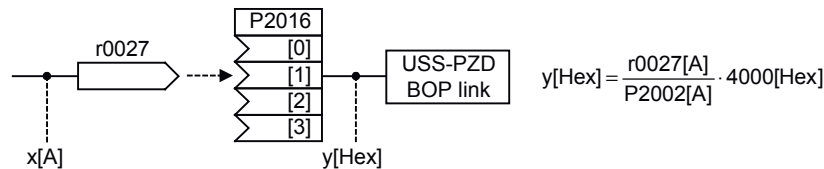

<b>P2003[3]</b>	<b>Reference torque</b>	<b>Datatype:</b> Float	<b>Unit:</b> Nm	<b>Min:</b> 0.10	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0.12	
	<b>P-Group:</b> COMM			<b>Max:</b> 99999.00	


Full-scale reference torque used over the serial link (corresponds to 4000H).

**Index:**

- P2003[0] : 1st. Drive data set (DDS)
- P2003[1] : 2nd. Drive data set (DDS)
- P2003[2] : 3rd. Drive data set (DDS)

**Example:**

If a BICO connection is made between two parameters or alternatively using P1500, the 'unit' of the parameters (standardized (Hex) or physical (i.e. Nm) values) may differ. MICROMASTER implicitly makes an automatic conversion to the target value.

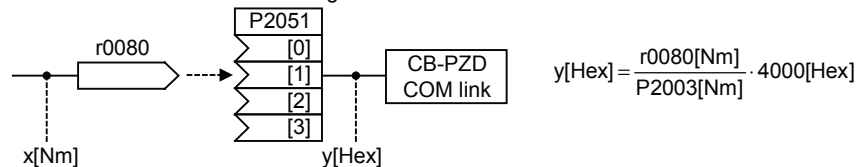

<b>r2004[3]</b>	<b>Reference power</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMM			<b>Def:</b> -	
				<b>Max:</b> -	

Full-scale reference power used over the serial link (corresponds to 4000H).


$$r2004 = \frac{1}{2} \cdot 2 \cdot \pi \cdot f \cdot M = \pi \cdot P2000 \cdot P2003$$

**Index:**

- r2004[0] : 1st. Drive data set (DDS)
- r2004[1] : 2nd. Drive data set (DDS)
- r2004[2] : 3rd. Drive data set (DDS)

**Example:**

If a BICO connection is made between two parameters, the 'unit' of the parameters (standardized (Hex) or physical (i.e. kW / hp) values) may differ. MICROMASTER implicitly makes an automatic conversion to the target value.

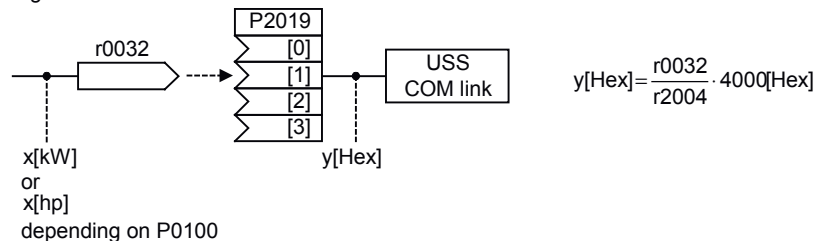

### 3.34 Communication parameters (USS, CB)

<b>P2009[2]</b>	<b>USS denormalization</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> COMM	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Enables denormalization for USS.

**Possible Settings:**

- 0 Disabled
- 1 Enabled

**Index:**

- P2009[0] : Serial interface COM link
- P2009[1] : Serial interface BOP link

**Note:**

If denormalization is enabled, the main setpoint (word 2 in PZD) is not interpreted as 100 % = 4000H, but as "absolute" instead (e.g. 4000H = 16384 means 163.84 Hz ) if this is a frequency. Denormalization (P2009 = 1) only works for frequencies and is intended for backwards compatibility with MM3.

<b>P2010[2]</b>	<b>USS baudrate</b>	<b>Min:</b> 4	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> COMM	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Sets baud rate for USS communication.

**Possible Settings:**

- 4 2400 baud
- 5 4800 baud
- 6 9600 baud
- 7 19200 baud
- 8 38400 baud
- 9 57600 baud
- 10 76800 baud
- 11 93750 baud
- 12 115200 baud

**Index:**

- P2010[0] : Serial interface COM link
- P2010[1] : Serial interface BOP link

<b>P2011[2]</b>	<b>USS address</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> COMM	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Sets unique address for inverter.

**Index:**

- P2011[0] : Serial interface COM link
- P2011[1] : Serial interface BOP link

**Note:**

You can connect up to a further 30 inverters via the serial link (i.e. 31 inverters in total) and control them with the USS serial bus protocol.

<b>P2012[2]</b>	<b>USS PZD length</b>			<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 2	
	<b>P-Group:</b> COMM	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 8	


Defines the number of 16-bit words in PZD part of USS telegram.

**Index:**

P2012[0] : Serial interface COM link  
P2012[1] : Serial interface BOP link

**Notice:**

USS protocol consists of PZD and PKW which can be changed by the user via parameters P2012 and P2013 respectively.

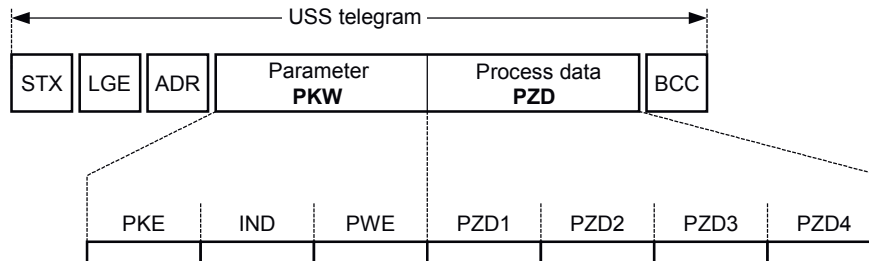


STX	Start of text	PKE	Parameter ID
LGE	Length	IND	Sub-index
ADR	Address	PWE	Parameter value
PKW	Parameter ID value		
PZD	Process data		
BCC	Block check character		

PZD transmits a control word and setpoint or status word and actual values. The number of PZD-words in a USS-telegram are determined by parameter P2012, where the first two words (P2012 >= 2) are either:

- control word and main setpoint or
- status word and actual value.

**Restrictions:**

- If the serial interface controls the inverter (P0700 or P0719) then the 1st control word must be transferred in the 1st PZD-word.
- If the setpoint source is selected via P1000 or P0719, then the main setpoint must be transferred in the 2nd PZD-word,
- When P2012 is greater than or equal to 4 the additional control word (2nd control word) must be transferred in the 4th PZD-word, if the serial interface controls the inverter (P0700 or P0719).

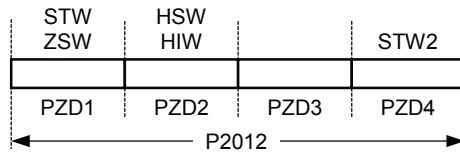

STW	Control word	HSW	Main setpoint
ZSW	Status word	HIW	Main actual value
PZD	Process data		

<b>P2013[2]</b>	<b>USS PKW length</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> COMM	<b>Active:</b> first confirm		<b>QuickComm.:</b> No
		<b>Def:</b> 127		
		<b>Max:</b> 127		

Defines the number of 16-bit words in PKW part of USS telegram. The PKW area can be varied. Depending on the particular requirement, 3-word, 4-word or variable word lengths can be parameterized. The PKW part of the USS telegram is used to read and write individual parameter values.

**Possible Settings:**

- 0 No words
- 3 3 words
- 4 4 words
- 127 Variable

**Index:**

- P2013[0] : Serial interface COM link
- P2013[1] : Serial interface BOP link


**Example:**

	Data type		
	U16 (16 Bit)	U32 (32 Bit)	Float (32 Bit)
P2013 = 3	X	Parameter access fault	Parameter access fault
P2013 = 4	X	X	X
P2013 = 127	X	X	X

**Notice:**

USS protocol consists of PZD and PKW which can be changed by the user via parameters P2012 and P2013 respectively. Parameter P2013 determines the number of PKW-words in a USS-telegram.

The setting P2013 = 3 or 4 defines the PKW length (3 = three words, 4 = four words). For P2013 = 127, the PKW length is automatically adapted to the particular parameter length.

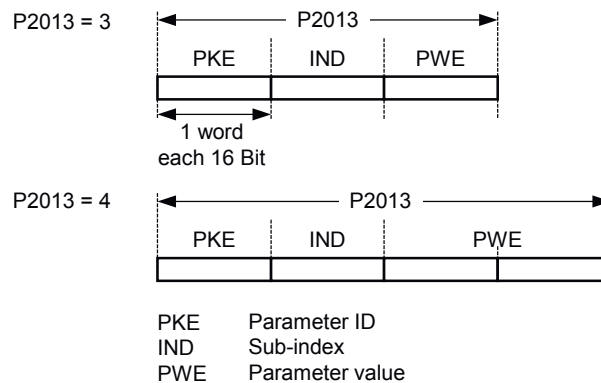

If a fixed PKW length is selected only one parameter value can be transferred. In the case of indexed parameter, you must use the variable PKW length if you wish to have the values of all indices transferred in a single telegram. In selecting the fixed PKW length, it is important to ensure the value in question can be transferred using this PKW length.

P2013 = 3, fixes PKW length, but does not allow access to many parameter values. A parameter fault is generated when an out-of-range value is used, the value will not be accepted but the inverter state will not be affected. Useful for applications where parameters are not changed, but MM3s are also used. Broadcast mode is not possible with this setting.

P2013 = 4, fixes PKW length. Allows access to all parameters, but indexed parameters can only be read one index at a time. Word order for single word values are different to setting 3 or 127, see example below.

P2013 = 127, most useful setting. PKW reply length varies depending on the amount of information needed. Can read fault information and all indices of a parameter with a single telegram with this setting.

**Example:**

Set P0700 to value 5 (0700 = 2BC (hex))

	P2013 = 3	P2013 = 4	P2013 = 127
Master → MM4	22BC 0000 0005	22BC 0000 0000 0005	22BC 0000 0005 0000
MM4 → Master	12BC 0000 0005	12BC 0000 0000 0005	12BC 0000 0005



<b>P2014[2]</b>	<b>USS telegram off time</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> ms
	<b>P-Group:</b> COMM	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 0	<b>3</b>
		<b>Max:</b> 65535	

Defines the telegram failure time for the serial interfaces with USS protocol.

The telegram failure time defines the time within which a valid telegram must have been received. If a valid telegram is not received within the specified time, the drive inverter outputs fault F0070.

**Index:**


P2014[0] : Serial interface COM link  
P2014[1] : Serial interface BOP link

**Notice:**

By default (time set to 0), no fault is generated (i.e. watchdog disabled).

<b>r2015[8]</b>	<b>CO: PZD from BOP link (USS)</b>	<b>Min:</b> -	<b>Level</b>
		<b>Datatype:</b> U16	<b>Unit:</b> -
	<b>P-Group:</b> COMM	<b>Def:</b> -	<b>3</b>
		<b>Max:</b> -	

Displays process data received via USS on BOP link (RS232 USS).

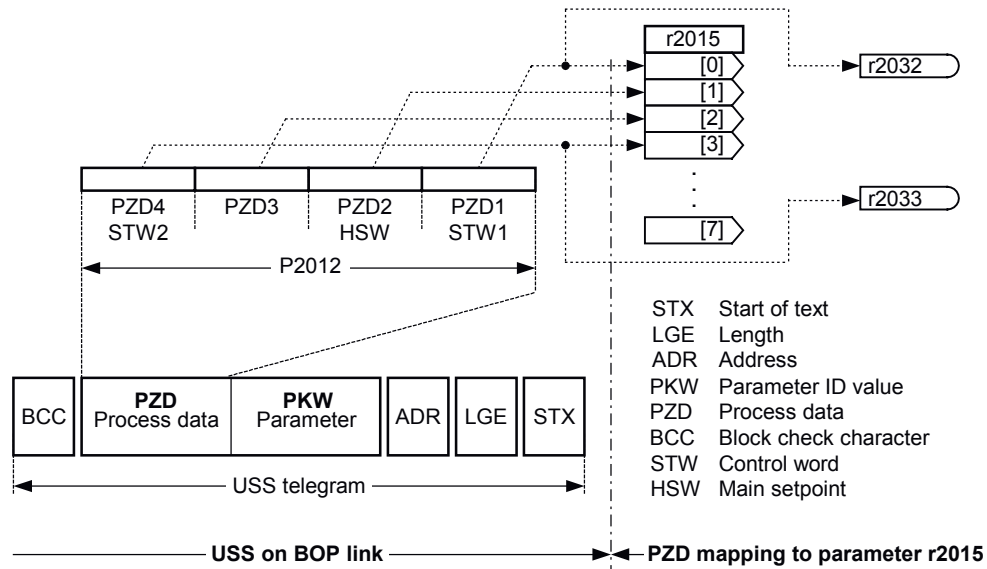

**Index:**

r2015[0] : Received word 0  
r2015[1] : Received word 1  
r2015[2] : Received word 2  
r2015[3] : Received word 3  
r2015[4] : Received word 4  
r2015[5] : Received word 5  
r2015[6] : Received word 6  
r2015[7] : Received word 7

**Note:**


The control words can be viewed as bit parameters r2032 and r2033.

**Restrictions:**

- If the above serial interface controls the inverter (P0700 or P0719) then the 1st control word must be transferred in the 1st PZD-word.
- If the setpoint source is selected via P1000 or P0719, then the main setpoint must be transferred in the 2nd PZD-word,
- When P2012 is greater than or equal to 4 the additional control word (2nd control word) must be transferred in the 4th PZD-word, if the above serial interface controls the inverter (P0700 or P0719).

<b>P2016[8]</b>	<b>CI: PZD to BOP link (USS)</b>	<b>Min:</b> 0:0	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Def:</b> 52:0
	<b>P-Group:</b> COMM	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 4000:0	<b>3</b>

Selects signals (process data, PZD), that are transferred via the BOP interface using USS.

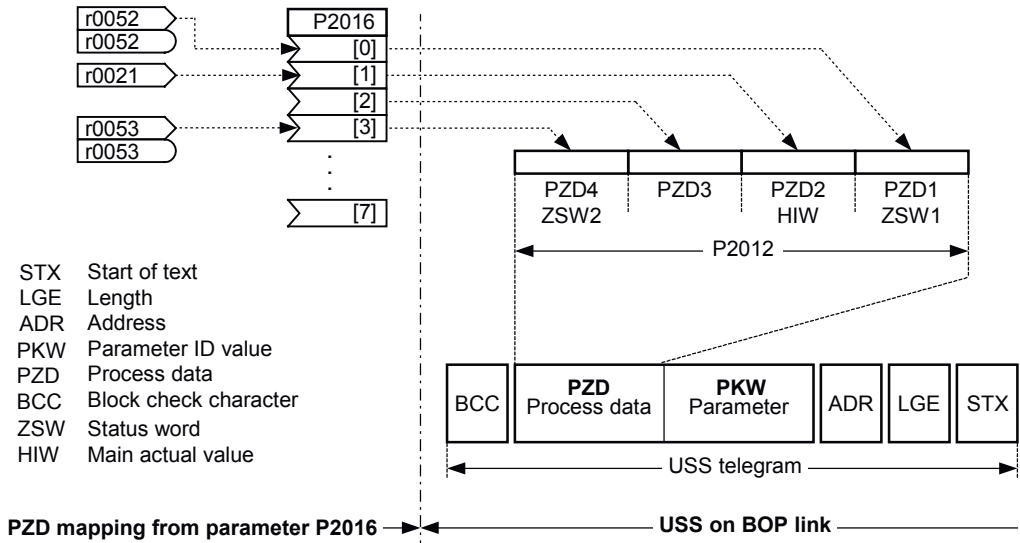

**Index:**

- P2016[0] : Transmitted word 0
- P2016[1] : Transmitted word 1
- P2016[2] : Transmitted word 2
- P2016[3] : Transmitted word 3
- P2016[4] : Transmitted word 4
- P2016[5] : Transmitted word 5
- P2016[6] : Transmitted word 6
- P2016[7] : Transmitted word 7

**Example:**


P2016[0] = 52.0 (default). In this case, the value of r0052[0] (CO/BO: Status word) is transmitted as 1st PZD to the BOP link.

**Note:**

If r0052 not indexed, display does not show an index ("0").

<b>r2018[8]</b>	<b>CO: PZD from COM link (USS)</b>	<b>Min:</b> -	<b>Level</b>
	<b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> -	<b>3</b>
<b>P-Group:</b> COMM		<b>Max:</b> -	

Displays process data received via USS on COM link.

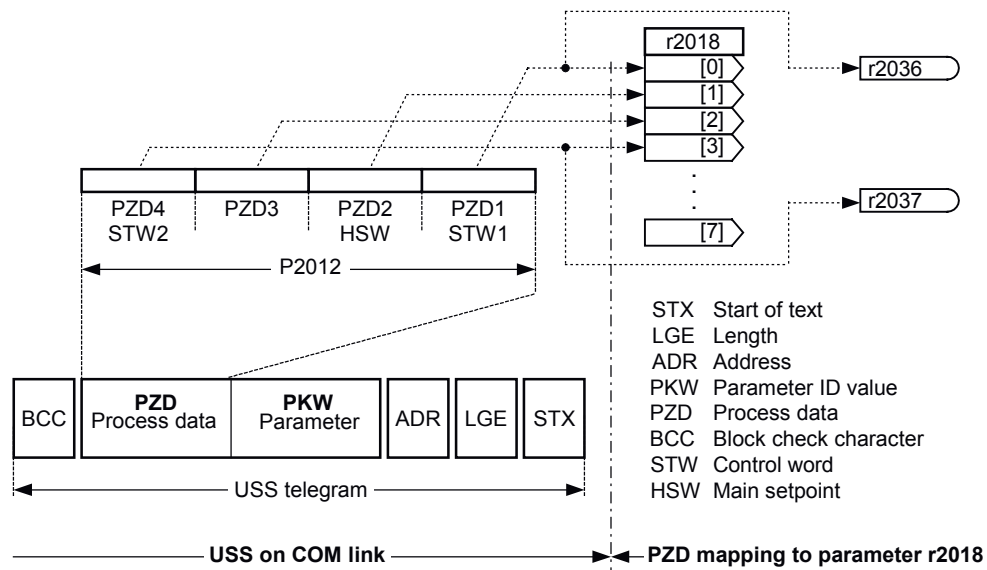

**Index:**

- r2018[0] : Received word 0
- r2018[1] : Received word 1
- r2018[2] : Received word 2
- r2018[3] : Received word 3
- r2018[4] : Received word 4
- r2018[5] : Received word 5
- r2018[6] : Received word 6
- r2018[7] : Received word 7

**Note:**


The control words can be viewed as bit parameters r2036 and r2037.

**Restrictions:**

- If the above serial interface controls the inverter (P0700 or P0719) then the 1st control word must be transferred in the 1st PZD-word.
- If the setpoint source is selected via P1000 or P0719, then the main setpoint must be transferred in the 2nd PZD-word,
- When P2012 is greater than or equal to 4 the additional control word (2nd control word) must be transferred in the 4th PZD-word, if the above serial interface controls the inverter (P0700 or P0719).

<b>r2019[8]</b>	<b>CI: PZD to COM link (USS)</b>	<b>Min:</b> 0:0	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Def:</b> 52:0
	<b>P-Group:</b> COMM	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 4000:0	<b>3</b>

Selects signals (process data, PZD), that are transferred via the COM interface using USS.

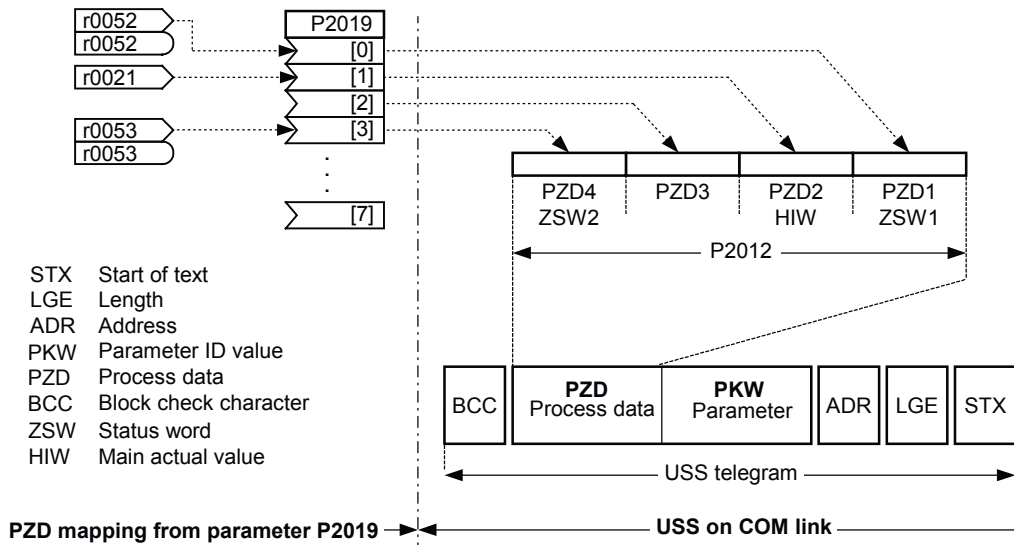

**Index:**

- P2019[0] : Transmitted word 0
- P2019[1] : Transmitted word 1
- P2019[2] : Transmitted word 2
- P2019[3] : Transmitted word 3
- P2019[4] : Transmitted word 4
- P2019[5] : Transmitted word 5
- P2019[6] : Transmitted word 6
- P2019[7] : Transmitted word 7

**Details:**

See P2016 (PZD to BOP link)

<b>r2024[2]</b>	<b>USS error-free telegrams</b>	<b>Min:</b> -	<b>Level</b>
	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> -
	<b>P-Group:</b> COMM		<b>Max:</b> -
			<b>3</b>

Displays number of error-free USS telegrams received.

**Index:**

- r2024[0] : Serial interface COM link
- r2024[1] : Serial interface BOP link

<b>r2025[2]</b>	<b>USS rejected telegrams</b>	<b>Min:</b> -	<b>Level</b>
	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> -
	<b>P-Group:</b> COMM		<b>Max:</b> -
			<b>3</b>

Displays the number of rejected USS telegrams. The sum of all USS errors (r2026 - r2031) is displayed in parameter r2025.

The following monitoring mechanisms have been implemented

- when a telegram is received, then initially, the correct start of a telegram (start interval + STX) must be identified and then the length must be evaluated (LGE). If the length does not correspond to the selected value for a fixed telegram or it does not have a valid value for a variable telegram length, the telegram is rejected.
- the appropriate times are monitored before and while receiving telegrams.
- the block check character (BCC) is generated while the telegram is received and after the complete telegram has been read-in, this is compared with the received BCC. If these do not match, then the telegram is not evaluated.
- if a character frame error or a parity error has not occurred in any of the received characters, then the node number (ADR) of the received telegram can be evaluated.
- the telegram is rejected if the address byte (ADR) does not correspond to the node number (for slave) or the expected slave node number (for the master).

**Index:**

- r2025[0] : Serial interface COM link
- r2025[1] : Serial interface BOP link

<b>r2026[2]</b>	<b>USS character frame error</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMM				

Displays number of USS character frame errors.

**Index:**

r2026[0] : Serial interface COM link  
r2026[1] : Serial interface BOP link

<b>r2027[2]</b>	<b>USS overrun error</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMM				

Displays number of USS telegrams with overrun error.

**Index:**

r2027[0] : Serial interface COM link  
r2027[1] : Serial interface BOP link

<b>r2028[2]</b>	<b>USS parity error</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMM				

Displays number of USS telegrams with parity error.

**Index:**

r2028[0] : Serial interface COM link  
r2028[1] : Serial interface BOP link

<b>r2029[2]</b>	<b>USS start not identified</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMM				

Displays number of USS telegrams with unidentified start.

**Index:**

r2029[0] : Serial interface COM link  
r2029[1] : Serial interface BOP link

<b>r2030[2]</b>	<b>USS BCC error</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMM				

Displays number of USS telegrams with BCC error.

**Index:**

r2030[0] : Serial interface COM link  
r2030[1] : Serial interface BOP link

<b>r2031[2]</b>	<b>USS length error</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMM				

Displays number of USS telegrams with incorrect length.

**Index:**

r2031[0] : Serial interface COM link  
r2031[1] : Serial interface BOP link

<b>r2032</b>	<b>BO: CtrlWrd1 from BOP link (USS)</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMM				

Displays control word 1 from BOP link (word 1 within USS).

**Bitfields:**

Bit00	ON/OFF1	0	NO	1	YES
Bit01	OFF2: Electrical stop	0	YES	1	NO
Bit02	OFF3: Fast stop	0	YES	1	NO
Bit03	Pulse enable	0	NO	1	YES
Bit04	RFG enable	0	NO	1	YES
Bit05	RFG start	0	NO	1	YES
Bit06	Setpoint enable	0	NO	1	YES
Bit07	Fault acknowledge	0	NO	1	YES
Bit08	JOG right	0	NO	1	YES
Bit09	JOG left	0	NO	1	YES
Bit10	Control from PLC	0	NO	1	YES
Bit11	Reverse (setpoint inversion)	0	NO	1	YES
Bit13	Motor potentiometer MOP up	0	NO	1	YES
Bit14	Motor potentiometer MOP down	0	NO	1	YES
Bit15	CDS Bit 0 (Local/Remote)	0	NO	1	YES

<b>r2033</b>	<b>BO: CtrlWrd2 from BOP link (USS)</b>	<b>Datatype: U16</b>	<b>Unit: -</b>	<b>Min: -</b>	<b>Def: -</b>	<b>Max: -</b>	<b>Level</b>
	<b>P-Group: COMM</b>						<b>3</b>

Displays control word 2 from BOP link (i.e. word 4 within USS).

**Bitfields:**

Bit00	Fixed frequency Bit 0	0	NO	1	YES
Bit01	Fixed frequency Bit 1	0	NO	1	YES
Bit02	Fixed frequency Bit 2	0	NO	1	YES
Bit03	Fixed frequency Bit 3	0	NO	1	YES
Bit04	Drive data set (DDS) Bit 0	0	NO	1	YES
Bit05	Drive data set (DDS) Bit 1	0	NO	1	YES
Bit08	PID enabled	0	NO	1	YES
Bit09	DC brake enabled	0	NO	1	YES
Bit11	Droop enabled	0	NO	1	YES
Bit12	Torque control	0	NO	1	YES
Bit13	External fault 1	0	YES	1	NO
Bit15	Command data set (CDS) Bit 1	0	NO	1	YES

**Dependency:**

P0700 = 4 (USS on BOP link) and P0719 = 0 (Cmd / Setpoint = BICO parameter).

<b>r2036</b>	<b>BO: CtrlWrd1 from COM link (USS)</b>	<b>Datatype: U16</b>	<b>Unit: -</b>	<b>Min: -</b>	<b>Def: -</b>	<b>Max: -</b>	<b>Level</b>
	<b>P-Group: COMM</b>						<b>3</b>

Displays control word 1 from COM link (i.e. word 1 within USS).

**Bitfields:**

Bit00	ON/OFF1	0	NO	1	YES
Bit01	OFF2: Electrical stop	0	YES	1	NO
Bit02	OFF3: Fast stop	0	YES	1	NO
Bit03	Pulse enable	0	NO	1	YES
Bit04	RFG enable	0	NO	1	YES
Bit05	RFG start	0	NO	1	YES
Bit06	Setpoint enable	0	NO	1	YES
Bit07	Fault acknowledge	0	NO	1	YES
Bit08	JOG right	0	NO	1	YES
Bit09	JOG left	0	NO	1	YES
Bit10	Control from PLC	0	NO	1	YES
Bit11	Reverse (setpoint inversion)	0	NO	1	YES
Bit13	Motor potentiometer MOP up	0	NO	1	YES
Bit14	Motor potentiometer MOP down	0	NO	1	YES
Bit15	CDS Bit 0 (Local/Remote)	0	NO	1	YES

**Details:**

See r2033 (control word 2 from BOP link).

<b>r2037</b>	<b>BO: CtrlWrd2 from COM link (USS)</b>	<b>Datatype: U16</b>	<b>Unit: -</b>	<b>Min: -</b>	<b>Def: -</b>	<b>Max: -</b>	<b>Level</b>
	<b>P-Group: COMM</b>						<b>3</b>

Displays control word 2 from COM link (i.e. word 4 within USS).

**Bitfields:**

Bit00	Fixed frequency Bit 0	0	NO	1	YES
Bit01	Fixed frequency Bit 1	0	NO	1	YES
Bit02	Fixed frequency Bit 2	0	NO	1	YES
Bit03	Fixed frequency Bit 3	0	NO	1	YES
Bit04	Drive data set (DDS) Bit 0	0	NO	1	YES
Bit05	Drive data set (DDS) Bit 1	0	NO	1	YES
Bit08	PID enabled	0	NO	1	YES
Bit09	DC brake enabled	0	NO	1	YES
Bit11	Droop enabled	0	NO	1	YES
Bit12	Torque control	0	NO	1	YES
Bit13	External fault 1	0	YES	1	NO
Bit15	Command data set (CDS) Bit 1	0	NO	1	YES

**Details:**

See r2033 (control word 2 from BOP link).

<b>P2040</b>	<b>CB telegram off time</b>	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 20	
	<b>P-Group:</b> COMM			<b>Max:</b> 65535	

Defines time after which a fault will be generated (F0070) if no telegram is received via the link.

**Dependency:**

Setting 0 = watchdog disabled

<b>P2041[5]</b>	<b>CB parameter</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0	
	<b>P-Group:</b> COMM			<b>Max:</b> 65535	

Configures a communication board (CB).

**Index:**


- P2041[0] : CB parameter 0
- P2041[1] : CB parameter 1
- P2041[2] : CB parameter 2
- P2041[3] : CB parameter 3
- P2041[4] : CB parameter 4

**Details:**

See relevant communication board manual for protocol definition and appropriate settings.

<b>r2050[8]</b>	<b>CO: PZD from CB</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> -	
	<b>P-Group:</b> COMM			<b>Max:</b> -	

Displays PZD received from communication board (CB).

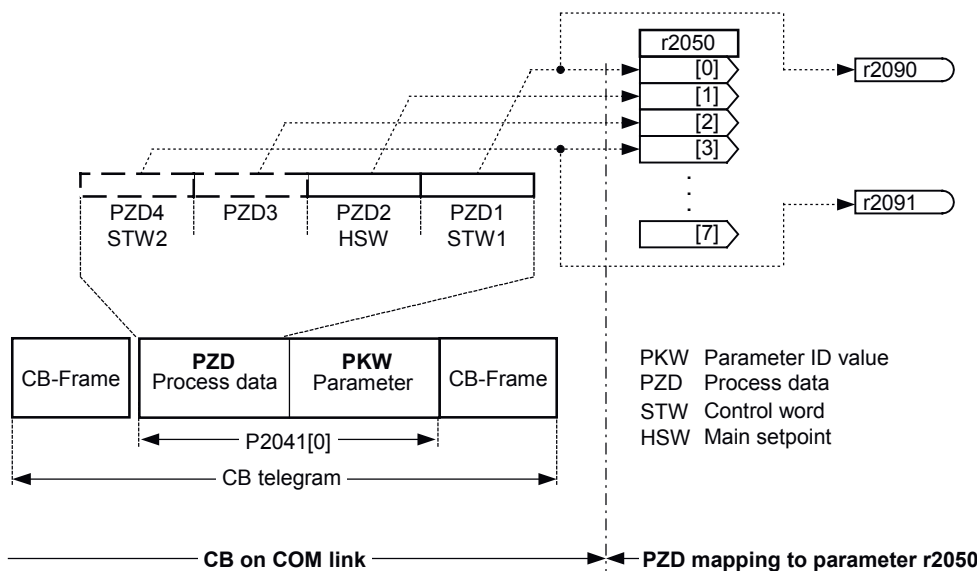

**Index:**

- r2050[0] : Received word 0
- r2050[1] : Received word 1
- r2050[2] : Received word 2
- r2050[3] : Received word 3
- r2050[4] : Received word 4
- r2050[5] : Received word 5
- r2050[6] : Received word 6
- r2050[7] : Received word 7

**Note:**


The control words can be viewed as bit parameters r2090 and r2091.

**Restrictions:**

- If the above serial interface controls the inverter (P0700 or P0719) then the 1st control word must be transferred in the 1st PZD-word.
- If the setpoint source is selected via P1000 or P0719, then the main setpoint must be transferred in the 2nd PZD-word,
- When P2012 is greater than or equal to 4 the additional control word (2nd control word) must transferred in the 4th PZD-word, if the above serial interface controls the inverter (P0700 or P0719).

<b>P2051[8]</b>	<b>CI: PZD to CB</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 52:0	
	<b>P-Group:</b> COMM			<b>Max:</b> 4000:0	

Selects signals (process data PZD), that are transferred via the COM interface using CB.

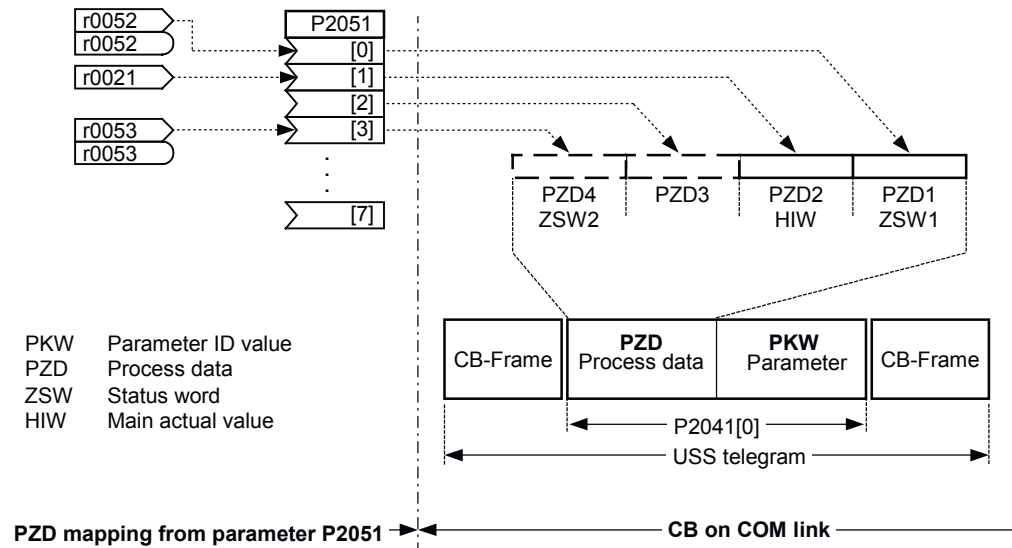

**Index:**

- P2051[0] : Transmitted word 0
- P2051[1] : Transmitted word 1
- P2051[2] : Transmitted word 2
- P2051[3] : Transmitted word 3
- P2051[4] : Transmitted word 4
- P2051[5] : Transmitted word 5
- P2051[6] : Transmitted word 6
- P2051[7] : Transmitted word 7

**Common Settings:**

- Status word 1 = 52 CO/BO: Act. status word 1 (see r0052)
- Actual value 1 = 21 inverter output frequency (see r0021)
- Other BICO settings are possible

<b>r2053[5]</b>	<b>CB identification</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> COMM			<b>Def:</b> -	
				<b>Max:</b> -	

Displays identification data of the communication board (CB). The different CB types (r2053[0]) are given in the Enum declaration.

**Possible Settings:**

- 0 No CB option board
- 1 PROFIBUS DP
- 2 DeviceNet
- 256 not defined

**Index:**

- r2053[0] : CB type (PROFIBUS = 1)
- r2053[1] : Firmware version
- r2053[2] : Firmware version detail
- r2053[3] : Firmware date (year)
- r2053[4] : Firmware date (day/month)



<b>r2054[7]</b>	<b>CB diagnosis</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b>
	<b>P-Group:</b> COMM			<b>Def:</b> - <b>Max:</b> -	<b>3</b>

Displays diagnostic information of communication board (CB).

**Index:**

r2054[0] : CB diagnosis 0  
r2054[1] : CB diagnosis 1  
r2054[2] : CB diagnosis 2  
r2054[3] : CB diagnosis 3  
r2054[4] : CB diagnosis 4  
r2054[5] : CB diagnosis 5  
r2054[6] : CB diagnosis 6

**Details:**

See relevant communications board manual.

<b>r2090</b>	<b>BO: Control word 1 from CB</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b>
	<b>P-Group:</b> COMM			<b>Def:</b> - <b>Max:</b> -	<b>3</b>

Displays control word 1 received from communication board (CB).

**Bitfields:**

Bit00	ON/OFF1	0	NO	1	YES
Bit01	OFF2: Electrical stop	0	YES	1	NO
Bit02	OFF3: Fast stop	0	YES	1	NO
Bit03	Pulse enable	0	NO	1	YES
Bit04	RFG enable	0	NO	1	YES
Bit05	RFG start	0	NO	1	YES
Bit06	Setpoint enable	0	NO	1	YES
Bit07	Fault acknowledge	0	NO	1	YES
Bit08	JOG right	0	NO	1	YES
Bit09	JOG left	0	NO	1	YES
Bit10	Control from PLC	0	NO	1	YES
Bit11	Reverse (setpoint inversion)	0	NO	1	YES
Bit13	Motor potentiometer MOP up	0	NO	1	YES
Bit14	Motor potentiometer MOP down	0	NO	1	YES
Bit15	CDS Bit 0 (Local/Remote)	0	NO	1	YES

**Details:**

See relevant communication board manual for protocol definition and appropriate settings.

<b>r2091</b>	<b>BO: Control word 2 from CB</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b>
	<b>P-Group:</b> COMM			<b>Def:</b> - <b>Max:</b> -	<b>3</b>

Displays control word 2 received from communication board (CB).

**Bitfields:**

Bit00	Fixed frequency Bit 0	0	NO	1	YES
Bit01	Fixed frequency Bit 1	0	NO	1	YES
Bit02	Fixed frequency Bit 2	0	NO	1	YES
Bit03	Fixed frequency Bit 3	0	NO	1	YES
Bit04	Drive data set (DDS) Bit 0	0	NO	1	YES
Bit05	Drive data set (DDS) Bit 1	0	NO	1	YES
Bit08	PID enabled	0	NO	1	YES
Bit09	DC brake enabled	0	NO	1	YES
Bit11	Droop enabled	0	NO	1	YES
Bit12	Torque control	0	NO	1	YES
Bit13	External fault 1	0	YES	1	NO
Bit15	Command data set (CDS) Bit 1	0	NO	1	YES

**Details:**

See relevant communication board manual for protocol definition and appropriate settings.

### 3.35 Faults, Alarms, Monitoring

<b>P2100[3]</b>	<b>Alarm number selection</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT <b>Datatype:</b> U16 <b>Unit:</b> - <b>Def:</b> 0		
	<b>P-Group:</b> ALARMS <b>Active:</b> first confirm <b>QuickComm.:</b> No <b>Max:</b> 65535		

Selects up to 3 faults or warnings for non-default reactions.

**Index:**

P2100[0] : Fault Number 1  
P2100[1] : Fault Number 2  
P2100[2] : Fault Number 3

**Example:**

If you want F0005 to perform an OFF3 instead of an OFF2, set P2100[0] = 5, then select the desired reaction in P2101[0] (in this case, set P2101[0] = 3).

**Note:**

All fault codes have a default reaction to OFF2. Some fault codes caused by hardware trips (e.g. overcurrent) cannot be changed from the default reactions.

<b>P2101[3]</b>	<b>Stop reaction value</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT <b>Datatype:</b> U16 <b>Unit:</b> - <b>Def:</b> 0		
	<b>P-Group:</b> ALARMS <b>Active:</b> first confirm <b>QuickComm.:</b> No <b>Max:</b> 4		

Sets drive stop reaction values for fault selected by P2100 (alarm number stop reaction).

This indexed parameter specifies the special reaction to the faults/warnings defined in P2100 indices 0 to 2.

**Possible Settings:**

- 0 No reaction, no display
- 1 OFF1 stop reaction
- 2 OFF2 stop reaction
- 3 OFF3 stop reaction
- 4 No reaction warning only

**Index:**

P2101[0] : Stop reaction value 1  
P2101[1] : Stop reaction value 2  
P2101[2] : Stop reaction value 3

**Note:**

- Settings 0 - 3 only are available for fault codes.
- Settings 0 and 4 only are available for warnings.
- Index 0 (P2101) refers to fault/warning in index 0 (P2100).

<b>P2103[3]</b>	<b>BI: 1. Faults acknowledgement</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT <b>Datatype:</b> U32 <b>Unit:</b> - <b>Def:</b> 722:2		
	<b>P-Group:</b> COMMANDS <b>Active:</b> first confirm <b>QuickComm.:</b> No <b>Max:</b> 4000:0		

Defines first source of fault acknowledgement, e.g. keypad/DIN, etc. (depending on setting).

**Index:**

P2103[0] : 1st. Command data set (CDS)  
P2103[1] : 2nd. Command data set (CDS)  
P2103[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)

<b>P2104[3]</b>	<b>BI: 2. Faults acknowledgement</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT <b>Datatype:</b> U32 <b>Unit:</b> - <b>Def:</b> 0:0		
	<b>P-Group:</b> COMMANDS <b>Active:</b> first confirm <b>QuickComm.:</b> No <b>Max:</b> 4000:0		

Selects second source of fault acknowledgement.

**Index:**

P2104[0] : 1st. Command data set (CDS)  
P2104[1] : 2nd. Command data set (CDS)  
P2104[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)

<b>P2106[3]</b>	<b>BI: External fault</b>			<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 1:0	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Selects source of external faults.

**Index:**

P2106[0] : 1st. Command data set (CDS)  
P2106[1] : 2nd. Command data set (CDS)  
P2106[2] : 3rd. Command data set (CDS)

**Common Settings:**

722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)  
722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)  
722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)  
722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)  
722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)  
722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)  
722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)  
722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)

<b>r2110[4]</b>	<b>Warning number</b>			<b>Min:</b> -	Level <b>2</b>
		<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> ALARMS			<b>Max:</b> -	

Displays warning information.

A maximum of 2 active warnings (indices 0 and 1) and 2 historical warnings (indices 2 and 3) may be viewed.

**Index:**

r2110[0] : Recent Warnings --, warning 1  
r2110[1] : Recent Warnings --, warning 2  
r2110[2] : Recent Warnings -1, warning 3  
r2110[3] : Recent Warnings -1, warning 4

**Note:**

- Indices 0 and 1 are not stored.
- The keypad will flash while a warning is active. The LEDs indicate the warning status in this case.
- If an AOP is in use, the display will show number and text of the active warning.

<b>P2111</b>	<b>Total number of warnings</b>			<b>Min:</b> 0	Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> ALARMS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4	

Displays number of warning (up to 4) since last reset. Set to 0 to reset the warning history.

<b>r2114[2]</b>	<b>Run time counter</b>			<b>Min:</b> -	Level <b>3</b>
		<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> ALARMS			<b>Max:</b> -	

Displays run time counter.

It is the total time the drive has been powered up. When power goes value is saved, then restored on powerup. The run time counter r2114 will be calculate as followed:

- Multiply the value in r2114[0], by 65536 and then add it to the value in r2114[1].
- The resultant answer will be in seconds.

When AOP is not connected, the time in this parameter is used by r0948 to indicate when a fault has occurred.

**Index:**

r2114[0] : System Time, Seconds, Upper Word  
r2114[1] : System Time, Seconds, Lower Word

**Example:**

If r2114[0] = 1 & r2114[1] = 20864  
We get  $1 * 65536 + 20864 = 86400$  seconds which equals 1 day.

<b>P2115[3]</b>	<b>AOP real time clock</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 0	<b>3</b>
		<b>Max:</b> 65535	

Displays AOP real time.

All of the frequency inverters have an internal time generator function which is used to time-stamp and log erroneous conditions. Therefore there is no battery-buffered real-time clock (RTC). The frequency inverters can support a software-controlled RTC where the RTC must be set from the AOP or via an interface. When using the AOP, this synchronization is automatic. When a serial interface is used, a task must be sent from the higher-level control to write into the parameter. If the AOP is withdrawn during operation, or if the bus is interrupted, then the real-time clock runs further using the runtime counter. The real-time clock is reset to zero only after power off.

The time is stored in a word array parameter P2115. This parameter number is common to all inverters. Inverters not supporting this feature would respond with parameter not recognised - a Master will ignore this. The time will be set by USS Protocol standard word array parameter write telegrams.

Within the AOP, while it is acting as a USS Master, at each tick of the heartbeat, the list of available USS Slaves will be flagged with a time update request. As the Master runs around the list of USS slaves on its next USS update cycle, if there are no higher priority tasks to perform, and the slave still has its time update flag set, then an array parameter write telegram will be issued, containing the current time. The request for that slave is cancelled if the slave responds correctly. The AOP will not need to read the time from the slave.

Time is maintained in a word array parameter and encoded as follows - the same format will be used in fault report logs.

Index	High Byte (MSB)	Low Byte (LSB)
0	Seconds (0 - 59)	Minutes (0 - 59)
1	Hours (0 - 23)	Days (1 - 31)
2	Month (1 - 12)	Years (00 - 250)

Time is measured from Jan 1st 2000. Values are in binary form.

**Index:**

- P2115[0] : Real Time, Seconds+Minutes
- P2115[1] : Real Time, Hours+Days
- P2115[2] : Real Time, Month+Year

**Example:**

- P2115[0] = 13625
- P2115[1] = 2579
- P2115[2] = 516

The conversion into binary quantities (U16) results in the following bit pattern:

Seconds + minutes:

- High byte (MSB) = 00110101 corresponding to the number 53, i.e. seconds 53
- Low byte (LSB) = 00111001 corresponding to the number 57, i.e. minutes 57

Hours + days:

- High byte (MSB) = 00001010 corresponding to the number 10, i.e. hours 10
- Low byte (LSB) = 00010011 corresponding to the number 19, i.e. days 19

Months + year:

- High byte (MSB) = 00000010 corresponding to the number 2, i.e. months 2
- Low byte (LSB) = 00000100 corresponding to the number 4, i.e. years 4

This means that the real time displayed in P2115 is 19.02.2004, 10:57:53.


<b>P2120</b>	<b>Indication counter</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 0	<b>4</b>
		<b>Max:</b> 65535	

Indicates total number of alarm events. This parameter is incremented whenever an alarm event occurs. It also gets incremented when a warning is cleared or faults are cleared.

This parameter is used by the PC tools.

<b>P2150[3]</b>	<b>Hysteresis frequency f_hys</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 3.00	<b>3</b>
		<b>Max:</b> 10.00	

Defines hysteresis level applied for comparing frequency and speed to threshold as illustrated in the diagram below.

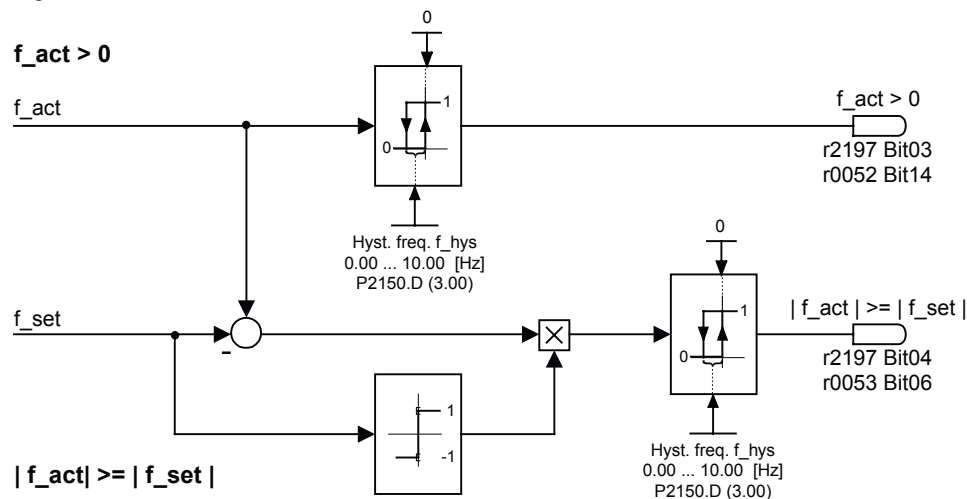

Index:

- P2150[0] : 1st. Drive data set (DDS)
- P2150[1] : 2nd. Drive data set (DDS)
- P2150[2] : 3rd. Drive data set (DDS)

<b>P2153[3]</b>	<b>Time-constant frequency filter</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> ms
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 5	<b>2</b>
		<b>Max:</b> 1000	

Specifies time constant of first-order frequency filter. The filtered frequency is then compared to the thresholds.

Index:


- P2153[0] : 1st. Drive data set (DDS)
- P2153[1] : 2nd. Drive data set (DDS)
- P2153[2] : 3rd. Drive data set (DDS)

Details:

See diagram in P2155, P2157 and P2159

<b>P2155[3]</b>	<b>Threshold frequency f_1</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 30.00	<b>3</b>
		<b>Max:</b> 650.00	

Sets a threshold for comparing actual frequency or frequency to threshold values  $f_1$ . This threshold controls status bits 4 and 5 in status word 2 (r0053).

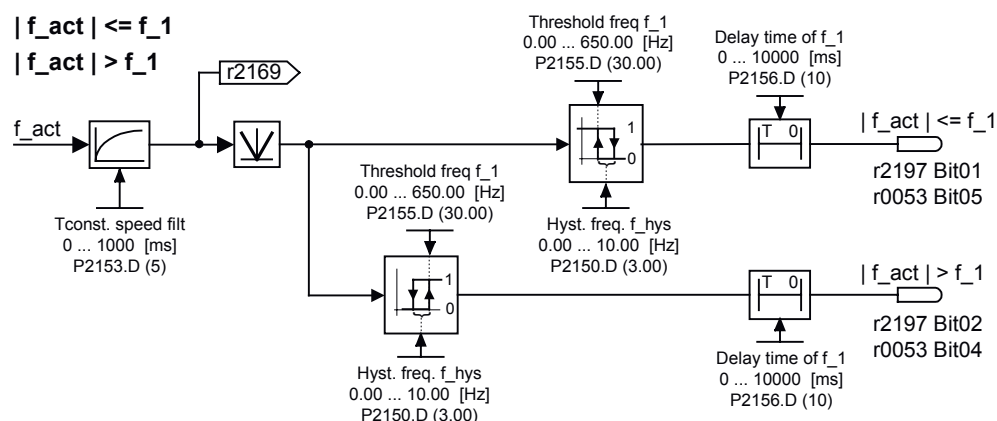

Index:

- P2155[0] : 1st. Drive data set (DDS)
- P2155[1] : 2nd. Drive data set (DDS)
- P2155[2] : 3rd. Drive data set (DDS)

<b>P2156[3]</b>	<b>Delay time of threshold freq f_1</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Def:</b> 10
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 10000	<b>3</b>

Sets delay time prior to threshold frequency f\_1 comparison (P2155).

**Index:**


P2156[0] : 1st. Drive data set (DDS)  
P2156[1] : 2nd. Drive data set (DDS)  
P2156[2] : 3rd. Drive data set (DDS)

**Details:**

See diagram in P2155 (threshold frequency f\_1)

<b>P2157[3]</b>	<b>Threshold frequency f_2</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Def:</b> 30.00
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 650.00	<b>2</b>

Threshold\_2 for comparing frequency or frequency to thresholds as illustrated in the diagram below.

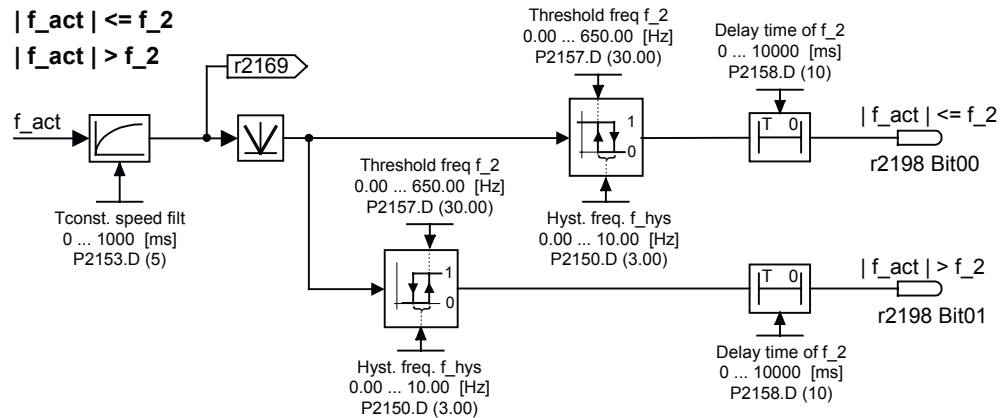

**Index:**

P2157[0] : 1st. Drive data set (DDS)  
P2157[1] : 2nd. Drive data set (DDS)  
P2157[2] : 3rd. Drive data set (DDS)

<b>P2158[3]</b>	<b>Delay time of threshold freq f_2</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Def:</b> 10
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 10000	<b>2</b>

Delay time for comparing frequency to threshold f\_2 (P2157).

**Index:**


P2158[0] : 1st. Drive data set (DDS)  
P2158[1] : 2nd. Drive data set (DDS)  
P2158[2] : 3rd. Drive data set (DDS)

**Details:**

See diagram in P2157 (threshold frequency f\_2)

<b>P2159[3]</b>	<b>Threshold frequency f_3</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 30.00	<b>2</b>
		<b>Max:</b> 650.00	

Threshold\_3 for comparing frequency to thresholds.

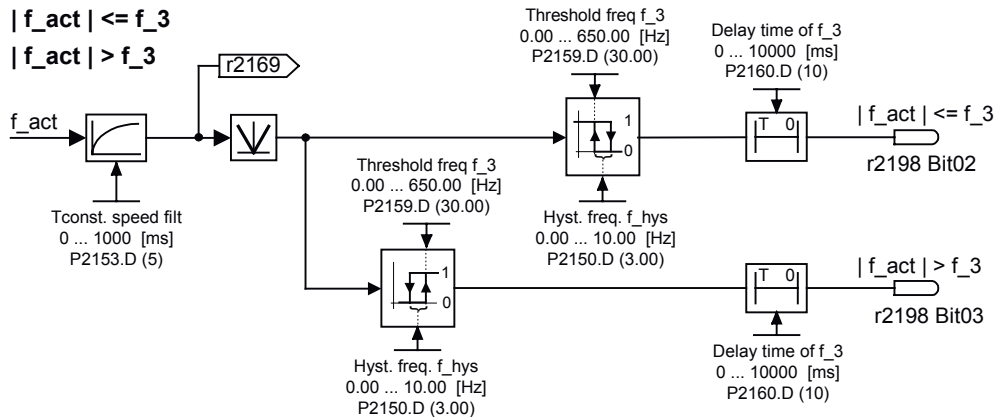

**Index:**

- P2159[0] : 1st. Drive data set (DDS)
- P2159[1] : 2nd. Drive data set (DDS)
- P2159[2] : 3rd. Drive data set (DDS)

<b>P2160[3]</b>	<b>Delay time of threshold freq f_3</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> ms
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 10	<b>2</b>
		<b>Max:</b> 10000	

Delay time for comparing frequency to threshold f\_3 (P2159).

**Index:**


- P2160[0] : 1st. Drive data set (DDS)
- P2160[1] : 2nd. Drive data set (DDS)
- P2160[2] : 3rd. Drive data set (DDS)

**Details:**

See diagram in P2159 (threshold frequency f\_3)

<b>P2161[3]</b>	<b>Min. threshold for freq. setp.</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 3.00	<b>2</b>
		<b>Max:</b> 10.00	

Minimum threshold value for comparing frequency setpoint.

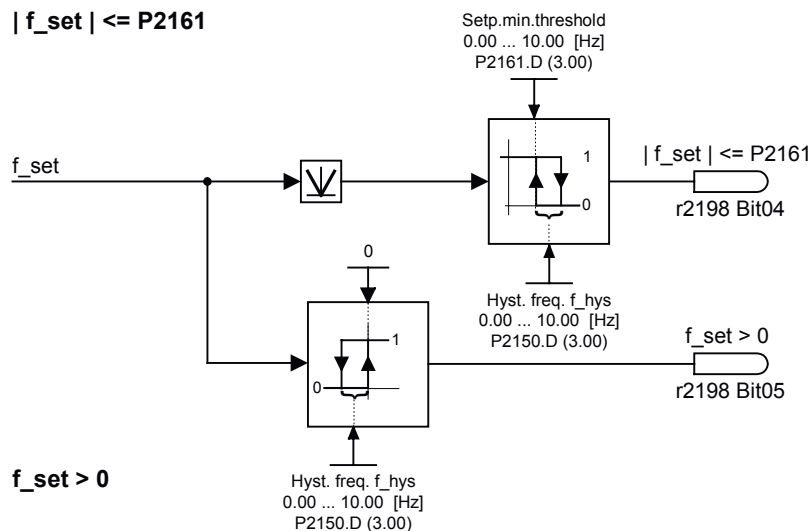


**Index:**

- P2161[0] : 1st. Drive data set (DDS)
- P2161[1] : 2nd. Drive data set (DDS)
- P2161[2] : 3rd. Drive data set (DDS)



<b>P2162[3]</b>	<b>Hysteresis freq. for overfreq.</b>	<b>Min:</b> 0.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Hysteresis frequency for overfrequency-detection as illustrated in the diagram below.

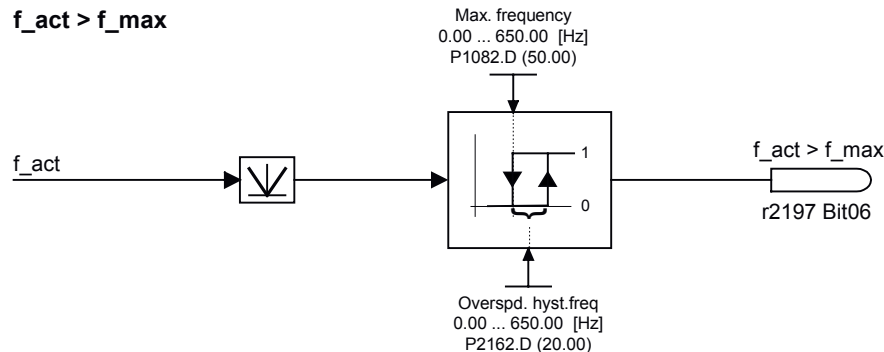

**Index:**

- P2162[0] : 1st. Drive data set (DDS)
- P2162[1] : 2nd. Drive data set (DDS)
- P2162[2] : 3rd. Drive data set (DDS)

<b>P2163[3]</b>	<b>Entry freq. for perm. deviation</b>	<b>Min:</b> 0.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No


Threshold for detecting frequency deviation from setpoint as illustrated in the diagram P2164.

**Index:**

- P2163[0] : 1st. Drive data set (DDS)
- P2163[1] : 2nd. Drive data set (DDS)
- P2163[2] : 3rd. Drive data set (DDS)

<b>P2164[3]</b>	<b>Hysteresis frequency deviation</b>	<b>Min:</b> 0.00	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Hysteresis frequency for detecting permitted deviation (from setpoint). This frequency controls bit 8 in status word 1 (r0052) and bit 6 in status word 2 (r0053).

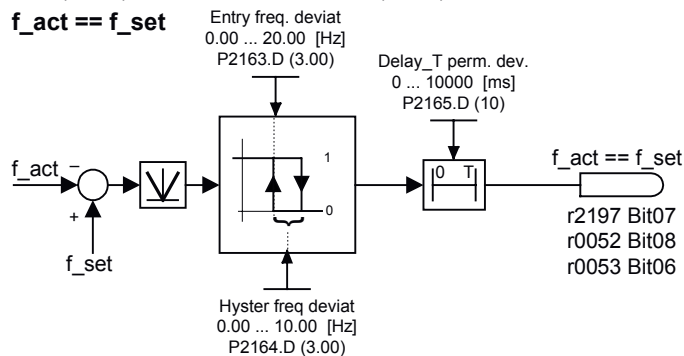

**Index:**

- P2164[0] : 1st. Drive data set (DDS)
- P2164[1] : 2nd. Drive data set (DDS)
- P2164[2] : 3rd. Drive data set (DDS)

<b>P2165[3]</b>	<b>Delay time permitted deviation</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> ms
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Delay time for detecting permitted deviation of frequency from setpoint.

**Index:**

- P2165[0] : 1st. Drive data set (DDS)
- P2165[1] : 2nd. Drive data set (DDS)
- P2165[2] : 3rd. Drive data set (DDS)

**Details:**

See diagram in P2164.



<b>P2166[3]</b>	<b>Delay time ramp up completed</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Def:</b> 10		
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 10000		

Delay time for signal that indicates completion of ramp-up.

**Index:**

P2166[0] : 1st. Drive data set (DDS)  
P2166[1] : 2nd. Drive data set (DDS)  
P2166[2] : 3rd. Drive data set (DDS)

**Details:**

See diagram in P2174.

<b>P2167[3]</b>	<b>Switch-off frequency <math>f_{off}</math></b>				<b>Min:</b> 0.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> 1.00		
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 10.00		


Defines the threshold of the monitoring function  $|f_{act}| > P2167 (f_{off})$ .

P2167 influences following functions:

- If the actual frequency falls below this threshold and the time delay has expired, bit 1 in status word 2 (r0053) is reset.
- If a OFF1 or OFF3 was applied and bit 1 is reset the inverter will disable the pulse (OFF2).

Restriction:

- The monitoring function  $|f_{act}| > P2167 (f_{off})$  is not updated and pulses are not disabled, if motor holding brake (MHB, P1215 = 1) is enabled.

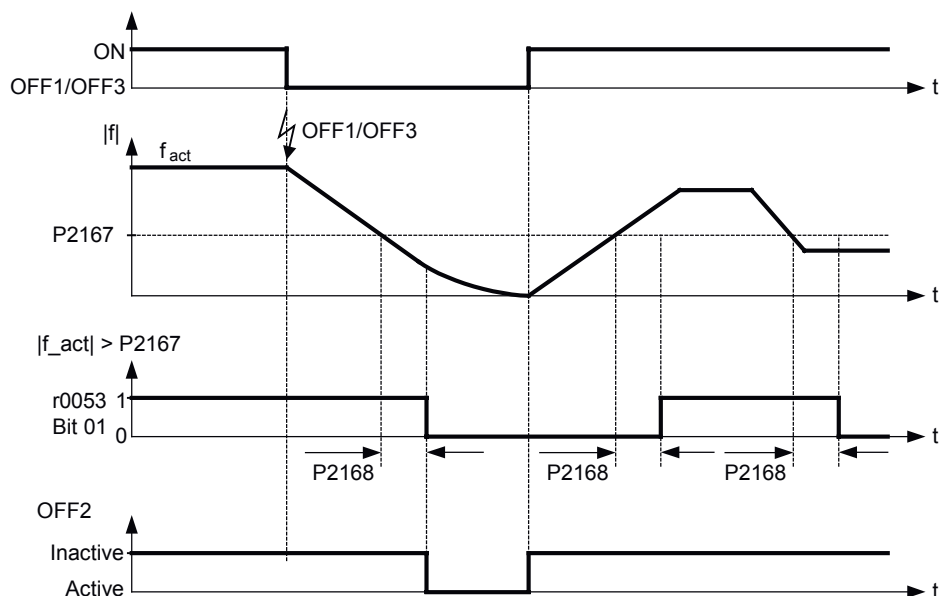

**Index:**

P2167[0] : 1st. Drive data set (DDS)  
P2167[1] : 2nd. Drive data set (DDS)  
P2167[2] : 3rd. Drive data set (DDS)

<b>P2168[3]</b>	<b>Delay time <math>T_{off}</math></b>				<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Def:</b> 10		
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 10000		

Defines time for which the inverter may operate below switch-off frequency (P2167) before switch off occurs.

**Index:**

P2168[0] : 1st. Drive data set (DDS)  
P2168[1] : 2nd. Drive data set (DDS)  
P2168[2] : 3rd. Drive data set (DDS)

**Dependency:**

Active if holding brake (P1215) not parameterized.

**Details:**

See diagram in P2167 (switch-off frequency)

<b>r2169</b>	<b>CO: Act. filtered frequency</b>	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Min:</b> -	Level <b>2</b>
	<b>P-Group:</b> ALARMS			<b>Def:</b> - <b>Max:</b> -	


Filtered frequency for monitoring behind first-order lowpass filter.

- $|f_{act}| > f_{1}$  (see P2155)
- $|f_{act}| > f_{2}$  (see P2157)
- $|f_{act}| > f_{3}$  (see P2159)

<b>P2170[3]</b>	<b>Threshold current I_thresh</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> 0.0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 100.0 <b>Max:</b> 400.0	

Defines threshold current in [%] relative to P0305 (rated motor current) to be used in comparisons of  $I_{act}$  and  $I_{Thresh}$  as illustrated in the diagram below.

$|I_{act}| > I_{thresh}$

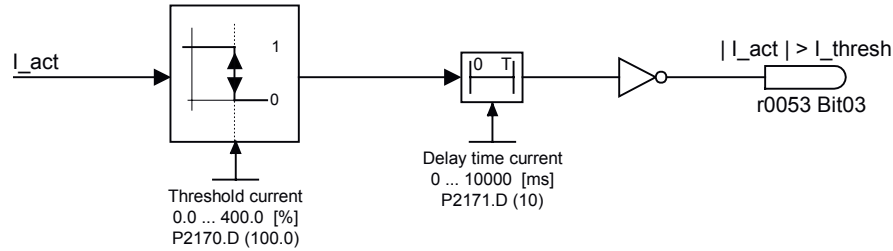

**Index:**

- P2170[0] : 1st. Drive data set (DDS)
- P2170[1] : 2nd. Drive data set (DDS)
- P2170[2] : 3rd. Drive data set (DDS)

**Note:**

This threshold controls bit 3 in status word 3 (r0053).

<b>P2171[3]</b>	<b>Delay time current</b>	<b>Datatype:</b> U16	<b>Unit:</b> ms	<b>Min:</b> 0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 10 <b>Max:</b> 10000	

Defines delay time prior to activation of current comparison.

**Index:**


- P2171[0] : 1st. Drive data set (DDS)
- P2171[1] : 2nd. Drive data set (DDS)
- P2171[2] : 3rd. Drive data set (DDS)

**Details:**

See diagram in P2170 (threshold current  $I_{thresh}$ )

<b>P2172[3]</b>	<b>Threshold DC-link voltage</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Def:</b> 800
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 2000	<b>3</b>

Defines DC link voltage to be compared to actual voltage as illustrated in the diagram below.

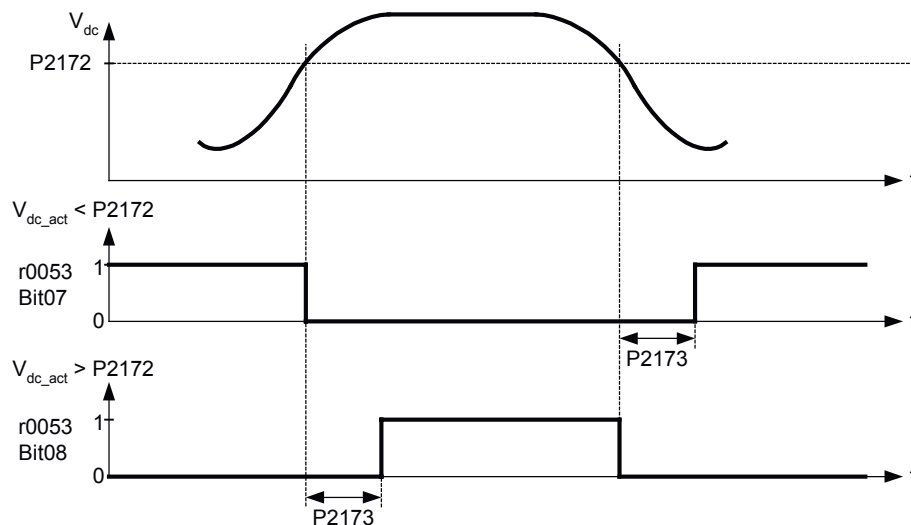

**Index:**

- P2172[0] : 1st. Drive data set (DDS)
- P2172[1] : 2nd. Drive data set (DDS)
- P2172[2] : 3rd. Drive data set (DDS)

**Note:**

This voltage controls bits 7 and 8 in status word 3 (r0053).

<b>P2173[3]</b>	<b>Delay time DC-link voltage</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Def:</b> 10
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 10000	<b>3</b>

Defines delay time prior to activation of threshold comparison.

**Index:**


- P2173[0] : 1st. Drive data set (DDS)
- P2173[1] : 2nd. Drive data set (DDS)
- P2173[2] : 3rd. Drive data set (DDS)

**Details:**

See diagram in P2172 (threshold DC-link voltage)

<b>P2174[3]</b>	<b>Torque threshold M_thresh</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Def:</b> 5.13
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 99999.00	<b>2</b>

Defines torque threshold for comparing actual torque.

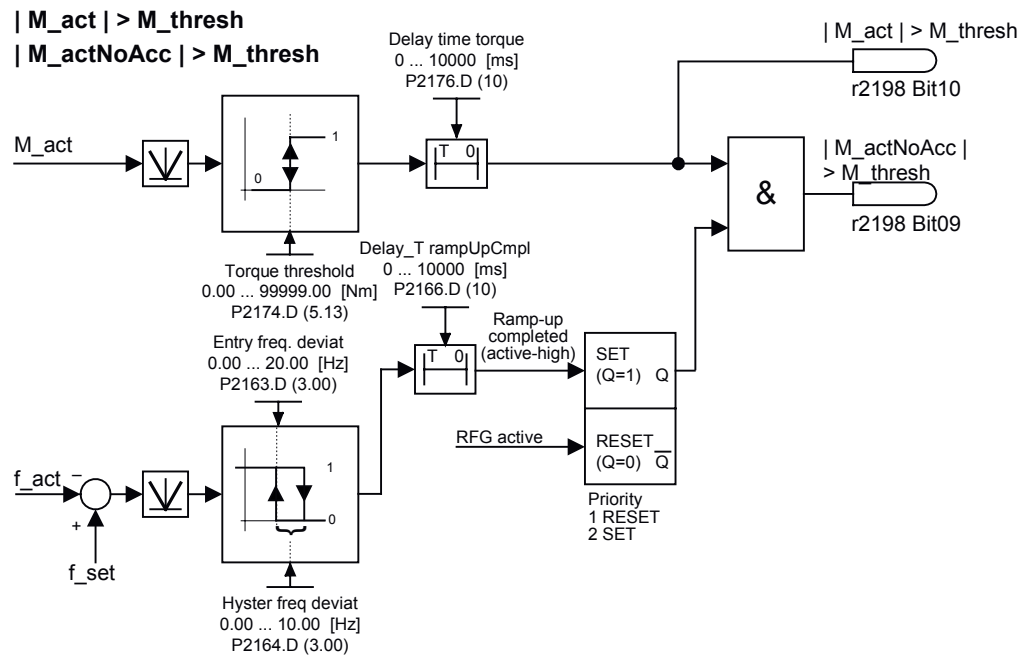

Index:

- P2174[0] : 1st. Drive data set (DDS)
- P2174[1] : 2nd. Drive data set (DDS)
- P2174[2] : 3rd. Drive data set (DDS)

<b>P2176[3]</b>	<b>Delay time for torque threshold</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Def:</b> 10
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 10000	<b>2</b>

Delay time for comparing actual torque to threshold.

Index:

- P2176[0] : 1st. Drive data set (DDS)
- P2176[1] : 2nd. Drive data set (DDS)
- P2176[2] : 3rd. Drive data set (DDS)

<b>P2177[3]</b>	<b>Delay time for motor is blocked</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Def:</b> 10
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 10000	<b>2</b>

Delay time for identification that motor is blocked.

Index:

- P2177[0] : 1st. Drive data set (DDS)
- P2177[1] : 2nd. Drive data set (DDS)
- P2177[2] : 3rd. Drive data set (DDS)

<b>P2178[3]</b>	<b>Delay time for motor pulled out</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Def:</b> 10
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 10000	<b>2</b>

Delay time for identification that motor is pulled out.


Index:

- P2178[0] : 1st. Drive data set (DDS)
- P2178[1] : 2nd. Drive data set (DDS)
- P2178[2] : 3rd. Drive data set (DDS)

<b>P2179</b>	<b>Current limit for no load ident.</b>	<b>Min:</b> 0.0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 3.0	<b>3</b>
		<b>Max:</b> 10.0	

Threshold current for A0922 (load missing) in [%] relative to P0305 (rated motor current) as illustrated in the diagram below.

**Load missing**

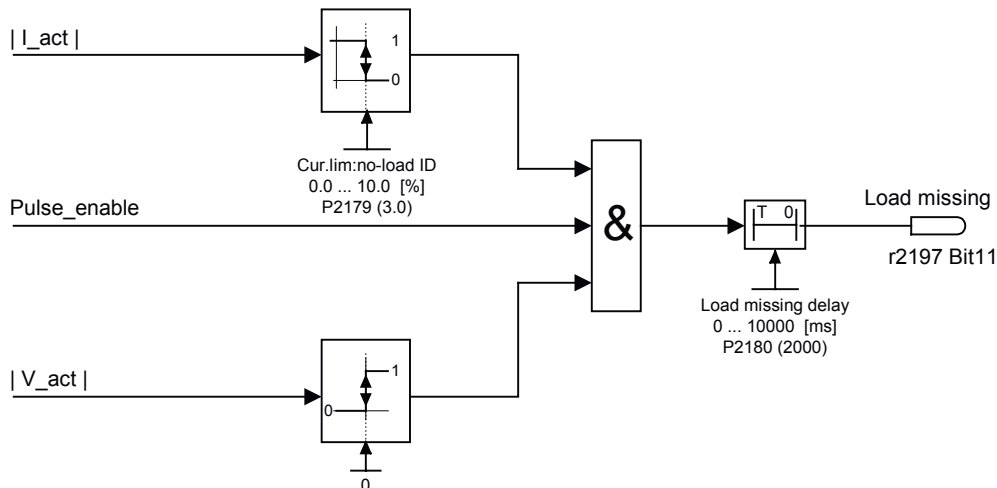

**Note:**

- It may be that the motor is not connected (load missing) or a phase could be missing.
- If a motor setpoint cannot be entered and the current limit (P2179) is not exceeded, Alarm A0922 (no load applied) is issued when delay time (P2180) expires.

<b>P2180</b>	<b>Delay time for load missing</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> ms
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Def:</b> 2000	<b>3</b>
		<b>Max:</b> 10000	

Delay time to identify that the current is less than the threshold defined in P2179.

**Details:**

See diagram in P2179 (current limit for no load identification).

### 3.36 Load torque monitoring

<b>P2181[3]</b>	<b>Belt failure detection mode</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -
	<b>P-Group:</b> ALARMS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
		<b>Def:</b> 0	<b>2</b>
		<b>Max:</b> 6	

Parameter P2181 activates or de-activates the load torque monitoring and defines the response to a load torque fault.

Using the load torque monitoring, it is possible to detect a mechanical failure or an overload condition of the mechanical transmission line, e.g. a broken drive belt or a stalled conveyor belt. In this case, the actual torque/frequency actual value is compared to a programmed envelope characteristic (refer to P2182 - P2190). If the actual torque/frequency actual value lies above or below the envelope curve, then after the delay time P2192 expires, as a function of P2181, alarm A0952 is output or the drive inverter is tripped with fault message F0452.

**Possible Settings:**

- 0 Belt failure detection disabled
- 1 Warning: Low torque / frequency
- 2 Warning: High torque / frequency
- 3 Warning: High / low torque / frequency
- 4 Trip: Low torque / frequency
- 5 Trip: High torque / frequency
- 6 Trip: High / low torque / frequency


**Index:**

- P2181[0] : 1st. Command data set (CDS)
- P2181[1] : 2nd. Command data set (CDS)
- P2181[2] : 3rd. Command data set (CDS)

<b>P2182[3]</b>	<b>Belt threshold frequency 1</b>			<b>Min:</b> 0.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> 5.00	
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 650.00	

Sets a frequency threshold 1 for comparing actual torque to torque the envelope for belt failure detection.

The frequency torque envelope is defined by 9 parameters - 3 are frequency parameters (P2182 - P2184), and the other 6 define the low and high torque limits (P2185 - P2190) for each frequency (see diagram below).

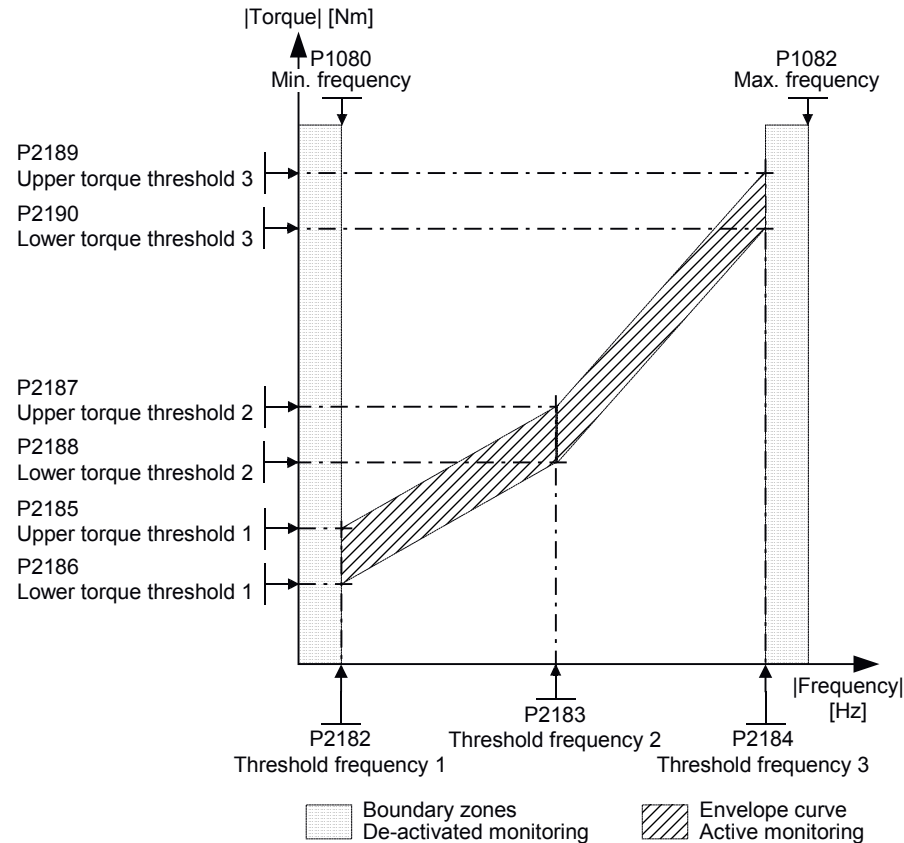

The allowed frequency/torque region is defined by the shaded area. When the torque falls outside the area shown, a trip or warning occurs (see parameter P2181).

**Index:**

- P2182[0] : 1st. Drive data set (DDS)
- P2182[1] : 2nd. Drive data set (DDS)
- P2182[2] : 3rd. Drive data set (DDS)

**Note:**

- The load torque monitoring function is not active below the frequency defined in P2182 and above the frequency defined in P2184.
- The current and torque limits of the drive inverter and motor still apply over the complete frequency range.
- The drive inverter output frequency is defined using Parameter P1080 and P1082. These limits should be carefully observed for the load torque monitoring frequencies.

<b>P2183[3]</b>	<b>Belt threshold frequency 2</b>			<b>Min:</b> 0.00	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> Hz	<b>Def:</b> 30.00	
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 650.00	

Sets a threshold F2 for comparing actual torque to torque the envelope for belt failure detection.

**Index:**

- P2183[0] : 1st. Drive data set (DDS)
- P2183[1] : 2nd. Drive data set (DDS)
- P2183[2] : 3rd. Drive data set (DDS)

**Details:**

See P2182 (belt threshold frequency 1).

<b>P2184[3]</b>	<b>Belt threshold frequency 3</b>	<b>Min:</b> 0.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Hz
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Sets a threshold F3 for comparing actual torque to torque the envelope for belt failure detection.

**Index:**

P2184[0] : 1st. Drive data set (DDS)  
P2184[1] : 2nd. Drive data set (DDS)  
P2184[2] : 3rd. Drive data set (DDS)

**Details:**

See P2182 (belt threshold frequency 1).

<b>P2185[3]</b>	<b>Upper torque threshold 1</b>	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Nm
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Upper limit threshold value 1 for comparing actual torque.

**Index:**

P2185[0] : 1st. Drive data set (DDS)  
P2185[1] : 2nd. Drive data set (DDS)  
P2185[2] : 3rd. Drive data set (DDS)

**Details:**

See P2182 (belt threshold frequency 1).

<b>P2186[3]</b>	<b>Lower torque threshold 1</b>	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Nm
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Lower limit threshold value 1 for comparing actual torque.

**Index:**

P2186[0] : 1st. Drive data set (DDS)  
P2186[1] : 2nd. Drive data set (DDS)  
P2186[2] : 3rd. Drive data set (DDS)

**Details:**

See P2182 (belt threshold frequency 1).

<b>P2187[3]</b>	<b>Upper torque threshold 2</b>	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Nm
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Upper limit threshold value 2 for comparing actual torque.

**Index:**

P2187[0] : 1st. Drive data set (DDS)  
P2187[1] : 2nd. Drive data set (DDS)  
P2187[2] : 3rd. Drive data set (DDS)

**Details:**

See P2182 (belt threshold frequency 1).

<b>P2188[3]</b>	<b>Lower torque threshold 2</b>	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Nm
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Lower limit threshold value 2 for comparing actual torque.

**Index:**

P2188[0] : 1st. Drive data set (DDS)  
P2188[1] : 2nd. Drive data set (DDS)  
P2188[2] : 3rd. Drive data set (DDS)

**Details:**

See P2182 (belt threshold frequency 1).

<b>P2189[3]</b>	<b>Upper torque threshold 3</b>	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Nm
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Upper limit threshold value 3 for comparing actual torque.

**Index:**

P2189[0] : 1st. Drive data set (DDS)  
P2189[1] : 2nd. Drive data set (DDS)  
P2189[2] : 3rd. Drive data set (DDS)

**Details:**

See P2182 (belt threshold frequency 1).

<b>P2190[3]</b>	<b>Lower torque threshold 3</b>	<b>Min:</b> 0.0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> Nm
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 0.0		
		<b>Max:</b> 99999.0		

Lower limit threshold value 3 for comparing actual torque.

**Index:**

P2190[0] : 1st. Drive data set (DDS)  
P2190[1] : 2nd. Drive data set (DDS)  
P2190[2] : 3rd. Drive data set (DDS)

**Details:**

See P2182 (belt threshold frequency 1).

<b>P2192[3]</b>	<b>Time delay for belt failure</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> s
	<b>P-Group:</b> ALARMS	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
		<b>Def:</b> 10		
		<b>Max:</b> 65		

P2192 defines a delay before warning/trip becomes active. It is used to eliminate events caused by transient conditions. It is used for both methods of fault detection.

**Index:**

P2192[0] : 1st. Drive data set (DDS)  
P2192[1] : 2nd. Drive data set (DDS)  
P2192[2] : 3rd. Drive data set (DDS)

<b>r2197</b>	<b>CO/BO: Monitoring word 1</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>	
		<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> ALARMS			<b>Def:</b> -
		<b>Max:</b> -		

Monitoring word 1 which indicates the state of monitor functions. Each bit represents one monitor function.

**Bitfields:**

Bit00	f_act <= P1080 (f_min)	0	NO	1	YES
Bit01	f_act <= P2155 (f_1)	0	NO	1	YES
Bit02	f_act > P2155 (f_1)	0	NO	1	YES
Bit03	f_act > zero	0	NO	1	YES
Bit04	f_act >= setp. (f_set)	0	NO	1	YES
Bit05	f_act > P2167 (f_off)	0	NO	1	YES
Bit06	f_act >= P1082 (f_max)	0	NO	1	YES
Bit07	f_act == setp. (f_set)	0	NO	1	YES
Bit08	Act. current r0068 > P2170	0	NO	1	YES
Bit09	Act. unfilt. Vdc < P2172	0	NO	1	YES
Bit10	Act. unfilt. Vdc > P2172	0	NO	1	YES
Bit11	Load missing	0	NO	1	YES

<b>r2198</b>	<b>CO/BO: Monitoring word 2</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>	
		<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> ALARMS			<b>Def:</b> -
		<b>Max:</b> -		

Monitoring word 2 which indicates the state of monitor functions. Each bit represents one monitor function.

**Bitfields:**

Bit00	f_act  <= P2157 (f_2)	0	NO	1	YES
Bit01	f_act  > P2157 (f_2)	0	NO	1	YES
Bit02	f_act  <= P2159 (f_3)	0	NO	1	YES
Bit03	f_act  > P2159 (f_3)	0	NO	1	YES
Bit04	f_set  < P2161 (f_min_set)	0	NO	1	YES
Bit05	f_set > 0	0	NO	1	YES
Bit06	Motor blocked	0	NO	1	YES
Bit07	Motor pulled out	0	NO	1	YES
Bit08	I_act r0068  > P2170	0	NO	1	YES
Bit09	m_act  > P2174 & setpoint reached	0	NO	1	YES
Bit10	m_act  > P2174	0	NO	1	YES
Bit11	Belt failure warning	0	NO	1	YES
Bit12	Belt failure trip	0	NO	1	YES




### 3.37 Technology controller (PID controller)

P2200[3]	<b>BI: Enable PID controller</b>	<b>Min:</b> 0:0	<b>Level 2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Allows user to enable/disable the PID controller.

**P2200 settings :**

- 0 : PID controller de-activated
- 1 : PID controller permanently activated
- BICO parameters : PID controller event-controlled, de-activated/activated

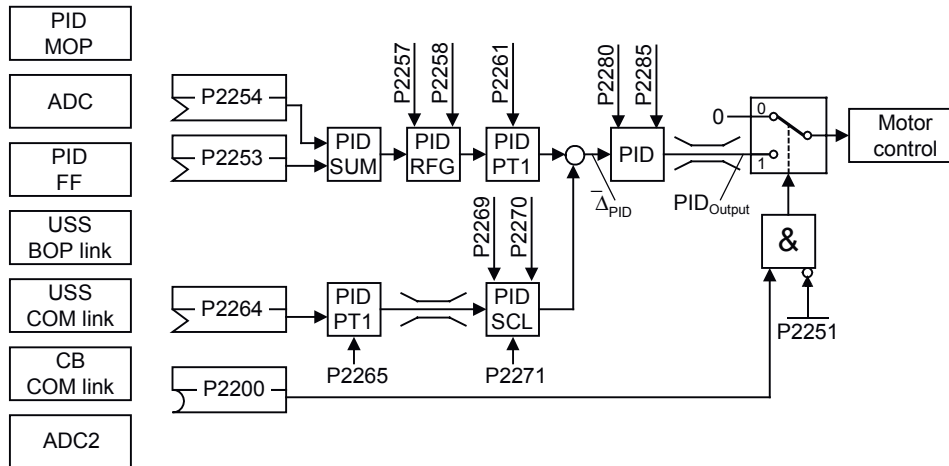

**Index:**

- P2200[0] : 1st. Command data set (CDS)
- P2200[1] : 2nd. Command data set (CDS)
- P2200[2] : 3rd. Command data set (CDS)

**Common Settings:**

Parameter	Parameter text	Setting	Meaning
P2200	BI: Enable PID controller	0	PID controller de-activated
		1.0	PID controller always active
		722.x	Digital input x
		BICO	BICO parameter
P2251	PID mode	0	PID as setpoint
P2253	CI: PID setpoint	2224	Fixed PID setpoint (PID-FF)
		2250	PID-MOP
		755.0	Analog input 1
		2015.1	USS on BOP link
		2019.1	USS on COM link
P2264	CI: PID feedback	755.0	Analog input 1
		755.1	Analog input 2

**Dependency:**

Setting 1 automatically disables normal ramp times set in P1120 and P1121 and the normal frequency setpoints.

Following an OFF1 or OFF3 command, however, the inverter frequency will ramp down to zero using the ramp time set in P1121 (P1135 for OFF3).

**Note:**

The PID setpoint source is selected using P2253. The PID setpoint and the PID feedback signal are interpreted as [%] values (not [Hz]). The output of the PID controller is displayed as [%] and then normalized into [Hz] through P2000 (reference frequency) when PID is enabled.

In level 3, the PID controller source enable can also come from the digital inputs in settings 722.0 to 722.5 for DIN1 to DIN6 or from any other BiCo source.

**Notice:**

The minimum and maximum motor frequencies (P1080 and P1082) as well as the skip frequencies (P1091 to P1094) remain active on the inverter output. However, enabling skip frequencies with PID control can produce instabilities.

<b>P2201[3]</b>	<b>Fixed PID setpoint 1</b>				<b>Min:</b> -200.00	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 0.00		
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00		

Defines Fixed PID Setpoint 1

There are three options available for selection of the PID fixed setpoints:

1. Direct selection
  2. Direct selection + ON command
  3. Binary coded selection + ON command
1. Direct selection (P0701 - P0706 = 15):
    - In this mode of operation, 1 digital input selects one PID fixed setpoint.
    - If several inputs are active together, the selected setpoints are summed.
    - E.g.: PID-FF1 + PID-FF2 + PID-FF3 + PID-FF4 + PID-FF5 + PID-FF6.
  2. Direct selection + ON command (P0701 - P0706 = 16):
    - Description as for 1), except that this type of selection issues an ON command concurrent with any setpoint selection.
    - If several inputs are active together, the selected setpoints are summed.
    - E.g.: PID-FF1 + PID-FF2 + PID-FF3 + PID-FF4 + PID-FF5 + PID-FF6.
  3. Binary coded selection + ON command (P0701 - P0706 = 17):
    - Using this method to select the fixed PID setpoint (FF-PID) allows you to choose up to 16 different PID setpoints.
    - The setpoints are selected according to the following table:

**Index:**

P2201[0] : 1st. Drive data set (DDS)  
P2201[1] : 2nd. Drive data set (DDS)  
P2201[2] : 3rd. Drive data set (DDS)


**Example:**

Binary coded selection :

		DIN4	DIN3	DIN2	DIN1
0 %	PID - FF0	0	0	0	0
P1001	PID - FF1	0	0	0	1
P1002	PID - FF2	0	0	1	0
P1003	PID - FF3	0	0	1	1
P1004	PID - FF4	0	1	0	0
P1005	PID - FF5	0	1	0	1
P1006	PID - FF6	0	1	1	0
P1007	PID - FF7	0	1	1	1
P1008	PID - FF8	1	0	0	0
P1009	PID - FF9	1	0	0	1
P1010	PID - FF10	1	0	1	0
P1011	PID - FF11	1	0	1	1
P1012	PID - FF12	1	1	0	0
P1013	PID - FF13	1	1	0	1
P1014	PID - FF14	1	1	1	0
P1015	PID - FF15	1	1	1	1

Direct selection of PID-FF1 P2201 via DIN 1:

P0701 = 15  
or  
P0701 = 99, P2220 = 722.0, P2216 = 1

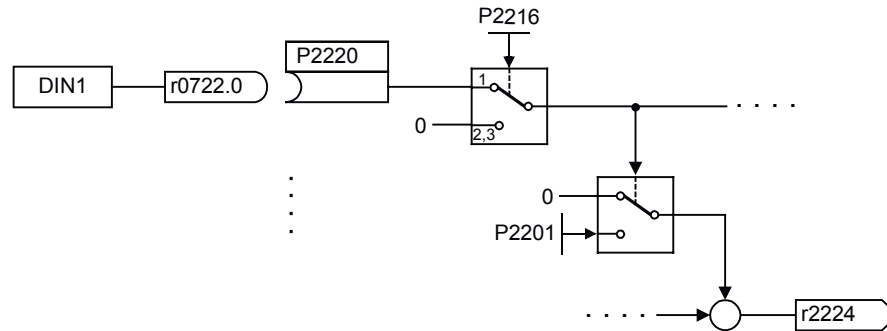

**Dependency:**

P2200 = 1 required in user access level 2 to enable setpoint source.

**Note:**

You may mix different types of frequencies; however, remember that they will be summed if selected together.

P2201 = 100 % corresponds to 4000 hex

<b>P2202[3]</b>	<b>Fixed PID setpoint 2</b>	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -200.00	<b>Def:</b> 10.00	<b>Level</b>
		<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00		<b>2</b>

Defines Fixed PID Setpoint 2

**Index:**

P2202[0] : 1st. Drive data set (DDS)  
P2202[1] : 2nd. Drive data set (DDS)  
P2202[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2203[3]</b>	<b>Fixed PID setpoint 3</b>	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -200.00	<b>Def:</b> 20.00	<b>Level</b>
		<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00		<b>2</b>

Defines Fixed PID Setpoint 3

**Index:**

P2203[0] : 1st. Drive data set (DDS)  
P2203[1] : 2nd. Drive data set (DDS)  
P2203[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 fixed PID setpoint 1 (FF-PID 1).

<b>P2204[3]</b>	<b>Fixed PID setpoint 4</b>	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -200.00	<b>Def:</b> 30.00	<b>Level</b>
		<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00		<b>2</b>

Defines Fixed PID Setpoint 4

**Index:**

P2204[0] : 1st. Drive data set (DDS)  
P2204[1] : 2nd. Drive data set (DDS)  
P2204[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2205[3]</b>	<b>Fixed PID setpoint 5</b>	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -200.00	<b>Def:</b> 40.00	<b>Level</b>
		<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00		<b>2</b>

Defines Fixed PID Setpoint 5

**Index:**

P2205[0] : 1st. Drive data set (DDS)  
P2205[1] : 2nd. Drive data set (DDS)  
P2205[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2206[3]</b>	<b>Fixed PID setpoint 6</b>			<b>Min:</b> -200.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 50.00	
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00	

Defines Fixed PID Setpoint 6

**Index:**

P2206[0] : 1st. Drive data set (DDS)  
P2206[1] : 2nd. Drive data set (DDS)  
P2206[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2207[3]</b>	<b>Fixed PID setpoint 7</b>			<b>Min:</b> -200.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 60.00	
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00	

Defines Fixed PID Setpoint 7

**Index:**

P2207[0] : 1st. Drive data set (DDS)  
P2207[1] : 2nd. Drive data set (DDS)  
P2207[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2208[3]</b>	<b>Fixed PID setpoint 8</b>			<b>Min:</b> -200.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 70.00	
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00	

Defines Fixed PID Setpoint 8

**Index:**

P2208[0] : 1st. Drive data set (DDS)  
P2208[1] : 2nd. Drive data set (DDS)  
P2208[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2209[3]</b>	<b>Fixed PID setpoint 9</b>			<b>Min:</b> -200.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 80.00	
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00	

Defines Fixed PID Setpoint 9

**Index:**

P2209[0] : 1st. Drive data set (DDS)  
P2209[1] : 2nd. Drive data set (DDS)  
P2209[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2210[3]</b>	<b>Fixed PID setpoint 10</b>			<b>Min:</b> -200.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 90.00	
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00	

Defines Fixed PID Setpoint 10

**Index:**

P2210[0] : 1st. Drive data set (DDS)  
P2210[1] : 2nd. Drive data set (DDS)  
P2210[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2211[3]</b>	<b>Fixed PID setpoint 11</b>			<b>Min:</b> -200.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 100.00	
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00	

Defines Fixed PID Setpoint 11

**Index:**

P2211[0] : 1st. Drive data set (DDS)  
P2211[1] : 2nd. Drive data set (DDS)  
P2211[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2212[3]</b>	<b>Fixed PID setpoint 12</b>	<b>Min:</b> -200.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
	<b>Def:</b> 110.00	<b>Max:</b> 200.00	<b>2</b>

Defines Fixed PID Setpoint 12

**Index:**

P2212[0] : 1st. Drive data set (DDS)  
P2212[1] : 2nd. Drive data set (DDS)  
P2212[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2213[3]</b>	<b>Fixed PID setpoint 13</b>	<b>Min:</b> -200.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
	<b>Def:</b> 120.00	<b>Max:</b> 200.00	<b>2</b>

Defines Fixed PID Setpoint 13

**Index:**

P2213[0] : 1st. Drive data set (DDS)  
P2213[1] : 2nd. Drive data set (DDS)  
P2213[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2214[3]</b>	<b>Fixed PID setpoint 14</b>	<b>Min:</b> -200.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
	<b>Def:</b> 130.00	<b>Max:</b> 200.00	<b>2</b>

Defines Fixed PID Setpoint 14

**Index:**

P2214[0] : 1st. Drive data set (DDS)  
P2214[1] : 2nd. Drive data set (DDS)  
P2214[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2215[3]</b>	<b>Fixed PID setpoint 15</b>	<b>Min:</b> -200.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
	<b>Def:</b> 130.00	<b>Max:</b> 200.00	<b>2</b>

Defines Fixed PID Setpoint 15

**Index:**

P2215[0] : 1st. Drive data set (DDS)  
P2215[1] : 2nd. Drive data set (DDS)  
P2215[2] : 3rd. Drive data set (DDS)

**Details:**

See P2201 (Fixed PID Setpoint 1).

<b>P2216</b>	<b>Fixed PID setpoint mode - Bit 0</b>	<b>Min:</b> 1	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
	<b>Def:</b> 1	<b>Max:</b> 3	<b>3</b>

Fixed frequencies for PID setpoint can be selected in three different modes. Parameter P2216 defines the mode of selection Bit 0.

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command
- 3 Binary coded selection + ON command

<b>P2217</b>	<b>Fixed PID setpoint mode - Bit 1</b>	<b>Min:</b> 1	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
	<b>Def:</b> 1	<b>Max:</b> 3	<b>3</b>

BCD or direct selection Bit 1 for PID setpoint.

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command
- 3 Binary coded selection + ON command

<b>P2218</b>	<b>Fixed PID setpoint mode - Bit 2</b>	<b>Min:</b> 1	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
	<b>Def:</b> 1	<b>Max:</b> 3	<b>3</b>

BCD or direct selection Bit 2 for PID setpoint.

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command
- 3 Binary coded selection + ON command

<b>P2219</b>	<b>Fixed PID setpoint mode - Bit 3</b>				Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 1	
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 3	

BCD or direct selection Bit 3 for PID setpoint.

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command
- 3 Binary coded selection + ON command

<b>P2220[3]</b>	<b>BI: Fixed PID setp. select Bit 0</b>				Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Defines command source of fixed PID setpoint selection Bit 0

**Index:**

- P2220[0] : 1st. Command data set (CDS)
- P2220[1] : 2nd. Command data set (CDS)
- P2220[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)

<b>P2221[3]</b>	<b>BI: Fixed PID setp. select Bit 1</b>				Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Defines command source of fixed PID setpoint selection Bit 1.

**Index:**

- P2221[0] : 1st. Command data set (CDS)
- P2221[1] : 2nd. Command data set (CDS)
- P2221[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)

<b>P2222[3]</b>	<b>BI: Fixed PID setp. select Bit 2</b>				Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Defines command source of fixed PID setpoint selection Bit 2

**Index:**

- P2222[0] : 1st. Command data set (CDS)
- P2222[1] : 2nd. Command data set (CDS)
- P2222[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)

<b>P2223[3]</b>	<b>BI: Fixed PID setp. select Bit 3</b>				Level <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 722:3	
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Defines command source of fixed PID setpoint selection Bit 3

**Index:**

- P2223[0] : 1st. Command data set (CDS)
- P2223[1] : 2nd. Command data set (CDS)
- P2223[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)

<b>r2224</b>	<b>CO: Act. fixed PID setpoint</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -	Level <b>2</b>
	<b>P-Group:</b> TECH			<b>Def:</b> - <b>Max:</b> -	

Displays total output of PID fixed setpoint selection.

**Note:**

r2224 = 100 % corresponds to 4000 hex

<b>P2225</b>	<b>Fixed PID setpoint mode - Bit 4</b>	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 1	Level <b>3</b>
	<b>P-Group:</b> TECH		<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 1 <b>Max:</b> 2	

Direct selection or direct selection + ON Bit 4 for PID setpoint.

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command

<b>P2226[3]</b>	<b>BI: Fixed PID setp. select Bit 4</b>	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	Level <b>3</b>
	<b>P-Group:</b> COMMANDS		<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 722:4 <b>Max:</b> 4000:0	

Defines command source of fixed PID setpoint selection Bit 4

**Index:**

- P2226[0] : 1st. Command data set (CDS)
- P2226[1] : 2nd. Command data set (CDS)
- P2226[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)

<b>P2227</b>	<b>Fixed PID setpoint mode - Bit 5</b>	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 1	Level <b>3</b>
	<b>P-Group:</b> TECH		<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 1 <b>Max:</b> 2	

Direct selection / direct selection + ON Bit 5 for PID setpoint.

**Possible Settings:**

- 1 Direct selection
- 2 Direct selection + ON command

<b>P2228[3]</b>	<b>BI: Fixed PID setp. select Bit 5</b>	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	Level <b>3</b>
	<b>P-Group:</b> COMMANDS		<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 722:5 <b>Max:</b> 4000:0	

Defines command source of fixed PID setpoint selection Bit 5

**Index:**

- P2228[0] : 1st. Command data set (CDS)
- P2228[1] : 2nd. Command data set (CDS)
- P2228[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)

<b>P2231[3]</b>	<b>Setpoint memory of PID-MOP</b>	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> 0	Level <b>2</b>
	<b>P-Group:</b> TECH		<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 0 <b>Max:</b> 1	

Setpoint memory

**Possible Settings:**

- 0 PID-MOP setpoint will not be stored
- 1 PID-MOP setpoint will be stored (P2240 is updated)

**Index:**

- P2231[0] : 1st. Drive data set (DDS)
- P2231[1] : 2nd. Drive data set (DDS)
- P2231[2] : 3rd. Drive data set (DDS)

**Dependency:**

P2231 = 0:  
If 0 selected, setpoint returns to value set in P2240 (setpoint of PID-MOP) after an OFF command.

P2231 = 1:  
If 1 is selected, active setpoint is 'remembered' and P2240 updated with current value.

**Details:**

See P2240 (setpoint of PID-MOP)



<b>P2232</b>	<b>Inhibit neg. PID-MOP setpoints</b>				<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 1		
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 1		

This parameter suppresses negative setpoints of the PID-MOP output r2250.

**Possible Settings:**

- 0 Neg. PID-MOP setpoint is allowed
- 1 Neg. PID-MOP setpoint inhibited

**Note:**

Setting 0 enables a change of motor direction using the motor potentiometer setpoint (increase/decrease frequency either by using digital inputs or motor potentiometer up/down buttons).

<b>P2235[3]</b>	<b>BI: Enable PID-MOP (UP-cmd)</b>				<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 19:13		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines source of UP command.

**Index:**

- P2235[0] : 1st. Command data set (CDS)
- P2235[1] : 2nd. Command data set (CDS)
- P2235[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 19.D = Keypad UP button

**Dependency:**

To change setpoint:

1. Use UP / DOWN key on BOP or
2. Set P0702/P0703 = 13/14 (function of digital inputs 2 and 3)

<b>P2236[3]</b>	<b>BI: Enable PID-MOP (DOWN-cmd)</b>				<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 19:14		
	<b>P-Group:</b> COMMANDS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0		

Defines source of DOWN command.

**Index:**

- P2236[0] : 1st. Command data set (CDS)
- P2236[1] : 2nd. Command data set (CDS)
- P2236[2] : 3rd. Command data set (CDS)

**Common Settings:**

- 722.0 = Digital input 1 (requires P0701 to be set to 99, BICO)
- 722.1 = Digital input 2 (requires P0702 to be set to 99, BICO)
- 722.2 = Digital input 3 (requires P0703 to be set to 99, BICO)
- 722.3 = Digital input 4 (requires P0704 to be set to 99, BICO)
- 722.4 = Digital input 5 (requires P0705 to be set to 99, BICO)
- 722.5 = Digital input 6 (requires P0706 to be set to 99, BICO)
- 722.6 = Digital input 7 (via analog input 1, requires P0707 to be set to 99)
- 722.7 = Digital input 8 (via analog input 2, requires P0708 to be set to 99)
- 19.E = Keypad DOWN button

**Dependency:**

To change setpoint:

1. Use UP / DOWN key on BOP or
2. Set P0702/P0703 = 13/14 (function of digital inputs 2 and 3)

<b>P2240[3]</b>	<b>Setpoint of PID-MOP</b>				<b>Min:</b> -200.00	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 10.00		
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00		

Setpoint of the motor potentiometer.

Allows user to set a digital PID setpoint in [%].

**Index:**

- P2240[0] : 1st. Drive data set (DDS)
- P2240[1] : 2nd. Drive data set (DDS)
- P2240[2] : 3rd. Drive data set (DDS)


**Note:**

P2240 = 100 % corresponds to 4000 hex



<b>r2250</b>	<b>CO: Output setpoint of PID-MOP</b>	<b>Min:</b> -	<b>Level</b>
	<b>Datatype:</b> Float <b>Unit:</b> %	<b>Def:</b> -	<b>2</b>
<b>P-Group:</b> TECH		<b>Max:</b> -	

Displays output setpoint of motor potentiometer in [%].

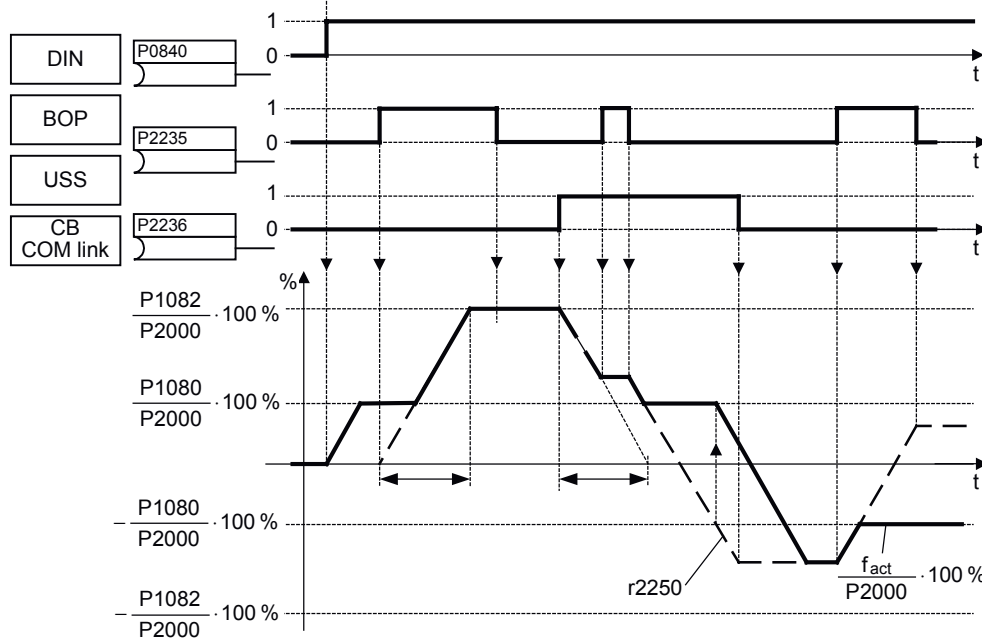

**Note:**

r2250 = 100 % corresponds to 4000 hex

<b>P2251</b>	<b>PID mode</b>	<b>Min:</b> 0	<b>Level</b>
	<b>CStat:</b> CT <b>Datatype:</b> U16 <b>Unit:</b> -	<b>Def:</b> 0	<b>3</b>
	<b>P-Group:</b> TECH <b>Active:</b> Immediately <b>QuickComm.:</b> No	<b>Max:</b> 1	


Configuration of PID controller.

**Possible Settings:**

- 0 PID as setpoint
- 1 PID as trim

**Common Settings:**

In addition to the open-loop/closed-loop control of a three-phase motor (standard applications for a drive inverter), MICROMASTER has a technological controller that can be used to control (closed-loop) process quantities such as pressure, filling level or control a winder. These applications and the closed-loop control structures required to implement these are shown in the following diagram.

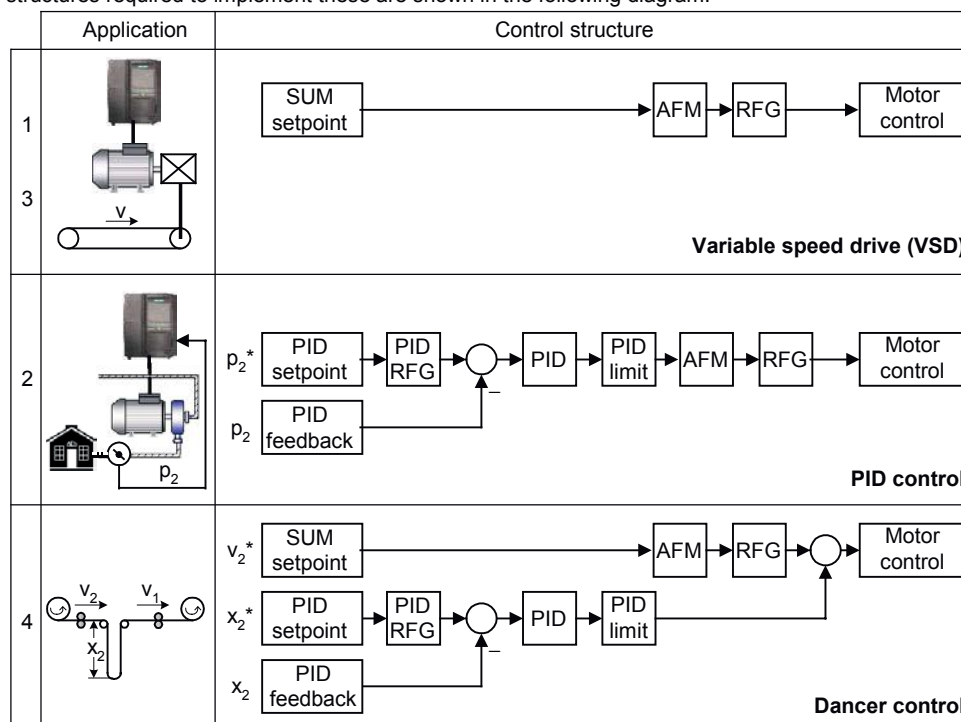


These structures are selected using parameters P2200 and P2251 (refer to the following table).

		Setpoint via		RFG	PID-RFG
		SUM	PID controller		
1	P2200 = 0:0 <sup>2)</sup> P2251 = 0	VSD	—	ON: active OFF1/3: active	ON: - OFF1/3: -
2	P2200 = 1:0 <sup>2)</sup> P2251 = 0	—	PID control	ON: - OFF1/3: active	ON: active OFF1/3: -
3	P2200 = 0:0 <sup>1)</sup> P2251 = 1	VSD	—	ON: active OFF1/3: active	ON: - OFF1/3: -
4	P2200 = 1:0 <sup>1)</sup> P2251 = 1	Dancer control		ON: active OFF1/3: active	ON: active OFF1/3: active

- 1) will take change with drive running
- 2) change only taken when drive stopped

Closed-loop dancer roll control is selected with P2251=P2200=1. Important parameters and the structure are shown in the following diagrams.

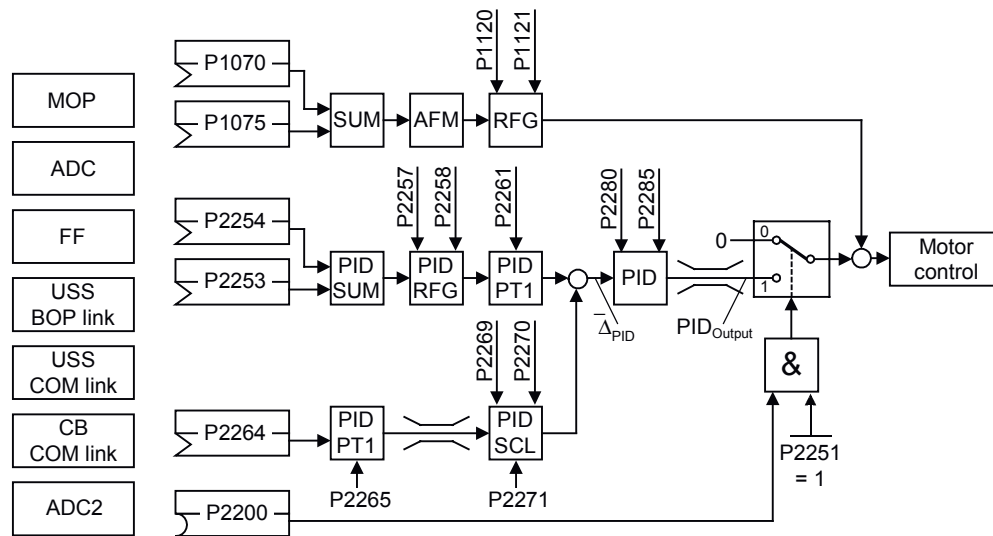


Parameter	Parameter text	Setting	Meaning
P1070	CI: Main setpoint	1024	Fixed setpoint (FF)
		1050	MOP
		755.0	Analog input 1
		2015.1	USS on BOP link
		2019.1	USS on COM link
		2050.1	CB on COM link
P2200	BI: Enable PID controller	0	PID controller de-activated
		1.0	PID controller always active
		722.x	Digital input x
		BICO	BICO parameter
P2251	PID mode	1	PID as trim
P2253	CI: PID setpoint	1024	Fixed setpoint (FF)
		1050	MOP
		755.0	Analog input 1
		2015.1	USS on BOP link
		2019.1	USS on COM link
		2050.1	CB on COM link
P2264	CI: PID feedback	755.0	Analog input 1
		755.1	Analog input 2

**Dependency:**

Active when PID loop is enabled (see P2200).

<b>P2253[3]</b>	<b>CI: PID setpoint</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

Defines setpoint source for PID setpoint input.

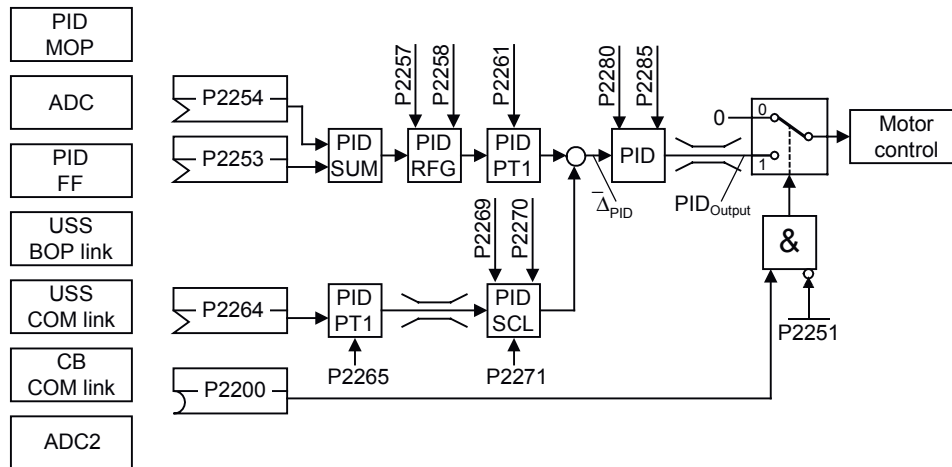

**Index:**

- P2253[0] : 1st. Command data set (CDS)
- P2253[1] : 2nd. Command data set (CDS)
- P2253[2] : 3rd. Command data set (CDS)

**Common Settings:**

Parameter	Parameter text	Setting	Meaning
P2200	BI: Enable PID controller	0	PID controller de-activated
		1.0	PID controller always active
		722.x	Digital input x
		BICO	BICO parameter
P2251	PID mode	0	PID as setpoint
P2253	CI: PID setpoint	2224	Fixed PID setpoint (PID-FF)
		2250	PID-MOP
		755.0	Analog input 1
		2015.1	USS on BOP link
		2019.1	USS on COM link
P2264	CI: PID feedback	755.0	Analog input 1
		755.1	Analog input 2

<b>P2254[3]</b>	<b>CI: PID trim source</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

Selects trim source for PID setpoint. This signal is multiplied by the trim gain and added to the PID setpoint.

**Index:**

- P2254[0] : 1st. Command data set (CDS)
- P2254[1] : 2nd. Command data set (CDS)
- P2254[2] : 3rd. Command data set (CDS)

**Common Settings:**

See parameter P2253

<b>P2255</b>	<b>PID setpoint gain factor</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> 0.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 100.00	
	<b>P-Group:</b> TECH			<b>Max:</b> 100.00	

Gain factor for PID setpoint. The PID setpoint input is multiplied by this gain factor to produce a suitable ratio between setpoint and trim.


<b>P2256</b>	<b>PID trim gain factor</b>	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Min:</b> 0.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Def:</b> 100.00	
	<b>P-Group:</b> TECH			<b>Max:</b> 100.00	

Gain factor for PID trim. This gain factor scales the trim signal, which is added to the main PID setpoint.

<b>P2257</b>	<b>Ramp-up time for PID setpoint</b>	<b>Min:</b> 0.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> s
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
	<b>Def:</b> 1.00	<b>Max:</b> 650.00		

Sets the ramp-up time for the PID setpoint.

PID Setpoint (%)

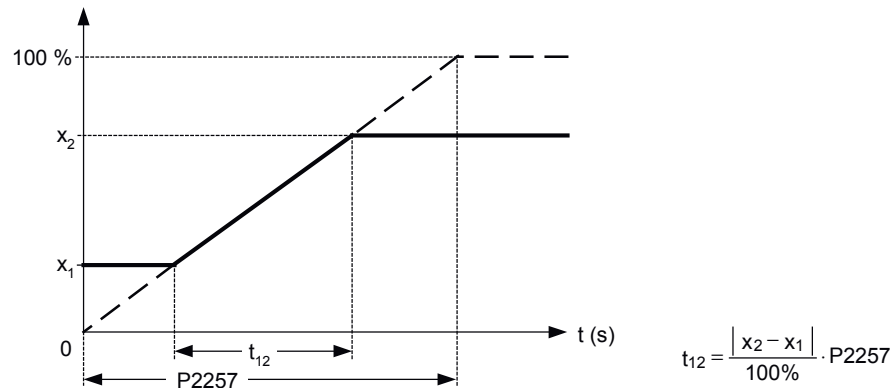

**Dependency:**

P2200 = 1 (PID control is enabled) disables normal ramp-up time (P1120).

PID ramp time effective only on PID setpoint and only active when PID setpoint is changed or when RUN command is given.


**Notice:**

Setting the ramp-up time too short may cause the inverter to trip, on overcurrent for example.

<b>P2258</b>	<b>Ramp-down time for PID setpoint</b>	<b>Min:</b> 0.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> s
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately		<b>QuickComm.:</b> No
	<b>Def:</b> 1.00	<b>Max:</b> 650.00		

Sets ramp-down time for PID setpoint.

PID Setpoint (%)

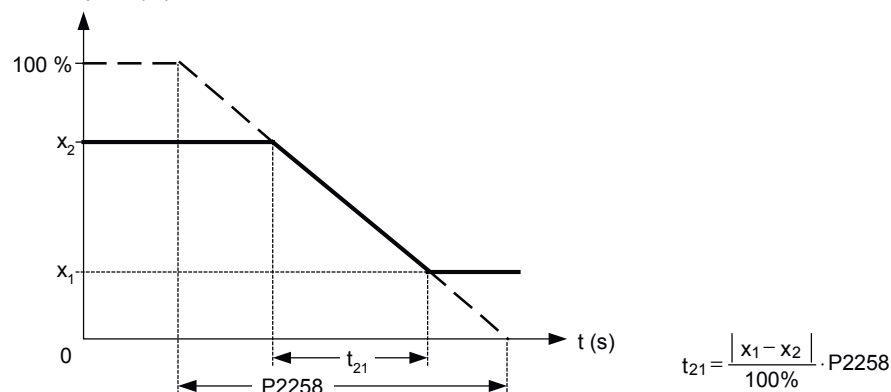

**Dependency:**

P2200 = 1 (PID control is enabled) disables normal ramp-up time (P1120).

PID setpoint ramp effective only on PID setpoint changes.

P1121 (ramp-down time) and P1135 (OFF3 ramp-down time) define the ramp times used after OFF1 and OFF3 respectively.

**Notice:**

Setting the ramp-down time too short can cause the inverter to trip on overvoltage (F0002) / overcurrent (F0001).

<b>r2260</b>	<b>CO: PID setpoint after PID-RFG</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>	
		<b>Datatype:</b> Float		<b>Unit:</b> %
	<b>P-Group:</b> TECH	<b>Def:</b> -		<b>Max:</b> -

Displays total active PID setpoint after PID-RFG in [%].

**Note:**

r2260 = 100 % corresponds to 4000 hex

<b>P2261</b>	<b>PID setpoint filter timeconstant</b>	<b>Min:</b> 0.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> s <b>Def:</b> 0.00	<b>Max:</b> 60.00	
	<b>P-Group:</b> TECH <b>Active:</b> Immediately <b>QuickComm.:</b> No		

Sets a time constant for smoothing the PID setpoint.

**Note:**

0 = no smoothing

<b>r2262</b>	<b>CO: Filtered PID setp. after RFG</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> -	<b>Max:</b> -	
	<b>P-Group:</b> TECH		

Displays filtered PID setpoint after PID-RFG in [%].

**Note:**

r2262 = 100 % corresponds to 4000 hex

<b>P2263</b>	<b>PID controller type</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CT <b>Datatype:</b> U16 <b>Unit:</b> - <b>Def:</b> 0	<b>Max:</b> 1	
	<b>P-Group:</b> TECH <b>Active:</b> Immediately <b>QuickComm.:</b> No		

Sets the PID controller type.

**Possible Settings:**

- 0 D component on feedback signal
- 1 D component on error signal

<b>P2264[3]</b>	<b>CI: PID feedback</b>	<b>Min:</b> 0:0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT <b>Datatype:</b> U32 <b>Unit:</b> - <b>Def:</b> 755:0	<b>Max:</b> 4000:0	
	<b>P-Group:</b> TECH <b>Active:</b> first confirm <b>QuickComm.:</b> No		

Selects the source of the PID feedback signal.

**Index:**

- P2264[0] : 1st. Command data set (CDS)
- P2264[1] : 2nd. Command data set (CDS)
- P2264[2] : 3rd. Command data set (CDS)

**Common Settings:**

Parameter	Parameter text	Setting	Meaning
P2200	BI: Enable PID controller	0	PID controller de-activated
		1.0	PID controller always active
		722.x	Digital input x
		BICO	BICO parameter
P2251	PID mode	0	PID as setpoint
P2253	CI: PID setpoint	2224	Fixed PID setpoint (PID-FF)
		2250	PID-MOP
		755.0	Analog input 1
		2015.1	USS on BOP link
		2019.1	USS on COM link
		2050.1	CB on COM link
P2264	CI: PID feedback	755.0	Analog input 1
		755.1	Analog input 2

**Note:**

When analog input is selected, offset and gain can be implemented using parameters P0756 to P0760 (ADC scaling).

<b>P2265</b>	<b>PID feedback filter timeconstant</b>	<b>Min:</b> 0.00	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> s <b>Def:</b> 0.00	<b>Max:</b> 60.00	
	<b>P-Group:</b> TECH <b>Active:</b> Immediately <b>QuickComm.:</b> No		

Defines time constant for PID feedback filter.

<b>r2266</b>	<b>CO: PID filtered feedback</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> -	<b>Max:</b> -	
	<b>P-Group:</b> TECH		

Displays PID feedback signal in [%].

**Note:**

r2266 = 100 % corresponds to 4000 hex

<b>P2267</b>	<b>Max. value for PID feedback</b>	<b>Min:</b> -200.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> 100.00	<b>Max:</b> 200.00	
	<b>P-Group:</b> TECH <b>Active:</b> Immediately <b>QuickComm.:</b> No		

Sets the upper limit for the value of the feedback signal in [%].

**Note:**

- P2267 = 100 % corresponds to 4000 hex
- When PID is enabled (P2200 = 1) and the signal rises above this value, the inverter will trip with F0222.

<b>P2268</b>	<b>Min. value for PID feedback</b>	<b>Min:</b> -200.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> 0.00	<b>Max:</b> 200.00	
	<b>P-Group:</b> TECH <b>Active:</b> Immediately <b>QuickComm.:</b> No		

Sets lower limit for value of feedback signal in [%].

**Note:**

- P2268 = 100 % corresponds to 4000 hex
- When PID is enabled (P2200 = 1) and the signal rises below this value, the inverter will trip with F0221.

<b>P2269</b>	<b>Gain applied to PID feedback</b>	<b>Min:</b> 0.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT <b>Datatype:</b> Float <b>Unit:</b> - <b>Def:</b> 100.00	<b>Max:</b> 500.00	
	<b>P-Group:</b> TECH <b>Active:</b> Immediately <b>QuickComm.:</b> No		

Allows the user to scale the PID feedback as a percentage value [%].

A gain of 100.0 % means that feedback signal has not changed from its default value.

<b>P2270</b>	<b>PID feedback function selector</b>	<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT <b>Datatype:</b> U16 <b>Unit:</b> - <b>Def:</b> 0	<b>Max:</b> 3	
	<b>P-Group:</b> TECH <b>Active:</b> Immediately <b>QuickComm.:</b> No		

Applies mathematical functions to the PID feedback signal, allowing multiplication of the result by P2269 (gain applied to PID feedback).

**Possible Settings:**

- 0 Disabled
- 1 Square root (root(x))
- 2 Square (x\*x)
- 3 Cube (x\*x\*x)

<b>P2271</b>	<b>PID transducer type</b>	<b>Min:</b> 0	<b>Level</b> <b>2</b>
	<b>CStat:</b> CUT <b>Datatype:</b> U16 <b>Unit:</b> - <b>Def:</b> 0	<b>Max:</b> 1	
	<b>P-Group:</b> TECH <b>Active:</b> Immediately <b>QuickComm.:</b> No		

Allows the user to select the transducer type for the PID feedback signal.

**Possible Settings:**

- 0 Disabled
- 1 Inversion of PID feedback signal

**Notice:**

It is essential that you select the correct transducer type.

If you are unsure whether 0 or 1 is applicable, you can determine the correct type as follows:

1. Disable the PID function (P2200 = 0).
2. Increase the motor frequency while measuring the feedback signal.
3. If the feedback signal increases with an increase in motor frequency, the PID transducer type should be 0.
4. If the feedback signal decreases with an increase in motor frequency the PID transducer type should be set to 1.

<b>r2272</b>	<b>CO: PID scaled feedback</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> -	<b>Max:</b> -	
	<b>P-Group:</b> TECH		

Displays PID scaled feedback signal in [%].

**Note:**

r2272 = 100 % corresponds to 4000 hex

<b>r2273</b>	<b>CO: PID error</b>	<b>Min:</b> -	<b>Level</b> <b>2</b>
	<b>Datatype:</b> Float <b>Unit:</b> % <b>Def:</b> -	<b>Max:</b> -	
	<b>P-Group:</b> TECH		

Displays PID error (difference) signal between setpoint and feedback signals in [%].

**Note:**

r2273 = 100 % corresponds to 4000 hex

<b>P2274</b>	<b>PID derivative time</b>	<b>Min:</b> 0.000	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> s
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Sets PID derivative time.


P2274 = 0:

The derivative term does not have any effect (it applies a gain of 1).

<b>P2280</b>	<b>PID proportional gain</b>	<b>Min:</b> 0.000	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> -
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Allows user to set proportional gain for PID controller.

The PID controller is implemented using the standard model.

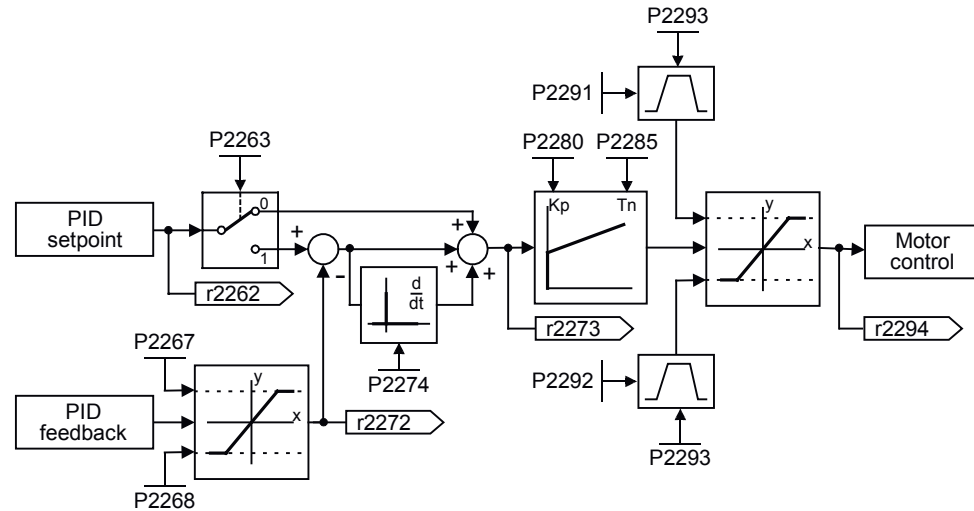

For best results, enable both P and I terms.

**Dependency:**

P2280 = 0 (P term of PID = 0):

I term acts on the square of the error signal.

P2285 = 0 (I term of PID = 0):

PID controller acts as a P or PD controller respectively.

**Note:**

- If the system is prone to sudden step changes in the feedback signal, P term should normally be set to a small value (0.5) with a faster I term for optimum performance.
- The D term (P2274) multiplies the difference between the present and previous feedback signal thus accelerating the controller reaction to an error that appears suddenly.
- The D term should be used carefully, since it can cause the controller output to fluctuate as every change in the feedback signal is amplified by the controller derivative action.

<b>P2285</b>	<b>PID integral time</b>	<b>Min:</b> 0.000	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> s
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Sets integral time constant for PID controller.

**Details:**

See P2280 (PID proportional gain).

<b>P2291</b>	<b>PID output upper limit</b>	<b>Min:</b> -200.00	<b>Level</b> <b>2</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> Float		<b>Unit:</b> %
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately		<b>QuickComm.:</b> No

Sets upper limit for PID controller output in [%].

**Dependency:**

If F max (P1082) is greater than P2000 (reference frequency), either P2000 or P2291 (PID output upper limit) must be changed to achieve F max.

**Note:**

P2291 = 100 % corresponds to 4000 hex (as defined by P2000 (reference frequency)).

<b>P2292</b>	<b>PID output lower limit</b>			<b>Min:</b> -200.00	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> 0.00	
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 200.00	

Sets lower limit for the PID controller output in [%].

**Dependency:**

A negative value allows bipolar operation of PID controller.

**Note:**

P2292 = 100 % corresponds to 4000 hex

<b>P2293</b>	<b>Ramp-up /-down time of PID limit</b>			<b>Min:</b> 0.00	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s	<b>Def:</b> 1.00	
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 100.00	

Sets maximum ramp rate on output of PID.

When PI is enabled, the output limits are ramped up from 0 to the limits set in P2291 (PID output upper limit) and P2292 (PID output lower limit). Limits prevent large step changes appearing on the output of the PID when the inverter is started. Once the limits have been reached, the PID controller output is instantaneous.

These ramp times are used whenever a RUN command is issued.

**Note:**

If an OFF1 or OFF 3 are issued, the inverter output frequency ramps down as set in P1121 (ramp-down time) or P1135 (OFF3 ramp-down time).

<b>r2294</b>	<b>CO: Act. PID output</b>			<b>Min:</b> -	Level <b>2</b>
		<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Def:</b> -	
	<b>P-Group:</b> TECH			<b>Max:</b> -	

Displays PID output in [%]

**Note:**

r2294 = 100 % corresponds to 4000 hex

<b>P2295</b>	<b>Gain applied to PID output</b>			<b>Min:</b> -100.00	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Def:</b> 100.00	
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 100.00	

Allows the user to scale the PID output as a percentage value [%].

A gain of 100.0 % means that output signal has not changed from its default value.

<b>P2350</b>	<b>PID autotune enable</b>			<b>Min:</b> 0	Level <b>2</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No	<b>Max:</b> 4	

Enables autotune function of PID controller.

**Possible Settings:**

- 0 PID autotuning disabled
- 1 PID autotuning via Ziegler Nichols (ZN) standard
- 2 PID autotuning as 1 plus some overshoot (O/S)
- 3 PID autotuning as 2 little or no overshoot (O/S)
- 4 PID autotuning PI only, quarter damped response

**Dependency:**

Active when PID loop is enabled (see P2200).

**Note:**

P2350 = 1  
This is the standard Ziegler Nichols (ZN) tuning which should be a quarter damped response to a step.

P2350 = 2  
This tuning will give some overshoot (O/S) but should be faster than option 1

P2350 = 3  
This tuning should give little or no overshoot but will not be as fast as option 2.

P2350 = 4  
This tuning only changes values of P and I and should be a quarter damped response.

The option to be selected depends on the application but broadly speaking option 1 will give an all round good response, whereas if a faster response is desired option 2 should be selected. If no overshoot is desired then option 3 is the choice. For cases where no D term is wanted then option 4 can be selected. The tuning procedure is the same for all options. It is just the calculation of P,I and D values that is different.

After autotune this parameter is set to zero (autotune completed).



<b>P2354</b>	<b>PID tuning timeout length</b>	<b>Min:</b> 60	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Def:</b> 240
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 65000	<b>3</b>

This parameter determines the time that the auto tuning code will wait before aborting a tuning run if no oscillation has been obtained.

<b>P2355</b>	<b>PID tuning offset</b>	<b>Min:</b> 0.00	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Def:</b> 5.00
	<b>P-Group:</b> TECH	<b>Active:</b> Immediately	<b>QuickComm.:</b> No
		<b>Max:</b> 20.00	<b>3</b>

Sets applied offset and deviation for PID autotuning.

**Note:**

This can be varied depending on plant conditions e.g. a very long system time constant might require a larger value.

### 3.38 Positioning down ramp

<b>P2480[3]</b>	<b>Position mode</b>	<b>Min:</b> 1	<b>Level</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Def:</b> 1
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
		<b>Max:</b> 1	<b>3</b>

Sets the mode for positioning mode.

**Possible Settings:**


- 1 Open loop positioning

**Index:**

- P2480[0] : 1st. Drive data set (DDS)
- P2480[1] : 2nd. Drive data set (DDS)
- P2480[2] : 3rd. Drive data set (DDS)

<b>P2481[3]</b>	<b>Gearbox ratio input</b>	<b>Min:</b> 0.01	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Def:</b> 1.00
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
		<b>Max:</b> 9999.99	<b>3</b>

Defines the ratio between number of motor shaft revolutions to equal one revolution of the gearbox output shaft.

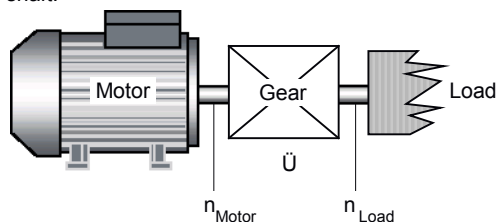

$$\ddot{U} = \frac{\text{Motor revolutions}}{\text{Load revolutions}} = \frac{P2481}{P2482}$$

**Index:**

- P2481[0] : 1st. Drive data set (DDS)
- P2481[1] : 2nd. Drive data set (DDS)
- P2481[2] : 3rd. Drive data set (DDS)

<b>P2482[3]</b>	<b>Gearbox ratio output</b>	<b>Min:</b> 0.01	<b>Level</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Def:</b> 1.00
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No
		<b>Max:</b> 9999.99	<b>3</b>


Defines the ratio between number of motor shaft revolutions to equal one revolution of the gearbox output shaft.

**Index:**

- P2482[0] : 1st. Drive data set (DDS)
- P2482[1] : 2nd. Drive data set (DDS)
- P2482[2] : 3rd. Drive data set (DDS)

<b>P2484[3]</b>	<b>No. of shaft turns = 1 Unit</b>			<b>Min:</b> 0.01	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Def:</b> 1.00	
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 9999.99	

Sets the number of rotations of the motor shaft required to represent 1 unit of user selected units.

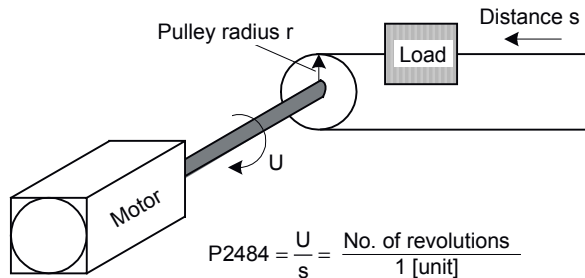

The following equation determines the number of motor shaft revolutions to stop:


$$\text{Revolutions}_{\text{Motor}} = P2488 \cdot P2484 \cdot \frac{P2481}{P2482}$$

**Index:**

- P2484[0] : 1st. Drive data set (DDS)
- P2484[1] : 2nd. Drive data set (DDS)
- P2484[2] : 3rd. Drive data set (DDS)

<b>P2488[3]</b>	<b>Distance / No. of revolutions</b>			<b>Min:</b> 0.01	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Def:</b> 1.00	
	<b>P-Group:</b> CONTROL	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 9999.99	

Sets the required distance or number of revolutions (see P2484).

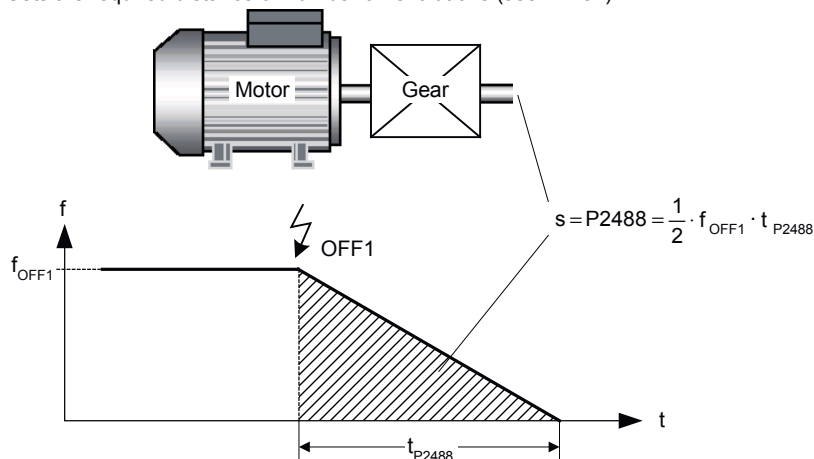

**Index:**

- P2488[0] : 1st. Drive data set (DDS)
- P2488[1] : 2nd. Drive data set (DDS)
- P2488[2] : 3rd. Drive data set (DDS)

<b>r2489</b>	<b>Act. number of shaft revolutions</b>			<b>Min:</b> -	<b>Level</b> <b>3</b>
		<b>Datatype:</b> Float	<b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> CONTROL			<b>Max:</b> -	


Displays the actual number of shaft revolutions since trigger of positioning.





<b>P2810[2]</b>	<b>BI: AND 1</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

P2810[0], P2810[1] define inputs of AND 1 element, output is P2811.

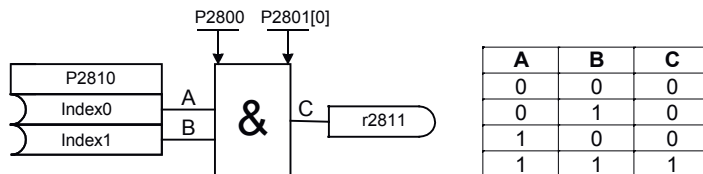

**Index:**

P2810[0] : Binector input 0 (BI 0)  
P2810[1] : Binector input 1 (BI 1)

**Dependency:**

P2801[0] is active level for the AND element.

<b>r2811</b>	<b>BO: AND 1</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> U16	<b>Def:</b> -	
	<b>P-Group:</b> TECH	<b>Max:</b> -	

Output of AND 1 element. Displays and logic of bits defined in P2810[0], P2810[1].

**Dependency:**

P2801[0] is active level for the AND element.

<b>P2812[2]</b>	<b>BI: AND 2</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

P2812[0], 2812[1] define inputs of AND 2 element, output is P2813.

**Index:**

P2812[0] : Binector input 0 (BI 0)  
P2812[1] : Binector input 1 (BI 1)

**Dependency:**

P2801[1] is active level for the AND element.

<b>r2813</b>	<b>BO: AND 2</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> U16	<b>Def:</b> -	
	<b>P-Group:</b> TECH	<b>Max:</b> -	

Output of AND 2 element. Displays and logic of bits defined in P2812[0], P2812[1].

**Dependency:**

P2801[1] is active level for the AND element.

<b>P2814[2]</b>	<b>BI: AND 3</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

P2814[0], P2814[1] define inputs of AND 3 element, output is P2815.

**Index:**

P2814[0] : Binector input 0 (BI 0)  
P2814[1] : Binector input 1 (BI 1)

**Dependency:**

P2801[2] is active level for the AND element.

<b>r2815</b>	<b>BO: AND 3</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> U16	<b>Def:</b> -	
	<b>P-Group:</b> TECH	<b>Max:</b> -	


Output of AND 3 element. Displays and logic of bits defined in P2814[0], P2814[1].

**Dependency:**

P2801[2] is active level for the AND element.

<b>P2816[2]</b>	<b>BI: OR 1</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

P2816[0], P2816[1] define inputs of OR 1 element, output is P2817.

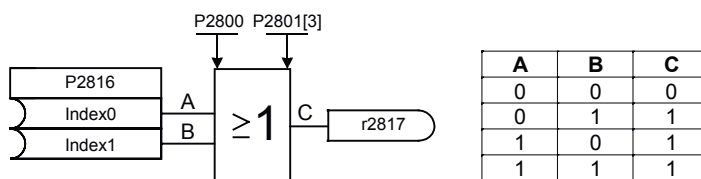

**Index:**

P2816[0] : Binector input 0 (BI 0)  
P2816[1] : Binector input 1 (BI 1)

**Dependency:**

P2801[3] is active level for the OR element.

<b>r2817</b>	<b>BO: OR 1</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> U16	<b>Def:</b> -	
	<b>P-Group:</b> TECH	<b>Max:</b> -	

Output of OR 1 element. Displays or logic of bits defined in P2816[0], P2816[1].

**Dependency:**

P2801[3] is active level for the OR element.

<b>P2818[2]</b>	<b>BI: OR 2</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

P2818[0], P2818[1] define inputs of OR 2 element, output is P2819.

**Index:**

P2818[0] : Binector input 0 (BI 0)  
P2818[1] : Binector input 1 (BI 1)

**Dependency:**

P2801[4] is active level for the OR element.

<b>r2819</b>	<b>BO: OR 2</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> U16	<b>Def:</b> -	
	<b>P-Group:</b> TECH	<b>Max:</b> -	

Output of OR 2 element. Displays or logic of bits defined in P2818[0], P2818[1].

**Dependency:**

P2801[4] is active level for the OR element.

<b>P2820[2]</b>	<b>BI: OR 3</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Def:</b> 0:0
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

P2820[0], P2820[1] define inputs of OR 3 element, output is P2821.

**Index:**

P2820[0] : Binector input 0 (BI 0)  
P2820[1] : Binector input 1 (BI 1)

**Dependency:**

P2801[5] is active level for the OR element.

<b>r2821</b>	<b>BO: OR 3</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>Datatype:</b> U16	<b>Def:</b> -	
	<b>P-Group:</b> TECH	<b>Max:</b> -	


Output of OR 3 element. Displays or logic of bits defined in P2820[0], P2820[1].

**Dependency:**

P2801[5] is active level for the OR element.

<b>P2822[2]</b>	<b>BI: XOR 1</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

P2822[0], P2822[1] define inputs of XOR 1 element, output is P2823.

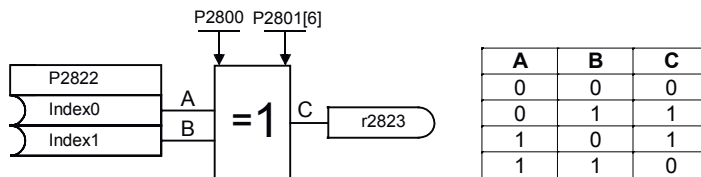

**Index:**

P2822[0] : Binector input 0 (BI 0)  
P2822[1] : Binector input 1 (BI 1)

**Dependency:**

P2801[6] is active level for the XOR element.

<b>r2823</b>	<b>BO: XOR 1</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
				<b>Def:</b> -	
	<b>P-Group:</b> TECH			<b>Max:</b> -	

Output of XOR 1 element. Displays exclusive-or logic of bits defined in P2822[0], P2822[1].

**Dependency:**

P2801[6] is active level for the XOR element.

<b>P2824[2]</b>	<b>BI: XOR 2</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

P2824[0], P2824[1] define inputs of XOR 2 element, output is P2825.

**Index:**

P2824[0] : Binector input 0 (BI 0)  
P2824[1] : Binector input 1 (BI 1)

**Dependency:**

P2801[7] is active level for the XOR element.

<b>r2825</b>	<b>BO: XOR 2</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
				<b>Def:</b> -	
	<b>P-Group:</b> TECH			<b>Max:</b> -	

Output of XOR 2 element. Displays exclusive-or logic of bits defined in P2824[0], P2824[1].

**Dependency:**

P2801[7] is active level for the XOR element.

<b>P2826[2]</b>	<b>BI: XOR 3</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

P2826[0], P2826[1] define inputs of XOR 3 element, output is P2827.

**Index:**

P2826[0] : Binector input 0 (BI 0)  
P2826[1] : Binector input 1 (BI 1)

**Dependency:**

P2801[8] is active level for the XOR element.

<b>r2827</b>	<b>BO: XOR 3</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
				<b>Def:</b> -	
	<b>P-Group:</b> TECH			<b>Max:</b> -	


Output of XOR 3 element. Displays exclusive-or logic of bits defined in P2826[0], P2826[1].

**Dependency:**

P2801[8] is active level for the XOR element.

<b>P2828</b>	<b>BI: NOT 1</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

P2828 defines input of NOT 1 element, output is P2829.

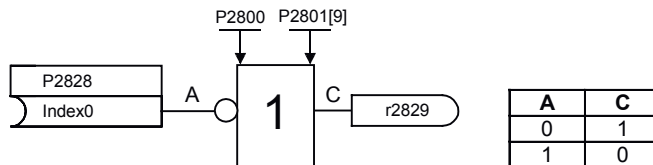

**Dependency:**

P2801[9] is active level for the NOT element.

<b>r2829</b>	<b>BO: NOT 1</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> -	
	<b>P-Group:</b> TECH			<b>Max:</b> -	

Output of NOT 1 element. Displays not logic of bit defined in P2828.

**Dependency:**

P2801[9] is active level for the NOT element.

<b>P2830</b>	<b>BI: NOT 2</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

P2830 defines input of NOT 2 element, output is P2831.

**Dependency:**

P2801[10] is active level for the NOT element.

<b>r2831</b>	<b>BO: NOT 2</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> -	
	<b>P-Group:</b> TECH			<b>Max:</b> -	

Output of NOT 2 element. Displays not logic of bit defined in P2830.

**Dependency:**

P2801[10] is active level for the NOT element.

<b>P2832</b>	<b>BI: NOT 3</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

P2832 defines input of NOT 3 element, output is P2833.

**Dependency:**

P2801[11] is active level for the NOT element.

<b>r2833</b>	<b>BO: NOT 3</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> -	
	<b>P-Group:</b> TECH			<b>Max:</b> -	

Output of NOT 3 element. Displays not logic of bit defined in P2832.


**Dependency:**

P2801[11] is active level for the NOT element.



<b>P2834[4]</b>	<b>BI: D-FF 1</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

P2834[0], P2834[1], P2834[2], P2834[3] define inputs of D-FlipFlop 1, outputs are P2835, P2836.

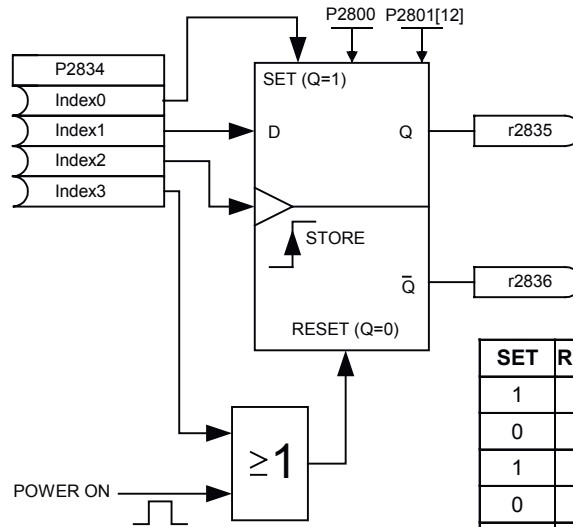

SET	RESET	D	STORE	Q	Q̄
1	0	x	x	1	0
0	1	x	x	0	1
1	1	x	x	Q <sub>n-1</sub>	Q̄ <sub>n-1</sub>
0	0	1	↑	1	0
0	0	0	↓	0	1
POWER-ON				0	1

**Index:**

- P2834[0] : Binector input: Set
- P2834[1] : Binector input: D input
- P2834[2] : Binector input: Store pulse
- P2834[3] : Binector input: Reset

**Dependency:**

P2801[12] is active level for the D-FlipFlop.

<b>r2835</b>	<b>BO: Q D-FF 1</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> TECH			<b>Def:</b> -	
				<b>Max:</b> -	

Displays output of D-FlipFlop 1, inputs are defined in P2834[0], P2834[1], P2834[2], P2834[3]

**Dependency:**

P2801[12] is active level for the D-FlipFlop.

<b>r2836</b>	<b>BO: NOT-Q D-FF 1</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> TECH			<b>Def:</b> -	
				<b>Max:</b> -	

Displays Not-output of D-FlipFlop 1, inputs are defined in P2834[0], P2834[1], P2834[2], P2834[3]

**Dependency:**

P2801[12] is active level for the D-FlipFlop.

<b>P2837[4]</b>	<b>BI: D-FF 2</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

P2837[0], P2837[1], P2837[2], P2837[3] define inputs of D-FlipFlop 2, outputs are P2838, 2839.

**Index:**

- P2837[0] : Binector input: Set
- P2837[1] : Binector input: D input
- P2837[2] : Binector input: Store pulse
- P2837[3] : Binector input: Reset

**Dependency:**

P2801[13] is active level for the D-FlipFlop.

<b>r2838</b>	<b>BO: Q D-FF 2</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH				

Displays output of D-FlipFlop 2, inputs are defined in P2837[0], P2837[1], P2837[2], P2837[3]

**Dependency:**

P2801[13] is active level for the D-FlipFlop.

<b>r2839</b>	<b>BO: NOT-Q D-FF 2</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH				


Displays Not-output of D-FlipFlop 2, inputs are defined in P2837[0], P2837[1], P2837[2], P2837[3]

**Dependency:**

P2801[13] is active level for the D-FlipFlop.

<b>P2840[2]</b>	<b>BI: RS-FF 1</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0 <b>Def:</b> 0:0 <b>Max:</b> 4000:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No		
	<b>P-Group:</b> TECH				

P2840[0], P2840[1] define inputs of RS-FlipFlop 1, outputs are P2841, P2842.

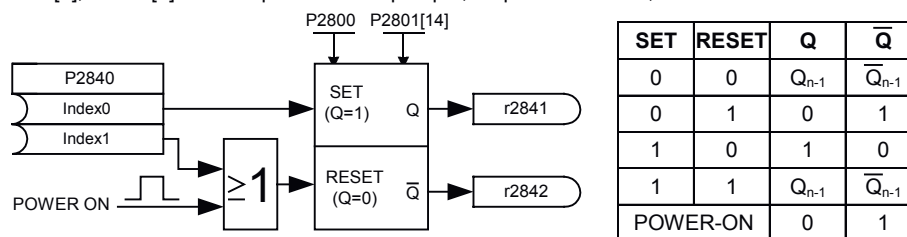

**Index:**

P2840[0] : Binector input: Set  
P2840[1] : Binector input: Reset

**Dependency:**

P2801[14] is active level for the RS-FlipFlop.

<b>r2841</b>	<b>BO: Q RS-FF 1</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH				

Displays output of RS-FlipFlop 1, inputs are defined in P2840[0], P2840[1]

**Dependency:**

P2801[14] is active level for the RS-FlipFlop.

<b>r2842</b>	<b>BO: NOT-Q RS-FF 1</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH				

Displays Not-output of RS-FlipFlop 1, inputs are defined in P2840[0], P2840[1]

**Dependency:**

P2801[14] is active level for the RS-FlipFlop.

<b>P2843[2]</b>	<b>BI: RS-FF 2</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0 <b>Def:</b> 0:0 <b>Max:</b> 4000:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No		
	<b>P-Group:</b> TECH				

P2843[0], P2843[1] define inputs of RS-FlipFlop 2, outputs are P2844, P2845.

**Index:**

P2843[0] : Binector input: Set  
P2843[1] : Binector input: Reset

**Dependency:**

P2801[15] is active level for the RS-FlipFlop.

<b>r2844</b>	<b>BO: Q RS-FF 2</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH				

Displays output of RS-FlipFlop 2, inputs are defined in P2843[0], P2843[1]

**Dependency:**

P2801[15] is active level for the RS-FlipFlop.

<b>r2845</b>	<b>BO: NOT-Q RS-FF 2</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> TECH			<b>Def:</b> - <b>Max:</b> -	

Displays Not-output of RS-FlipFlop 2, inputs are defined in P2843[0], P2843[1]

**Dependency:**

P2801[15] is active level for the RS-FlipFlop.

<b>P2846[2]</b>	<b>BI: RS-FF 3</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

P2846[0], P2846[1] define inputs of RS-FlipFlop 3, outputs are P2847, P2848.

**Index:**

P2846[0] : Binector input: Set  
P2846[1] : Binector input: Reset

**Dependency:**

P2801[16] is active level for the RS-FlipFlop.

<b>r2847</b>	<b>BO: Q RS-FF 3</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> TECH			<b>Def:</b> - <b>Max:</b> -	

Displays output of RS-FlipFlop 3, inputs are defined in P2846[0], P2846[1]

**Dependency:**

P2801[16] is active level for the RS-FlipFlop.

<b>r2848</b>	<b>BO: NOT-Q RS-FF 3</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> TECH			<b>Def:</b> - <b>Max:</b> -	



Displays Not-output of RS-FlipFlop 3, inputs are defined in P2846[0], P2846[1]

**Dependency:**

P2801[16] is active level for the RS-FlipFlop.

<b>P2849</b>	<b>BI: Timer 1</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

Define input signal of timer 1. P2849, P2850, P2851 are the inputs of the timer, outputs are P2852, P2853.

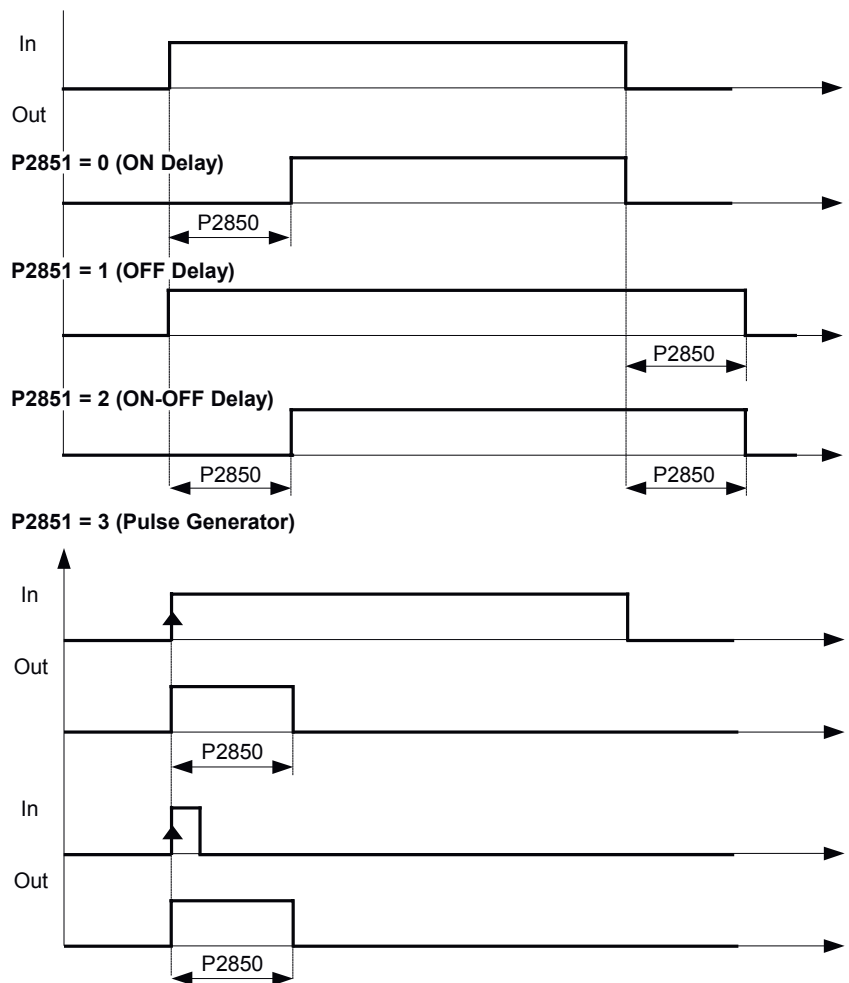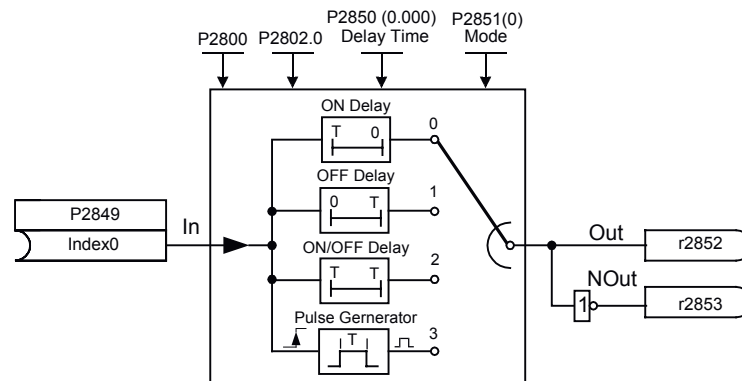

**Dependency:**  
P2802[0] is active level for the timer.

<b>P2850</b>	<b>Delay time of timer 1</b>	<b>Datatype:</b> Float	<b>Unit:</b> s	<b>Min:</b> 0.0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0.0	
	<b>P-Group:</b> TECH			<b>Max:</b> 6000.0	

Defines delay time of timer 1. P2849, P2850, P2851 are the inputs of the timer, outputs are P2852, P2853.

**Dependency:**  
P2802[0] is active level for the timer.

<b>P2851</b>	<b>Mode timer 1</b>			<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 3	

Selects mode of timer 1. P2849, P2850, P2851 are the inputs of the timer, outputs are P2852, P2853.

**Possible Settings:**

- 0 ON delay
- 1 OFF delay
- 2 ON/OFF delay
- 3 Pulse generator

**Dependency:**

P2802[0] is active level for the timer.

<b>r2852</b>	<b>BO: Timer 1</b>			<b>Min:</b> -	<b>Level</b> <b>3</b>
		<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> TECH			<b>Max:</b> -	

Displays output of timer 1. P2849, P2850, P2851 are the inputs of the timer, outputs are P2852, P2853.

**Dependency:**

P2802[0] is active level for the timer.

<b>r2853</b>	<b>BO: Nout timer 1</b>			<b>Min:</b> -	<b>Level</b> <b>3</b>
		<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> TECH			<b>Max:</b> -	

Displays Not-output of timer 1. P2849, P2850, P2851 are the inputs of the timer, outputs are P2852, P2853.

**Dependency:**

P2802[0] is active level for the timer.

<b>P2854</b>	<b>BI: Timer 2</b>			<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Define input signal of timer 2. P2854, P2855, P2856 are the inputs of the timer, outputs are P2857, P2858.

**Dependency:**

P2802[1] is active level for the timer.

<b>P2855</b>	<b>Delay time of timer 2</b>			<b>Min:</b> 0.0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s	<b>Def:</b> 0.0	
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 6000.0	

Defines delay time of timer 2. P2854, P2855, P2856 are the inputs of the timer, outputs are P2857, P2858.

**Dependency:**

P2802[1] is active level for the timer.

<b>P2856</b>	<b>Mode timer 2</b>			<b>Min:</b> 0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 3	

Selects mode of timer 2. P2854, P2855, P2856 are the inputs of the timer, outputs are P2857, P2858.

**Possible Settings:**

- 0 ON delay
- 1 OFF delay
- 2 ON/OFF delay
- 3 Pulse generator

**Dependency:**

P2802[1] is active level for the timer.

<b>r2857</b>	<b>BO: Timer 2</b>			<b>Min:</b> -	<b>Level</b> <b>3</b>
		<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> TECH			<b>Max:</b> -	

Displays output of timer 2. P2854, P2855, P2856 are the inputs of the timer, outputs are P2857, P2858.

**Dependency:**

P2802[1] is active level for the timer.

<b>r2858</b>	<b>BO: Nout timer 2</b>			<b>Min:</b> -	<b>Level</b> <b>3</b>
		<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> -	
	<b>P-Group:</b> TECH			<b>Max:</b> -	

Displays Not-output of timer 2 P2854, P2855, P2856 are the inputs of the timer, outputs are P2857, P2858.

**Dependency:**

P2802[1] is active level for the timer.

<b>P2859</b>	<b>BI: Timer 3</b>			<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Define input signal of timer 3. P2859, P2860, P2861 are the inputs of the timer, outputs are P2862, P2863.

**Dependency:**

P2802[2] is active level for the timer.

<b>P2860</b>	<b>Delay time of timer 3</b>			<b>Min:</b> 0.0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s	<b>Def:</b> 0.0	
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 6000.0	

Defines delay time of timer 3. P2859, P2860, P2861 are the inputs of the timer, outputs are P2862, P2863.

**Dependency:**

P2802[2] is active level for the timer.

<b>P2861</b>	<b>Mode timer 3</b>			<b>Min:</b> 0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 3	

Selects mode of timer 3. P2859, P2860, P2861 are the inputs of the timer, outputs are P2862, P2863.

**Possible Settings:**

- 0 ON delay
- 1 OFF delay
- 2 ON/OFF delay
- 3 Pulse generator

**Dependency:**

P2802[2] is active level for the timer.

<b>r2862</b>	<b>BO: Timer 3</b>			<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> TECH	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> -	
				<b>Max:</b> -	

Displays output of timer 3. P2859, P2860, P2861 are the inputs of the timer, outputs are P2862, P2863.

**Dependency:**

P2802[2] is active level for the timer.

<b>r2863</b>	<b>BO: Nout timer 3</b>			<b>Min:</b> -	Level <b>3</b>
	<b>P-Group:</b> TECH	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> -	
				<b>Max:</b> -	

Displays Not-output of timer 3. P2859, P2860, P2861 are the inputs of the timer, outputs are P2862, P2863.

**Dependency:**

P2802[2] is active level for the timer.

<b>P2864</b>	<b>BI: Timer 4</b>			<b>Min:</b> 0:0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Def:</b> 0:0	
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 4000:0	

Define input signal of timer 4. P2864, P2865, P2866 are the inputs of the timer, outputs are P2867, P2868.

**Dependency:**

P2802[3] is active level for the timer.

<b>P2865</b>	<b>Delay time of timer 4</b>			<b>Min:</b> 0.0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> Float	<b>Unit:</b> s	<b>Def:</b> 0.0	
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 6000.0	

Defines delay time of timer 4. P2864, P2865, P2866 are the inputs of the timer, outputs are P2867, P2868.

**Dependency:**

P2802[3] is active level for the timer.

<b>P2866</b>	<b>Mode timer 4</b>			<b>Min:</b> 0	Level <b>3</b>
	<b>CStat:</b> CUT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0	
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 3	

Selects mode of timer 4. P2864, P2865, P2866 are the inputs of the timer, outputs are P2867, P2868.

**Possible Settings:**

- 0 ON delay
- 1 OFF delay
- 2 ON/OFF delay
- 3 Pulse generator

**Dependency:**

P2802[3] is active level for the timer.

<b>r2867</b>	<b>BO: Timer 4</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH				

Displays output of timer 4. P2864, P2865, P2866 are the inputs of the timer, outputs are P2867, P2868.

**Dependency:**

P2802[3] is active level for the timer.

<b>r2868</b>	<b>BO: Nout timer 4</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH				


Displays Not-output of timer 4. P2864, P2865, P2866 are the inputs of the timer, outputs are P2867, P2868.

**Dependency:**

P2802[3] is active level for the timer.

<b>P2869[2]</b>	<b>CI: ADD 1</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0 <b>Def:</b> 755:0 <b>Max:</b> 4000:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No		
	<b>P-Group:</b> TECH				

Define inputs of Adder 1, result is in P2870.

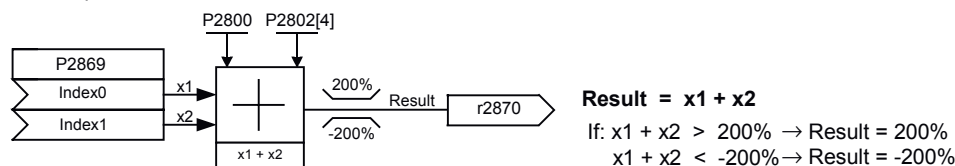

**Index:**

P2869[0] : Connector input 0 (CI 0)  
P2869[1] : Connector input 1 (CI 1)

**Dependency:**

P2802[4] is the active level for the Adder.

<b>r2870</b>	<b>CO: ADD 1</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH				

Result of Adder 1.

**Dependency:**

P2802[4] is active level for the Adder.

<b>P2871[2]</b>	<b>CI: ADD 2</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0 <b>Def:</b> 755:0 <b>Max:</b> 4000:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No		
	<b>P-Group:</b> TECH				

Define inputs of Adder 2, result is in P2872.

**Index:**

P2871[0] : Connector input 0 (CI 0)  
P2871[1] : Connector input 1 (CI 1)

**Dependency:**

P2802[5] is active level for the Adder.

<b>r2872</b>	<b>CO: ADD 2</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> - <b>Def:</b> - <b>Max:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH				


Result of Adder 2.

**Dependency:**

P2802[5] is active level for the Adder.

<b>P2873[2]</b>	<b>CI: SUB 1</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 755:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

Define inputs of Subtractor 1, result is in P2874.

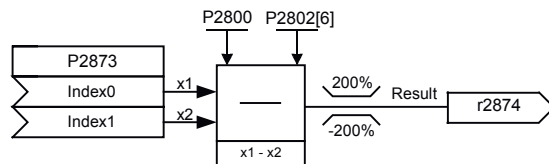

$$\text{Result} = x1 - x2$$

If:  $x1 - x2 > 200\% \rightarrow \text{Result} = 200\%$   
 $x1 - x2 < -200\% \rightarrow \text{Result} = -200\%$

**Index:**

P2873[0] : Connector input 0 (CI 0)  
P2873[1] : Connector input 1 (CI 1)

**Dependency:**

P2802[6] is active level for the Subtractor.

<b>r2874</b>	<b>CO: SUB 1</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH			<b>Def:</b> -	
				<b>Max:</b> -	

Result of Subtractor 1.

**Dependency:**

P2802[6] is active level for the Subtractor.

<b>P2875[2]</b>	<b>CI: SUB 2</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 755:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

Define inputs of Subtractor 2, result is in P2876.

**Index:**

P2875[0] : Connector input 0 (CI 0)  
P2875[1] : Connector input 1 (CI 1)

**Dependency:**

P2802[7] is active level for the Subtractor.

<b>r2876</b>	<b>CO: SUB 2</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH			<b>Def:</b> -	
				<b>Max:</b> -	


Result of Subtractor 2.

**Dependency:**

P2802[7] is active level for the Subtractor.

<b>P2877[2]</b>	<b>CI: MUL 1</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 755:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

Define inputs of Multiplier 1, result is in P2878.

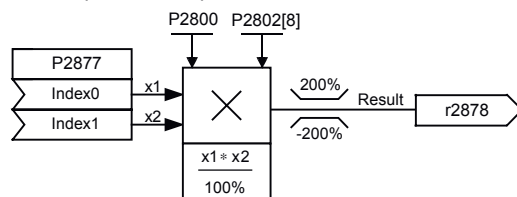

$$\text{Result} = \frac{x1 * x2}{100\%}$$

If:  $\frac{x1 * x2}{100\%} > 200\% \rightarrow \text{Result} = 200\%$   
 $\frac{x1 * x2}{100\%} < -200\% \rightarrow \text{Result} = -200\%$

**Index:**

P2877[0] : Connector input 0 (CI 0)  
P2877[1] : Connector input 1 (CI 1)

**Dependency:**

P2802[8] is active level for the Multiplier.

<b>r2878</b>	<b>CO: MUL 1</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH			<b>Def:</b> -	
				<b>Max:</b> -	

Result of Multiplier 1.

**Dependency:**

P2802[8] is active level for the Multiplier.



<b>P2879[2]</b>	<b>CI: MUL 2</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Def:</b> 755:0
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Define inputs of Multiplier 2, result is in P2880.

**Index:**

P2879[0] : Connector input 0 (CI 0)  
P2879[1] : Connector input 1 (CI 1)

**Dependency:**

P2802[9] is active level for the Multiplier.

<b>r2880</b>	<b>CO: MUL 2</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>	
	<b>Datatype:</b> Float	<b>Unit:</b> %		<b>Def:</b> -
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No


Result of Multiplier 2.

**Dependency:**

P2802[9] is active level for the Multiplier.

<b>P2881[2]</b>	<b>CI: DIV 1</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Def:</b> 755:0
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Define inputs of Divider 1, result is in P2882.

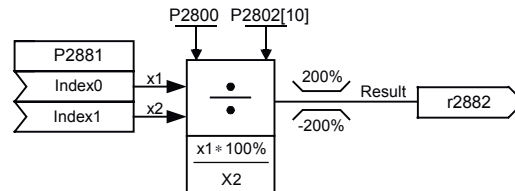

$$\text{Result} = \frac{x1 * 100\%}{x2}$$

If:  $\frac{x1 * 100\%}{x2} > 200\% \rightarrow \text{Result} = 200\%$   
 If:  $\frac{x1 * 100\%}{x2} < -200\% \rightarrow \text{Result} = -200\%$

**Index:**

P2881[0] : Connector input 0 (CI 0)  
P2881[1] : Connector input 1 (CI 1)

**Dependency:**

P2802[10] is active level for the Divider.

<b>r2882</b>	<b>CO: DIV 1</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>	
	<b>Datatype:</b> Float	<b>Unit:</b> %		<b>Def:</b> -
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Result of Divider 1.

**Dependency:**

P2802[10] is active level for the Divider.

<b>P2883[2]</b>	<b>CI: DIV 2</b>	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U32		<b>Def:</b> 755:0
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Define inputs of Divider 2, result is in P2884.

**Index:**

P2883[0] : Connector input 0 (CI 0)  
P2883[1] : Connector input 1 (CI 1)

**Dependency:**

P2802[11] is active level for the Divider.

<b>r2884</b>	<b>CO: DIV 2</b>	<b>Min:</b> -	<b>Level</b> <b>3</b>	
	<b>Datatype:</b> Float	<b>Unit:</b> %		<b>Def:</b> -
	<b>P-Group:</b> TECH	<b>Active:</b> first confirm		<b>QuickComm.:</b> No


Result of Divider 2.

**Dependency:**

P2802[11] is active level for the Divider.

<b>P2885[2]</b>	<b>CI: CMP 1</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 755:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

Defines inputs of Comparator 1, output is P2886.

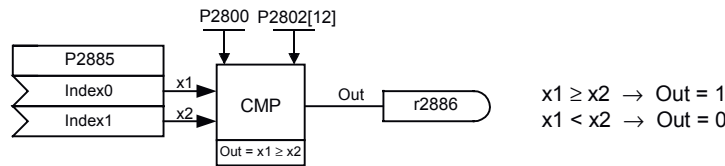

**Index:**

P2885[0] : Connector input 0 (CI 0)  
P2885[1] : Connector input 1 (CI 1)

**Dependency:**

P2802[12] is active level for the Comparator.

<b>r2886</b>	<b>BO: CMP 1</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH			<b>Def:</b> -	
				<b>Max:</b> -	

Displays result bit of Comparator 1.

**Dependency:**

P2802[12] is active level for the Comparator.

<b>P2887[2]</b>	<b>CI: CMP 2</b>	<b>Datatype:</b> U32	<b>Unit:</b> -	<b>Min:</b> 0:0	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 755:0	
	<b>P-Group:</b> TECH			<b>Max:</b> 4000:0	

Defines inputs of Comparator 2, output is P2888.

**Index:**

P2887[0] : Connector input 0 (CI 0)  
P2887[1] : Connector input 1 (CI 1)

**Dependency:**

P2802[13] is active level for the Comparator.

<b>r2888</b>	<b>BO: CMP 2</b>	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Min:</b> -	<b>Level</b> <b>3</b>
	<b>P-Group:</b> TECH			<b>Def:</b> -	
				<b>Max:</b> -	

Displays result bit of Comparator 2.


**Dependency:**

P2802[13] is active level for the Comparator.

<b>P2889</b>	<b>CO: Fixed setpoint 1 in [%]</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -200.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0.00	
	<b>P-Group:</b> TECH			<b>Max:</b> 200.00	

Fixed percent setting 1.

Connector Setting in %



Range : -200% ... 200%

<b>P2890</b>	<b>CO: Fixed setpoint 2 in [%]</b>	<b>Datatype:</b> Float	<b>Unit:</b> %	<b>Min:</b> -200.00	<b>Level</b> <b>3</b>
	<b>CStat:</b> CUT	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Def:</b> 0.00	
	<b>P-Group:</b> TECH			<b>Max:</b> 200.00	

Fixed percent setting 2.

### 3.40 Inverter parameters

<b>P3900</b>	<b>End of quick commissioning</b>	<b>Min:</b> 0	<b>Level</b> <b>1</b>	
	<b>CStat:</b> C	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> QUICK	<b>Active:</b> first confirm		<b>QuickComm.:</b> Yes

Performs calculations necessary for optimized motor operation.

After completion of calculation, P3900 and P0010 (parameter groups for commissioning) are automatically reset to their original value 0.

**Possible Settings:**

- 0 No quick commissioning
- 1 Start quick commissioning with factory reset
- 2 Start quick commissioning
- 3 Start quick commissioning only for motor data

**Dependency:**

Changeable only when P0010 = 1 (quick commissioning)

**Note:**

P3900 = 1 :

When setting 1 is selected, only the parameter settings carried out via the commissioning menu "Quick commissioning", are retained; all other parameter changes, including the I/O settings, are lost. Motor calculations are also performed.

P3900 = 2 :

When setting 2 is selected, only those parameters, which depend on the parameters in the commissioning menu "Quick commissioning" (P0010 = 1) are calculated. The I/O settings are also reset to default and the motor calculations performed.

P3900 = 3 :

When setting 3 is selected, only the motor and controller calculations are performed. Exiting quick commissioning with this setting saves time (for example, if only motor rating plate data have been changed).

Calculates a variety of motor parameters, overwriting previous values (see parameter P0340, setting P0340 = 1).

<b>P3950</b>	<b>Access of hidden parameters</b>	<b>Min:</b> 0	<b>Level</b> <b>4</b>	
	<b>CStat:</b> CUT	<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> ALWAYS	<b>Active:</b> first confirm		<b>QuickComm.:</b> No

Accesses special parameters for development (expert only) and factory functionality (calibration parameter).

<b>r3954[13]</b>	<b>CM version and GUI ID</b>	<b>Min:</b> -	<b>Level</b> <b>4</b>	
		<b>Datatype:</b> U16		<b>Unit:</b> -
	<b>P-Group:</b> -			<b>Def:</b> -

Used to classify firmware (only for SIEMENS internal purposes).

**Index:**

- r3954[0] : CM version (major release)
- r3954[1] : CM version (minor release)
- r3954[2] : CM version (baselevel or patch)
- r3954[3] : GUI ID
- r3954[4] : GUI ID
- r3954[5] : GUI ID
- r3954[6] : GUI ID
- r3954[7] : GUI ID
- r3954[8] : GUI ID
- r3954[9] : GUI ID
- r3954[10] : GUI ID
- r3954[11] : GUI ID major release
- r3954[12] : GUI ID minor release

<b>P3980</b>	<b>Commissioning command selection</b>				<b>Min:</b> 0	<b>Level</b> <b>4</b>
	<b>CStat:</b> T	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> -	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 66		

Toggles command and setpoint sources between freely programmable BICO parameters and fixed command/setpoint profiles for commissioning.

The command and setpoint sources can be changed independently. The tens digit selects the command source, the ones digit the setpoint source.

**Possible Settings:**

0	Cmd = BICO parameter	Setpoint = BICO parameter
1	Cmd = BICO parameter	Setpoint = MOP setpoint
2	Cmd = BICO parameter	Setpoint = Analog setpoint
3	Cmd = BICO parameter	Setpoint = Fixed frequency
4	Cmd = BICO parameter	Setpoint = USS on BOP link
5	Cmd = BICO parameter	Setpoint = USS on COM link
6	Cmd = BICO parameter	Setpoint = CB on COM link
10	Cmd = BOP	Setpoint = BICO parameter
11	Cmd = BOP	Setpoint = MOP setpoint
12	Cmd = BOP	Setpoint = Analog setpoint
13	Cmd = BOP	Setpoint = Fixed frequency
15	Cmd = BOP	Setpoint = USS on COM link
16	Cmd = BOP	Setpoint = CB on COM link
40	Cmd = USS on BOP link	Setpoint = BICO parameter
41	Cmd = USS on BOP link	Setpoint = MOP setpoint
42	Cmd = USS on BOP link	Setpoint = Analog setpoint
43	Cmd = USS on BOP link	Setpoint = Fixed frequency
44	Cmd = USS on BOP link	Setpoint = USS on BOP link
45	Cmd = USS on BOP link	Setpoint = USS on COM link
46	Cmd = USS on BOP link	Setpoint = CB on COM link
50	Cmd = USS on COM link	Setpoint = BICO parameter
51	Cmd = USS on COM link	Setpoint = MOP setpoint
52	Cmd = USS on COM link	Setpoint = Analog setpoint
53	Cmd = USS on COM link	Setpoint = Fixed frequency
54	Cmd = USS on COM link	Setpoint = USS on BOP link
55	Cmd = USS on COM link	Setpoint = USS on COM link
60	Cmd = CB on COM link	Setpoint = BICO parameter
61	Cmd = CB on COM link	Setpoint = MOP setpoint
62	Cmd = CB on COM link	Setpoint = Analog setpoint
63	Cmd = CB on COM link	Setpoint = Fixed frequency
64	Cmd = CB on COM link	Setpoint = USS on BOP link
66	Cmd = CB on COM link	Setpoint = CB on COM link

<b>P3981</b>	<b>Reset active fault</b>				<b>Min:</b> 0	<b>Level</b> <b>4</b>
	<b>CStat:</b> CT	<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> 0		
	<b>P-Group:</b> ALARMS	<b>Active:</b> first confirm	<b>QuickComm.:</b> No	<b>Max:</b> 1		

Resets active faults when changed from 0 to 1.

**Possible Settings:**

0	No fault reset
1	Reset fault

**Note:**

Automatically reset to 0.

**Details:**

See r0947 (last fault code)

<b>r3986[2]</b>	<b>Number of parameters</b>				<b>Min:</b> -	<b>Level</b> <b>4</b>
		<b>Datatype:</b> U16	<b>Unit:</b> -	<b>Def:</b> -		
	<b>P-Group:</b> -			<b>Max:</b> -		
























Number of parameters on the drive


**Index:**

r3986[0]	: Read only
r3986[1]	: Read & write



## 4 Function Diagrams

Explanation of symbols used in the function diagrams							
<p><b>Setting parameters</b></p> <p>ParName Min ... Max [Dim] PNumber.C/D [3] (Default)</p> <p>Parameter text Minimum ... Maximum value [Unit] Parameter number.Command/Drive data set [Number indexes] (Default)</p>	<p>Summation</p> <p>Multiplication</p> <p>Division</p> <p>Switch</p> <p>Selection switch (1 out of 4)</p> <p>ON delay</p> <p>OFF delay</p> <p>ON and OFF delay</p> <p>AND gate</p> <p>OR gate</p> <p>NOT gate</p> <p>NOT gate</p> <p>A/D converter</p> <p>D/A converter</p>	<p><b>Monitoring parameters</b></p> <p>ParName [Dim] PNumber.C/D [3]</p> <p>Parameter text [Unit] Parameter number.Command/Drive data set [Number indexes]</p>	<p><b>BICO parameters</b></p> <p>Binecotor input (Setting parameter) ParName [Dim] PNum.C/D [3] (Default)</p> <p>Parameter text [Unit] Parameter number.Command/Drive data set (Default)</p> <p>Binecotor output (Monitoring parameter) ParName PNum</p> <p>Connector input (Setting parameter) ParName PNum.C/D [3] (Default)</p> <p>Parameter text Parameter number.Command/Drive data set [Number indexes] (Default)</p> <p>Connector output (Monitoring parameter) ParName [Hz] PNum [3]</p> <p>Connector/Binecotor output (Monitoring parameter) ParName PNum PNum</p>	        	             	<p>Filter element</p> <p>Gain element</p> <p>Integrator</p> <p>PI controller</p> <p>Differentiator</p> <p>Limitation</p> <p>Limitation</p> <p>Characteristic</p> <p>Hysteresis</p>	<p>1</p> <p>2</p> <p>3</p> <p>4</p> <p>5</p> <p>6</p> <p>7</p> <p>8</p>
Symbols in function diagrams							
440_PLI_en_0305.doc						Function diagram	
01.03.2005 V2.0						MICROMASTER 440	

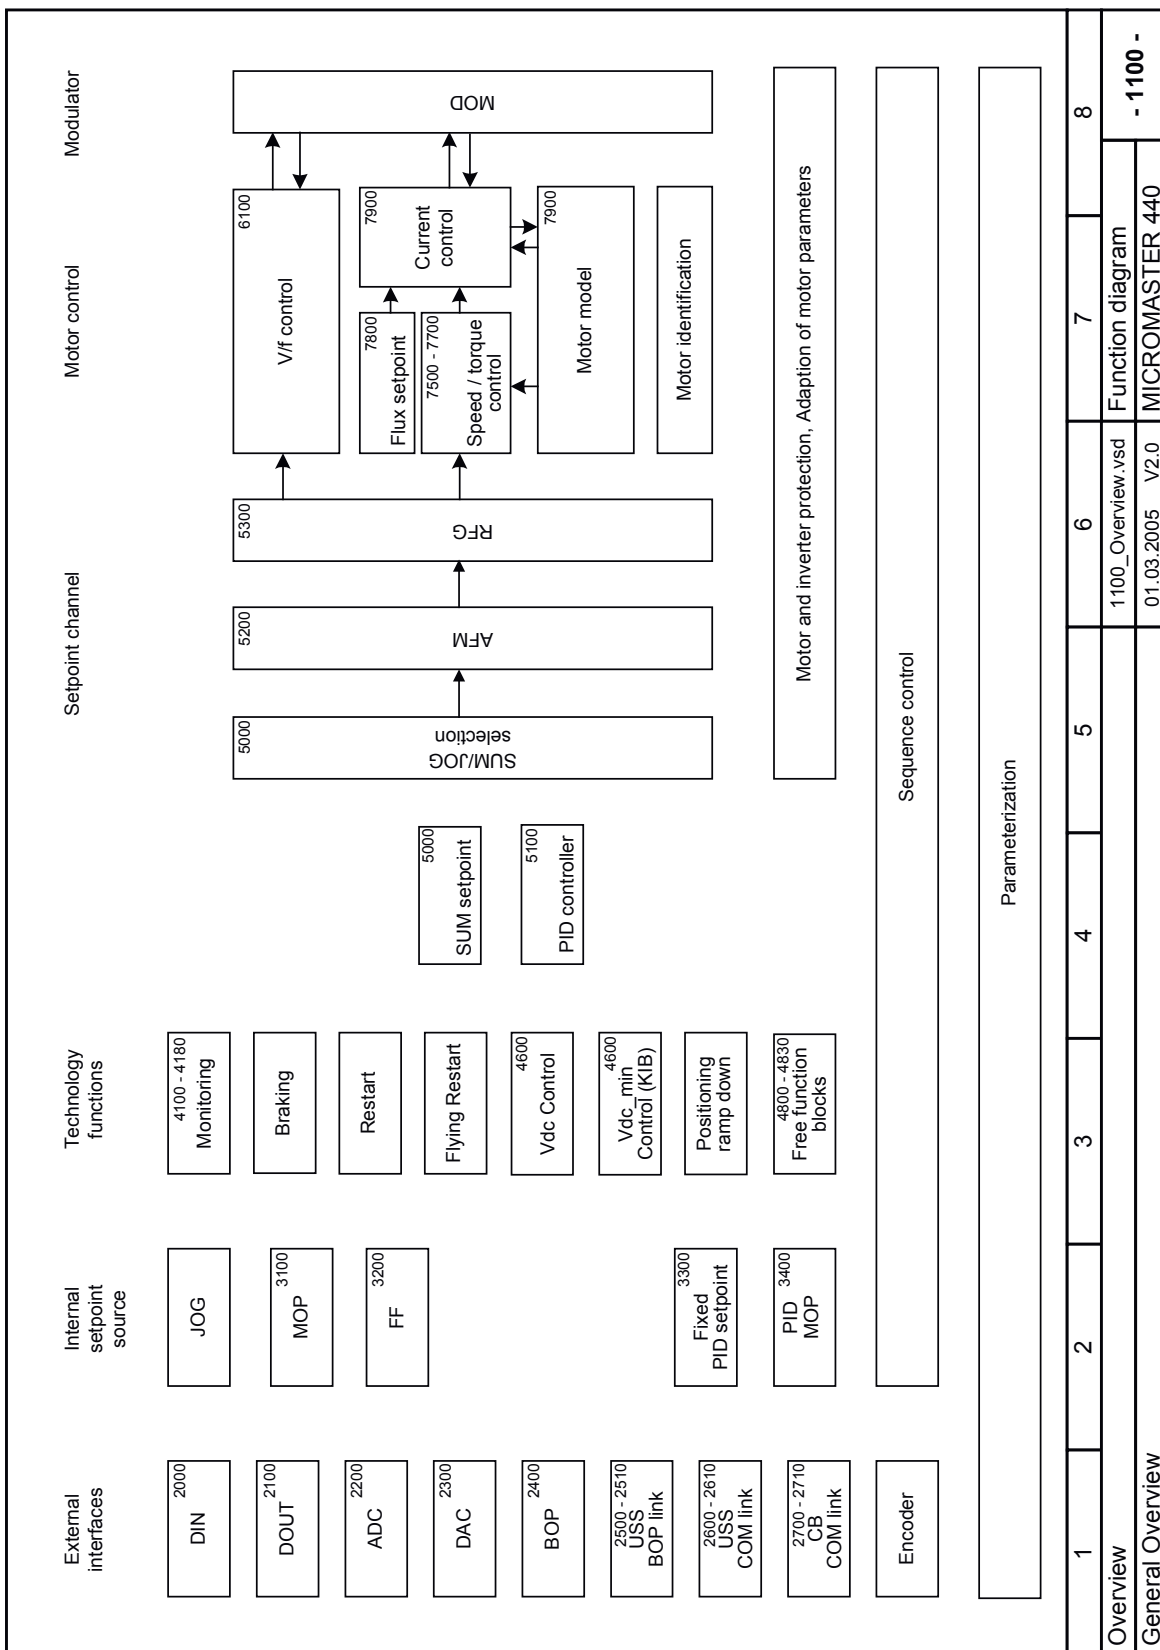


Motor and inverter protection, Adaption of motor parameters

Sequence control

Parameterization


1	2	3	4	5	6	7	8
Overview		1100_Overview.vsd		01.03.2005		V2.0	
General Overview		Function diagram		MICROMASTER 440		- 1100 -	

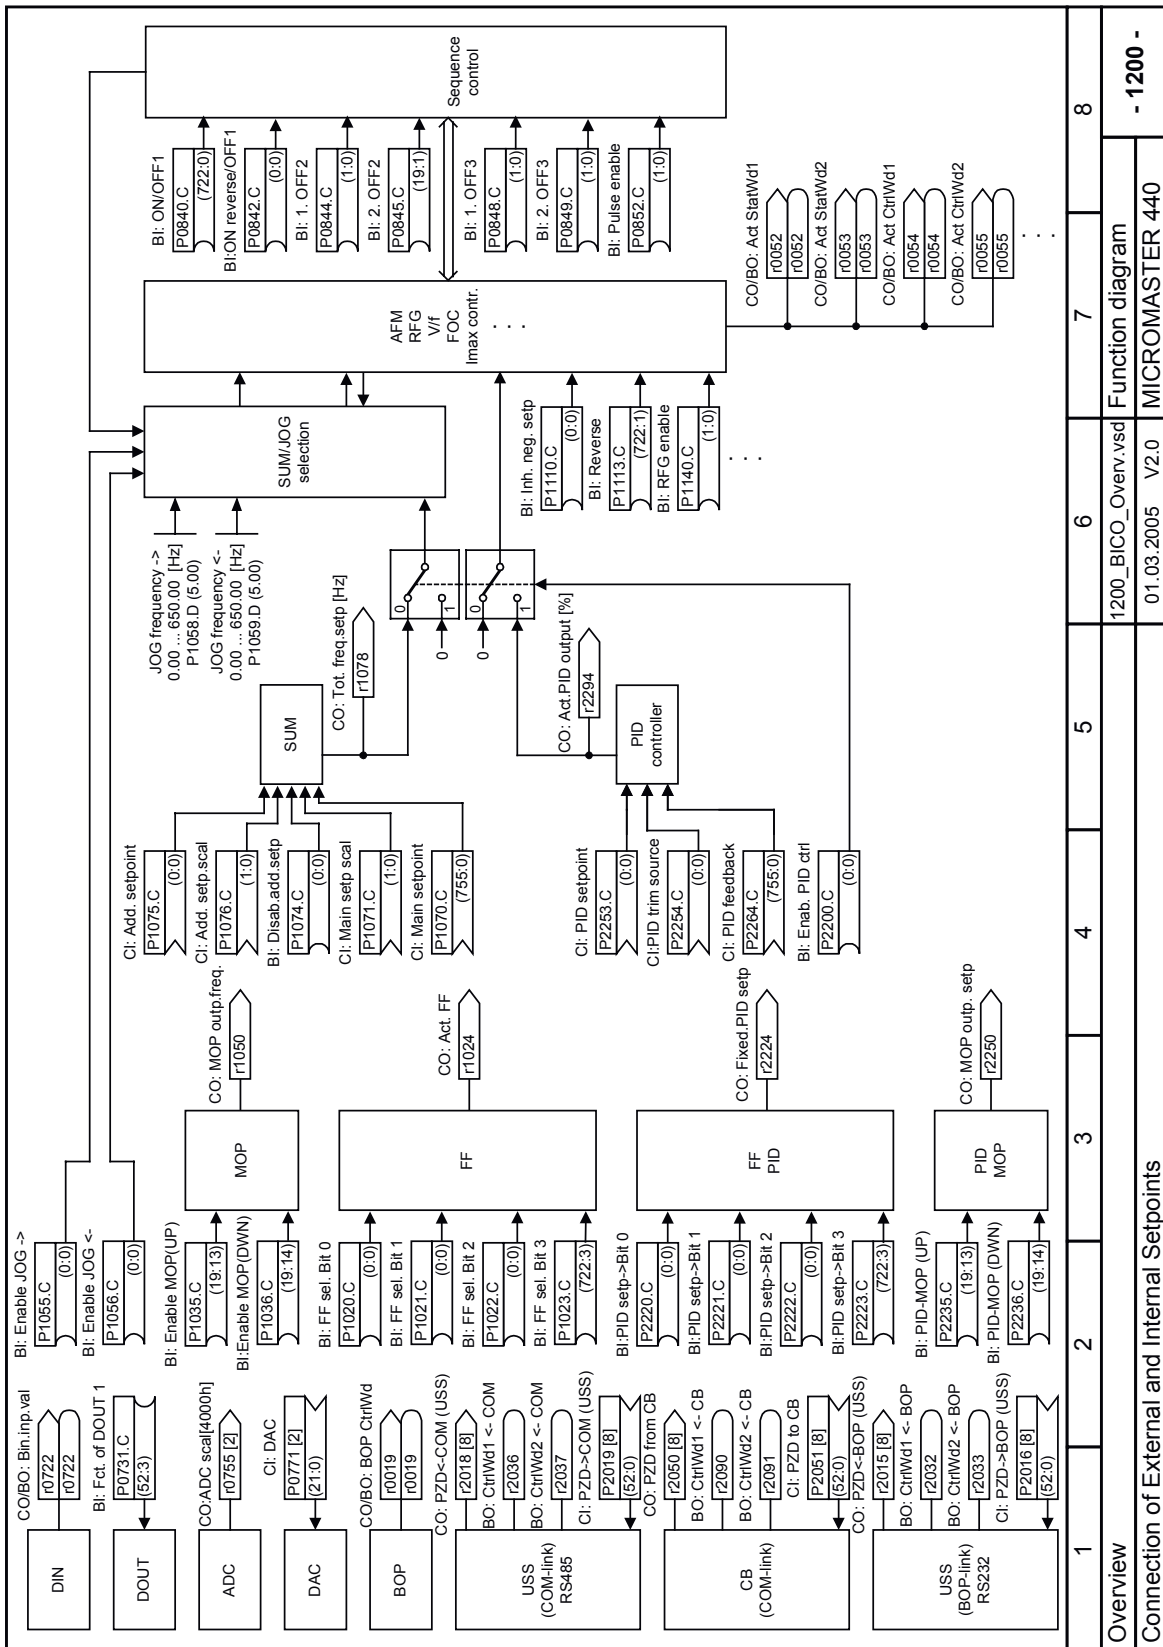


Overview  
Connection of External and Internal Setpoints







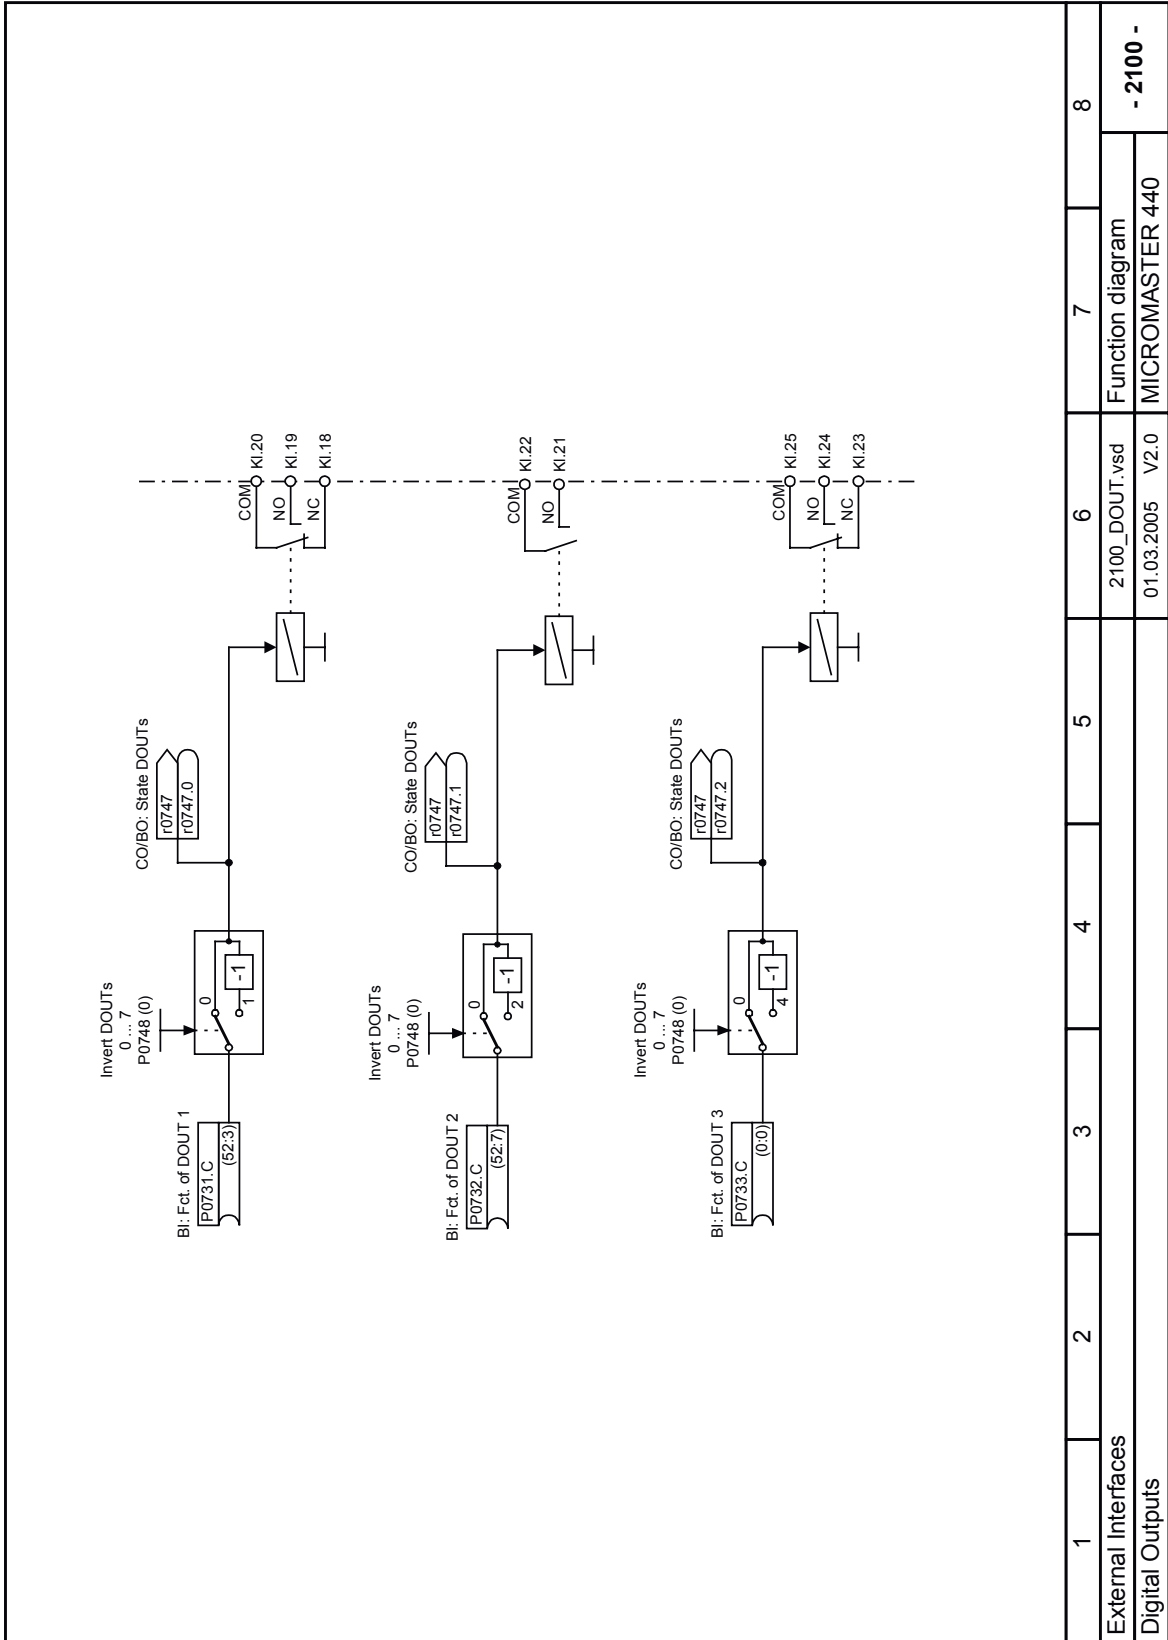


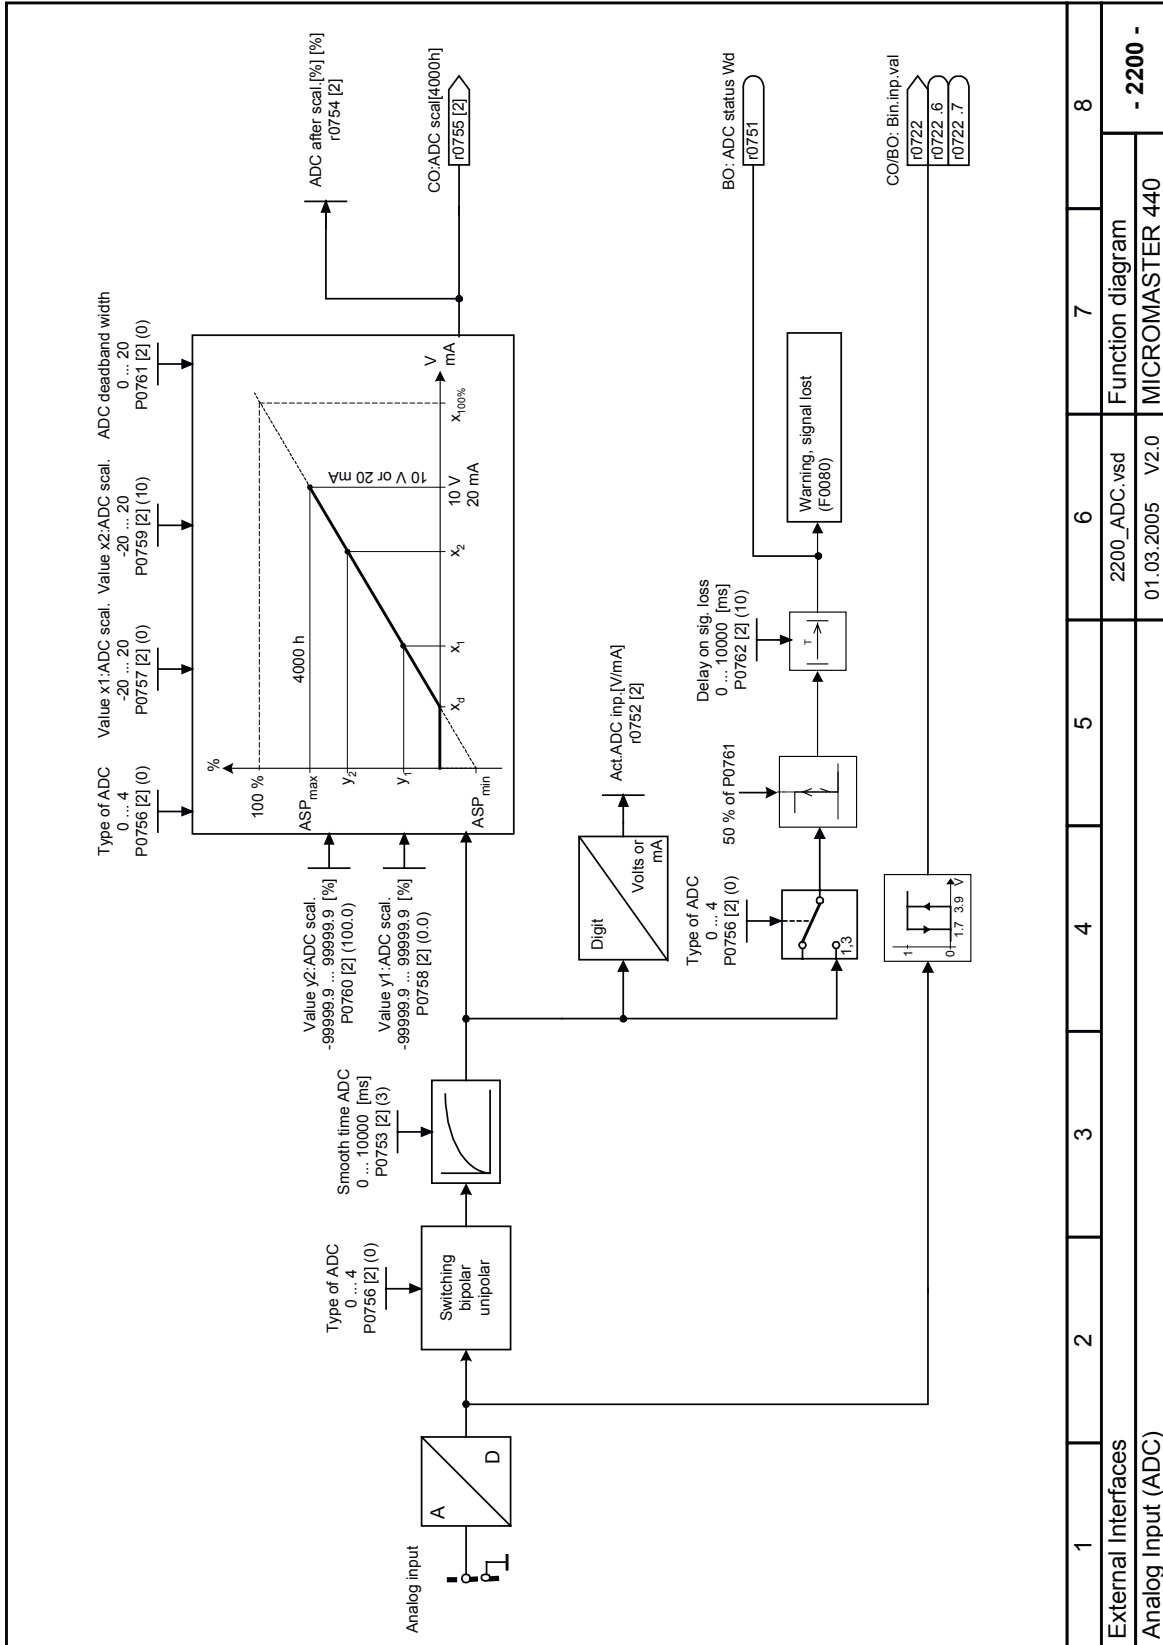


1	2	3	4	5	6	7	8
External Interfaces							
Analog Input (ADC)						Function diagram	
2200_ADC.vsd						MICROMASTER 440	
01.03.2005 V2.0						- 2200 -	

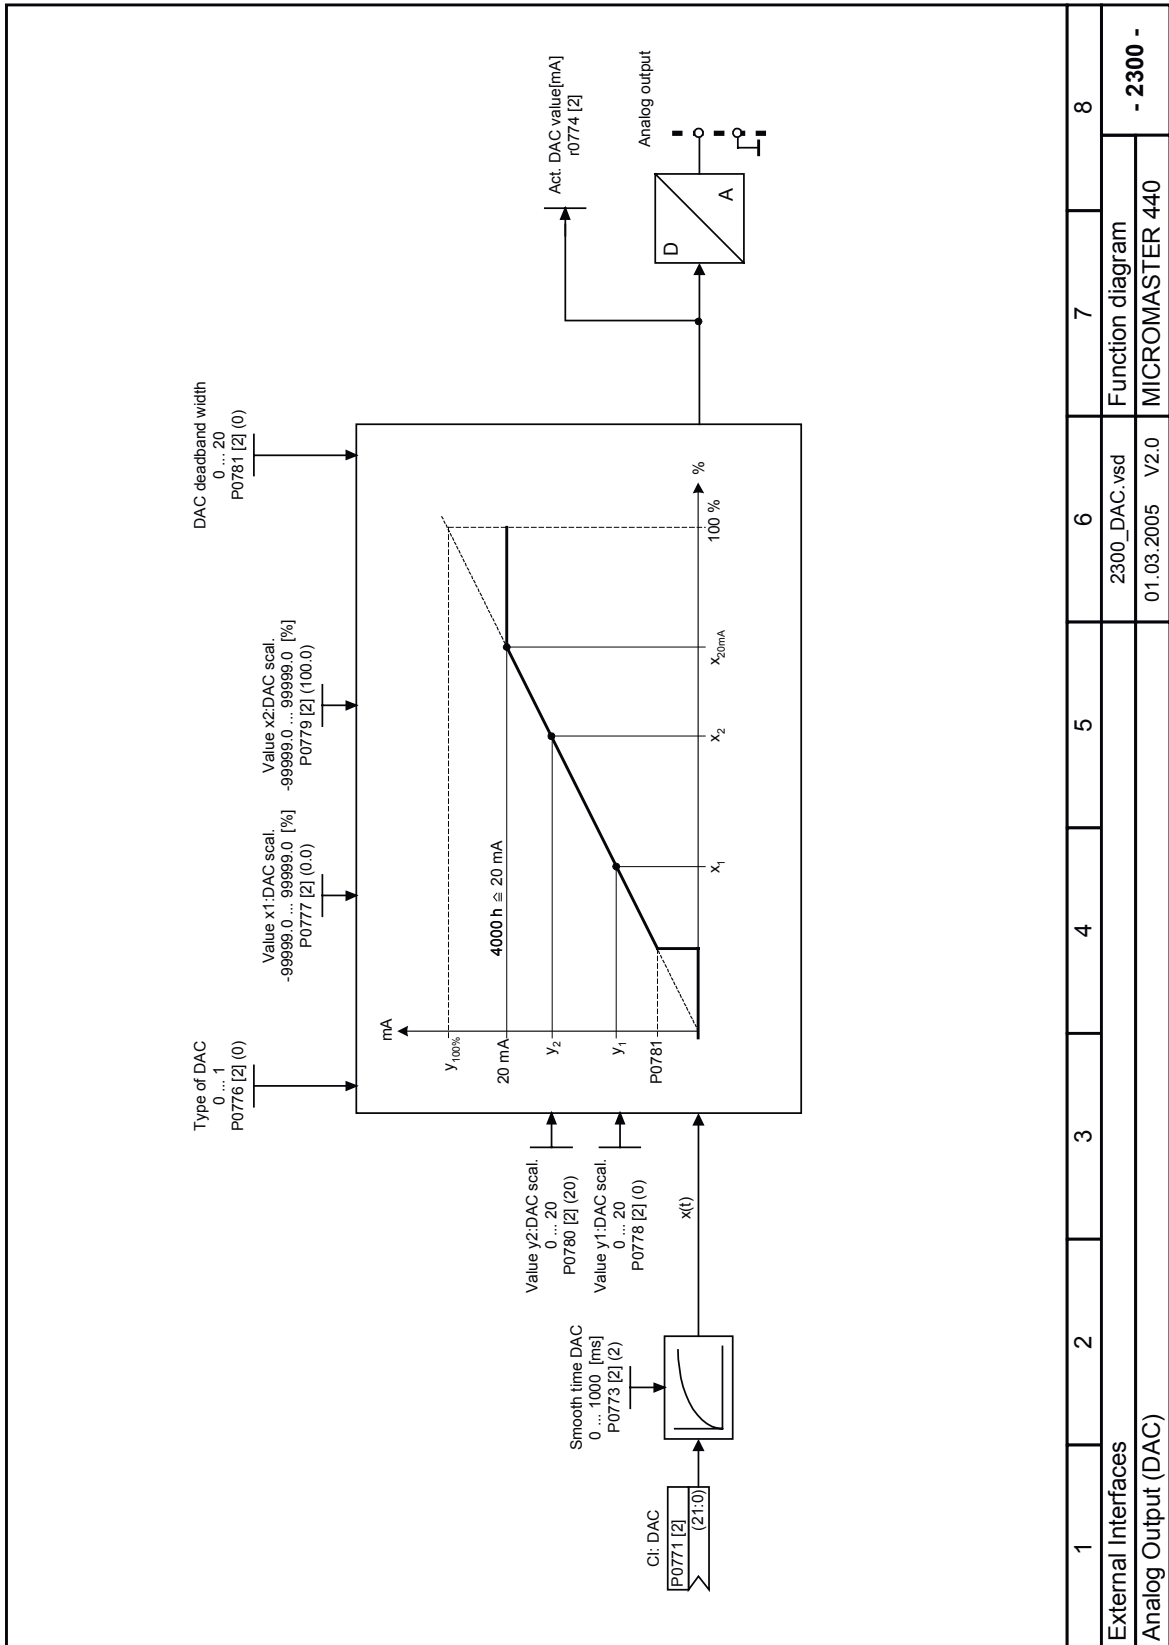

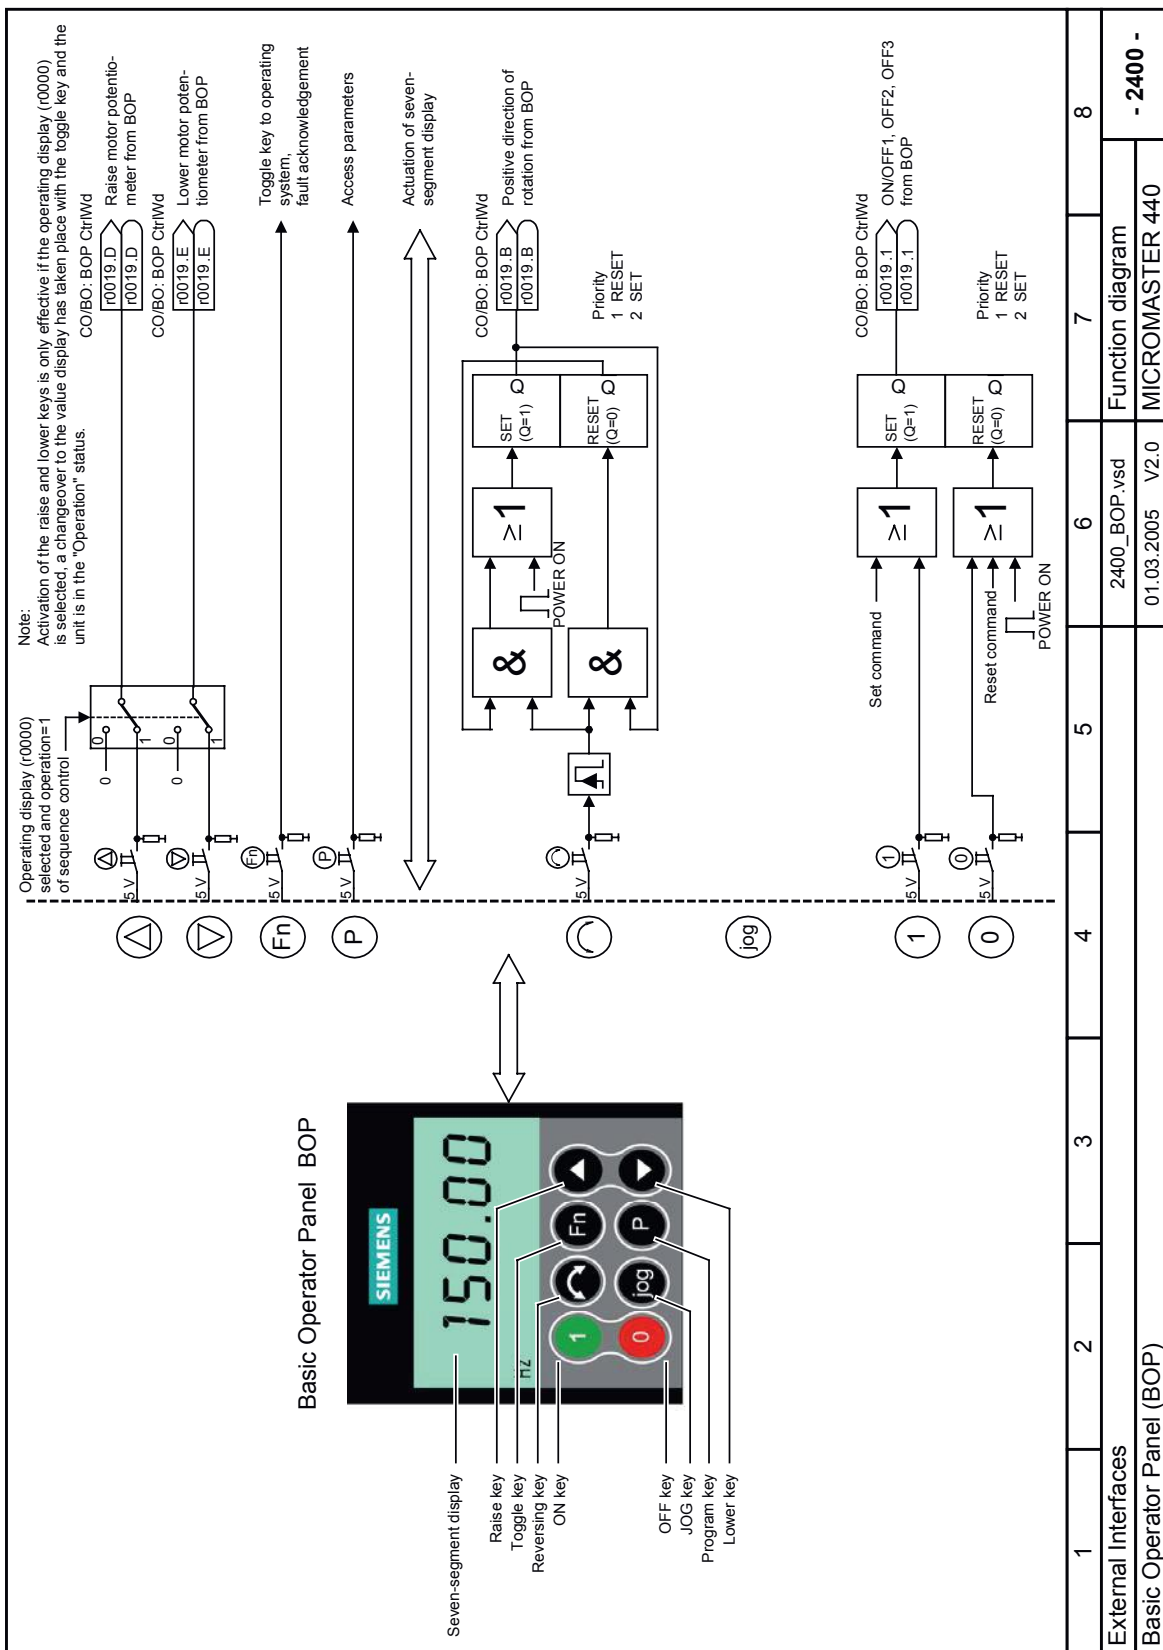


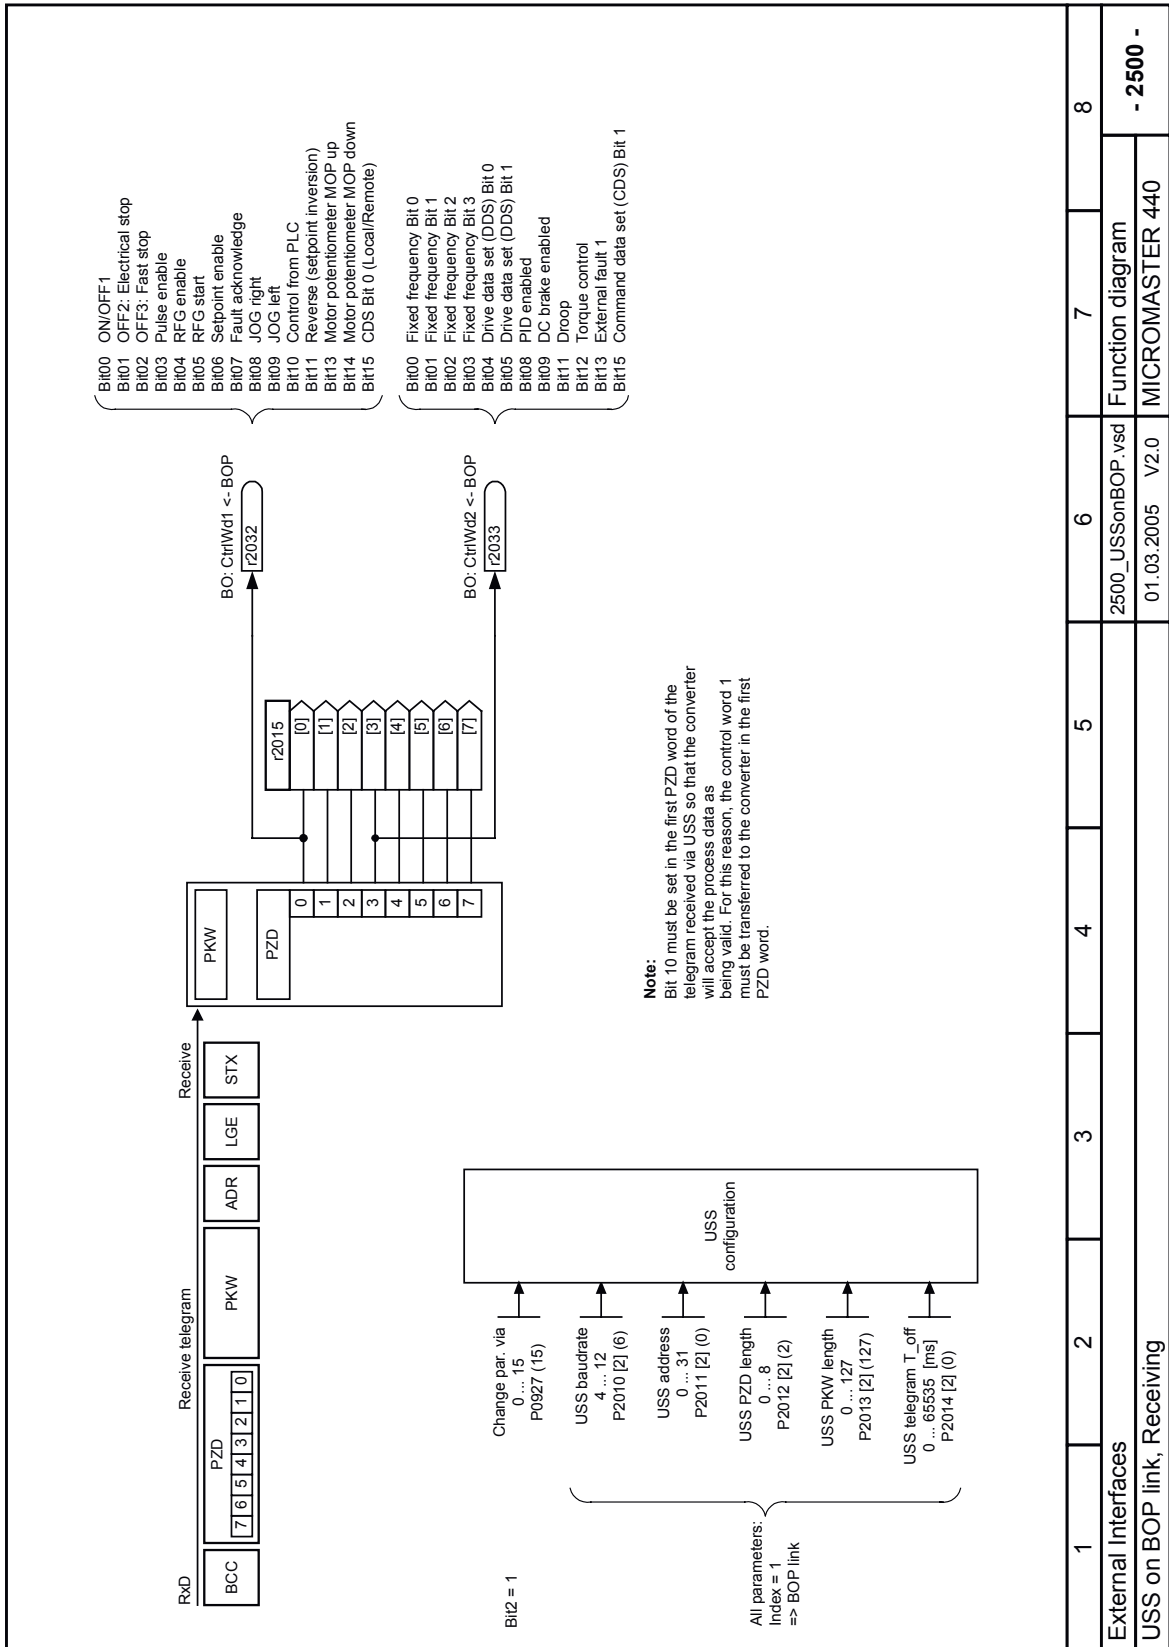





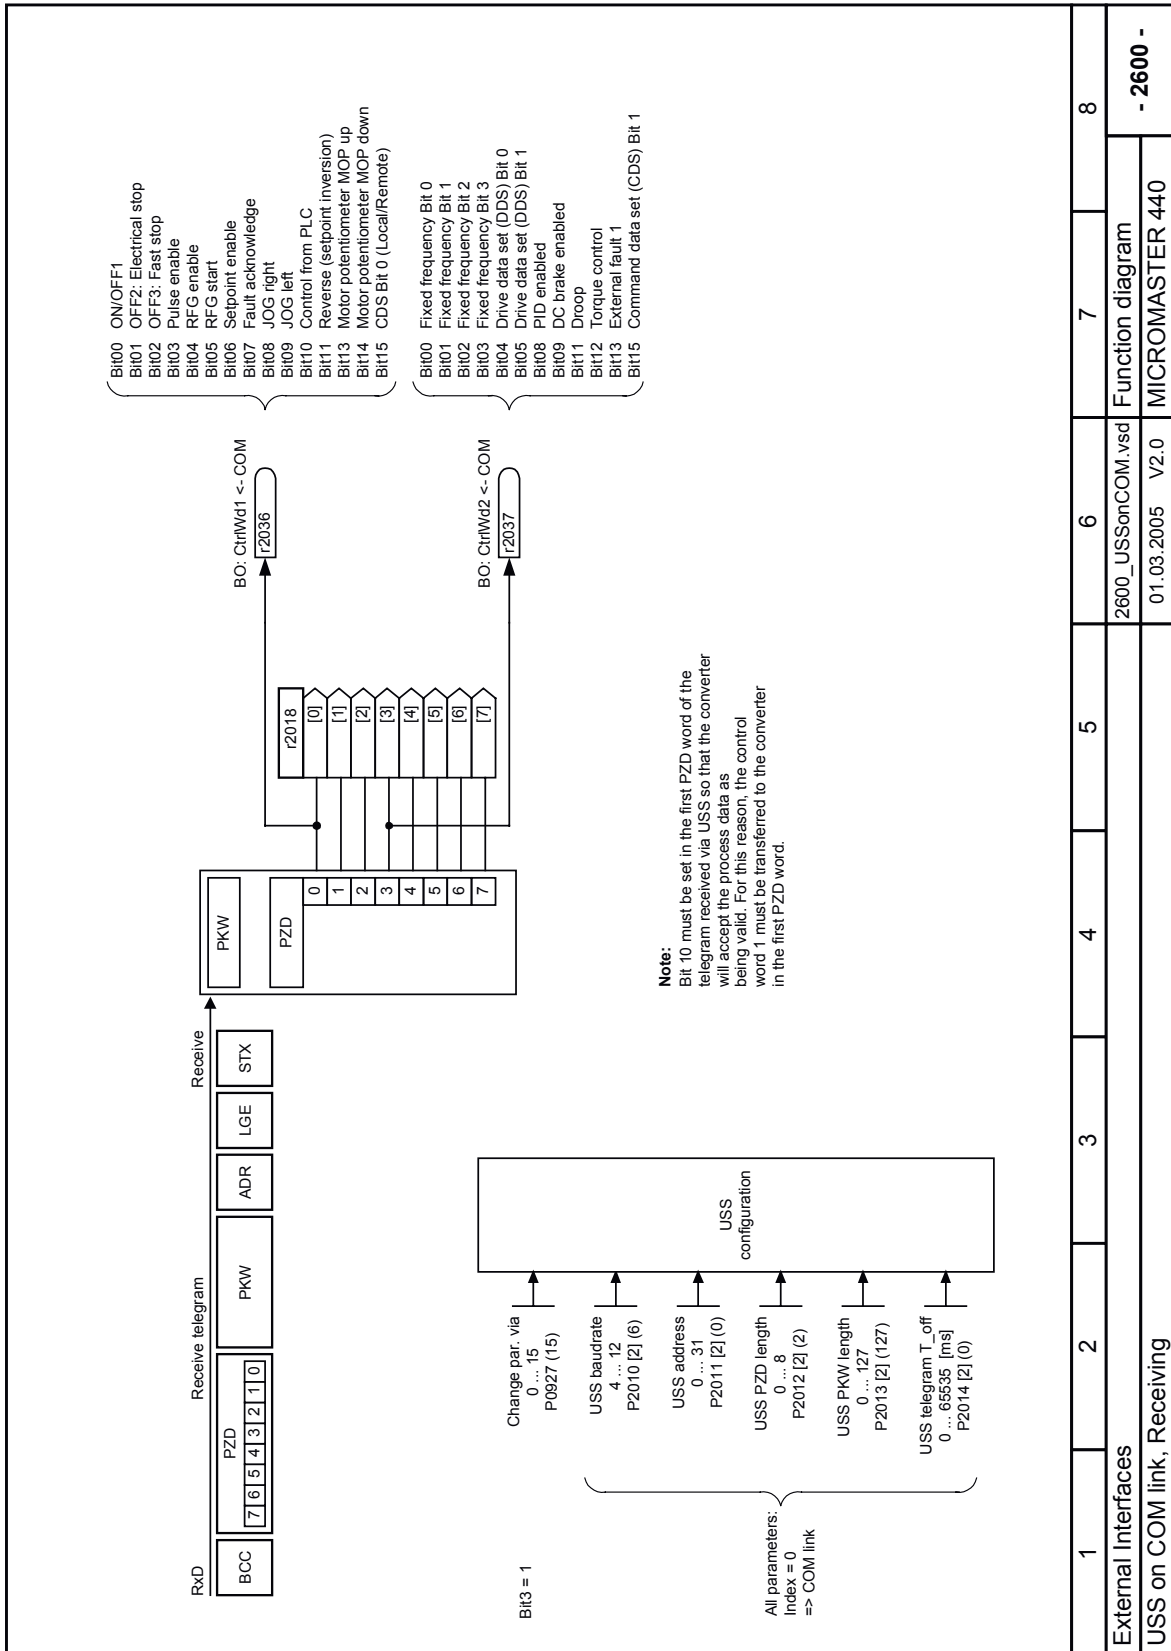





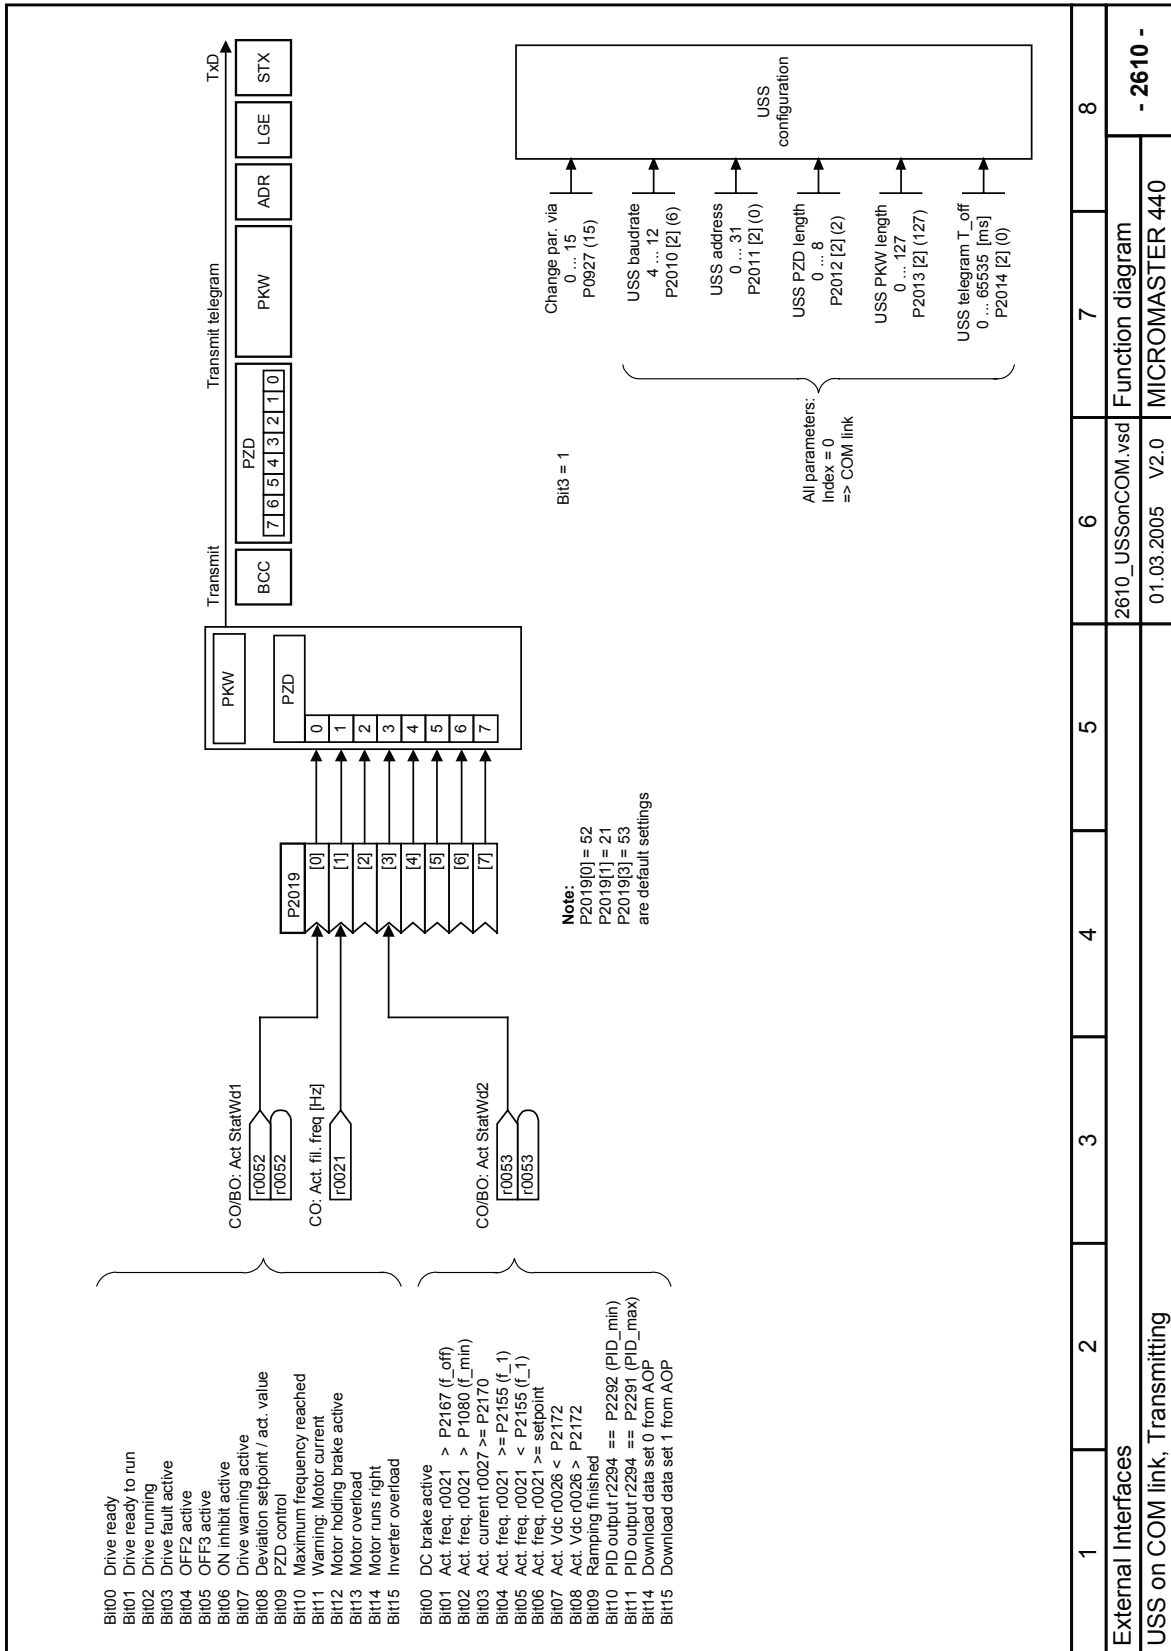

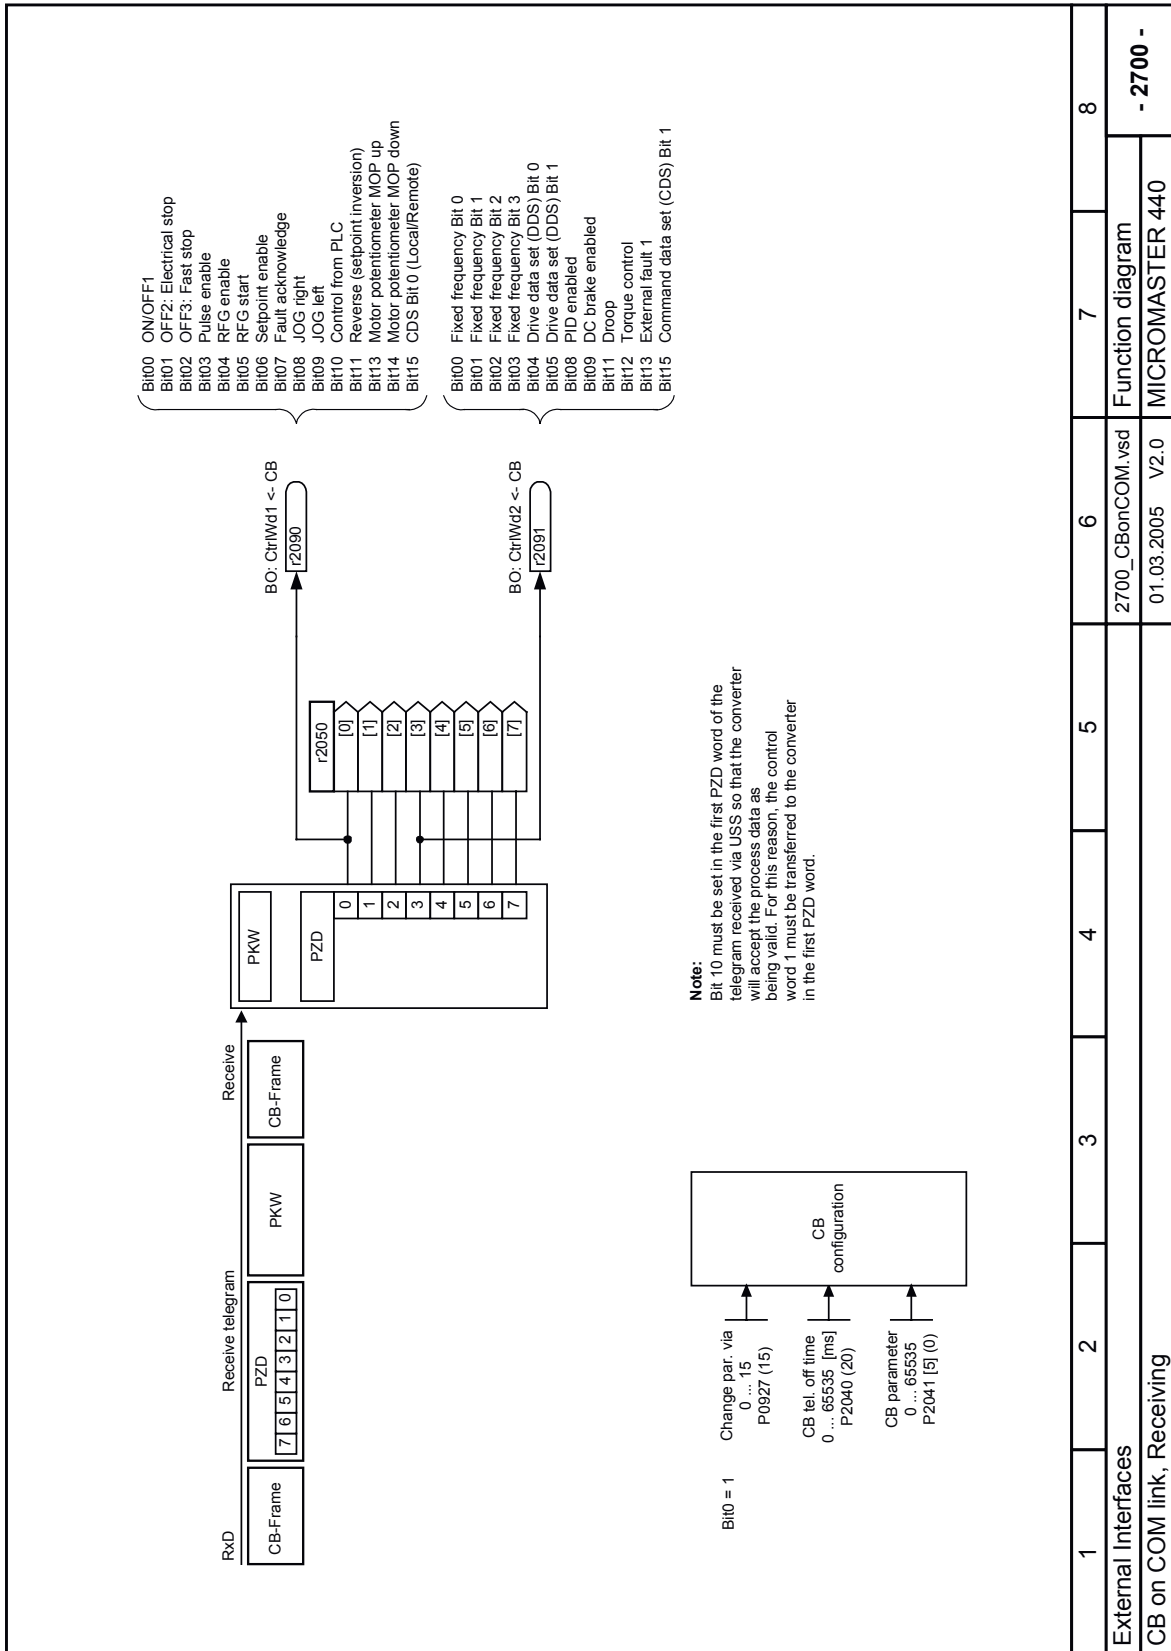


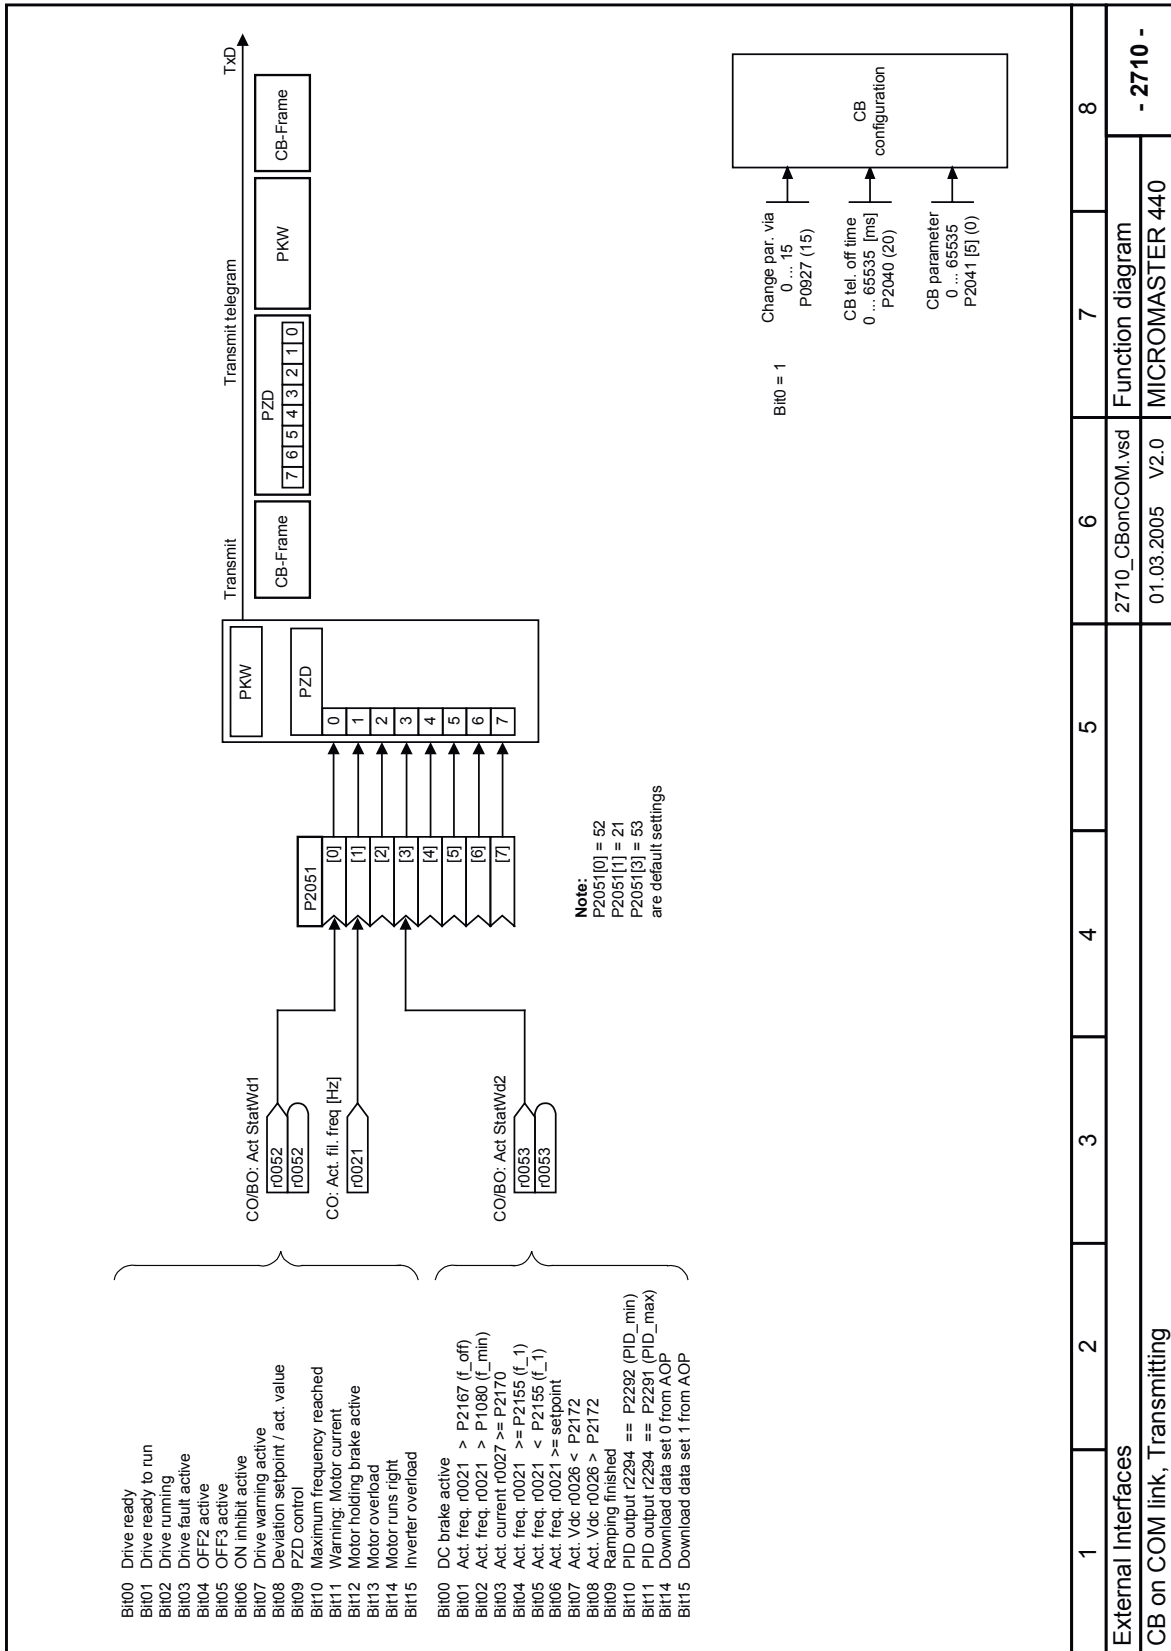


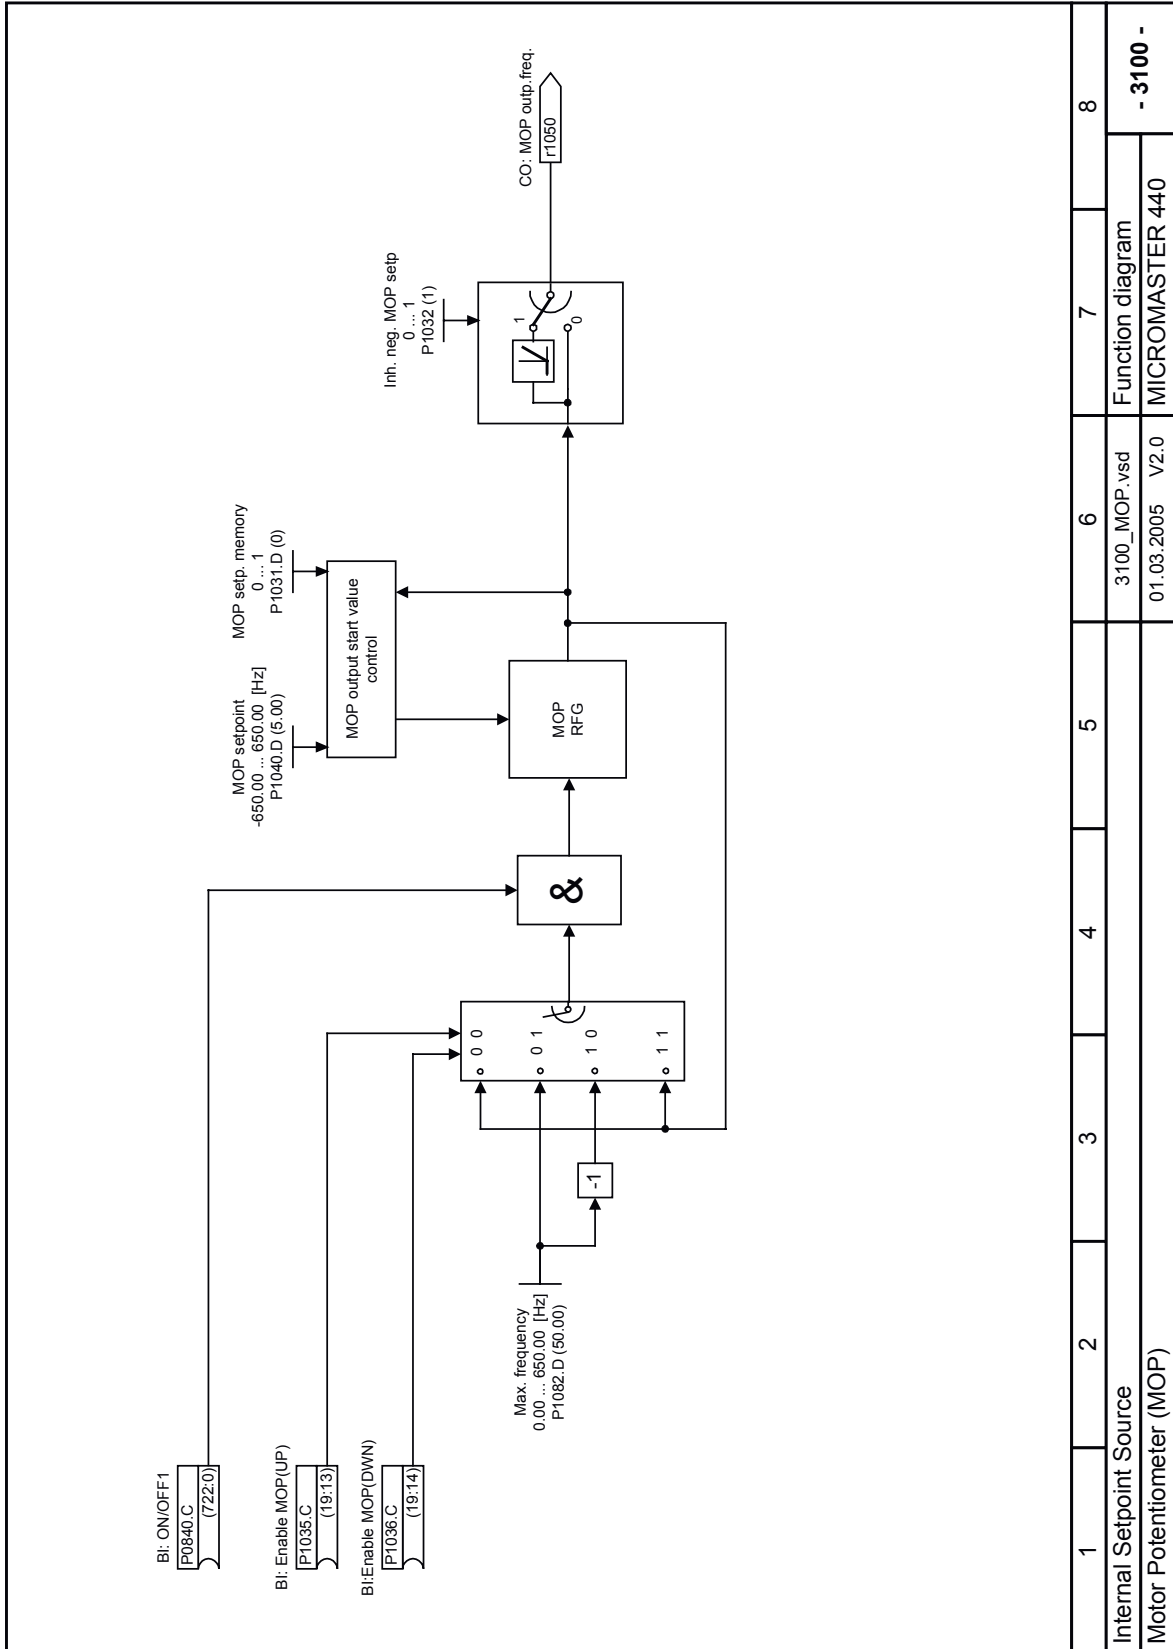


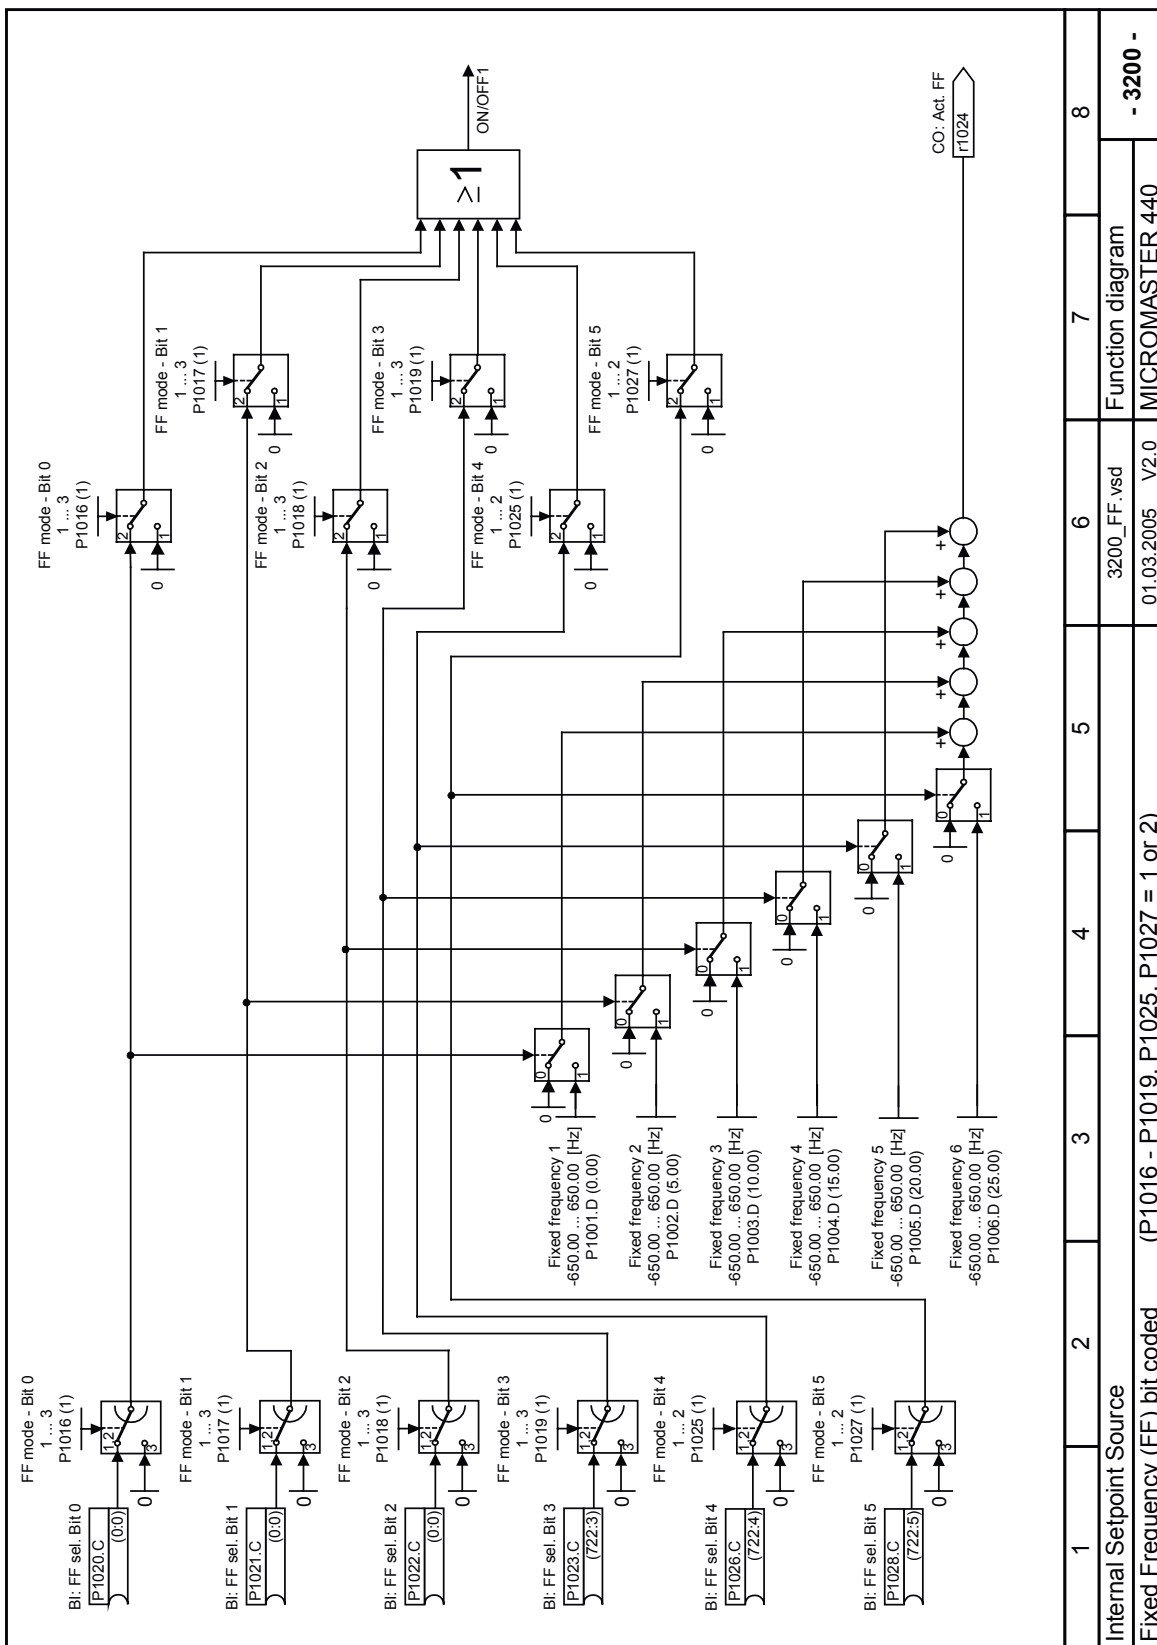

1	2	3	4	5	6	7	8
Internal Setpoint Source							
Fixed Frequency (FF) bit coded (P1016 - P1019, P1025, P1027 = 1 or 2)						Function diagram	
3200_FF.vsd						MICROMASTER 440	
01.03.2005 V2.0						- 3200 -	

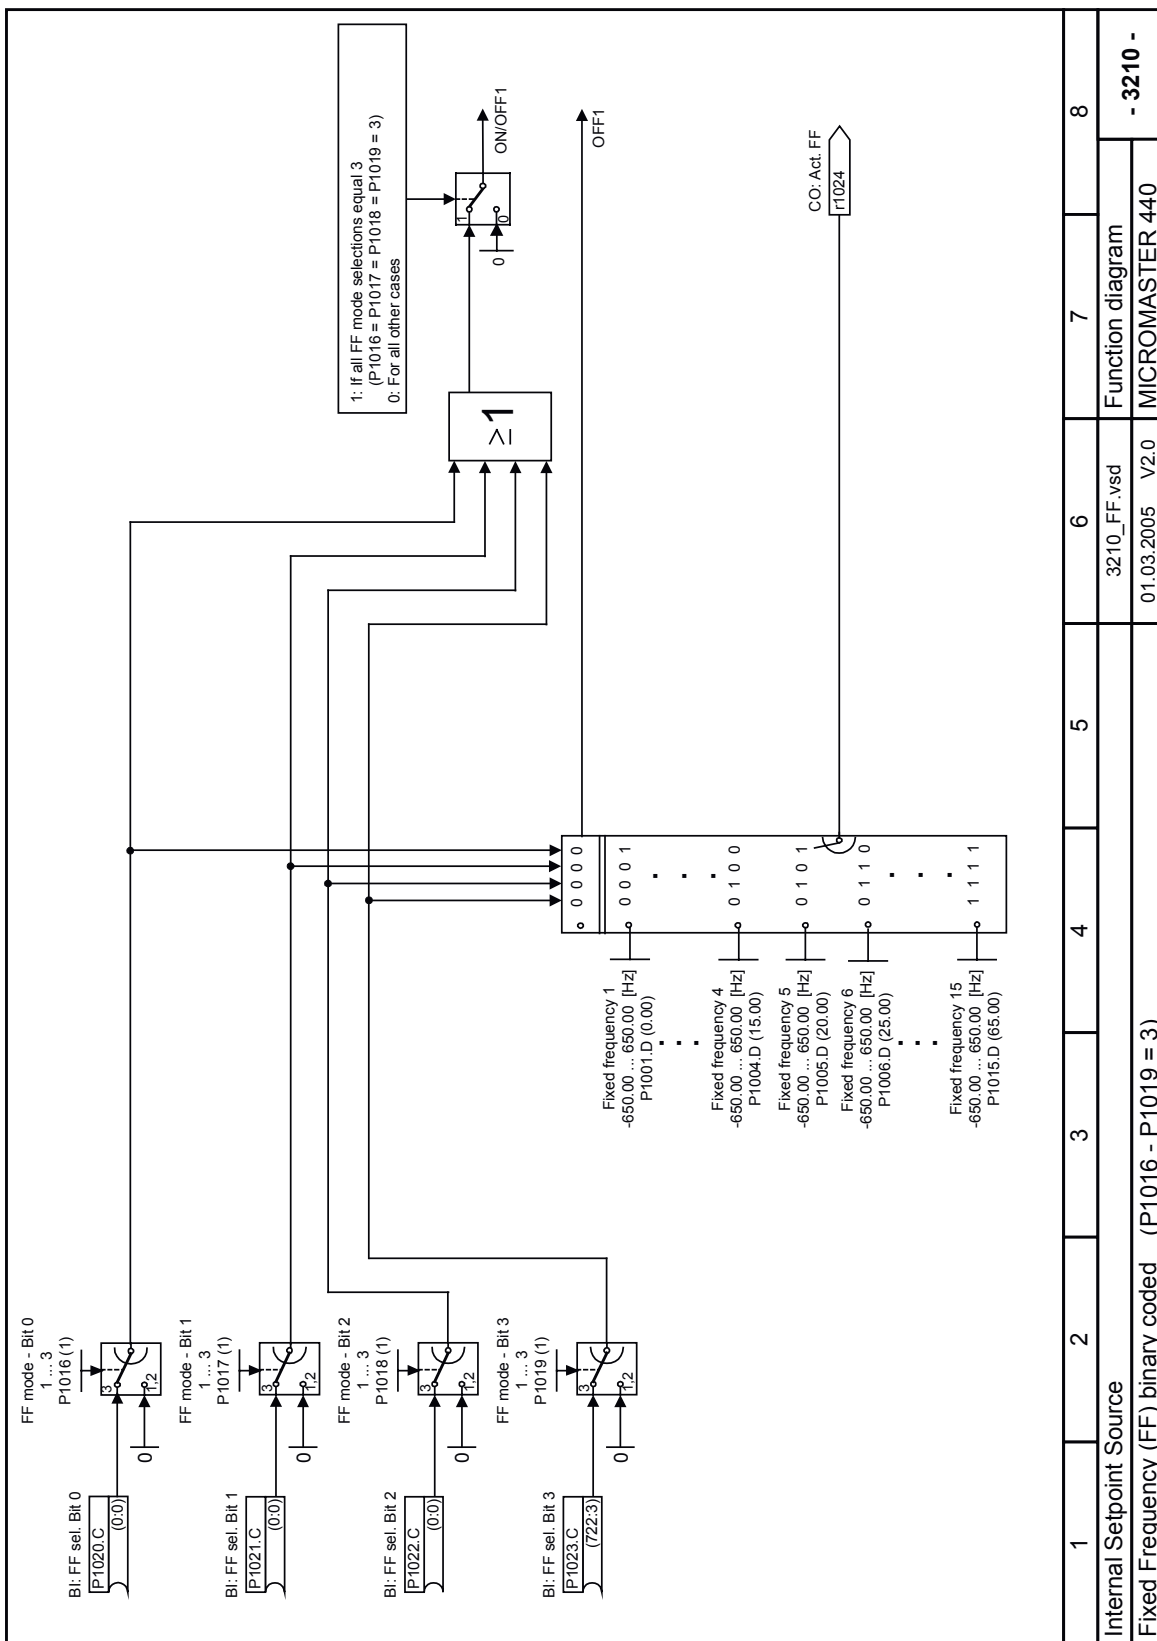


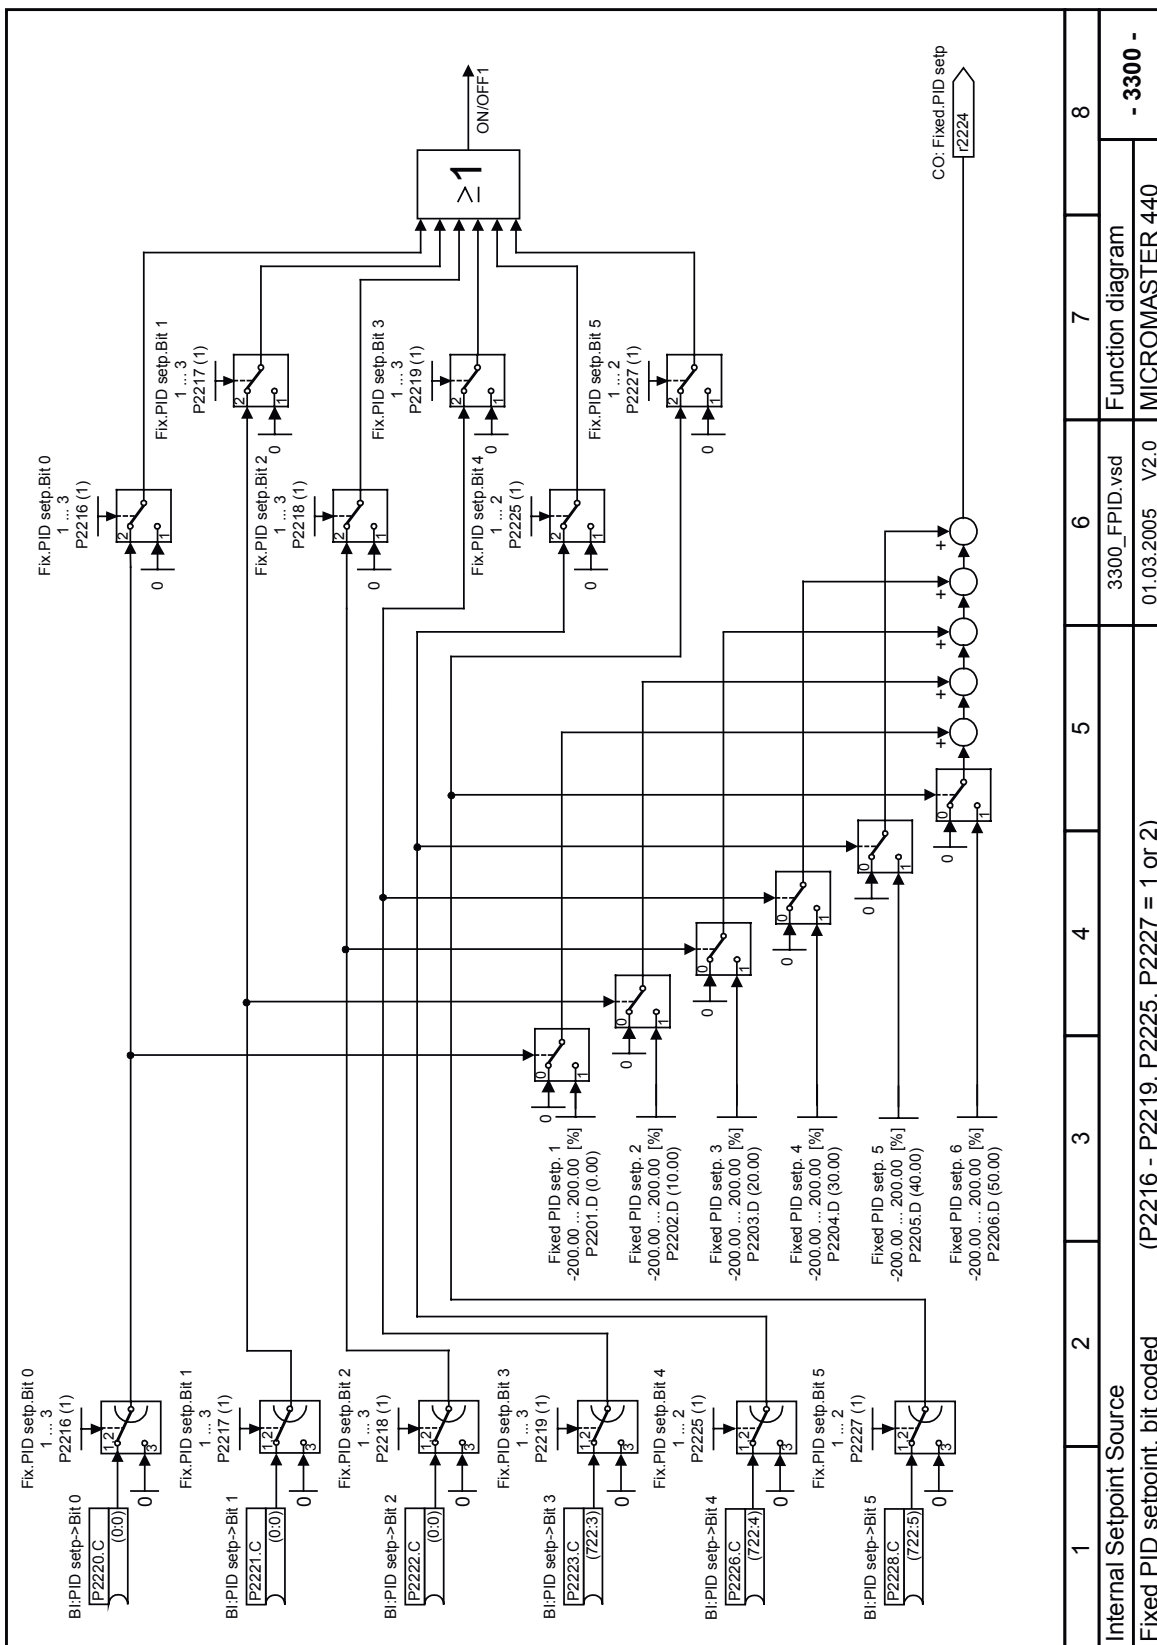


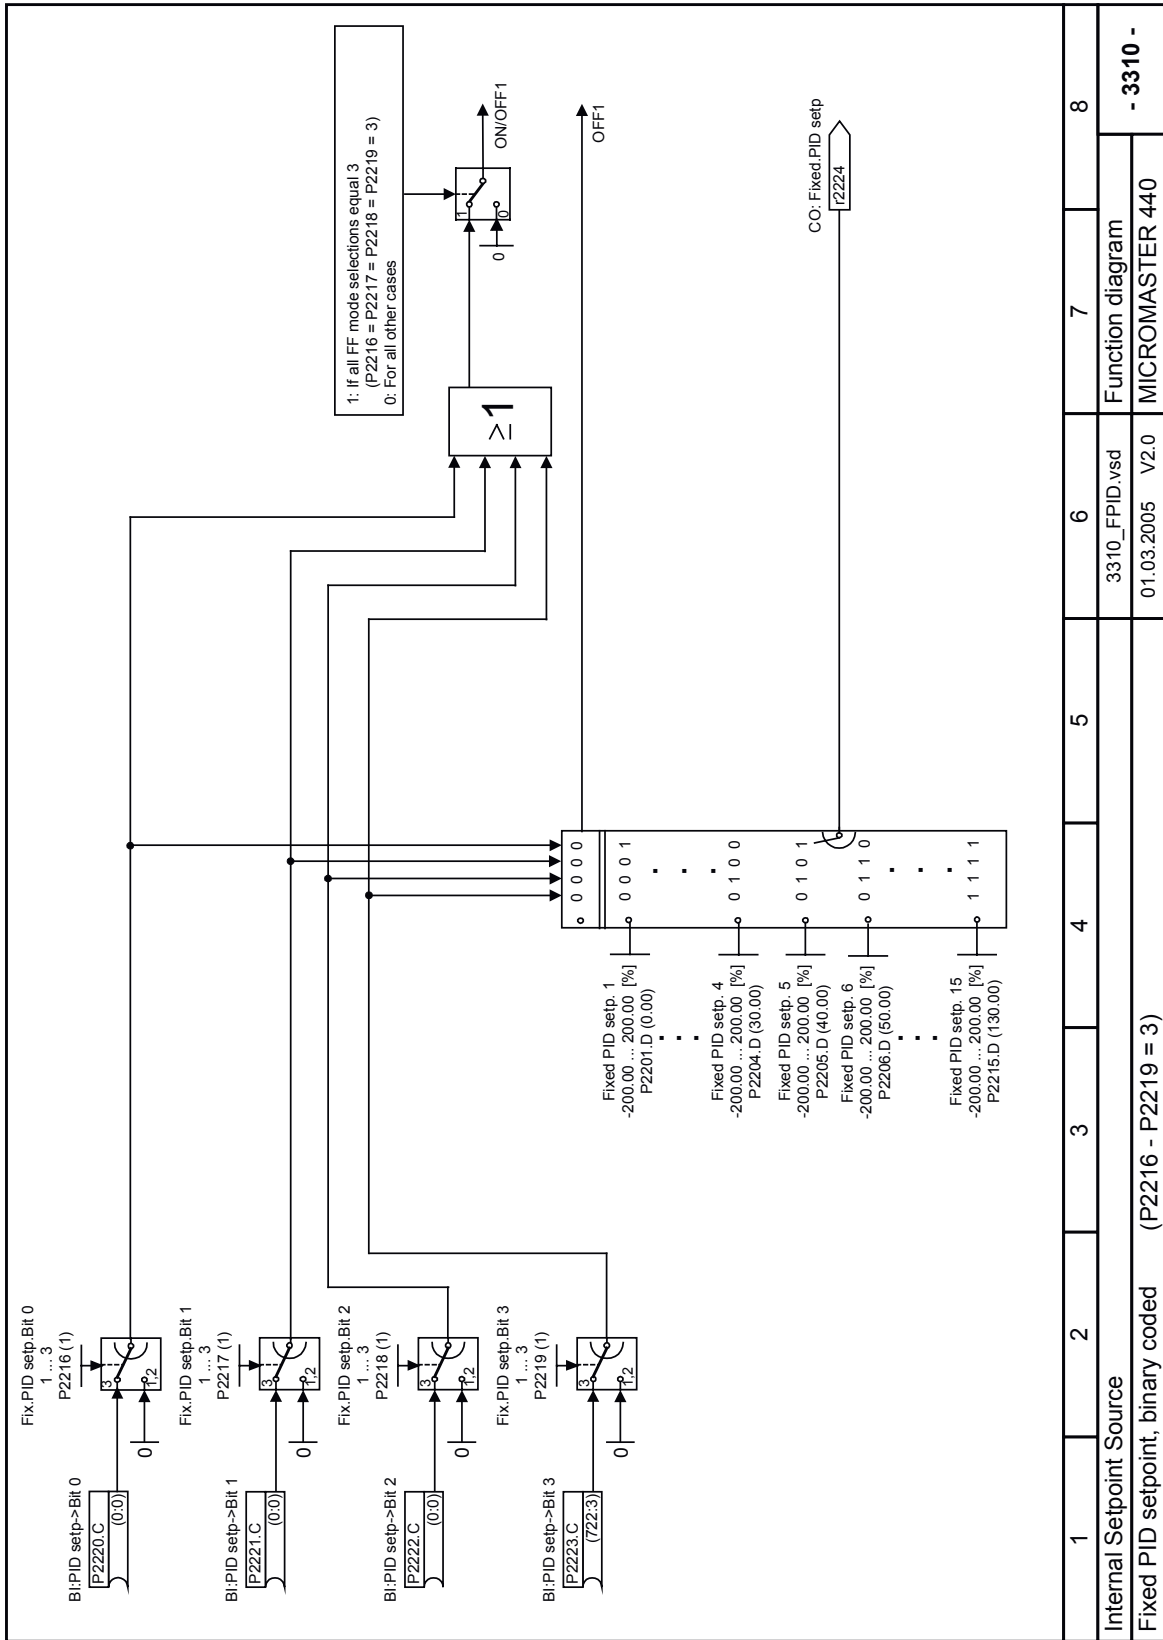


1	2	3	4	5	6	7	8
Internal Setpoint Source							
Fixed PID setpoint, binary coded (P2216 - P2219 = 3)							
3310_FPID.vsd						Function diagram	
01.03.2005 V2.0						MICROMASTER 440	
- 3310 -							



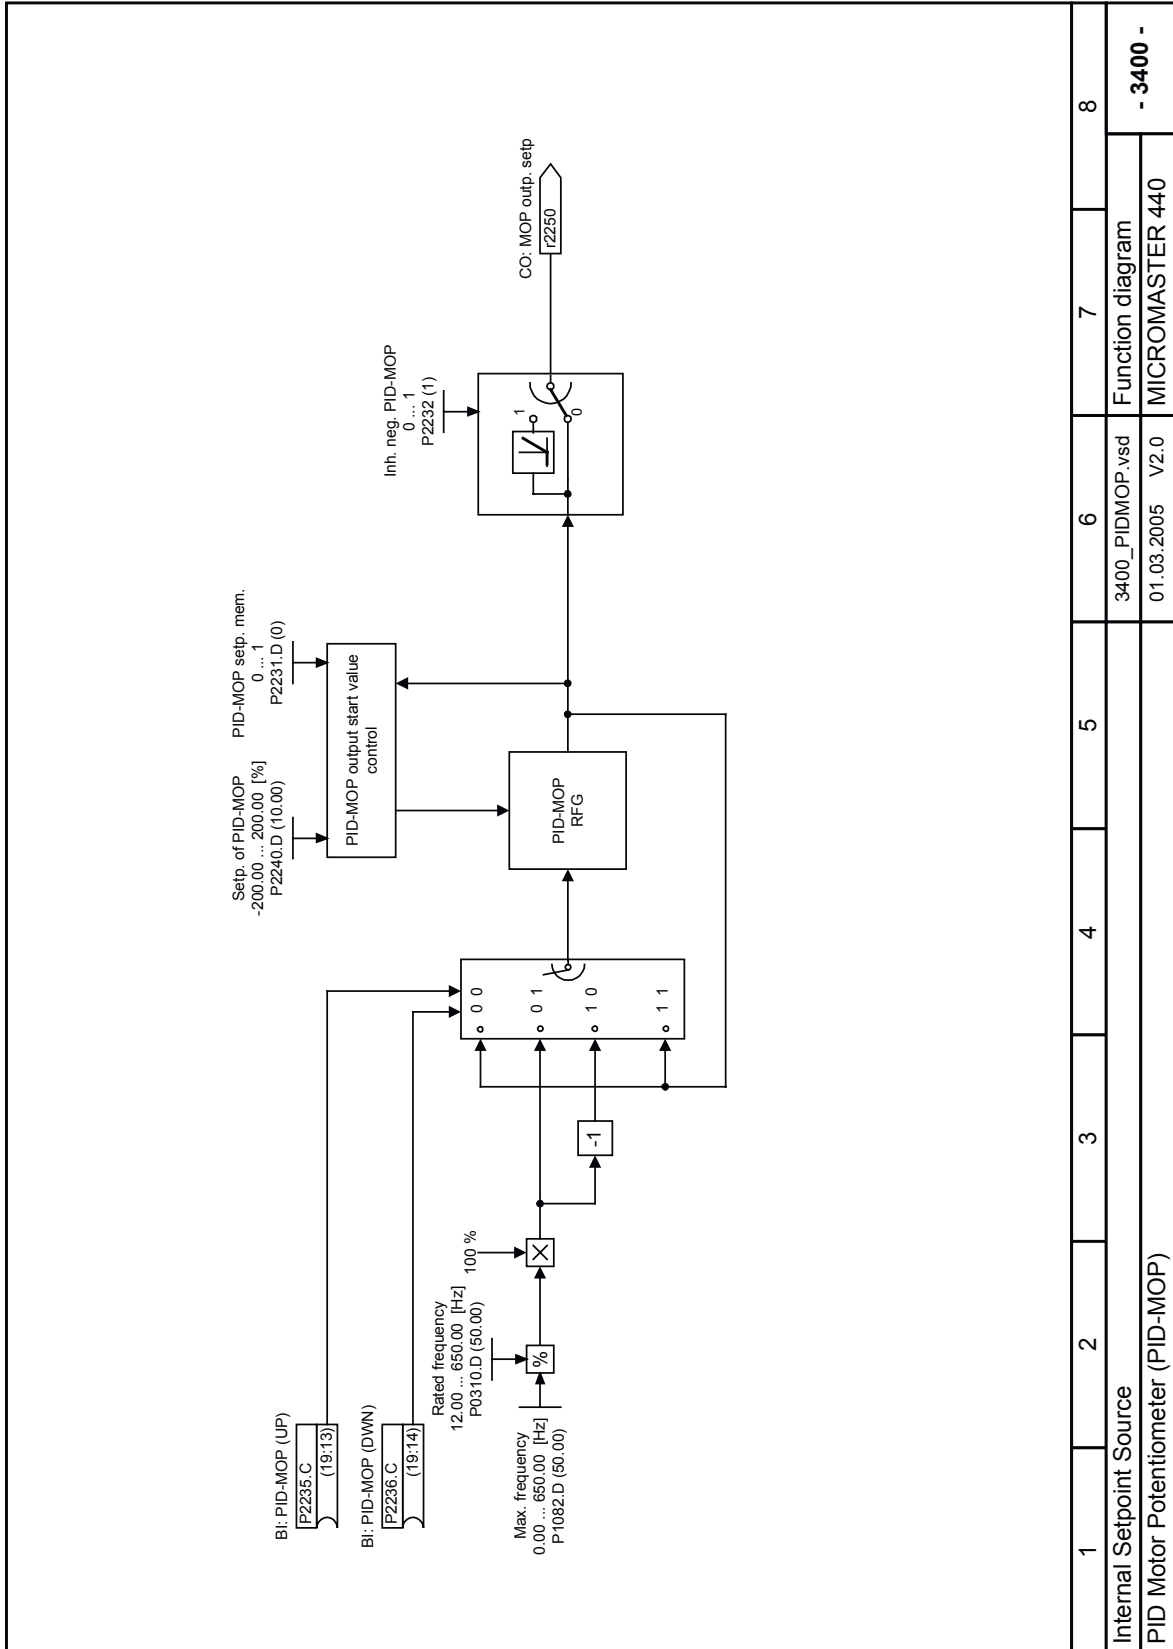

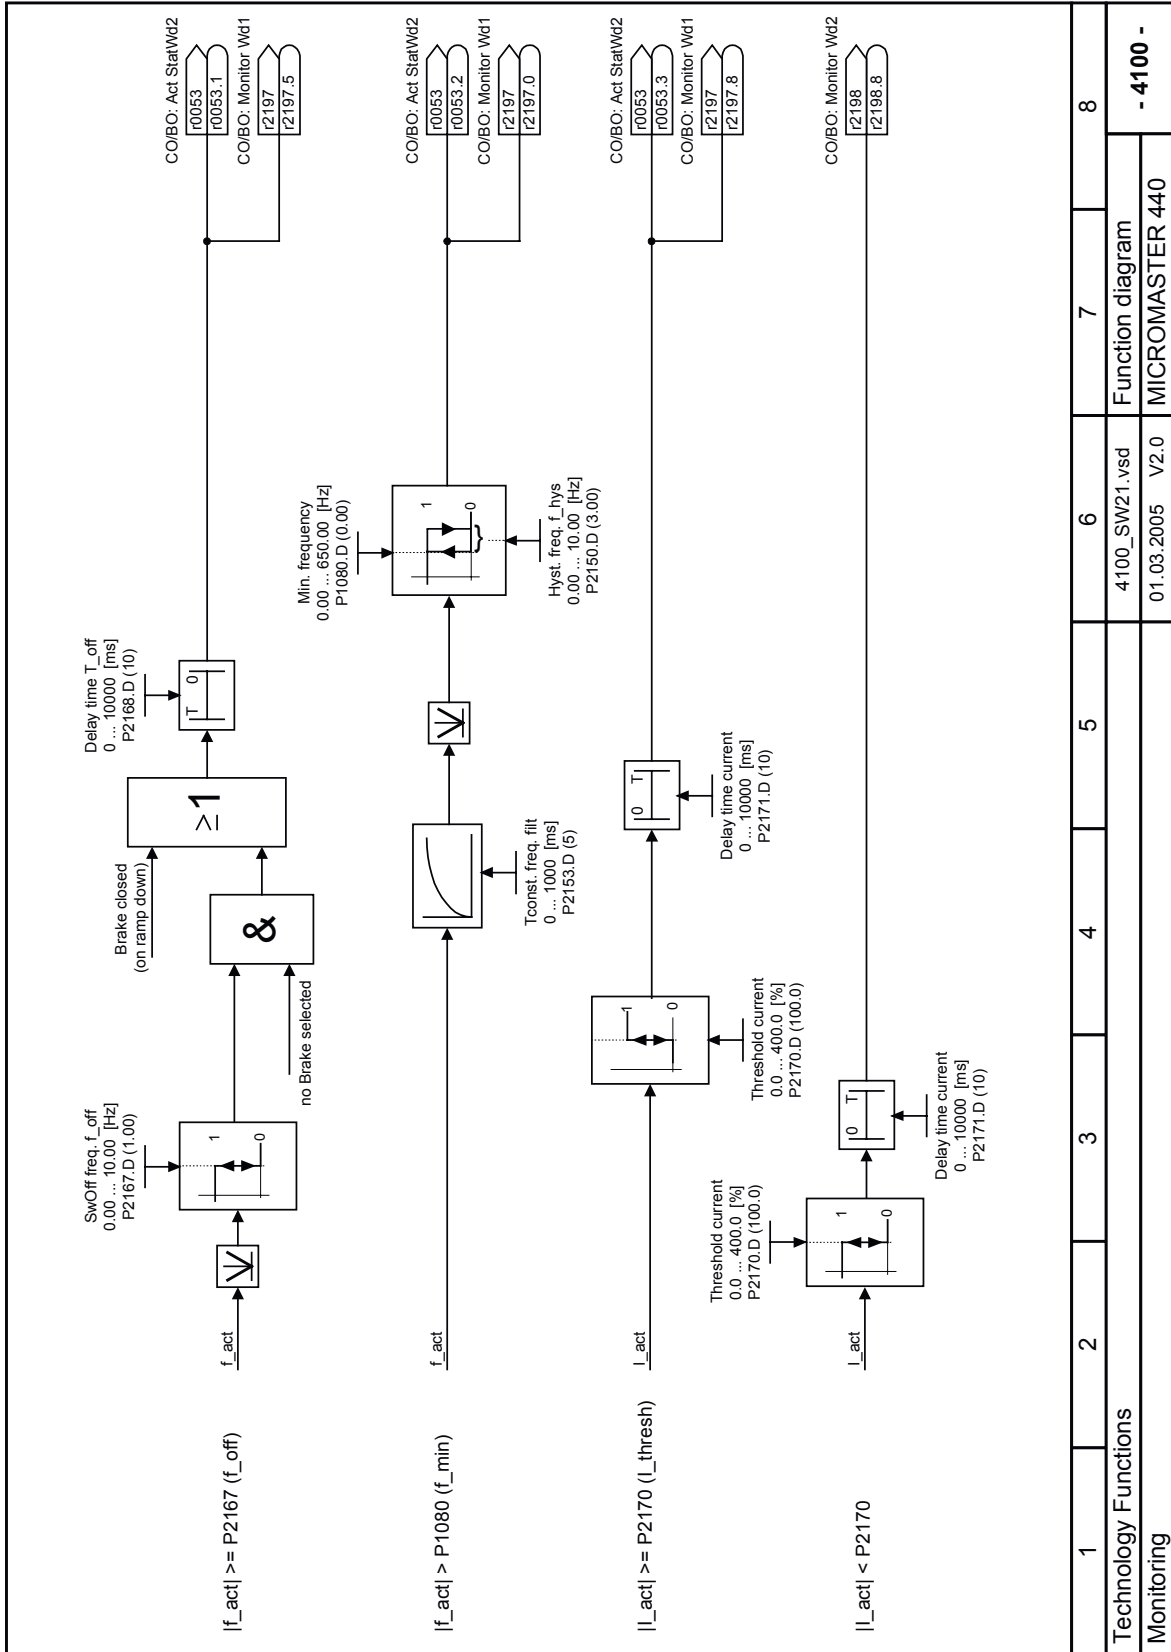

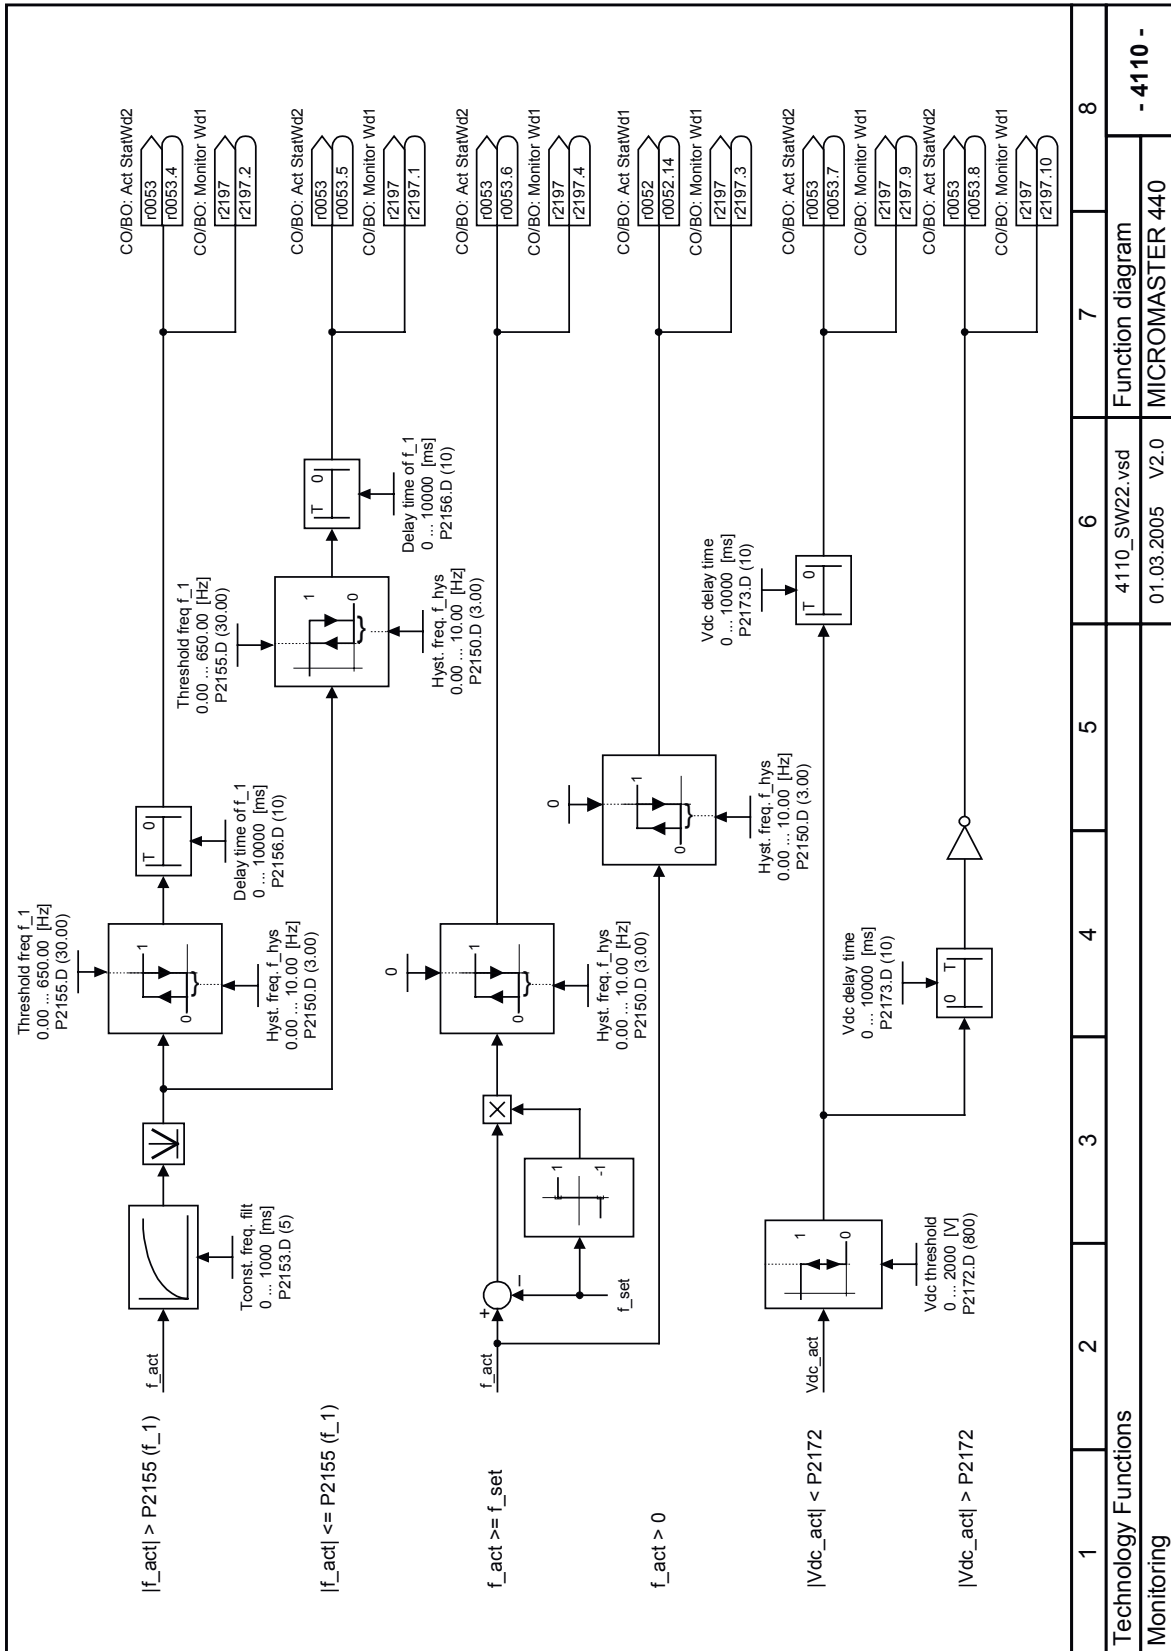


Technology Functions  
Monitoring

4110\_SW22.vsd  
01.03.2005 V2.0

Function diagram  
MICROMASTER 440

- 4110 -

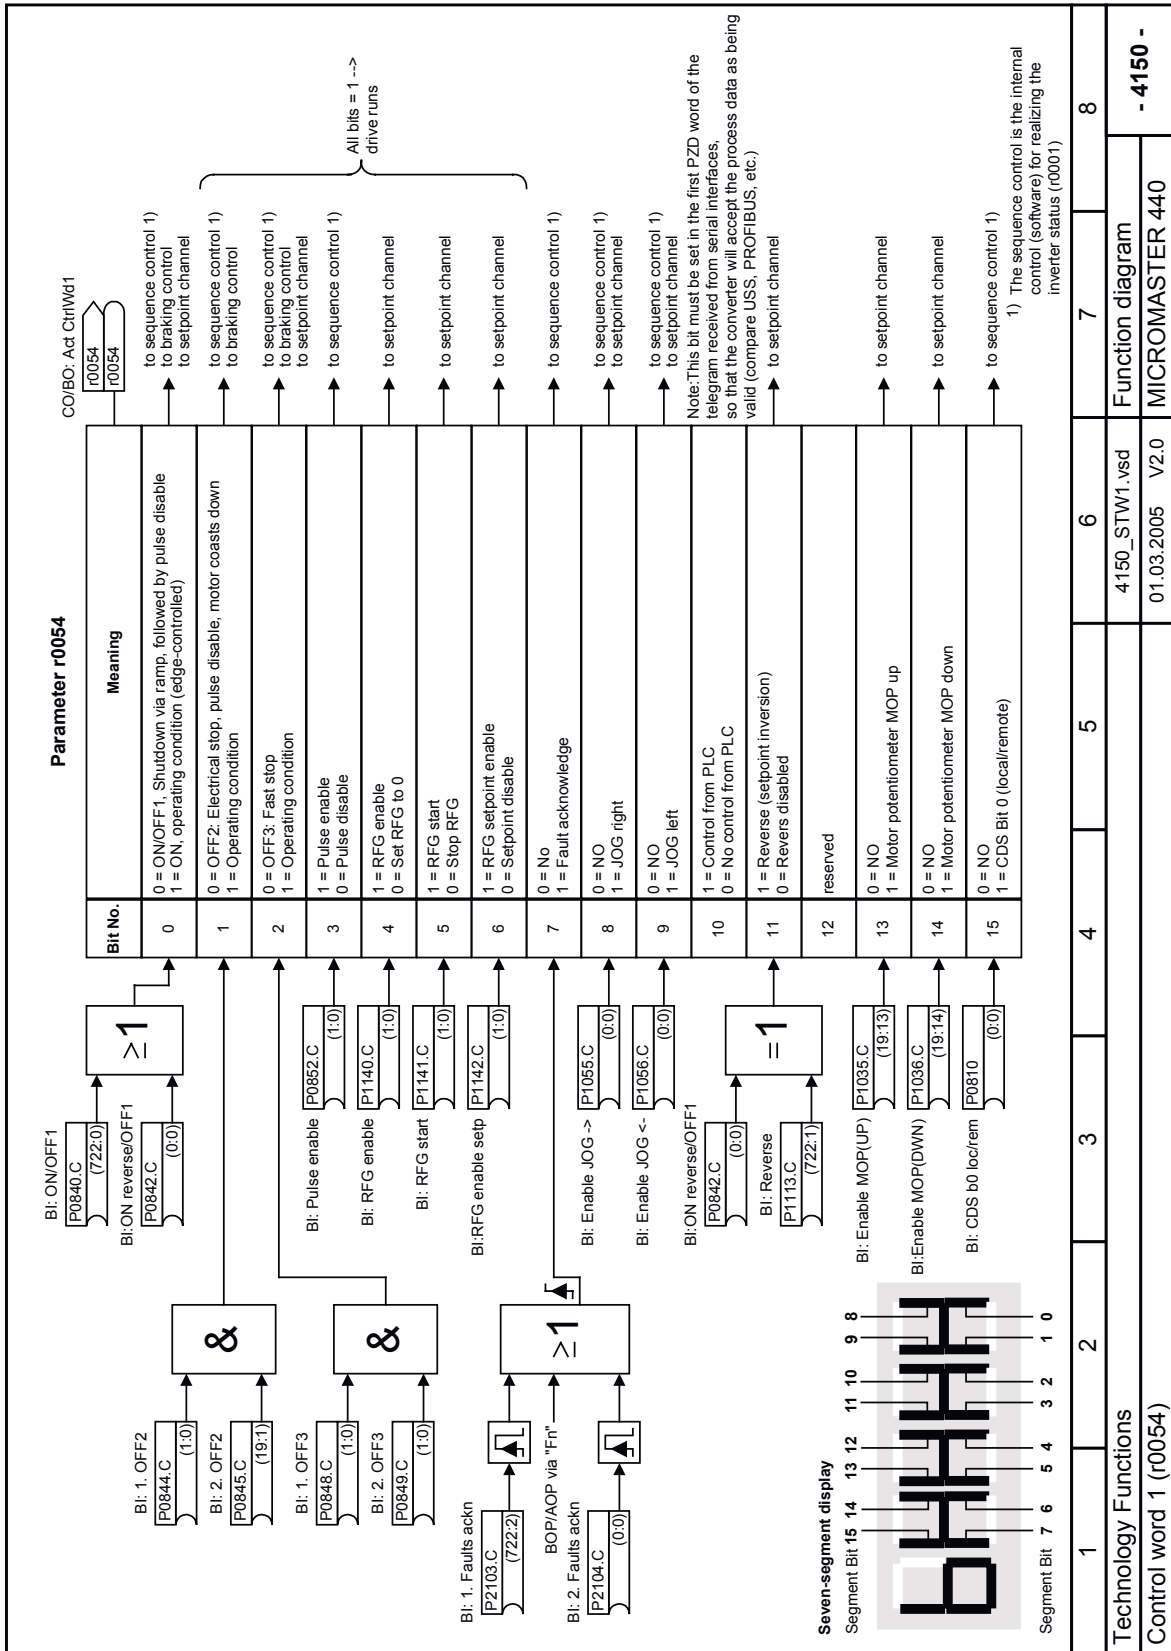

Parameter r0055		CO/BO: Act CtrlWd2	
Bit No.	Meaning		
0	0 = NO 1 = Fixed frequency Bit 0	↑	↑ to fixed frequencies
1	0 = NO 1 = Fixed frequency Bit 1	↑	↑ to fixed frequencies
2	0 = NO 1 = Fixed frequency Bit 2	↑	↑ to fixed frequencies
3	0 = NO 1 = Fixed frequency Bit 3	↑	↑ to fixed frequencies
4	0 = NO 1 = Drive data set (DDS) Bit 0	↑	↑ to sequence control 1)
5	0 = NO 1 = Drive data set (DDS) Bit 1	↑	↑ to sequence control 1)
6	reserved		
7	reserved		
8	0 = NO 1 = PID enabled	↑	↑ to PID control
9	0 = NO 1 = DC brake enabled	↑	↑ to DC braking control
10	reserved		
11	0 = NO 1 = Droop (only SLVC/MC)	↑	↑ to speed control
12	0 = NO 1 = Torque control (only SLVC/MC)	↑	↑ to speed/torque control
13	0 = External fault 1 1 = No external fault	↑	↑ to sequence control 1)
14	reserved		
15	0 = NO 1 = Command data set (CDS) Bit 1	↑	↑ to sequence control 1)

Bit: ON/OFF1  
P0840.C (722.0)

Bit: ON reverse/OFF1  
P0842.C (0.0)

Droop input source  
0 ... 3  
P1488.D (0)

Enable droop  
0 ... 1  
P1492.D (0)

Seven-segment display  
Segment Bit 15 14 13 12 11 10 9 8  
Segment Bit 7 6 5 4 3 2 1 0

Bit: FF sel. Bit 0  
P1020.C (0.0)

Bit: FF sel. Bit 1  
P1021.C (0.0)

Bit: FF sel. Bit 2  
P1022.C (0.0)

Bit: FF sel. Bit 3  
P1023.C (722.3)

Bit: DDS bit 0  
P0820 (0.0)

Bit: DDS bit 1  
P0821 (0.0)

Bit: Enab. PID ctrl  
P2200.C (0.0)

Bit: Enable DC brk.  
P1230.C (0.0)

Bit:-> torque ctrl.  
P1501.C (0.0)

Bit: External fault  
P2106.C (1.0)

Bit: CDS bit 1  
P0811 (0.0)

1	2	3	4	5	6	7	8
Technology Functions							
Control word 2 (r0055)							
4160_STW2.vsd						Function diagram	
01.03.2005 V2.0						MICROMASTER 440	

1) The sequence control is the internal control (software) for realizing the drive status (r0002)


Parameter r0052		CO/BO: Act StatWd1	
Bit No.	Meaning	r0052	r0052
0	1 = Drive ready 0 = Drive not ready	↑	↑
1	1 = Drive ready to run (DC link loaded, pulses disabled) 0 = Drive not ready to run	↑	↑
2	1 = Drive running (voltage at output terminals) 0 = Pulses disabled	↑	↑
3	1 = Drive fault active (pulses disabled) 0 = No fault	↑	↑
4	0 = OFF2 active 1 = No OFF2	↑	↑
5	0 = OFF3 active 1 = No OFF3	↑	↑
6	1 = ON inhibit active 0 = No On inhibit (possible to switch on)	↑	↑
7	1 = Drive warning active 0 = No warning	↑	↑
8	0 = Deviation setpoint / act. value 1 = No deviation setpoint / act. Value	↑	↑
9	1 = PZD control (always 1)	↑	↑
10	1 = Maximum frequency reached 0 = Maximum frequency not reached	↑	↑
11	0 = Warning: Motor current limit 1 = Motor current limit not reached	↑	↑
12	1 = Motor holding brake active 0 = Motor holding brake not active	↑	↑
13	0 = Motor overload 1 = No Motor overload	↑	↑
14	1 = Motor runs right 0 = Motor does not run right	↑	↑
15	0 = Inverter overload 1 = No inverter overload	↑	↑

Seven-segment display

Segment Bit 15 14 13 12 11 10 9 8

Segment Bit 7 6 5 4 3 2 1 0

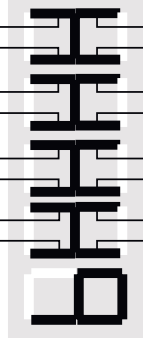

1

2

3

4

5

6

7

8

Technology Functions

4170\_ZSW1.vsd

01.03.2005 V2.0

Function diagram

- 4170 -

MICROMASTER 440

Status word 1 (r0052)

1

2

3

4

5

6

7

8

1) The sequence control is the internal control (software) for realizing the drive status (r0002)

↑

↑

↑

↑

↑

↑

↑

↑


Parameter r0053		CO/BO: Act StatWd2
Bit No.	Meaning	
0	1 = DC brake active 0 = DC brake not active	
1	1 = f_act > P2167 (f_off)	
2	1 = f_act >= P1080 (f_min)	
3	1 = Act. current r0027 >= P2170	
4	1 = f_act > P2155 (f_1)	
5	1 = f_act <= P2155 (f_1)	
6	1 = f_act >= setpoint	
7	1 = Act. Vdc: r0026 < P2172	
8	1 = Act. Vdc: r0026 > P2172	
9	1 = Ramping finished	
10	1 = PID output r2294 == P2292 (PID_min)	
11	1 = PID output r2294 == P2291 (PID_max)	
12	reserved	
13	reserved	
14	Download data set 0 from AOP	
15	Download data set 1 from AOP	

Seven-segment display

Segment Bit 15 14 13 12 11 10 9 8


Segment Bit 7 6 5 4 3 2 1 0

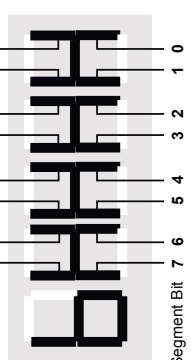





1	2	3	4	5	6	7	8
Technology Functions							
Status word 2 (r0053)							
4180_ZSW2.vsd						Function diagram	
01.03.2005 V2.0						MICROMASTER 440	
						- 4180 -	


1) The sequence control is the internal control (software) for realizing the drive status (r0002)

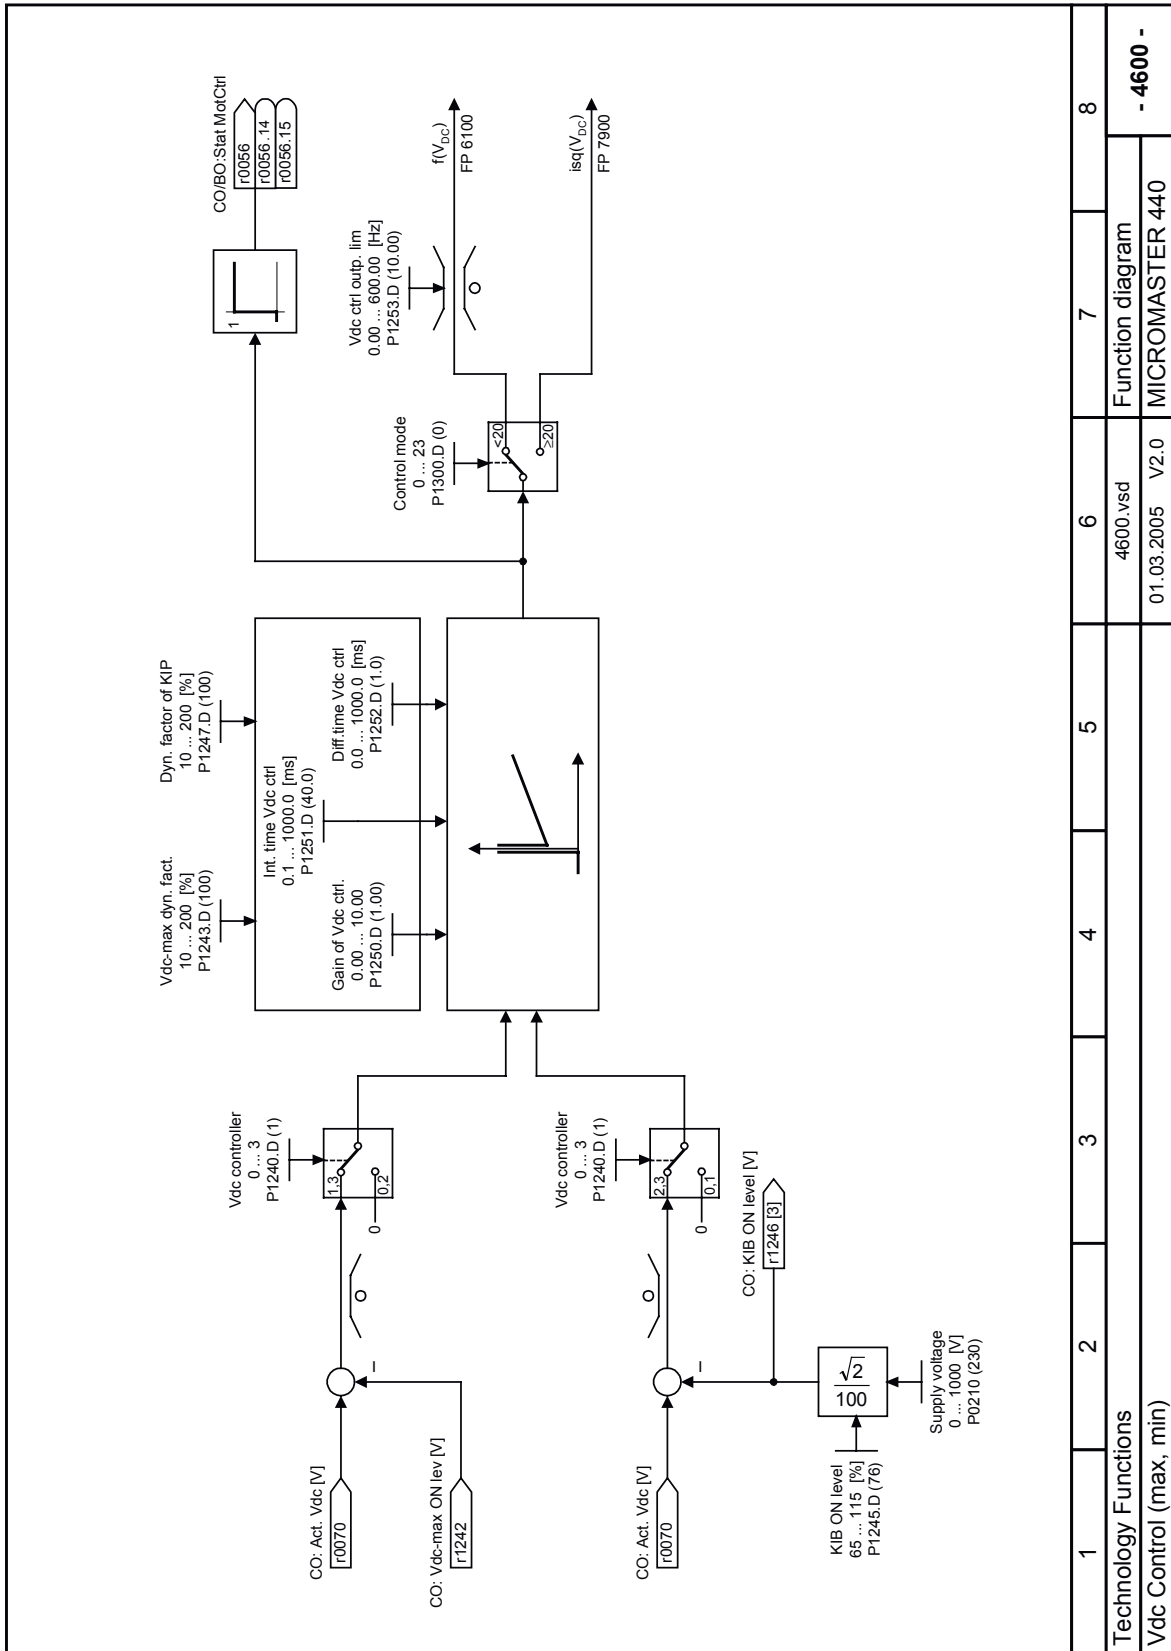













1	2	3	4	5	6	7	8
Technology Functions							
Vdc Control (max, min)							
					4600.vsd	Function diagram	
					01.03.2005	MICROMASTER 440	
					V2.0	- 4600 -	

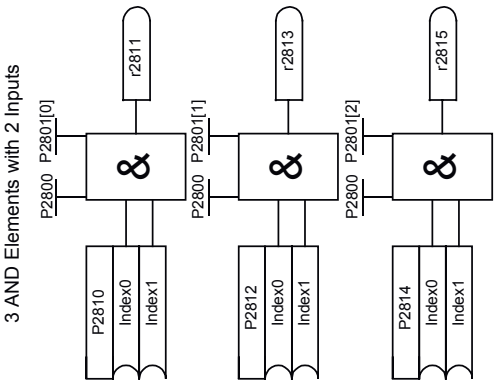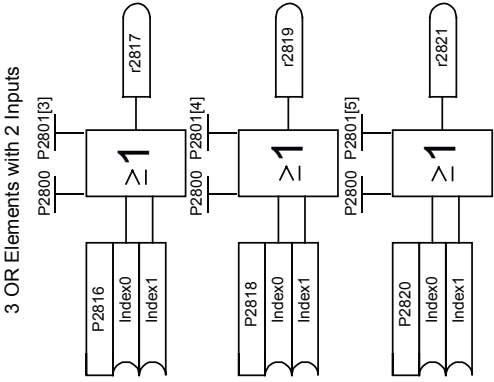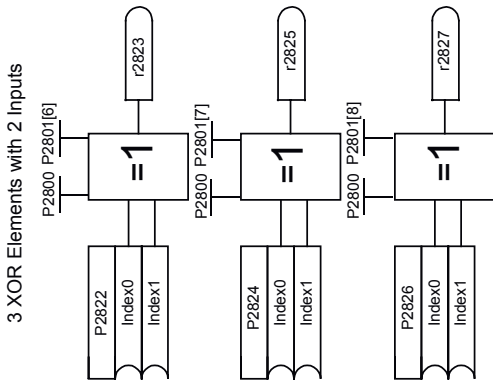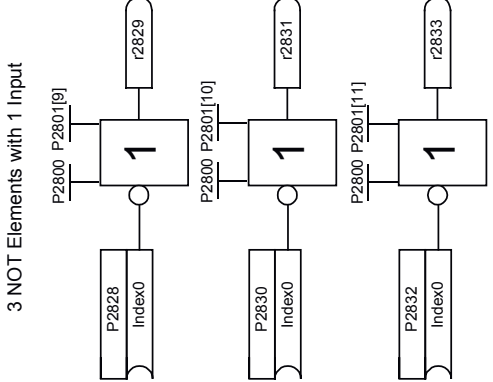


3 AND Elements with 2 Inputs			3 OR Elements with 2 Inputs			3 XOR Elements with 2 Inputs			3 NOT Elements with 1 Input								
1	2	3	4	5	6	7	8	1	2	3	4	5	6	7	8		
												<p>Free Blocks</p> <p>4800_FreeBlocks1.vsd</p> <p>01.03.2005 V2.0</p>			<p>Function diagram</p> <p>MICROMASTER 440</p>		
AND-, OR-, XOR- and NOT- Elements																	
- 4800 -																	

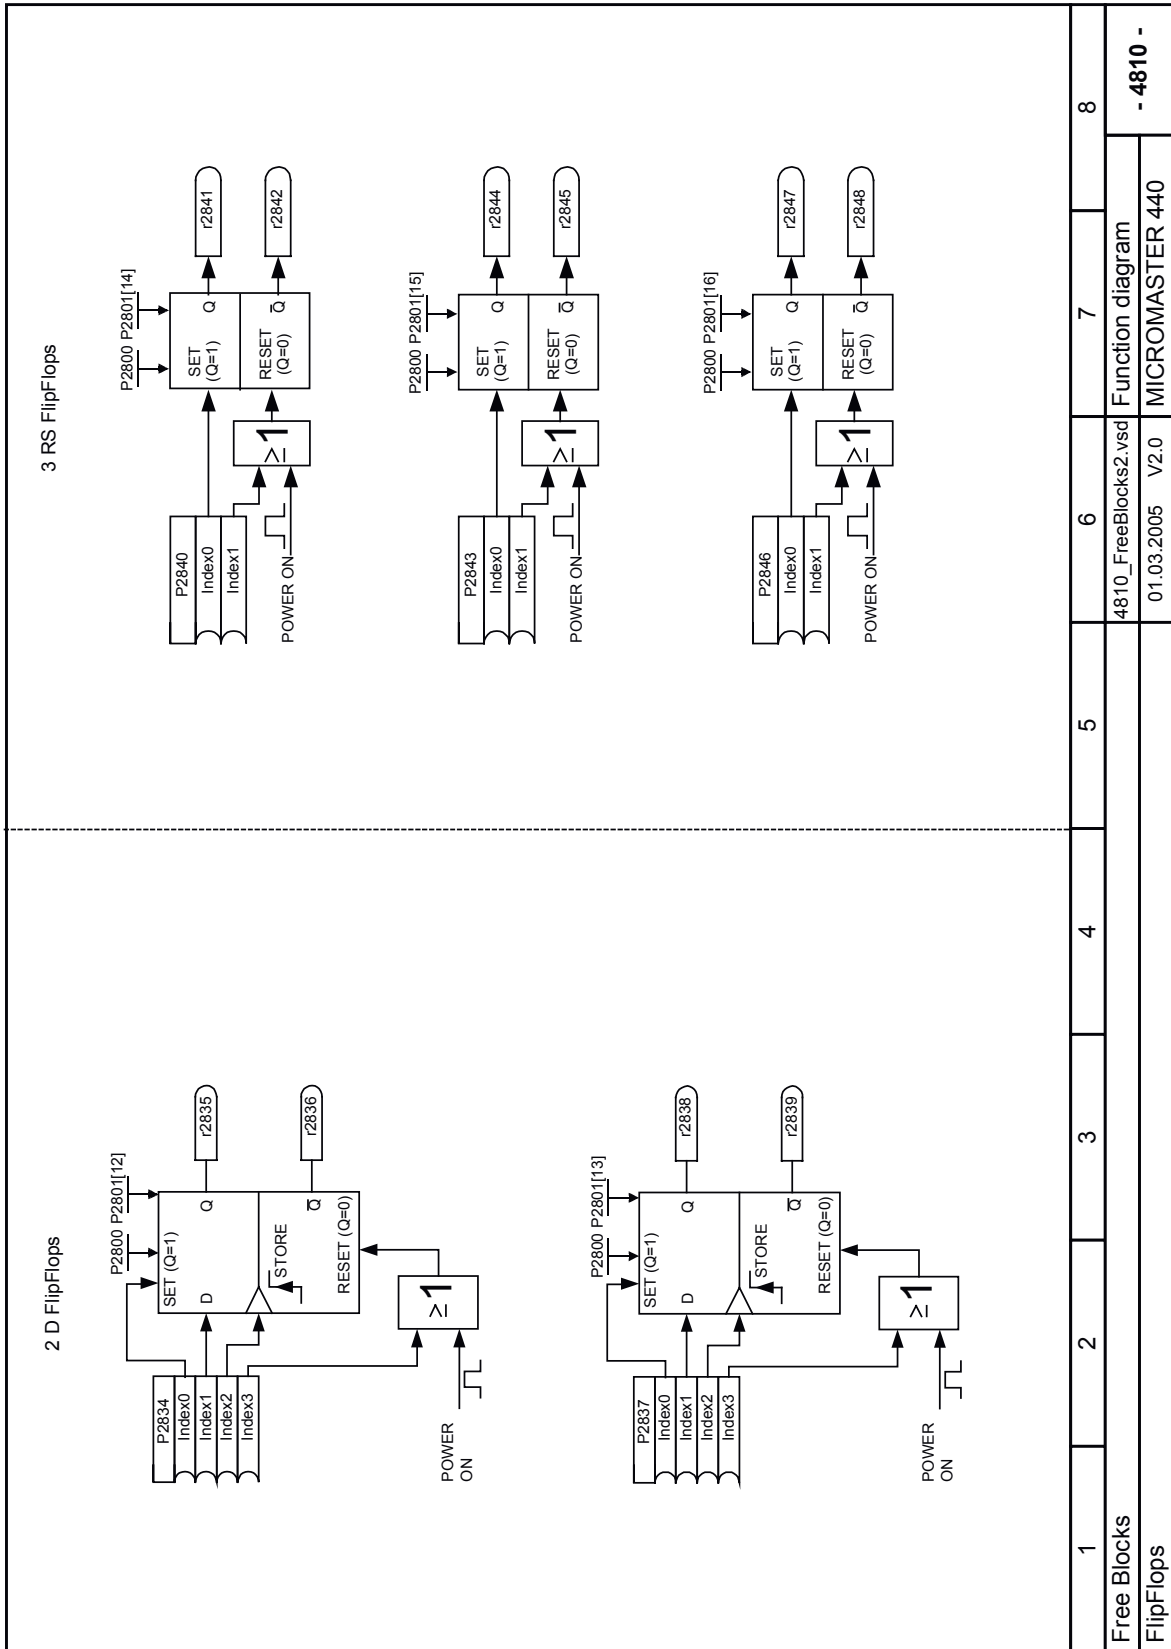

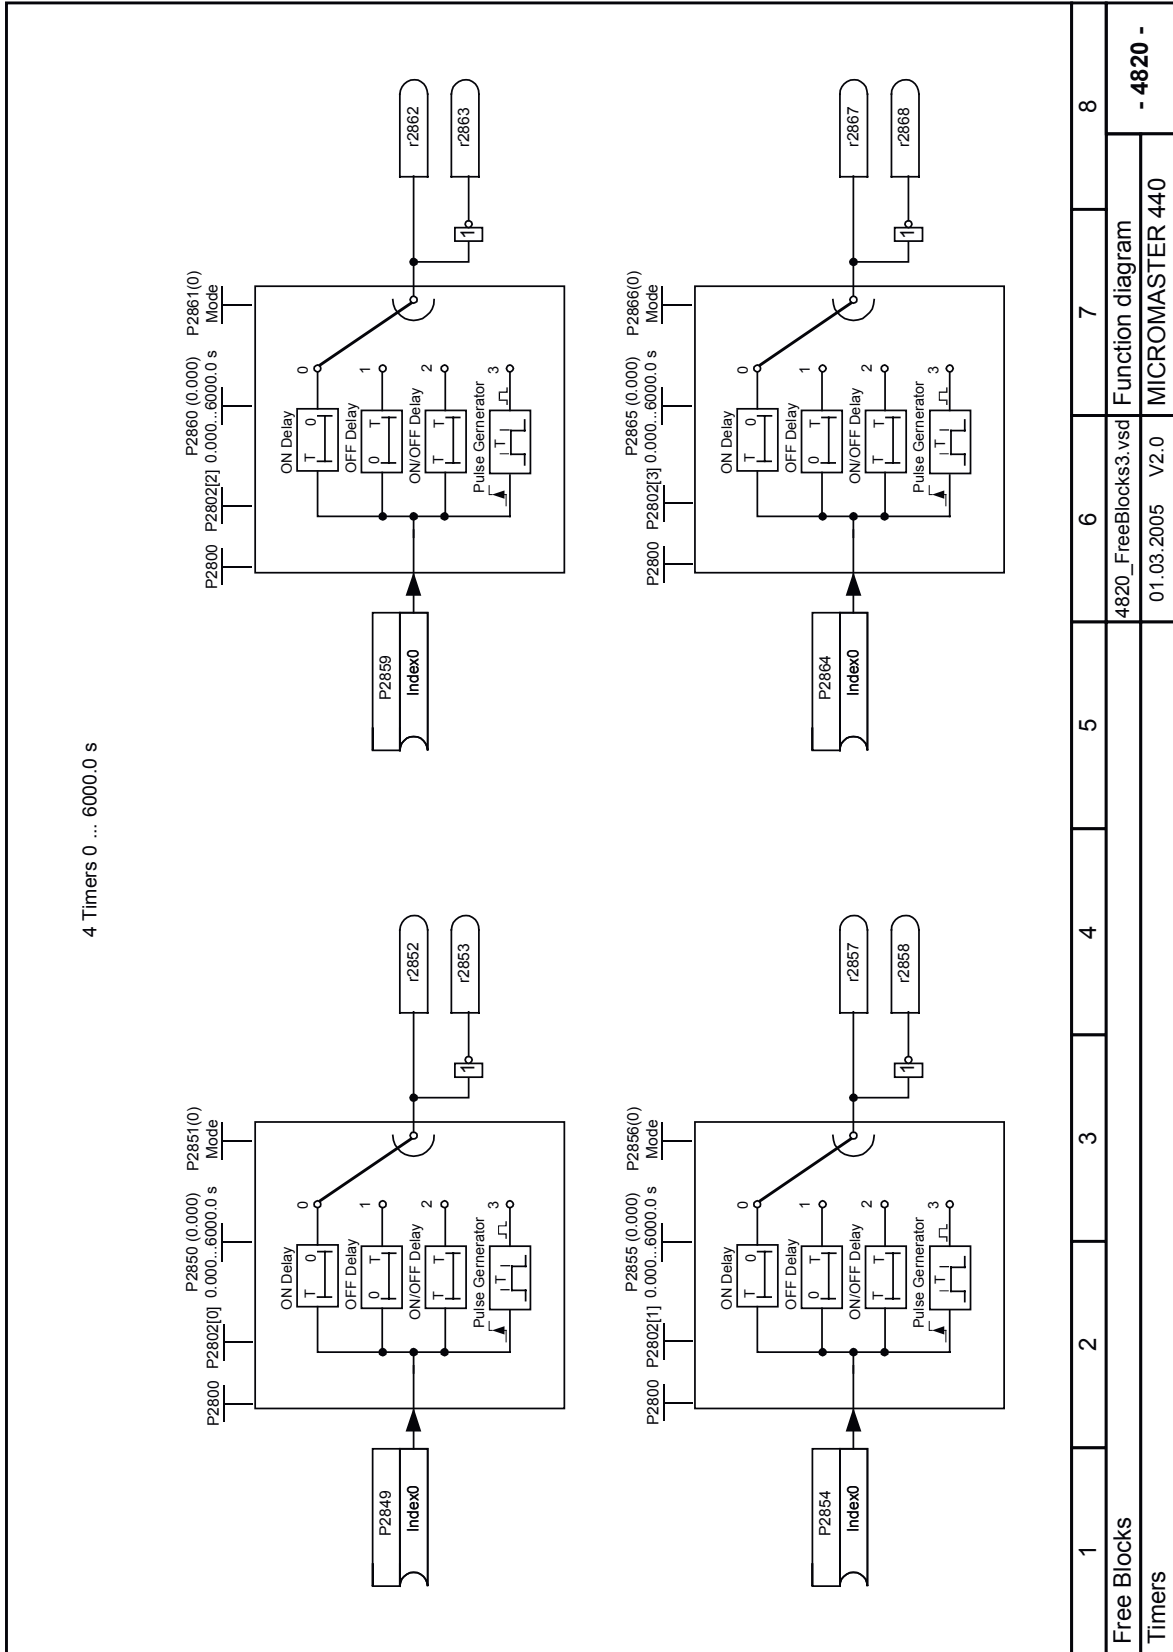


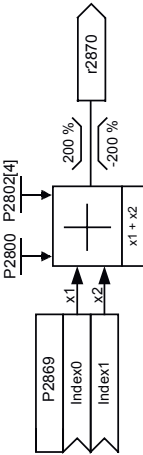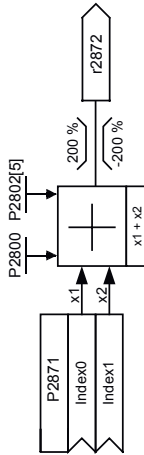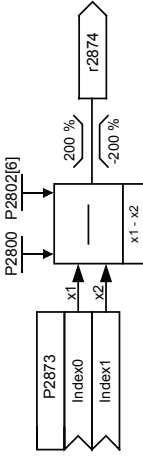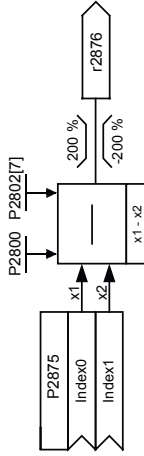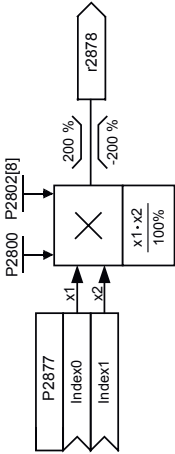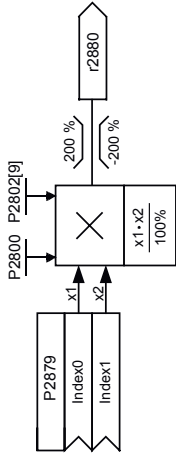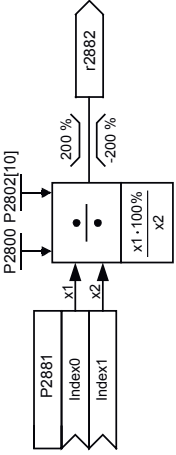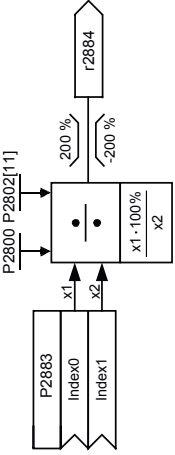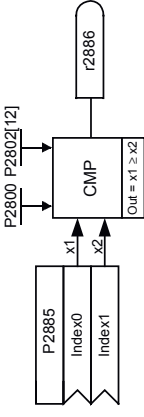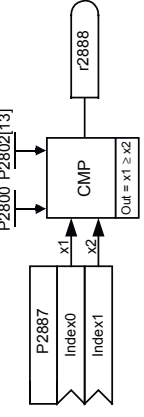2 Adders with 2 Inputs (1 Word)		2 Subtracters with 2 Inputs (1 Word)		2 Multipliers (1 Word)			
 	 	 	<p>Connector Setting in %</p> 				
<p>2 Dividers (1 Word)</p>  		<p>Word Compare</p>  					
1	2	3	4	5	6	7	8
Free Blocks						Function diagram	
Adders, Subtracters, Multipliers, Dividers, Comparators, Setting in %						MICROMASTER 440	
4830_FreeBlocks4.vsd							
01.03.2005						V2.0	
						- 4830 -	

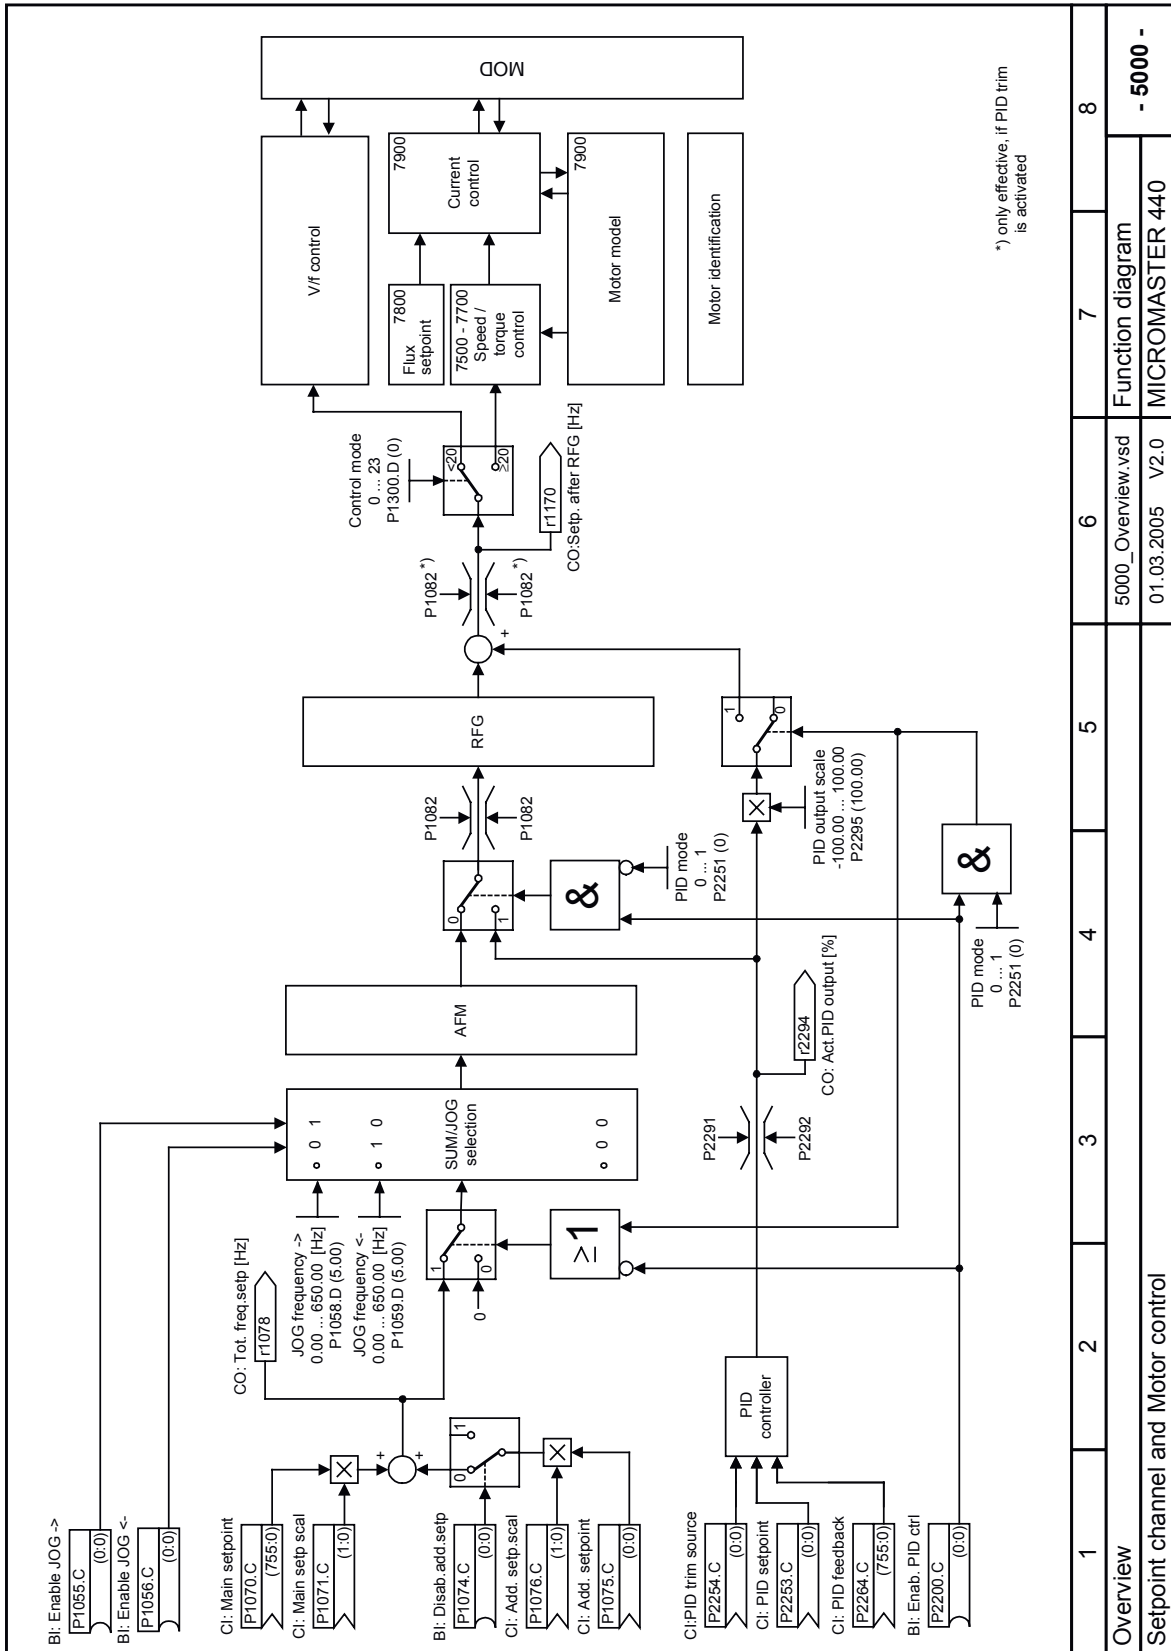



\*) only effective, if PID trim is activated

1	2	3	4	5	6	7	8
Overview							
Setpoint channel and Motor control							
5000_Overview.vsd						Function diagram	
01.03.2005						MICROMASTER 440	
V2.0						- 5000 -	

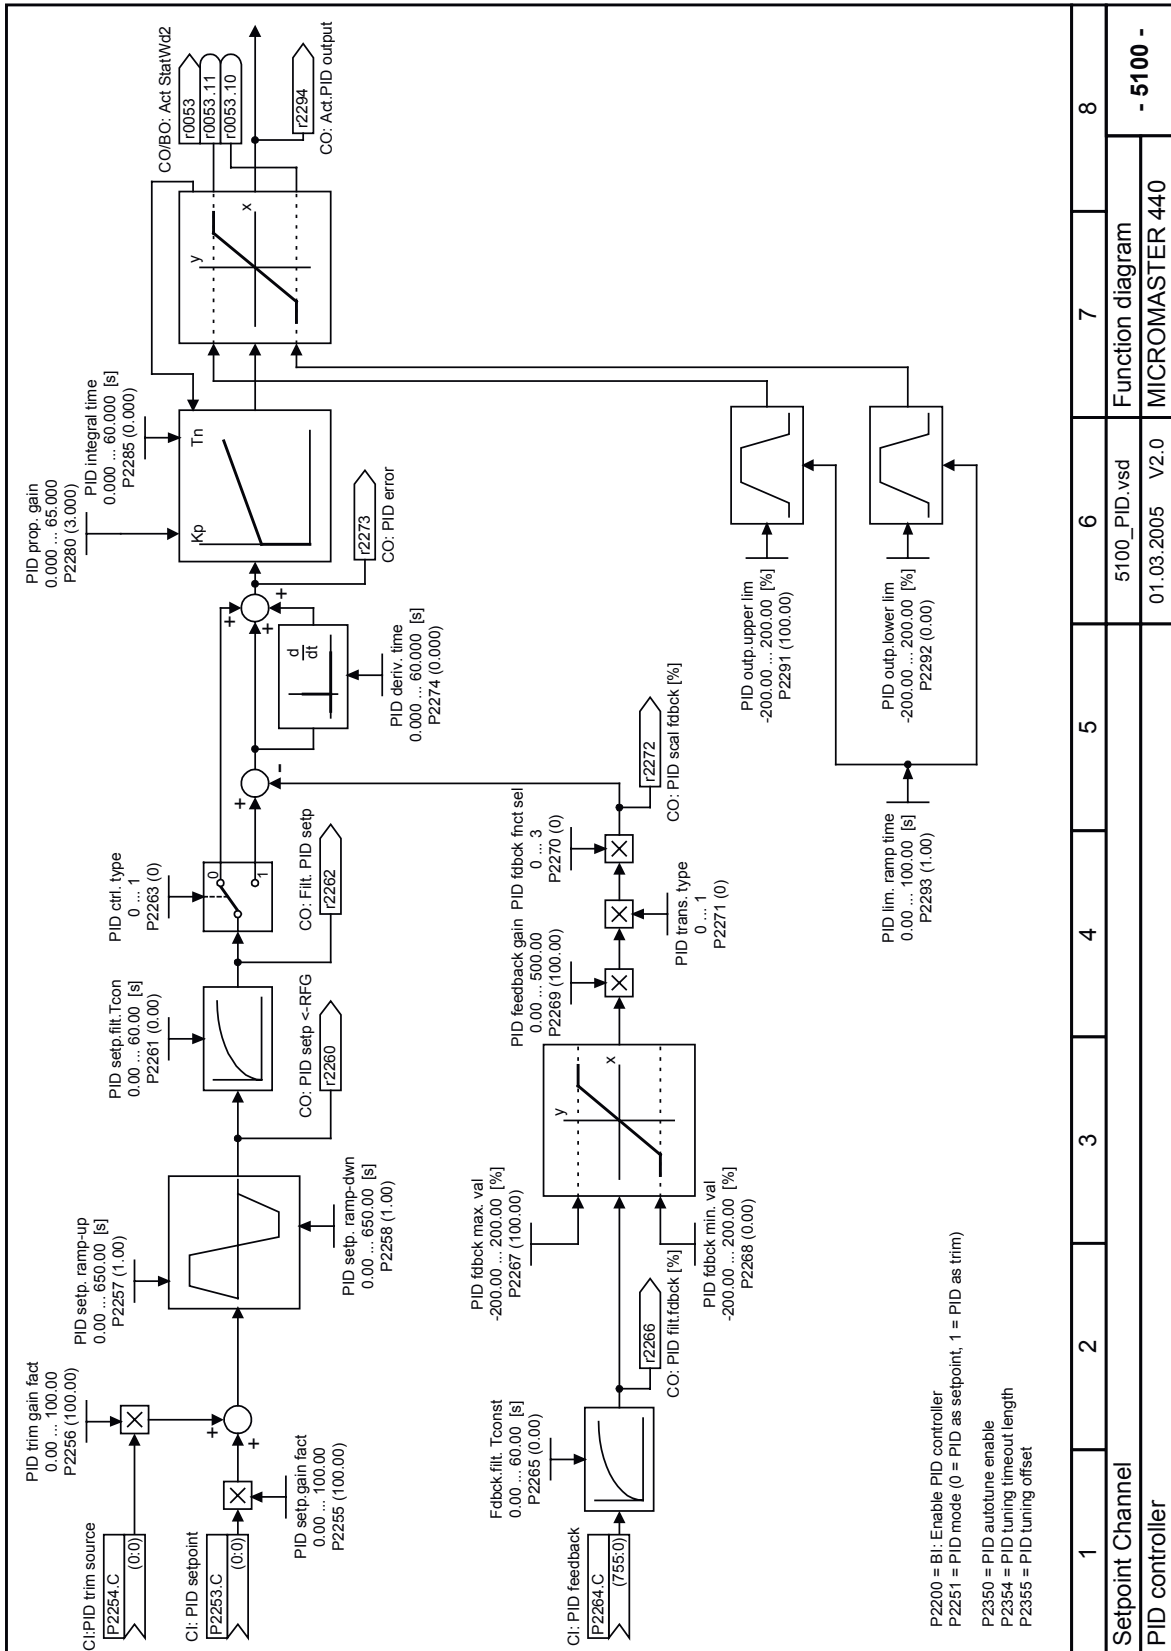


1	2	3	4	5	6	7	8	
Setpoint Channel							Function diagram	- 5100 -
PID controller							MICROMASTER 440	
					5100_PID.vsd			
					01.03.2005	V2.0		

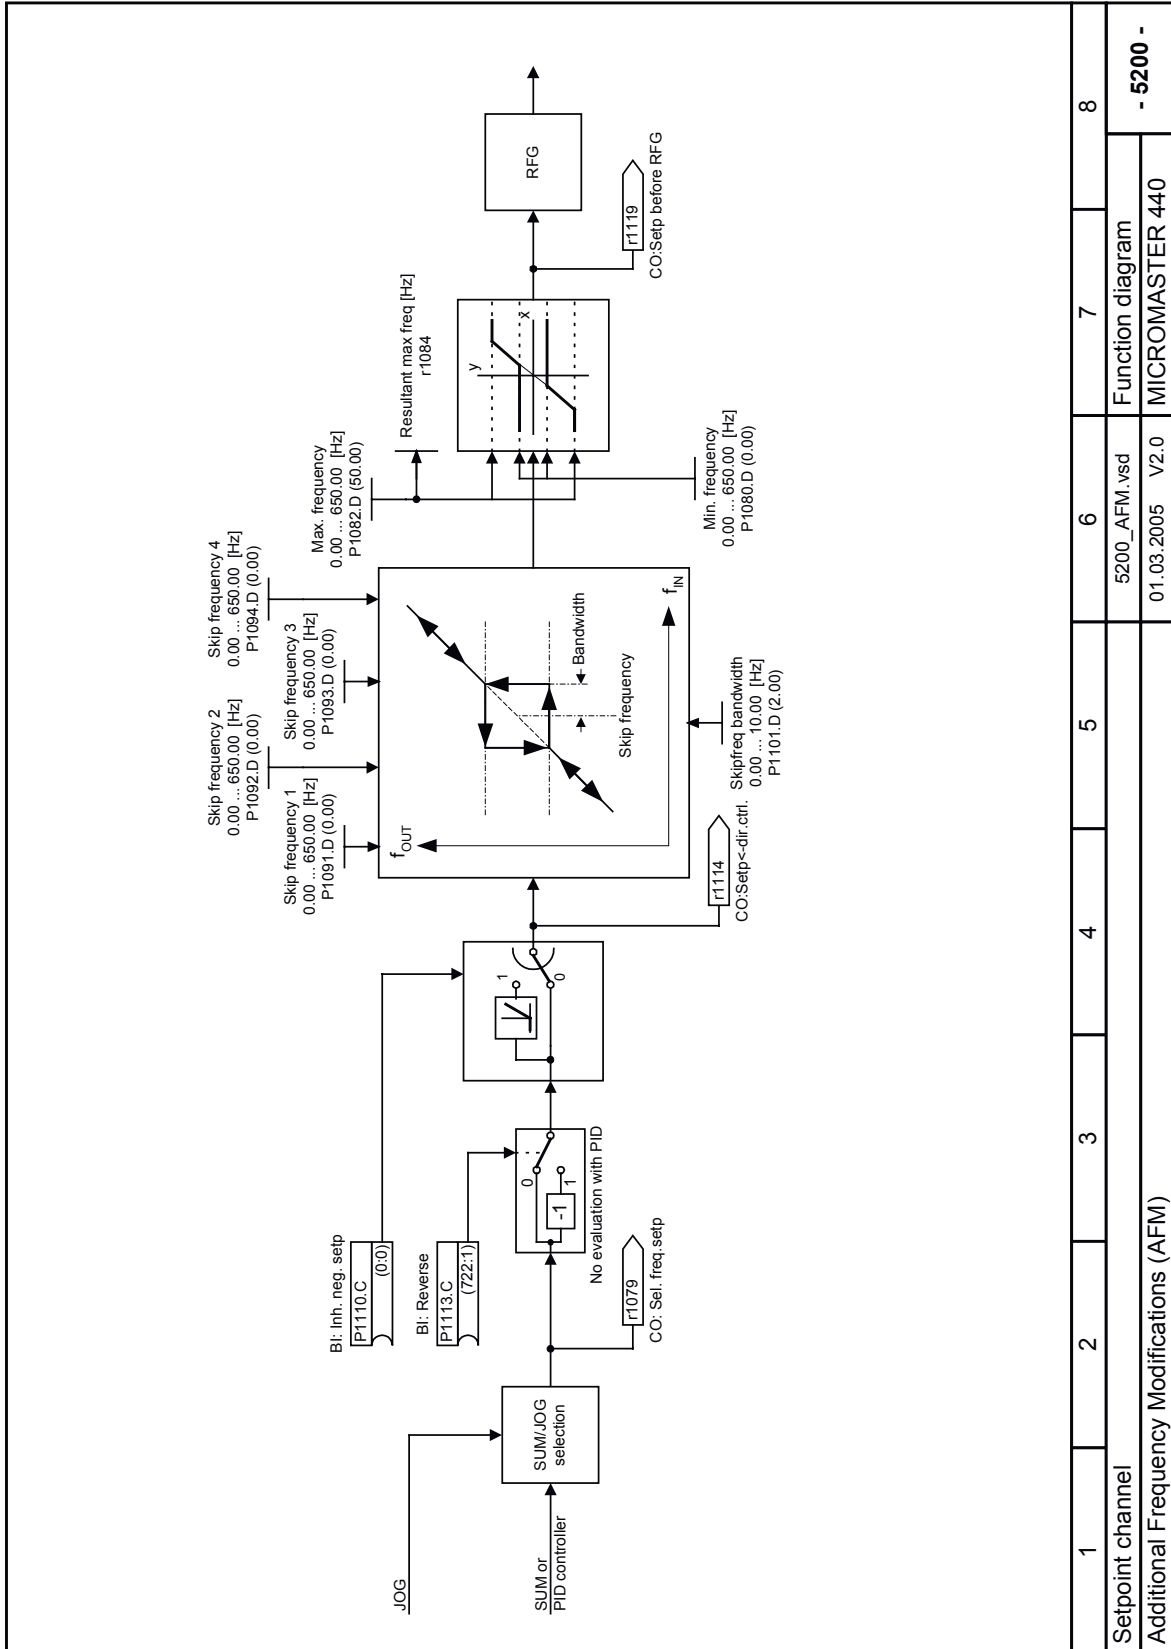


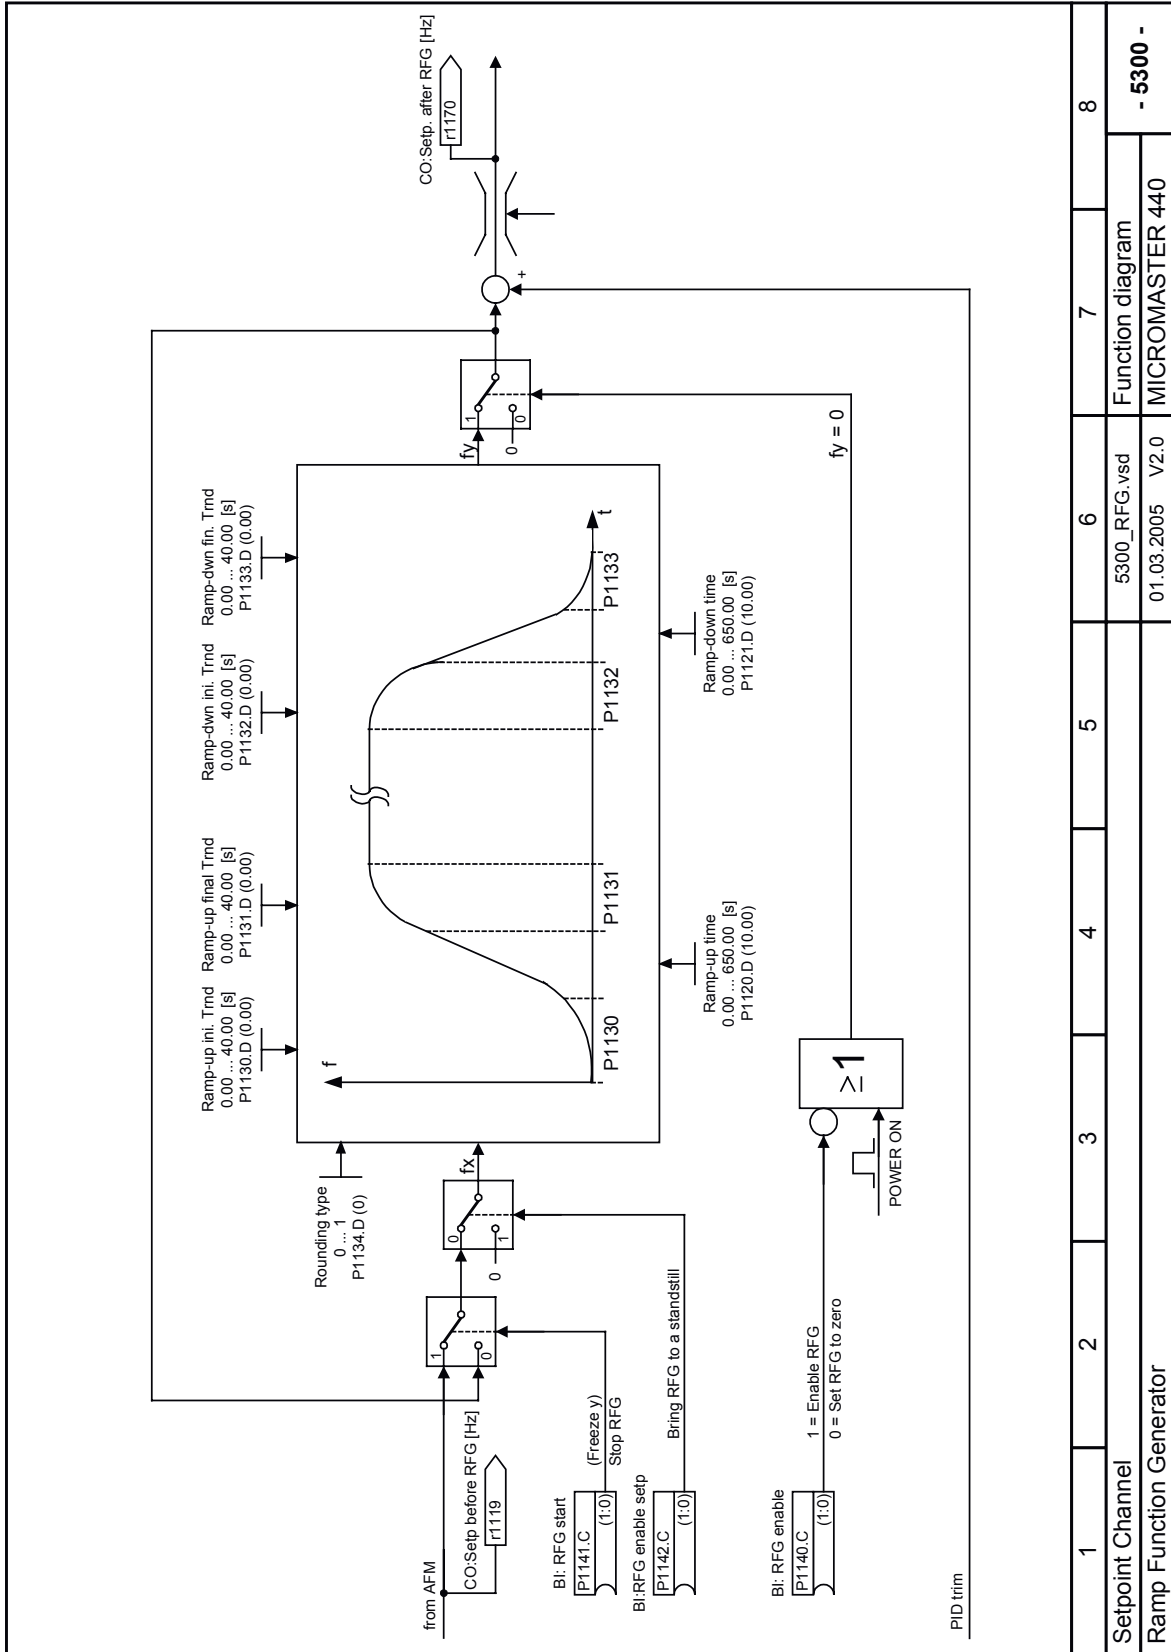





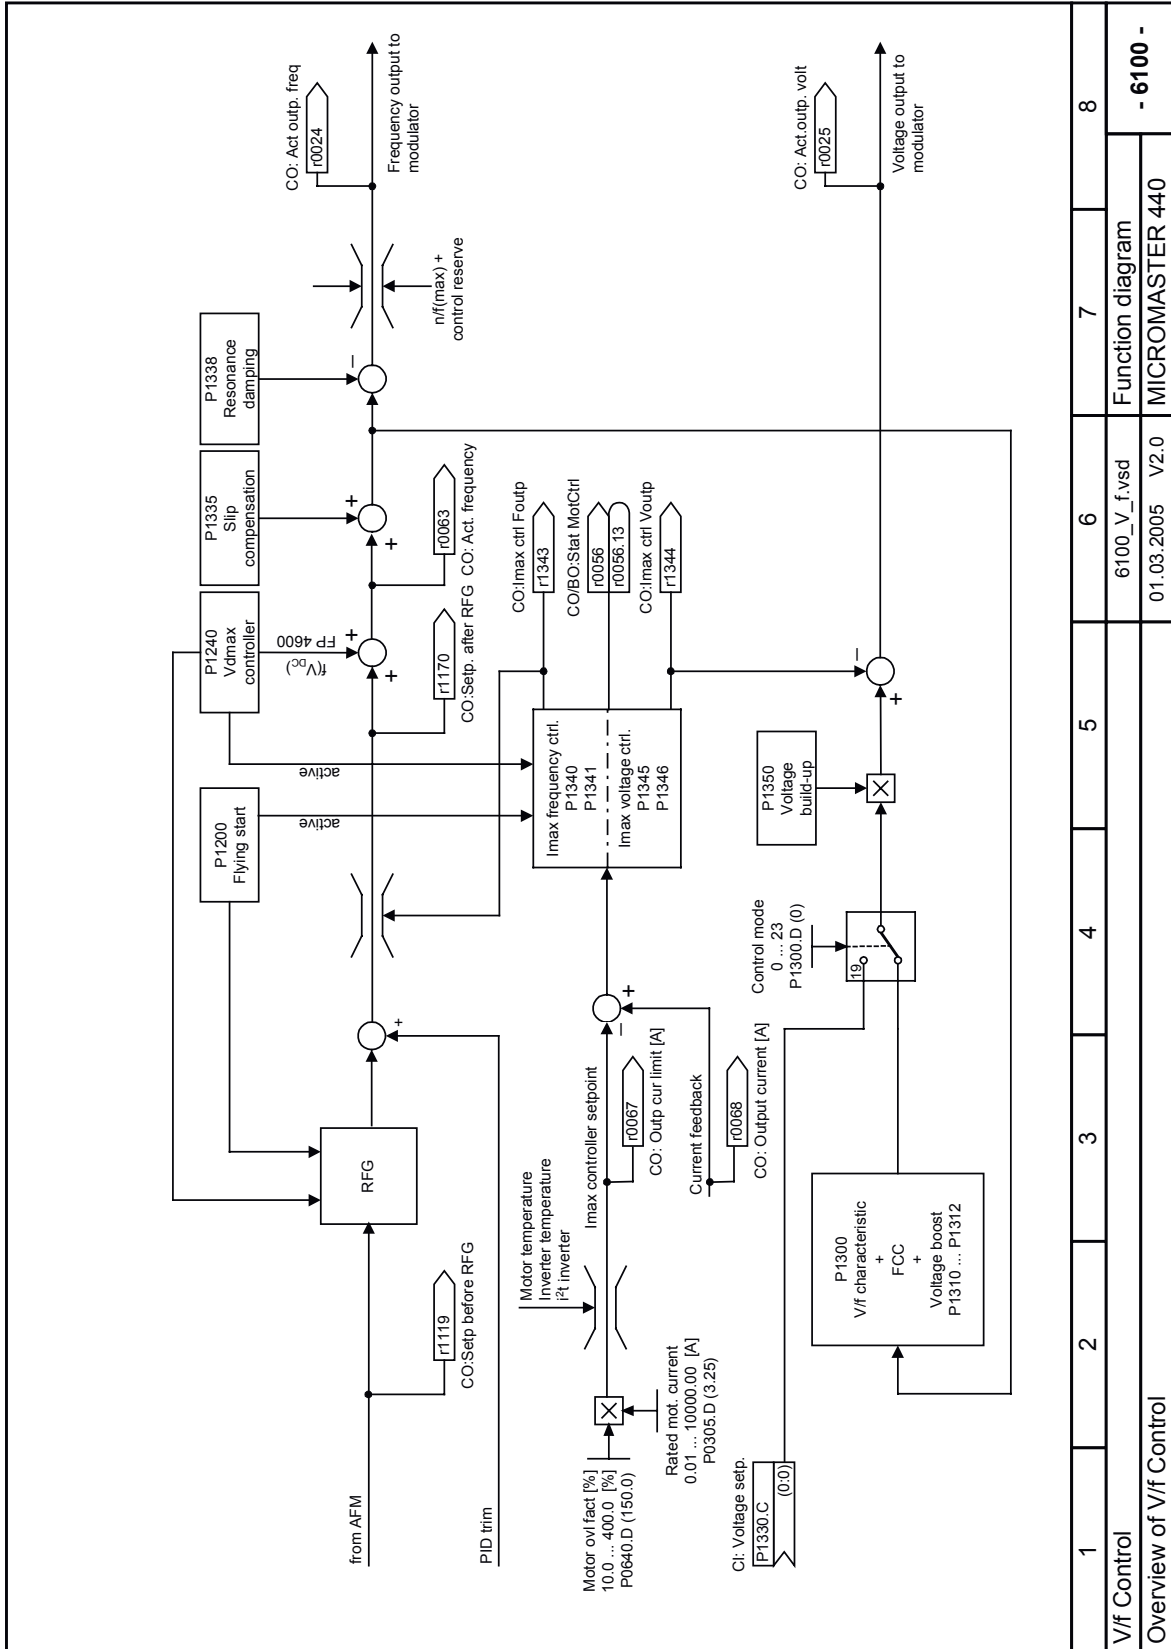


1	2	3	4	5	6	7	8
V/f Control							
Overview of V/f Control							
					6100_V_f.vsd	Function diagram	
					01.03.2005	V2.0	
- 6100 - MICROMASTER 440							

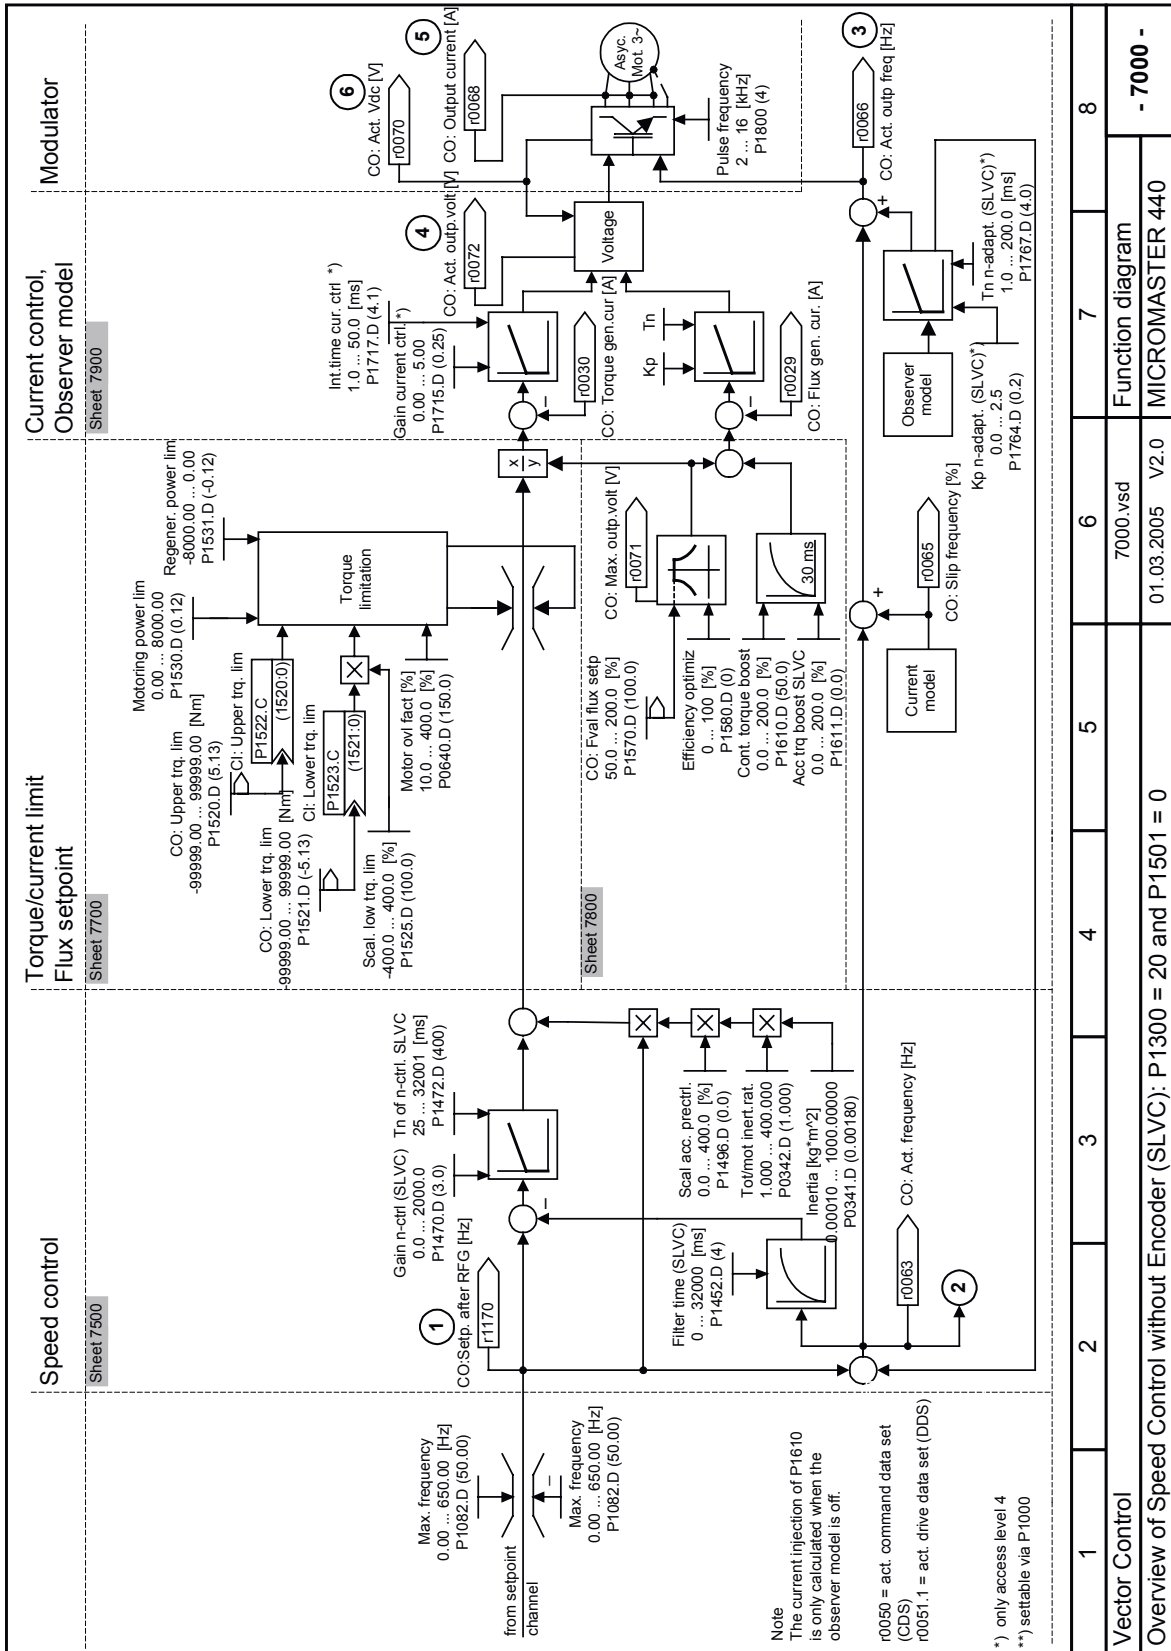

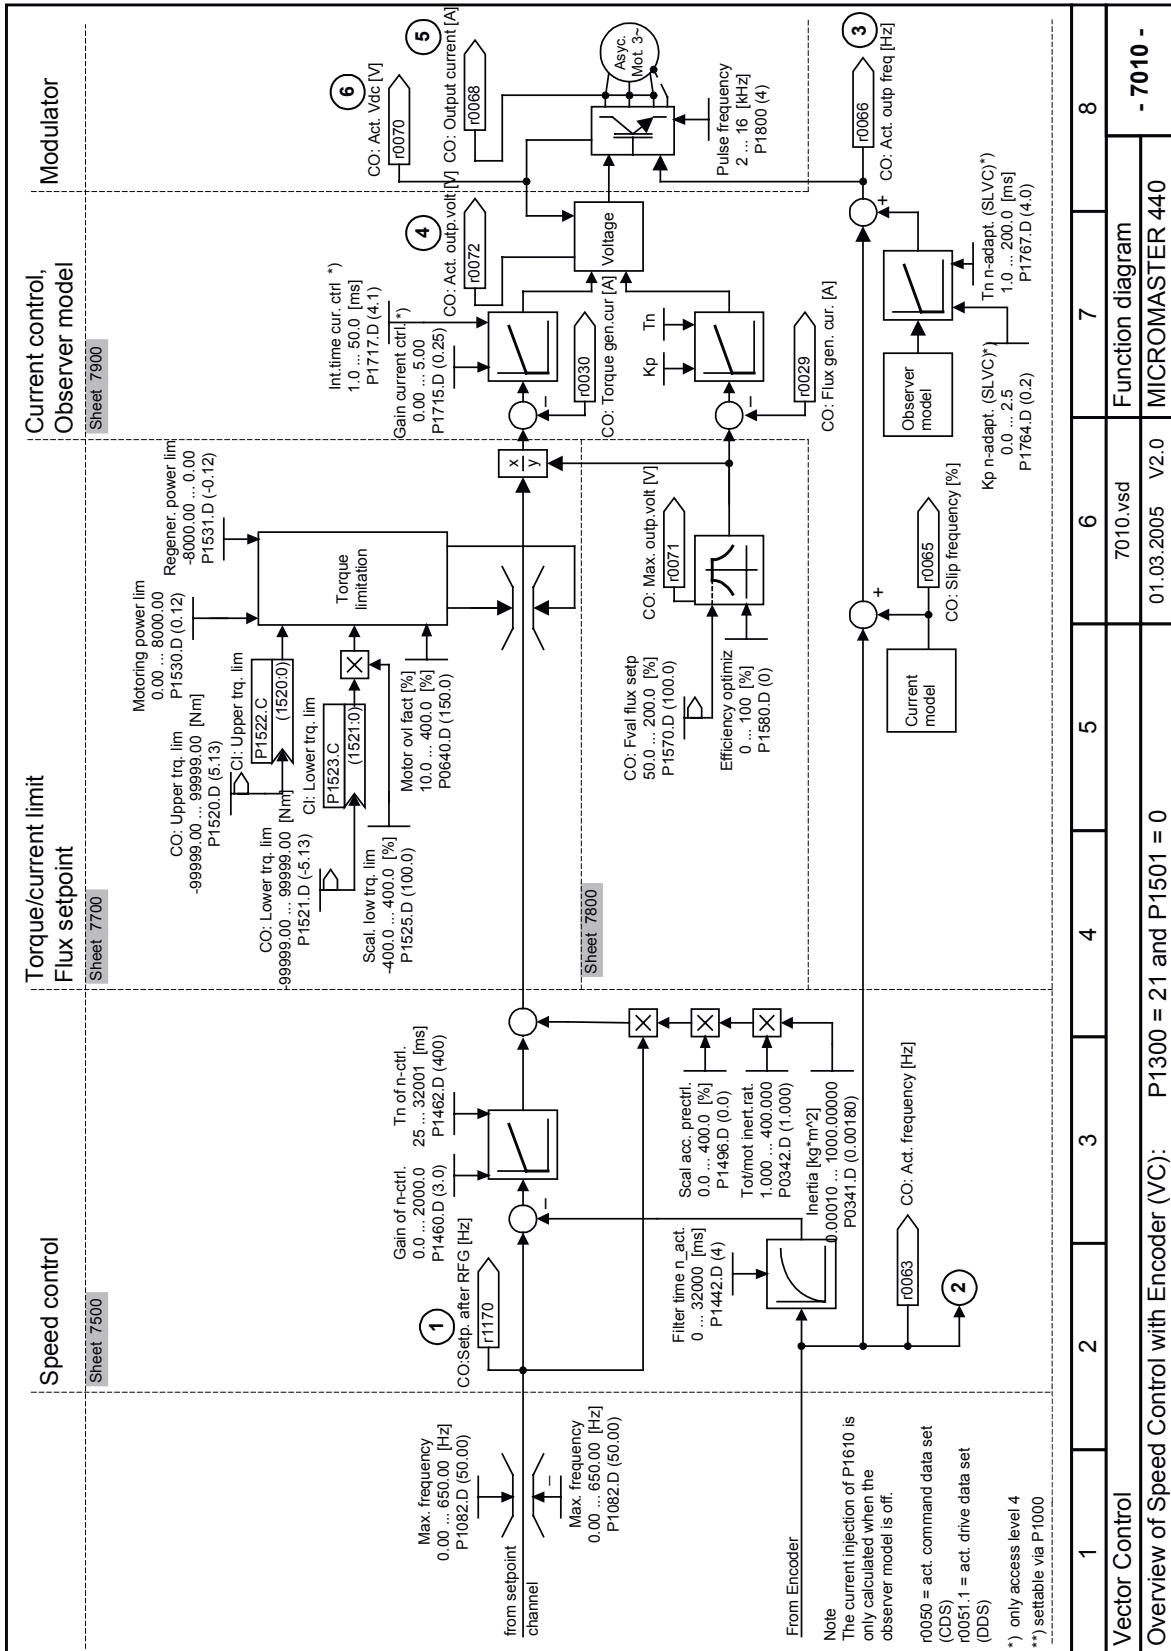

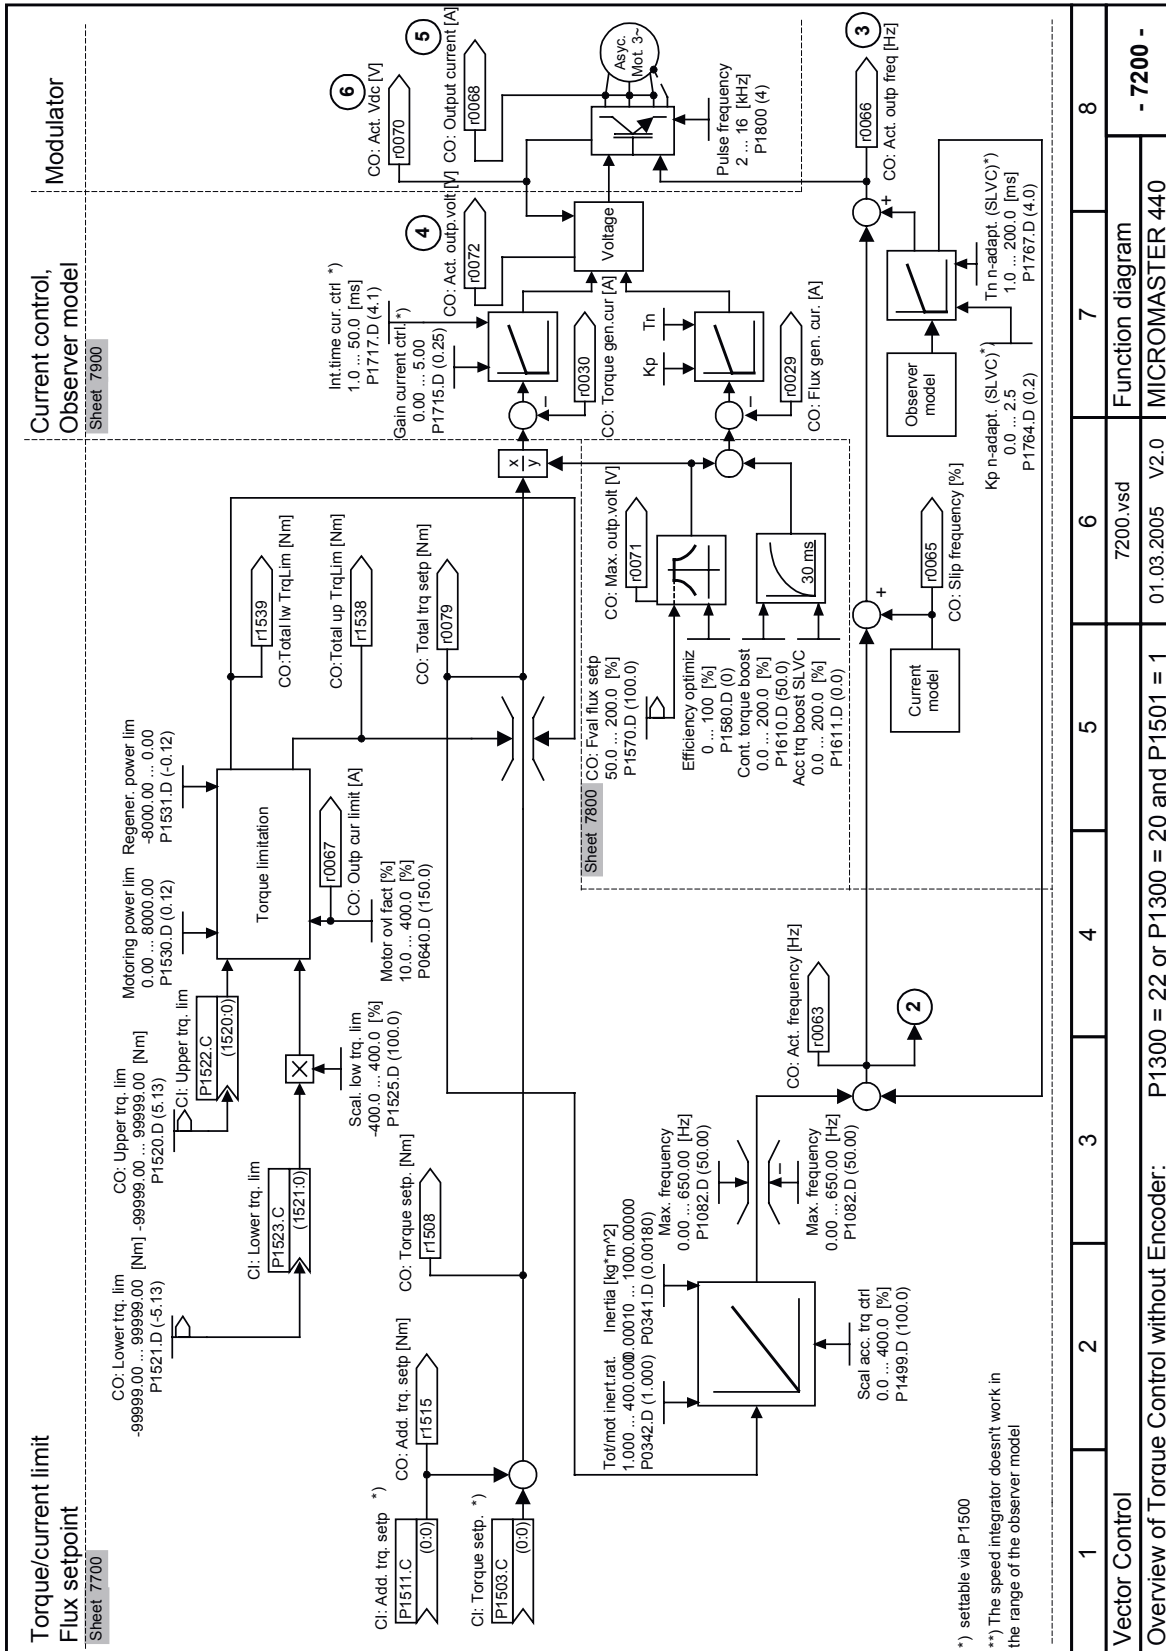




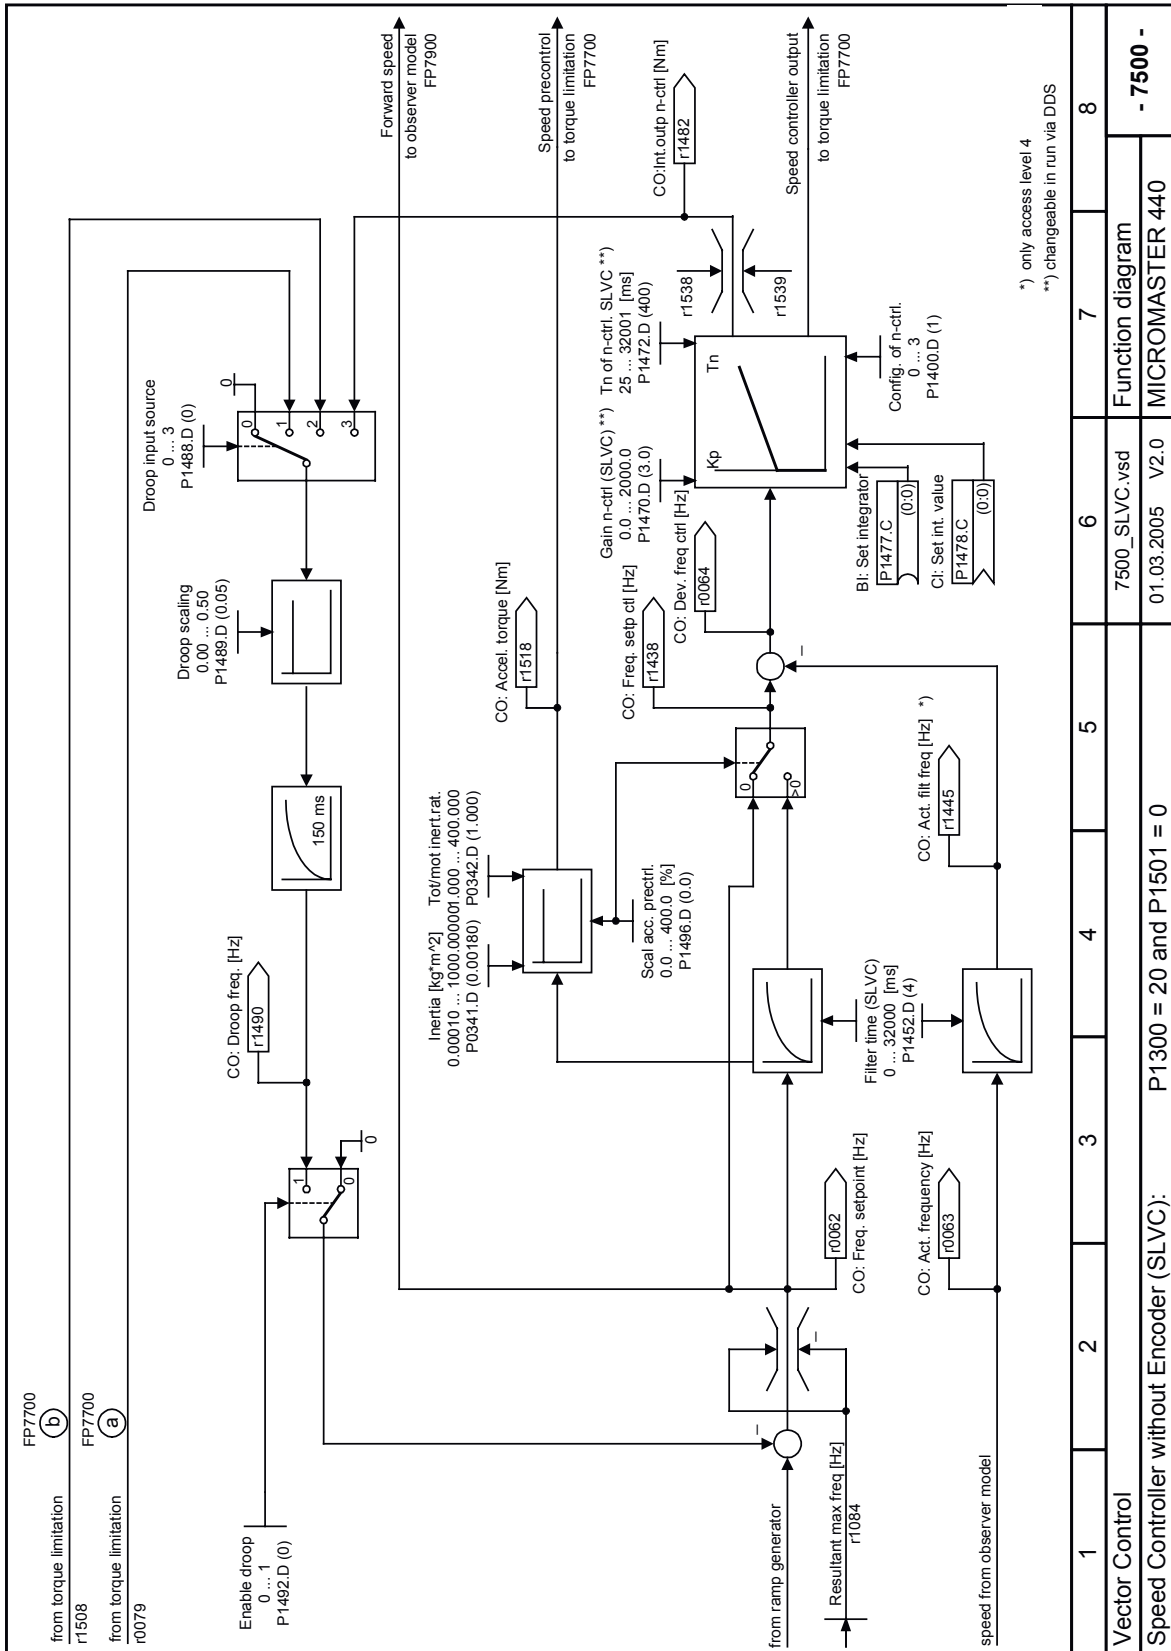

1	2	3	4	5	6	7	8	
Vector Control							Function diagram	- 7500 -
Speed Controller without Encoder (SLVC):							P1300 = 20 and P1501 = 0	MICROMASTER 440
					7500_SLVC.vsd	V2.0	01.03.2005	




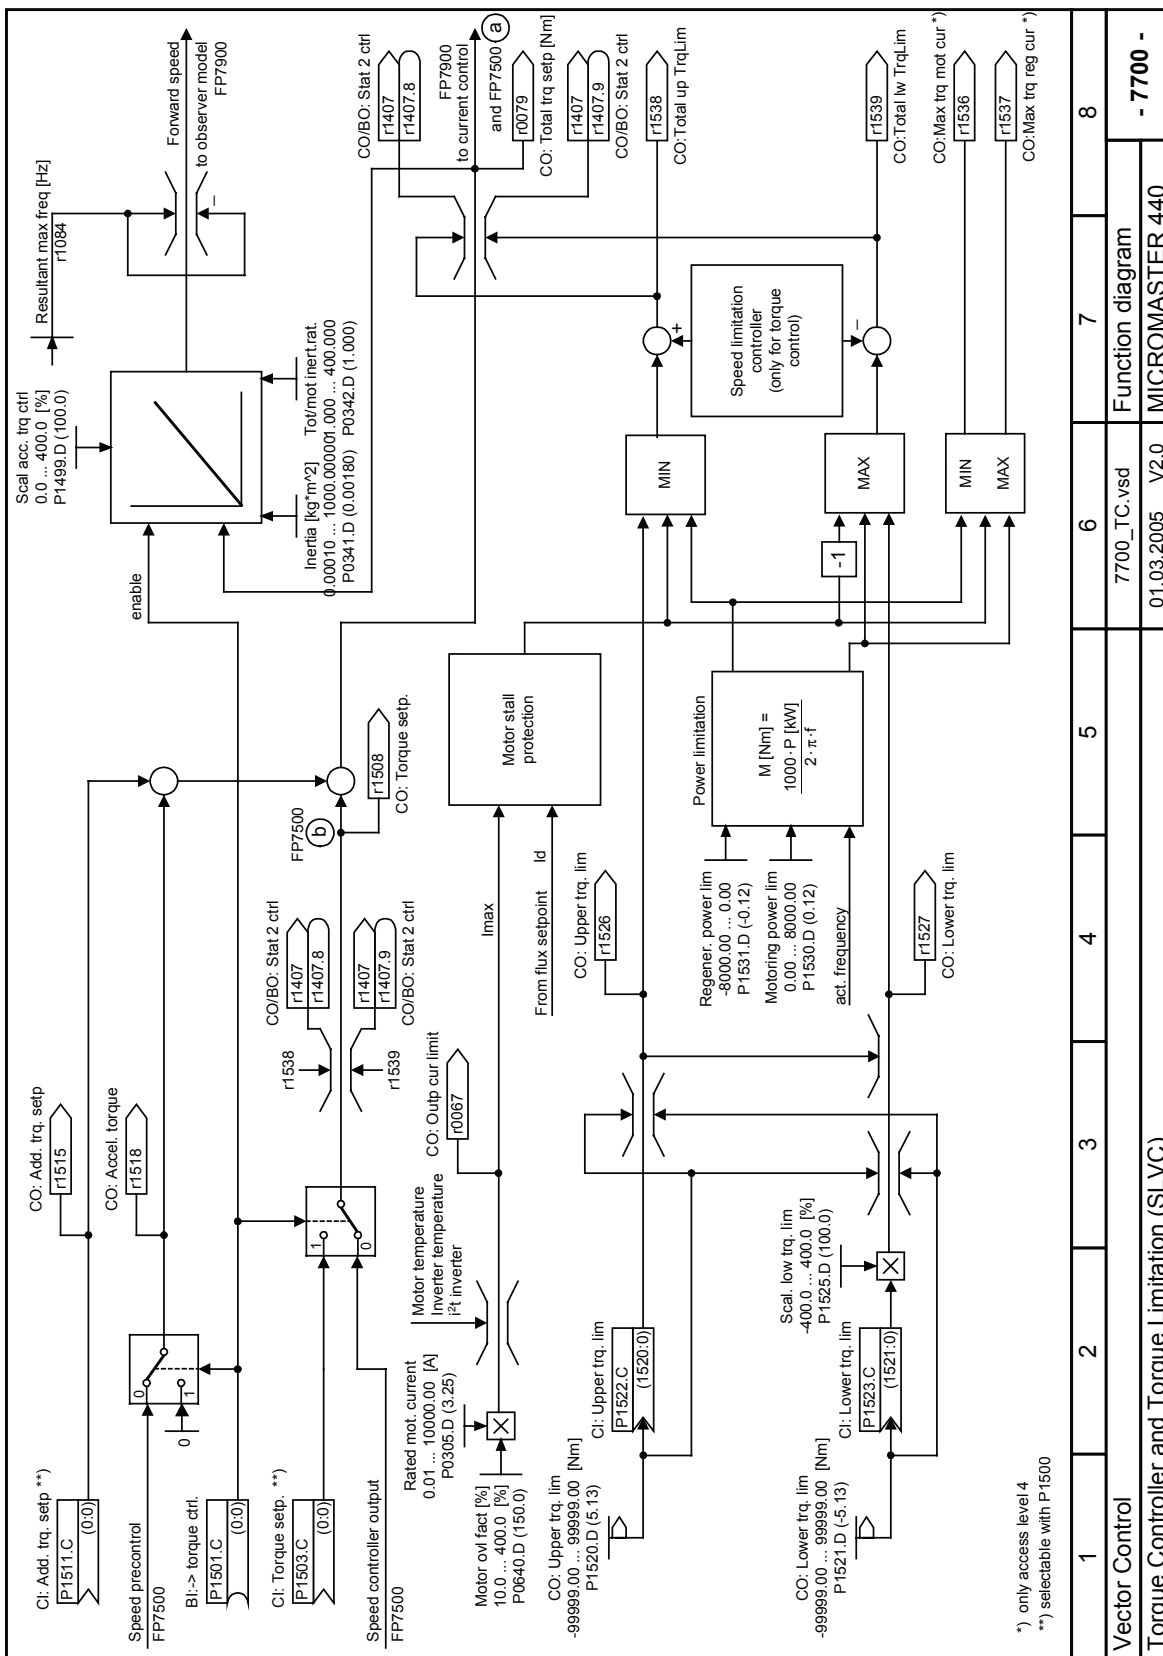


\*) only access level 4  
\*\*) selectable with P1500

1	2	3	4	5	6	7	8
Vector Control							
Torque Controller and Torque Limitation (SLVC)							
7700_TC.vsd						Function diagram	
01.03.2005 V2.0						MICROMASTER 440	
						- 7700 -	




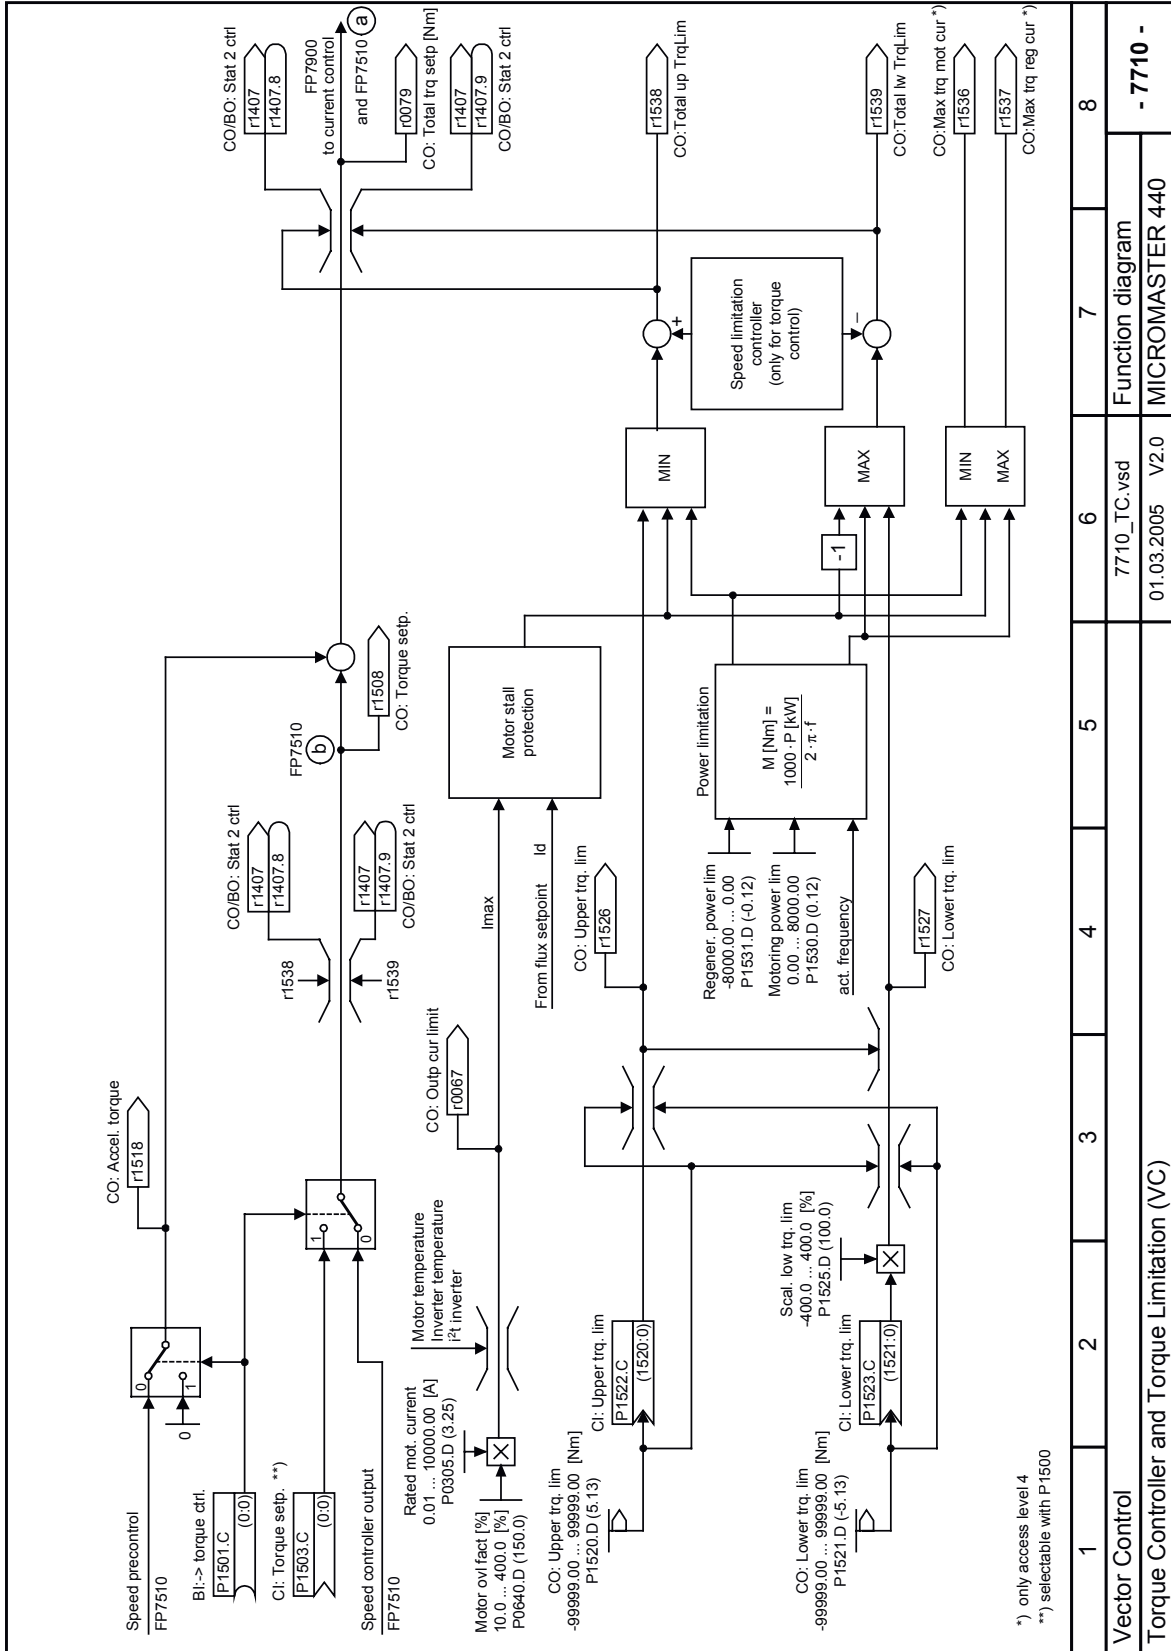


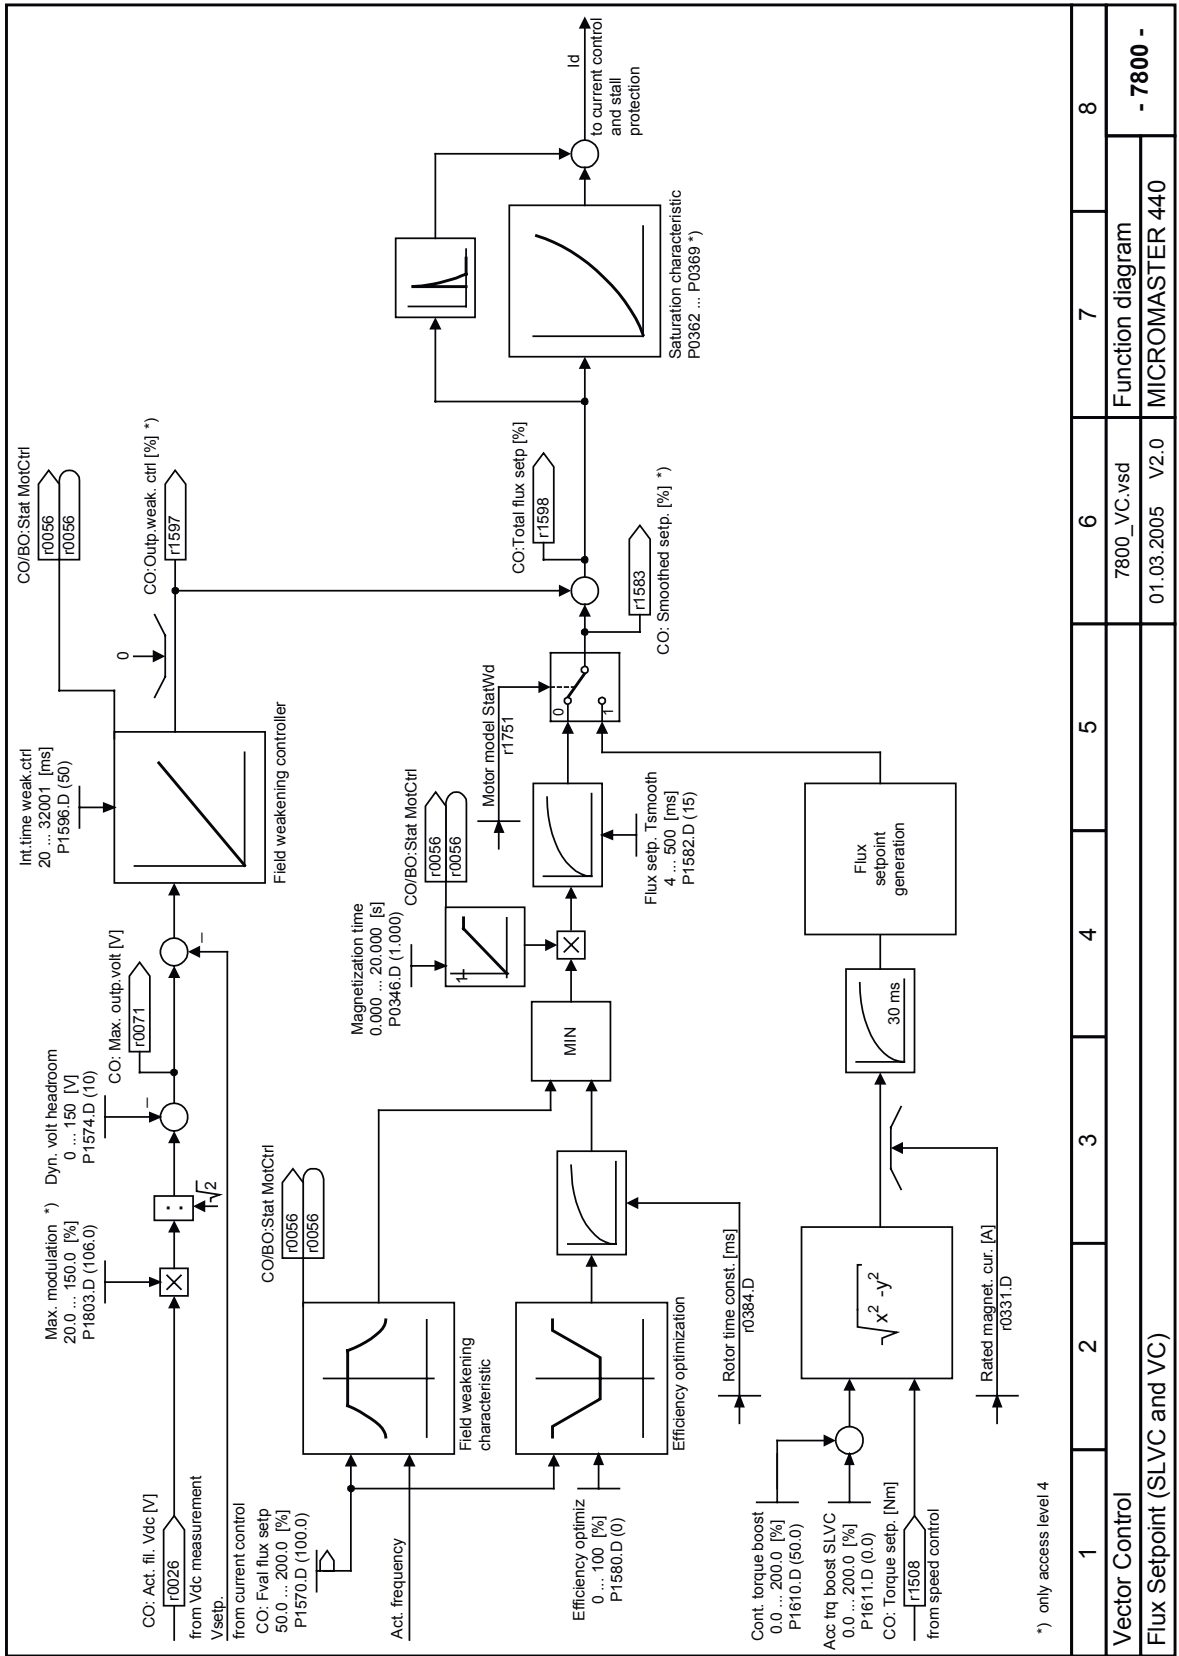

\*) only access level 4

1	2	3	4	5	6	7	8
Vector Control							
Flux Setpoint (SLVC and VC)							
					7800_VC.vsd	Function diagram	- 7800 -
					01.03.2005	V2.0	MICROMASTER 440

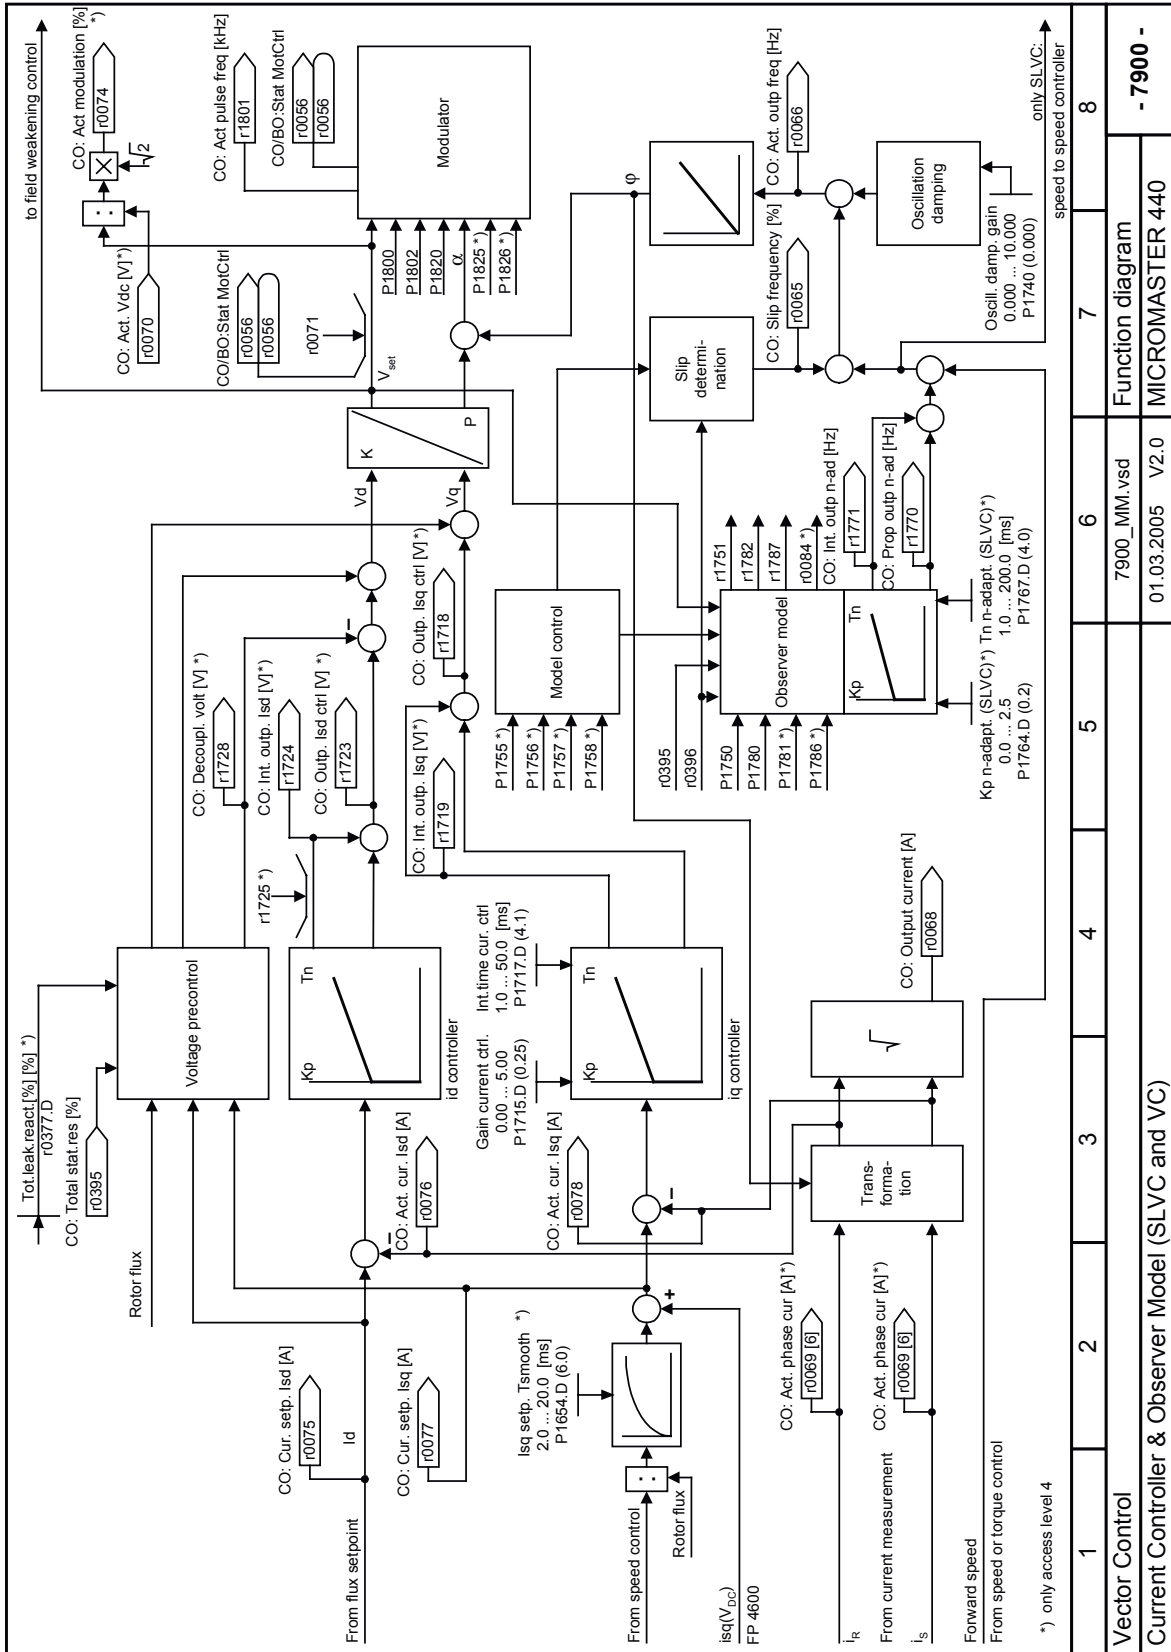

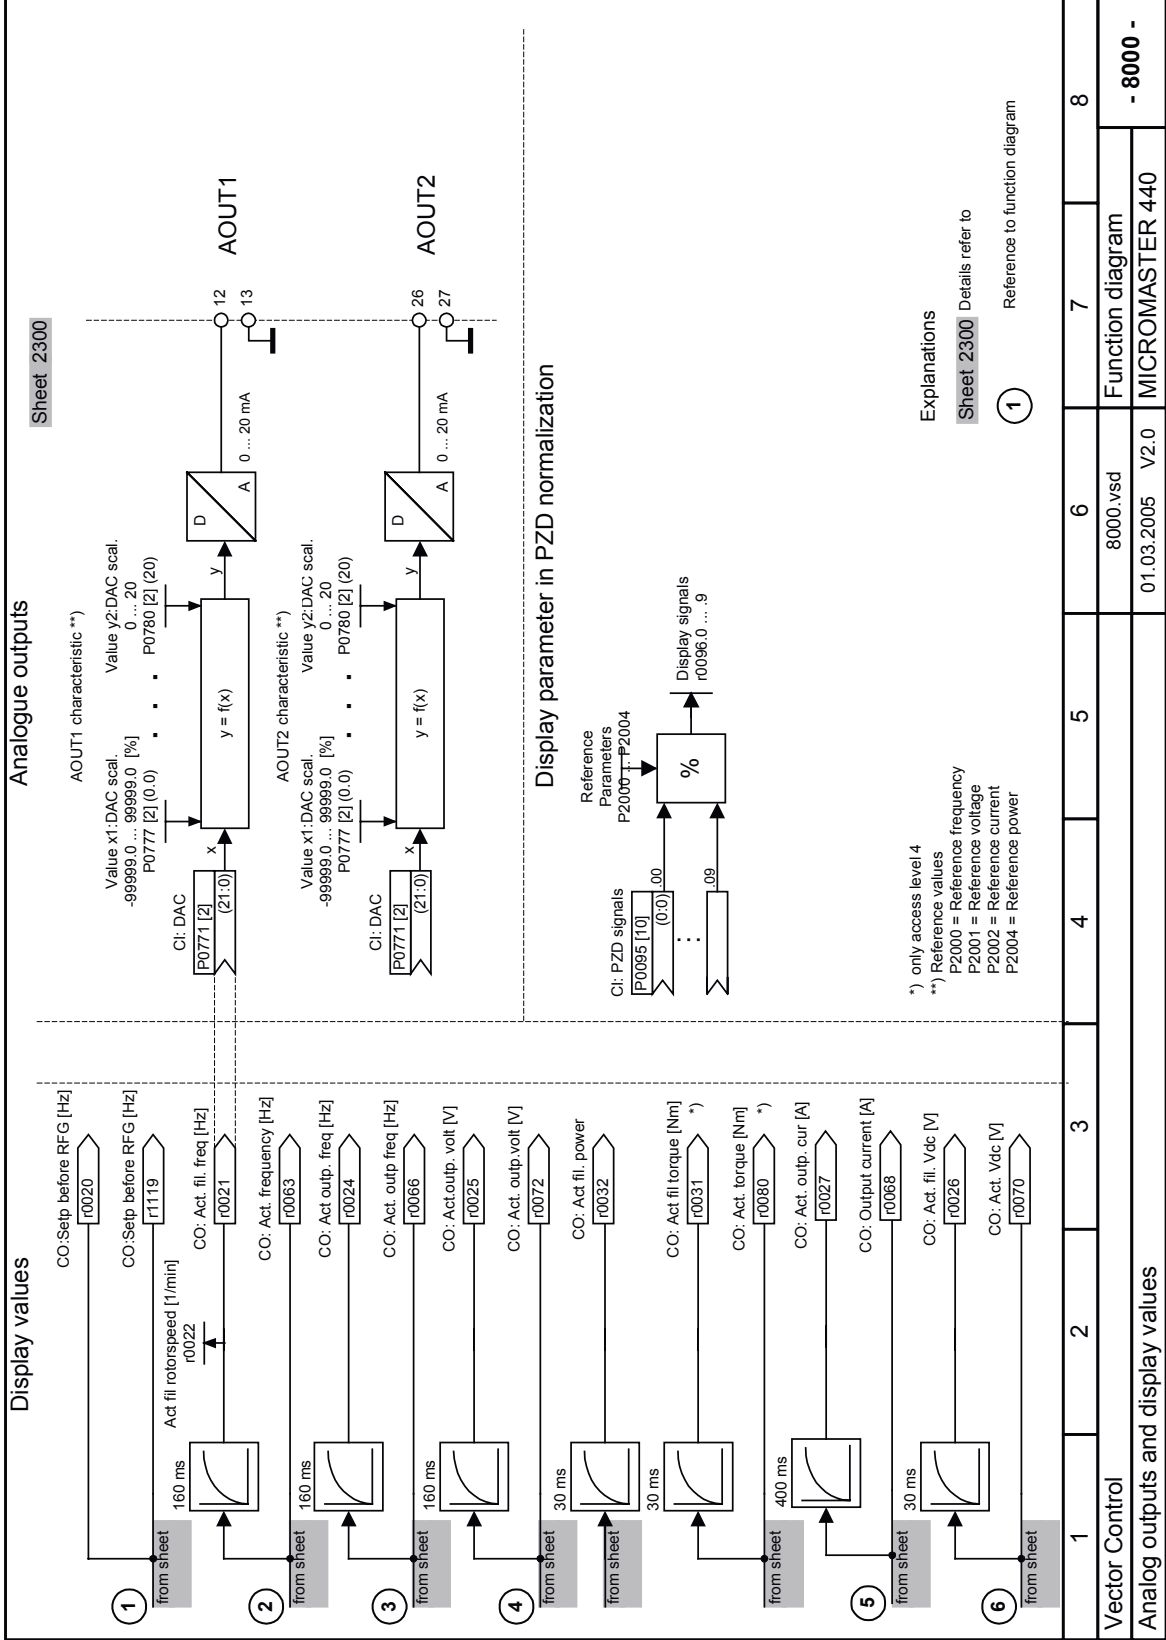

## 5 Faults and Alarms


### 5.1 Fault messages

In the event of a failure, the inverter switches off and a fault code appears on the display.

---

#### NOTE

To reset the fault code, one of three methods listed below can be used:

1. Cycle the power to the drive.
2. Press the  button on the BOP or AOP.
3. Via Digital Input 3 (default setting)

---

Fault messages are stored in parameter r0947 under their code number (e.g. F0003 = 3). The associated error value is found in parameter r0949. The value 0 is entered if a fault has no error value. It is furthermore possible to read out the point in time that a fault occurred (r0948) and the number of fault messages (P0952) stored in Parameter r0947.

#### F0001 OverCurrent STOP II

##### Quit

- Remove fault and reset fault memory by disconnecting the
- drive converter from the line supply and powering-up again
  - Press the Fn key on the BOP or AOP
  - Acknowledge fault P2103, P2104
  - P0952 (complete fault memory)

##### Cause

- Short circuit at the output
- Earth faults
- Excessively large motor
- Defective end stage

##### Diagnosis & Remedy

Check the following:

- Cable length limits must not be exceeded.
- Motor cable and motor must have no short-circuits or earth faults
- Motor parameters must match the motor in use
- Value of stator resistance (P0350) must be correct
- Motor must not be obstructed or overloaded
- Increase the ramp time
- Reduce the boost level
- Connect a smaller motor (lower rating)

#### F0002 OverVoltage STOP II

##### Quit

Refer to F0001

##### Cause

- DC-link voltage (r0026) exceeds the overvoltage threshold (refer to parameter r0026)
- Ground fault

---

#### NOTE

Overvoltage can be caused either by too high main supply voltage or if motor is in regenerative mode. Regenerative mode can be caused by fast ramp downs or if the motor is driven from an active load.

---

#### Diagnosis & Remedy

Check the following:

- Supply voltage (P0210) must lie within limits indicated on rating plate .
- DC-link voltage controller must be enabled (P1240) and parameterized properly.
- Extend the deceleration ramps (ramp-down time P1121, P1135)
- Remove the ground fault
- Required braking power must lie within specified limits.
- Check the feeder cable to the braking resistor
- Check the technical data of the braking resistor
- Check the load duty cycle of the braking resistor with reference to the application

#### NOTE

Higher inertia requires longer ramp times; otherwise, apply braking resistor.

### F0003 UnderVoltage STOP II

#### Quit

Refer to F0001

#### Cause

- Main supply failed.
- Shock load outside specified limits.

#### Diagnosis & Remedy

Check the following:

- Supply voltage (P0210) must lie within limits indicated on rating plate.
- Supply must not be susceptible to temporary failures or voltage reductions.

### F0004 Inverter Over Temperature STOP II

#### Quit

Refer to F0001

#### Cause

- Ventilation inadequate
- Ambient temperature is too high.
- Actual drive converter temperature r0037 exceeds the overtemperature threshold (refer to P0292)

#### Diagnosis & Remedy

Check the following:

- Fan must turn when inverter is running
- Pulse frequency must be set to default value
- Ambient temperature could be higher than specified for the inverter
- Reduce the load and / or ensure adequate cooling

Additional meaning for frame sizes FX and GX:

- P949 = 1: Rectifier overtemperature
- P949 = 2: Ambient overtemperature
- P949 = 3: EBOX overtemperature

### F0005 Inverter I2T STOP II

#### Quit

Refer to F0001

#### Cause

- Inverter overloaded.
- Duty cycle too demanding.
- Motor power (P0307) exceeds inverter power capability (r0206).
- 100 % overload reached (refer to utilization r0036 )

#### Diagnosis & Remedy

Check the following:

- Load duty cycle must lie within specified limits.
- Motor power (P0307) must match inverter power (r0206)

### F0011 Motor Over Temperature STOP II

#### Quit

Refer to F0001

#### Cause

Motor overloaded

#### Diagnosis & Remedy

Check the following:

- Load duty cycle must be correct
- Motor nominal overtemperatures (P0626-P0628) must be correct
- Motor temperature warning level (P0604) must match
- Voltage boost (increase) too high and / or frequency setpoint too low ?
- Adapt the motor cooling to the application

<b>F0012</b>	<b>Inverter temp. signal lost</b>	<b>STOP I</b>
	<p><b>Quit</b> Refer to F0001</p> <p><b>Cause</b> Wire breakage of inverter temperature (heatsink) sensor</p>	
<b>F0015</b>	<b>Motor temperature signal lost</b>	<b>STOP II</b>
	<p><b>Quit</b> Refer to F0001</p> <p><b>Cause</b> Open or short circuit of motor temperature sensor. If signal loss is detected, temperature monitoring switches over to monitoring with the motor thermal model.</p>	
<b>F0020</b>	<b>Mains Phase Missing</b>	<b>STOP II</b>
	<p><b>Quit</b> Refer to F0001</p> <p><b>Cause</b> Fault occurs if one of the three input phases are missed and the pulses are enabled and drive is loaded</p> <p><b>Diagnosis &amp; Remedy</b> check the input wiring of the mains phases</p>	
<b>F0021</b>	<b>Earth fault</b>	<b>STOP II</b>
	<p><b>Quit</b> Refer to F0001</p> <p><b>Cause</b> Fault occurs if the sum of the phase currents is higher than 5 % of the nominal inverter current.</p> <hr/> <p>NOTE This fault only occurs on inverters that have 3 current sensors. Framesizes D to F</p> <hr/>	
<b>F0022</b>	<b>HW monitoring active</b>	<b>STOP II</b>
	<p><b>Quit</b> Refer to F0001</p> <p><b>Cause</b> That hardware fault (P0947 = 22 and P0949 = 1) caused by the following events:                      (1) DC-link overcurrent = short circuit of IGBT                      (2) Short circuit of chopper                      (3) Earth fault                      (4) I/O board is not properly inserted.                      - Framesizes A to C (1),(2),(3),(4)                      - Framesizes D to E (1),(2),(4)                      - Framesize F (2),(4)</p> <p>Since all these faults are assigned to one signal on the power stack, it is not possible to establish which one actually occurred.                      The following faults (UCE and I2C) occur for frame size FX / GX only:                      - UCE failure was detected, when P0947 = 22 and fault value P0949 = 12 or 13 or 14, depending on UCE.                      - I2C bus read out error, when P0947 = 22 and fault value P0949 = 21 (the power has to be switched off/on).</p> <p><b>Diagnosis &amp; Remedy</b>                      First you must see if the fault is permanent (i.e. the inverter cannot be started without the fault occurring) or sporadic (occurs occasionally or in certain defined operating conditions).                      Permanent F0022 fault:                      - Check the I/O board. It has to be fully pressed home.                      - Is there an earth fault or short circuit on the output of the inverter or in an IGBT? Disconnecting the motor cables will establish which of these.                      In the case where the fault occurs permanently when all external wiring (apart from mains) is disconnected, then the unit almost certainly has a defect and should be repaired.</p> <p>Sporadic F0022 fault:                      This should be treated as "overcurrent". The following may cause the sporadic occurrence of F0022:                      - Sudden load changes or mechanical blockages.                      - Very short ramp times.                      - If the Sensorless Vector Control is badly optimized.                      - If an incorrect braking resistor of too low a resistance is fitted.</p>	

<b>F0023</b>	<b>Output fault</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> One phase of output is disconnected	
<b>F0024</b>	<b>Rectifier Over Temperature</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> <ul style="list-style-type: none"><li>- Ventilation inadequate</li><li>- Fan inoperative</li><li>- Ambient temperature is too high.</li></ul>	
	<b>Diagnosis &amp; Remedy</b> Check the following: <ul style="list-style-type: none"><li>- Fan must turn when inverter is running</li><li>- Pulse frequency must be set to default value</li><li>- Ambient temperature could be higher than specified for the inverter</li></ul>	
<b>F0030</b>	<b>Fan has failed</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> Fan no longer working	
	<b>Diagnosis &amp; Remedy</b> <ul style="list-style-type: none"><li>- Fault cannot be masked while options module (AOP or BOP) is connected.</li><li>- Need a new fan.</li></ul>	
<b>F0035</b>	<b>Auto restart after n</b>	<b>STOP II</b>
	<b>Quit</b> reset fault memory or Power On / Stop	
	<b>Cause</b> Auto restart attempts exceed value of P1211.	
<b>F0040</b>	<b>Automatic Calibration Failure</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> A calibration error occurred when automatically calibrating the analog inputs / outputs or the current actual value sensing. In the factory, the calibration is only carried-out once. This means that fault F0040 is only to be expected during the production process of the drive converter and not while the converter is being used.	
	<b>Diagnostics and removing faults</b> Replace the drive	
<b>F0041</b>	<b>Motor Data Identification Failure</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> Motor data identification failed. Alarm value = 0: Load missing Alarm value = 1: Current limit level reached during identification. Alarm value = 2: Identified stator resistance less than 0.1% or greater than 100%. Alarm value = 3: Identified rotor resistance less than 0.1% or greater than 100%. Alarm value = 4: Identified stator reactance less than 50% and greater than 500% Alarm value = 5: Identified main reactance less than 50% and greater than 500% Alarm value = 6: Identified rotor time constant less than 10ms or greater than 5s Alarm value = 7: Identified total leakage reactance less than 5% and greater than 50% Alarm value = 8: Identified stator leakage reactance less than 25% and greater than 250% Alarm value = 9: Identified rotor leakage inductance less than 25% and greater than 250% Alarm value = 20: Identified IGBT on-voltage less than 0.5 or greater than 10V Alarm value = 30: Current controller at voltage limit Alarm value = 40: Inconsistence of identified data set, at least one identification failed Percentage values based on the impedance $Z_b = V_{mot,nom} / \sqrt{3} / I_{mot,nom}$	



**Diagnosis & Remedy**

Check the following:

- 0: Check that the motor is connected to the inverter.
- 1-40: Check if motor data in P0304 P0311 are correct.
- Check what type of motor wiring is required (star, delta).

**F0042 Speed Control Optimisation Failure STOP II**

**Quit**

Refer to F0001

**Cause**

- Motor data identification failed.
- Alarm value = 0: Time out waiting for stable speed
- Alarm value = 1: Inconsistent readings

**F0051 Parameter EEPROM Fault STOP II**

**Quit**

Refer to F0001

**Cause**

Read or write failure while saving non-volatile parameter.

**Diagnosis & Remedy**

- Factory Reset and new parameterization
- Change drive

**F0052 power stack Fault STOP II**

**Quit**

Refer to F0001

**Cause**

Read failure for power stack information or invalid data.

**Diagnosis & Remedy**

Change drive

**F0053 IO Eeprom Fault STOP II**

**Quit**

Refer to F0001

**Cause**

Read failure for IO EEPROM information or invalid data.

**Diagnosis & Remedy**

- Check data
- Change IO module

**F0054 Wrong IO Board STOP II**

**Quit**

Refer to F0001

**Cause**

- Wrong IO board is connected.
- No ID detected on IO board, No data.

**Diagnosis & Remedy**

- Check data
- Change IO module

**F0060 Asic Timeout STOP II**

**Quit**

Refer to F0001

**Cause**

Internal communications failure

**Diagnosis & Remedy**

- If fault persists, change inverter
- Contact Service Department

<b>F0070</b>	<b>CB setpoint fault</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> No setpoint values from CB (communication board) during telegram off time	
	<b>Diagnosis &amp; Remedy</b> Check CB and communication partner	
<b>F0071</b>	<b>USS (BOP-link) setpoint fault</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> No setpoint values from USS during telegram off time	
	<b>Diagnosis &amp; Remedy</b> Check USS master	
<b>F0072</b>	<b>USS (COMM link) setpoint fault</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> No setpoint values from USS during telegram off time	
	<b>Diagnosis &amp; Remedy</b> Check USS master	
<b>F0080</b>	<b>ADC lost input signal</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> <ul style="list-style-type: none"><li>- Broken wire</li><li>- Signal out of limits</li></ul>	
<b>F0085</b>	<b>External Fault</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> External fault triggered via terminal inputs	
	<b>Diagnosis &amp; Remedy</b> Disable terminal input for fault trigger.	
<b>F0090</b>	<b>Encoder feedback loss</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> Signal from Encoder lost (check alarm value r0949):	
	<b>Diagnosis &amp; Remedy</b> <ul style="list-style-type: none"><li>- Alarm value = 0: Encoder signal lost.</li><li>- Alarm value = 5: Encoder not configured in P0400, but required for sensed control (P1300 = 21 or 23).</li><li>- Alarm value = 6: Encoder module not found, but configured in P0400.</li><li>- Check connections between encoder and inverter. Check that encoder not faulty (select P1300 = 0, run at fixed speed, check encoder feedback signal in r0061)</li><li>- Increase encoder loss threshold in P0492</li></ul>	
<b>F0101</b>	<b>Stack Overflow</b>	<b>STOP II</b>
	<b>Quit</b> Refer to F0001	
	<b>Cause</b> Software error or processor failure	
	<b>Diagnosis &amp; Remedy</b> Run self test routines	

**F0221 PID Feedback below min. value STOP II**

**Quit**

Refer to F0001

**Cause**

PID Feedback below min. value P2268.

**Diagnosis & Remedy**

- Change value of P2268.
- Adjust feedback gain.

**F0222 PID Feedback above max. value STOP II**

**Quit**

Refer to F0001

**Cause**

PID feedback above max. value P2267.

**Diagnosis & Remedy**

- Change value of P2267.
- Adjust feedback gain.

**F0450 BIST Tests Failure STOP II**

**Quit**

Refer to F0001

**Cause**

Fault value:

1. Some power section tests have failed
2. Some control board tests have failed
4. Some functional tests have failed
8. Some IO module tests have failed. (MM 420 only)
16. Internal RAM failed on power-up check

**Diagnosis & Remedy**

Drive may run but some features will not work properly. Replace drive.

**F0452 Belt Failure Detected STOP II**

**Quit**

Refer to F0001

**Cause**

Load conditions on motor indicate belt failure or mechanical fault.

**Diagnosis & Remedy**

Check the following:

1. No breakage, seizure or obstruction of drive train.
2. If using an external speed sensor, check for correct function. Check parameters:
  - P2192 (delay time for permitted deviation)
3. If using the torque envelope, check parameters:
  - P2182 (threshold frequency f1)
  - P2183 (threshold frequency f2)
  - P2184 (threshold frequency f3)
  - P2185 (upper torque threshold 1)
  - P2186 (lower torque threshold 1)
  - P2187 (upper torque threshold 2)
  - P2188 (lower torque threshold 2)
  - P2189 (upper torque threshold 3)
  - P2190 (lower torque threshold 3)
  - P2192 (delay time for permitted deviation)
4. Apply lubrication if required.

## 5.2 Alarm Messages

Alarm messages are stored in parameter r2110 under their code number (e.g. A0503 = 503) and can be read out from there.

### A0501 Current Limit

#### Cause

- Motor power does not correspond to the inverter power
- Motor leads are too long
- Earth faults

#### Diagnosis & Remedy

Check the following:

- Motor power (P0307) must correspond to inverter power (r0206).
- Cable length limits must not be exceeded.
- Motor cable and motor must have no short-circuits or earth faults
- Motor parameters must match the motor in use
- Value of stator resistance (P0350) must be correct
- Motor must not be obstructed or overloaded
- Increase the ramp-up-time.
- Reduce the boost.

### A0502 Overvoltage limit

#### Cause

Overvoltage limit is reached.

- This warning is generated,
- if the dc-link controller is disabled (P1240 = 0).
  - if pulses are enabled
  - if actual dc voltage  $r0026 > r1242$ .

#### Diagnosis & Remedy

If this warning is displayed permanently, check drive input voltage .

### A0503 UnderVoltage Limit

#### Cause

- Main supply failed
- Main supply (P0210) and consequently DC-link voltage (r0026) below specified limit (refer to parameter r0026).

Overvoltage can be caused either by too high main supply voltage or if motor is in regenerative mode.

#### Diagnosis & Remedy

Check main supply voltage (P0210).

### A0504 Inverter OverTemperature

#### Cause

Warning level of inverter heat-sink temperature (P0614) is exceeded, resulting in pulse frequency reduction and/or output frequency reduction (depending on parameterization in (P0610)

#### Diagnosis & Remedy

Check the following:

- Ambient temperature must lie within specified limits
- Load conditions and duty cycle must be appropriate

### A0505 Inverter I2T

#### Cause

- Overload alarm limit P0294 is exceeded (refer to utilization r0036)
- Pulse frequency and output frequency are reduced as a function of the parameter setting P0290.

#### Diagnosis & Remedy

Check that duty cycle lies within specified limits

### A0506 Inverter duty cycle

#### Cause

Difference between heatsink and IGBT junction temperature exceeds warning limits

#### Diagnosis & Remedy

Check that duty cycle and shock loads lie within specified limits

## A0511 Motor Over Temperature

### Cause

- Motor overloaded.
- Load duty cycle too high.

### Diagnosis & Remedy

Independently of the kind of temperature determination check:

- P0604 motor temperature warning threshold
- P0625 motor ambient temperature
- If (P0601 = 0 or 1) Check the following:
  1. Check if name plate data are correct (if not perform quick commissioning)
  2. Accurate equivalent circuit data can be found by performing motor identification (P1910=1).
  3. Check if motor weight (P0344) is reasonable. Change if necessary.
  4. Via P0626, P0627, P0628 the standard overtemperatures can be changed, if the motor is not a Siemens standard motor.
- If (P601 = 2) Check the following:
  1. Check if temperature shown in r0035 is reasonable.
  2. Check if the sensor is a KTY84 (other sensors are not supported)

## A0520 Rectifier OverTemperature

### Cause

Warning level of rectifier heat-sink temperature (P) is exceeded

### Diagnosis & Remedy

Check the following:

- Ambient temperature must lie within specified limits
- Load conditions and duty cycle must be appropriate
- Fan must turn when drive is running

## A0521 Ambient OverTemperature

### Cause

Warning level of ambient temperature (P) is exceeded

### Diagnosis & Remedy

Check the following:

- Ambient temperature must lie within specified limits
- Fan must turn when drive is running
- Fan intake air has to be without any resistance

## A0522 I2C read out timeout

### Cause

the cyclic access to the UCE Values and powerstack temperatures via the i2c bus (only for frame sizes FX and GX) is disturbed

## A0523 Output fault

### Cause

One phase of output is disconnected

### Diagnosis & Remedy

Warning can be masked.

## A0535 Braking Resistor Hot

## A0541 Motor Data Identification Active

### Cause

Motor data identification (P1910) selected or running

## A0542 Speed Control Optimization Active

### Cause

Speed Control Optimization (P1960) is selected or running

## **A0590 Encoder feedback loss warning**

### **Cause**

Signal from Encoder lost; Inverter might have switched to sensorless vector control(check also alarm value r0949):

### **Diagnosis & Remedy**

Stop inverter and then

- Check encoder fitted. If encoder fitted and r0949 = 5, select encoder type via P0400.
- If encoder fitted and r0949 = 6, check connections between encoder module and inverter.
- If encoder not fitted and r0949 = 5, select SLVC mode (P1300 = 20 or 22).
- If encoder not fitted and r0949 = 6, set P0400 = 0.
- Check connections between encoder and inverter
- Check that encoder not faulty (select P1300 = 0, run at fixed speed, check encoder feedback signal in r0061)
- Increase encoder loss threshold in P0492

## **A0600 RTOS Overrun Warning**

**A0700 CB warning 1 see CB manual for details.**

**A0701 CB warning 2 see CB manual for details.**

**A0702 CB warning 3 see CB manual for details.**

**A0703 CB warning 4 see CB manual for details.**

**A0704 CB warning 5 see CB manual for details.**

**A0705 CB warning 6 see CB manual for details.**

**A0706 CB warning 7 see CB manual for details.**

**A0707 CB warning 8 see CB manual for details.**

**A0708 CB warning 9 see CB manual for details.**

**A0709 CB warning 10 see CB manual for details.**

## **A0710 CB communication error**

### **Cause**

Communication with CB (communication board) is lost

### **Diagnosis & Remedy**

Check CB hardware

## **A0711 CB configuration error**

### **Cause**

CB (communication board) reports a configuration error.

### **Diagnosis & Remedy**

Check CB parameters

## A0910 Vdc-max controller de-activated

### Cause

Vdc max controller has been de-activated, since controller is not capable of keeping DC-link voltage (r0026) within limits (refer to r0026 and P1240).

- Occurs if main supply voltage (P0210) is permanently too high.
- Occurs if motor is driven by an active load, causing motor to go into regenerative mode.
- Occurs at very high load inertias, when ramping down.

### Diagnosis & Remedy

Check the following:

- Input voltage (P0210) must lie within range.
- Load must be match.

## A0911 Vdc-max controller active

### Cause

Vdc max controller is active; so ramp-down times will be increased automatically to keep DC-link voltage (r0026) within limits (refer to r0026 and P1240).

## A0912 Vdc-min controller active

### Cause

- Vdc min controller will be activated if DC-link voltage (r0026) falls below minimum level (refer to r0026 and P1240).
- The kinetic energy of the motor is used to buffer the DC-link voltage, thus causing deceleration of the drive!
- So short mains failures do not necessarily lead to an undervoltage trip.

## A0920 ADC parameters not set properly.

### Cause

ADC parameters should not be set to identical values, since this would produce illogical results.

- Index 0: Parameter settings for output identical
- Index 1: Parameter settings for input identical
- Index 2: Parameter settings for input do not correspond to ADC type

## A0921 DAC parameters not set properly.

### Cause

DAC parameters should not be set to identical values, since this would produce illogical results.

- Index 0: Parameter settings for output identical
- Index 1: Parameter settings for input identical
- Index 2: Parameter settings for output do not correspond to DAC type

## A0922 No load applied to inverter

### Cause

No Load is applied to the inverter. As a result, some functions may not work as under normal load conditions.

## A0923 Both JOG Left and JOG Right are requested

### Cause

Both JOG right and JOG left (P1055/P1056) have been requested. This freezes the RFG output frequency at its current value.

### Diagnosis & Remedy

Do not press JOG right and left simultaneously.

## A0952 Belt Failure Detected

### Cause

Load conditions on motor indicate belt failure or mechanical fault.

### Diagnosis & Remedy

Check the following:

1. No breakage, seizure or obstruction of drive train.
2. If using an external speed sensor, check for correct function. Check parameters:
  - P0409 (pulse per min at rated speed).
  - P2191 (Belt failure speed tolerance).
  - P2192 (delay time for permitted deviation)
3. If using the torque envelope, check parameters:
  - P2182 (threshold frequency f1)
  - P2183 (threshold frequency f2)
  - P2184 (threshold frequency f3)
  - P2185 (upper torque threshold 1)
  - P2186 (lower torque threshold 1)
  - P2187 (upper torque threshold 2)
  - P2188 (lower torque threshold 2)
  - P2189 (upper torque threshold 3)
  - P2190 (lower torque threshold 3)
  - P2192 (delay time for permitted deviation)
4. Apply lubrication if required.

## A0936 PID Autotuning Active

### Cause

PID Autotuning (P2350) selected or running



## 6 Abbreviations

AC	Alternating current
AD	Analog digital converter
ADC	Analog digital converter
ADR	Address
AFM	Additional frequency modification
AG	Automation unit
AIN	Analog input
AOP	Advanced operator panel
AOUT	Analog output
ASIC	Application-specific integrated circuit
ASP	Analog setpoint
ASVM	Asymmetric space vector modulation
BCC	Block check character
BCD	Binary-coded decimal code
BI	Binector input
BICO	Binector / connector
BO	Binector output
BOP	Basic operator panel
C	Commissioning
CB	Communication board
CCW	Counter-clockwise
CDS	Command data set
CI	Connector input
CM	Configuration management
CMD	Commando
CMM	Combimaster
CO	Connector output
CO/BO	Connector output / Binector output
COM	Common (terminal that is connected to NO or NC)
COM-Link	Communication link
CT	Commissining, ready to run
CT	Constant torque
CUT	Commissining, run, ready to run
CW	Clockwise
DA	Digital analog converter
DAC	Digital analog converter
DC	Direct current
DDS	Drive data set
DIN	Digital input
DIP	DIP switch
DOUT	Digital output
DS	Drive state
EEC	European Economic Community
EEPROM	Electrical erasable programmable read-only memory
ELCB	Earth leakage circuit breaker

EMC	Electro-magnetic compatibility
EMF	Electromotive force
EMI	Electro-magnetic interference
ESB	Equivalent circuit
FAQ	Frequently asked questions
FB	Function block
FCC	Flux current control
FCL	Fast current limit
FF	Fixed frequency
FFB	Free function block
FOC	Field orientated control
FSA	Frame size A
GSG	Getting started guide
GUI ID	Global unique identifier
HIW	Main actual value
HSW	Main setpoint
HTL	High-threshold logic
I/O	Input and output
IBN	Commissioning
IGBT	Insulated gate bipolar transistor
IND	Sub-index
JOG	Jog
KIB	Kinetic buffering
LCD	Liquid crystal display
LED	Light emitting diode
LGE	Length
MHB	Motor holding brake
MM4	MICROMASTER 4th. Generation
MOP	Motor potentiometer
NC	Normally closed
NO	Normally open
NPN	Negative positive negative
OPI	Operating instructions
PDS	Power drive system
PID	PID controller (proportional, integral, derivative)
PKE	Parameter ID
PKW	Parameter ID value
PLC	Programmable logic controller
PLI	Parameter list
PNP	Positive negative positive
POT	Potentiometer
PPO	Parameter process data object
PTC	Positive temperature coefficient
PWE	Parameter value
PWM	Pulse-width modulation
PX	Power extension
PZD	Process data
QC	Quick commissioning
RAM	Random-access memory

RCCB	Residual current circuit breaker
RCD	Residual current device
RFG	Ramp function generator
RFI	Radio-frequency interference
RPM	Revolutions per minute
SCL	Scaling
SDP	Status display panel
SLVC	Sensorless vector control
STW	Control word
STX	Start of text
SVM	Space vector modulation
TTL	Transistor-transistor logic
USS	Universal serial interface
VC	Vector control
Vdc	DC-link voltage
VT	Variable torque
ZSW	Status word
ZUSW	Additional setpoint

## Suggestions and/or Corrections

To  
Siemens AG  
Automation & Drives Group  
SD VM 4  
P.O. Box 3269  
  
D-91050 Erlangen  
Federal Republic of Germany

Email:  
[documentation.sd@siemens.com](mailto:documentation.sd@siemens.com)

Suggestions Corrections
For Publication/Manual: MICROMASTER 440 Parameter List
User Documentation
Order number: 6SE6400-5BB00-0BP0 Date of Issue: 07/05
Should you come across any printing errors when reading this publication, please notify us on this sheet. Suggestions for improvement are also welcome.

**From**

Name: \_\_\_\_\_

Company/Service Department

Address: \_\_\_\_\_

Phone: \_\_\_\_\_ / \_\_\_\_\_

Fax: \_\_\_\_\_ / \_\_\_\_\_